


- GENERAL NOTES:**
1. ALL DIFFUSERS AND VENTILATION EQUIPMENT SHOWN AS APPROXIMATE LOCATION. CONTRACTOR TO COORDINATE EXACT LOCATIONS ON-SITE.
 2. ALL NEW EQUIPMENT AND DUCTWORK TO BE SEISMICALLY BRACED AS PER OBC.
 3. BALANCE ALL DIFFUSERS TO THE VALUES INDICATED.

- DRAWING NOTES:**
- 1 FAN COIL FC-01 & FAN COIL FC-04 TO BE SET TO LOW SPEED.
 - 2 CUT IN NEW RETURN DUCTWORK.
 - 3 ADD NEW MULTI-LEAF BALANCING DAMPERS, BOTH TO BE BALANCED TO 50% OF RETURN AIRFLOW EACH.
 - 4 CAP OLD RETURN BRANCH

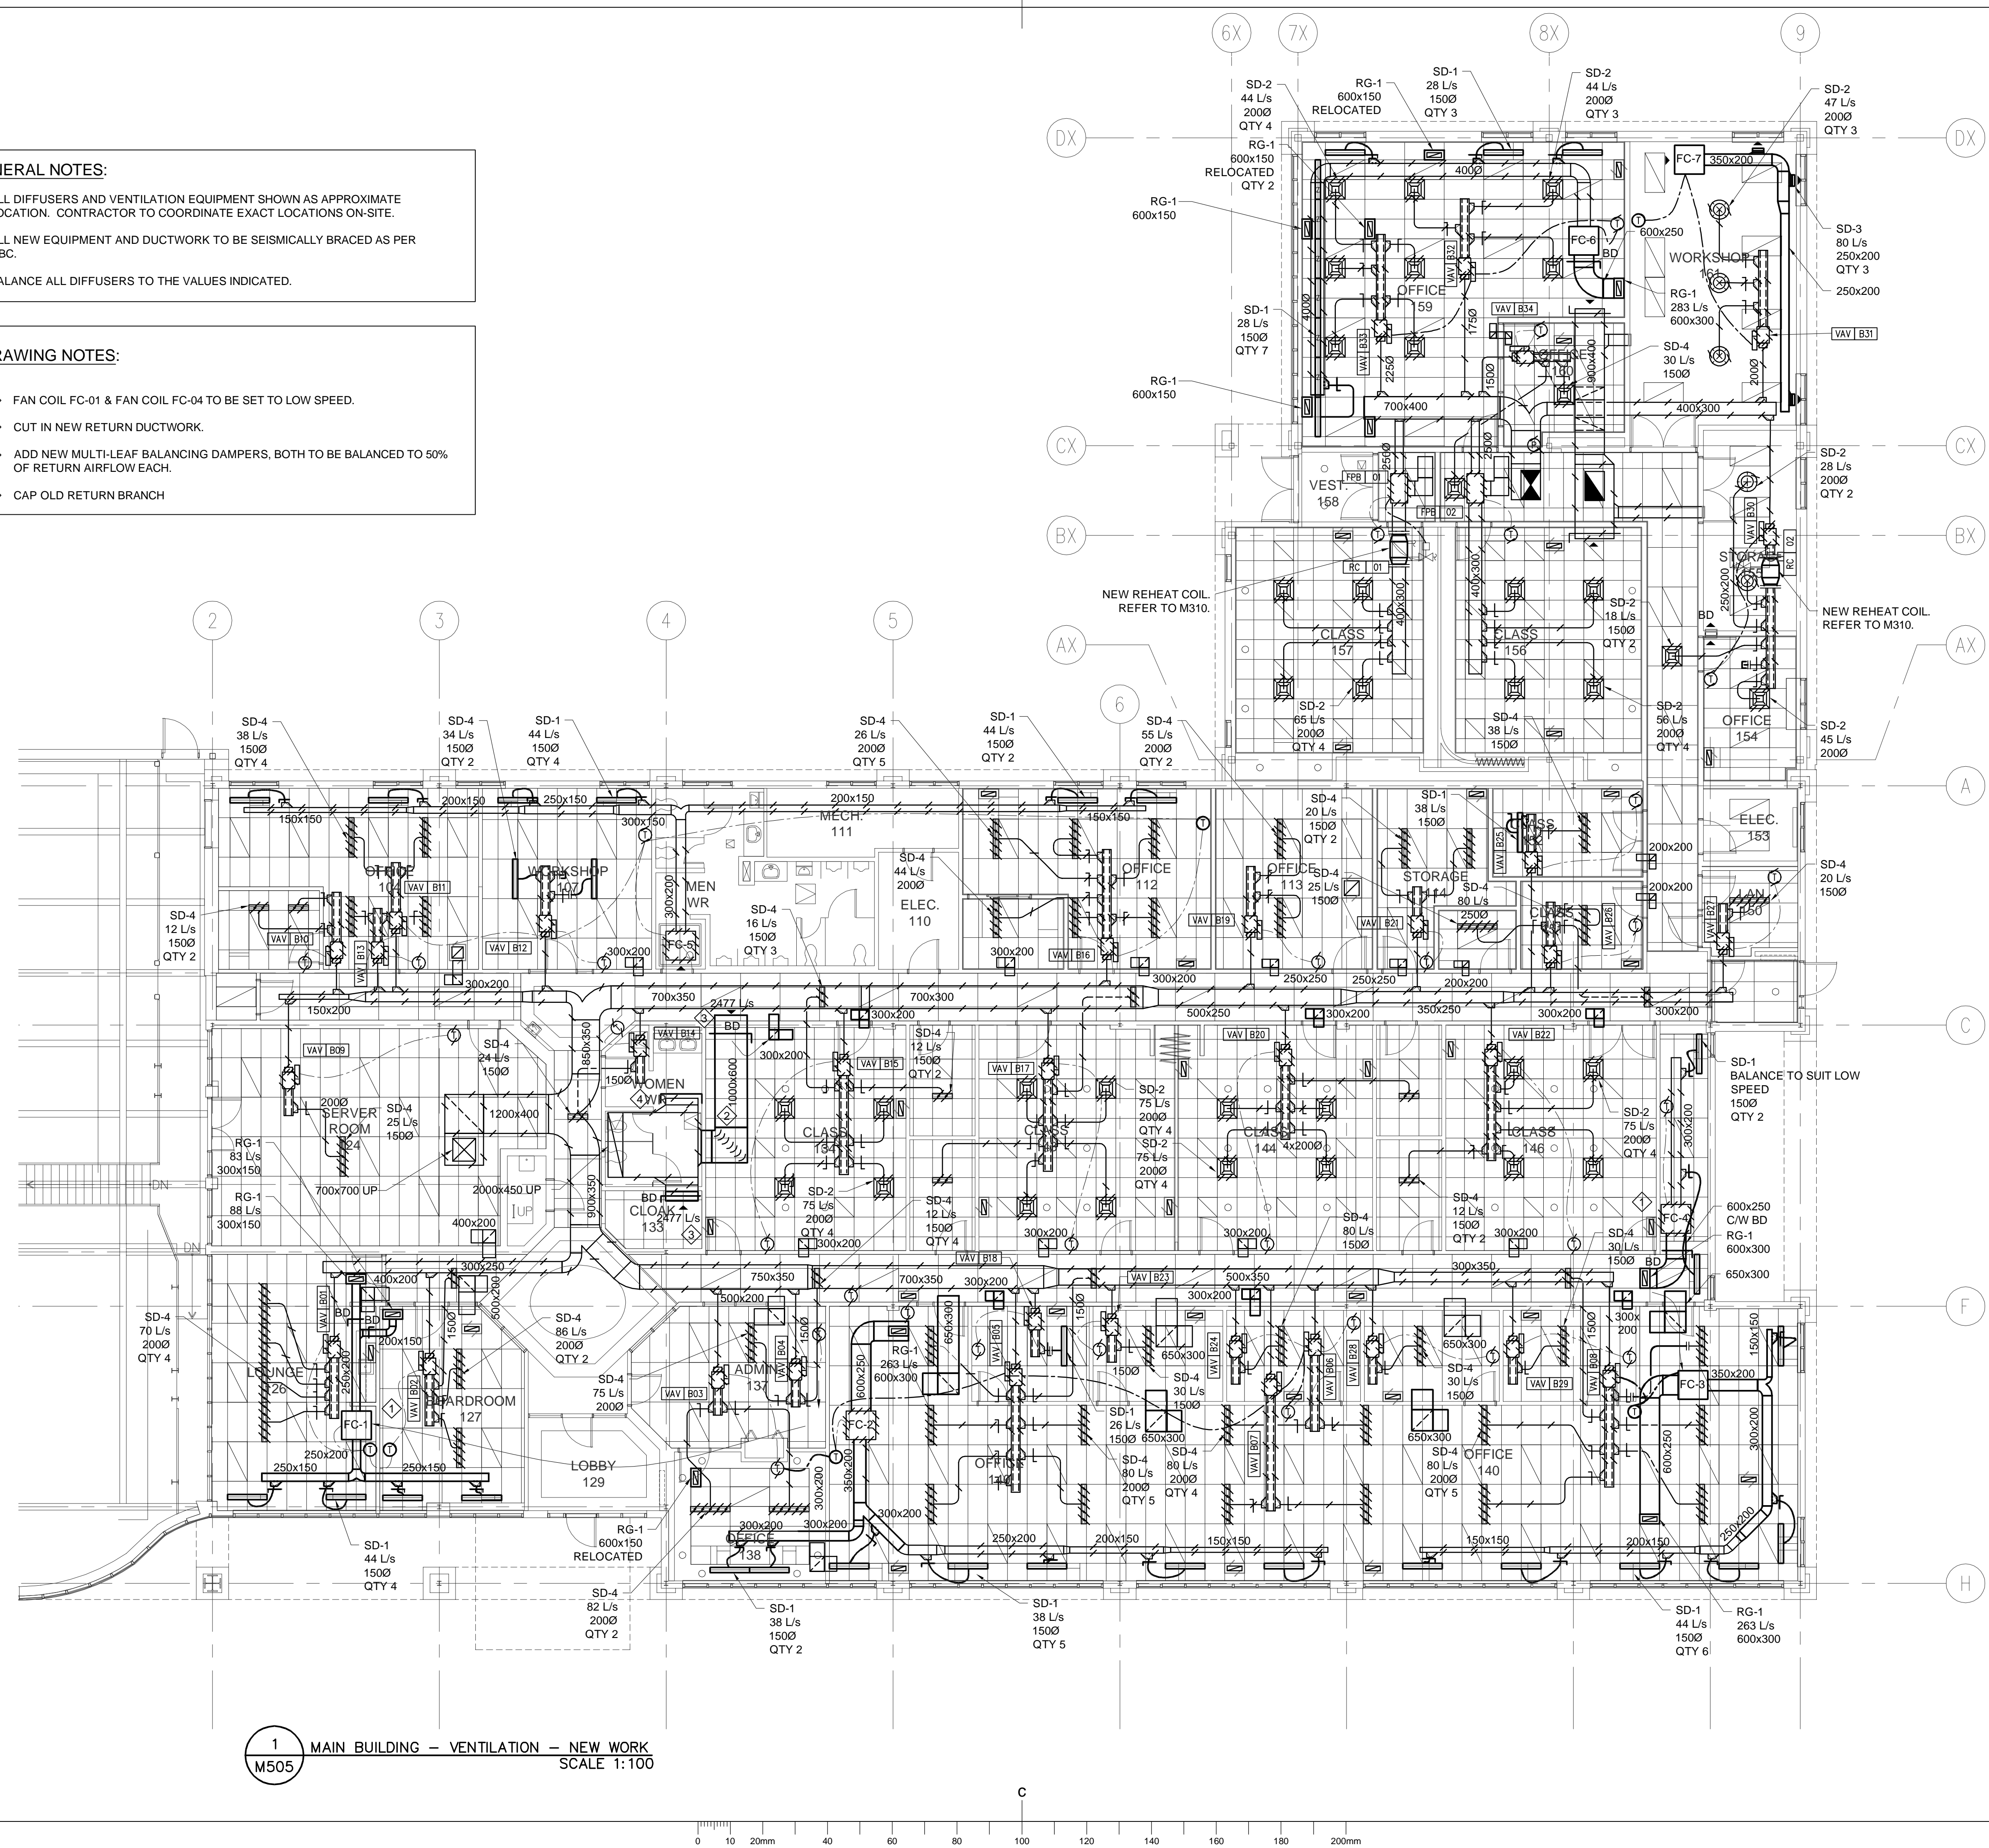

1 MAIN BUILDING – VENTILATION – NEW WORK
M505 SCALE 1:100

Publics Works and Government Services Canada
Travaux publics et Services gouvernementaux Canada

100-1960 Robertson Road, Suite 100
Ottawa (Ontario) K2H 5B9
(613) 596-6454
(613) 596-3346_Fax
www.bpa.ca

1960, chemin Robertson, bureau 100
Ottawa (Ontario) K2H 5B9
(613) 596-6454
(613) 596-3346 – télécopieur
www.bpa.ca

mechanical | electrical | energy | telecommunications
mécanique | électricité | efficacité énergétique | télécommunications

KEY PLAN
PLAN-REPÈRE

PROJECT NORTH
NORD DU PROJET

N.T.S.
PAS À L'ÉCHELLE

2	ISSUED FOR TENDER	2015-04-15
1	ISSUED FOR 100% REVIEW - TENDER	2015-01-30

revisions	description	date
A	A detail no. no du détail	A
C	B location drawing no. no du dessin de localisation	B C
	C drawing no. no du dessin	

project

CHILLER REPLACEMENT FOR TRANSPORT CANADA TRAINING CENTRE (BUILDING O-276)

project

drawing

MAIN BUILDING VENTILATION NEW WORK

dessin

Designed By CARL MUIR Conçu par

Date 2014-08-21 (yyyy/mm/dd)

Drawn By CARL MUIR Dessiné par

Date 2014-08-21 (yyyy/mm/dd)

Reviewed By DAVID LANDSBERG Examiné par

Date 2014-09-10 (yyyy/mm/dd)

Approved By DAVID LANDSBERG Approuvé par

Date 2014-09-10 (yyyy/mm/dd)

Tender 2015-01-30 Soumission

K. DUNN
Project Manager Administrateur de projet

Project no. no du projet

R.060139.002

Drawing no. no du dessin

M505