

2	ISSUED FOR TENDER	2015-04-15
1	ISSUED FOR 100% REVIEW - TENDER	2015-01-30

revisions	description	date
-----------	-------------	------

A	A detail no. no du détail	A
C	B location drawing no. no du dessin de localisation	B
	C drawing no. no du dessin	C

project	projet
---------	--------

CHILLER REPLACEMENT
FOR TRANSPORT CANADA
TRAINING CENTRE
(BUILDING O-276)

drawing	dessin
---------	--------

MAIN BUILDING
LOW LEVEL & GROUND FLOOR
HEATING AND COOLING
DEMOLITION

Designed By	CARL MUIR	Conçu par
-------------	-----------	-----------

Date	2014-08-21	(yyyy/mm/dd)
------	------------	--------------

Drawn By	CARL MUIR	Dessiné par
----------	-----------	-------------

Date	2014-08-21	(yyyy/mm/dd)
------	------------	--------------

Reviewed By	DAVID LANDSBERG	Examiné par
-------------	-----------------	-------------

Date	2014-09-10	(yyyy/mm/dd)
------	------------	--------------

Approved By	DAVID LANDSBERG	Approuvé par
-------------	-----------------	--------------

Date	2014-09-10	(yyyy/mm/dd)
------	------------	--------------

Tender	2015-01-30	Soumission
--------	------------	------------


Project Manager	K. DUNN	Administrateur de projet
-----------------	---------	--------------------------

Project no.		no du projet
-------------	--	--------------


R.060139.002

Drawing no.		no du dessin
-------------	--	--------------

M304

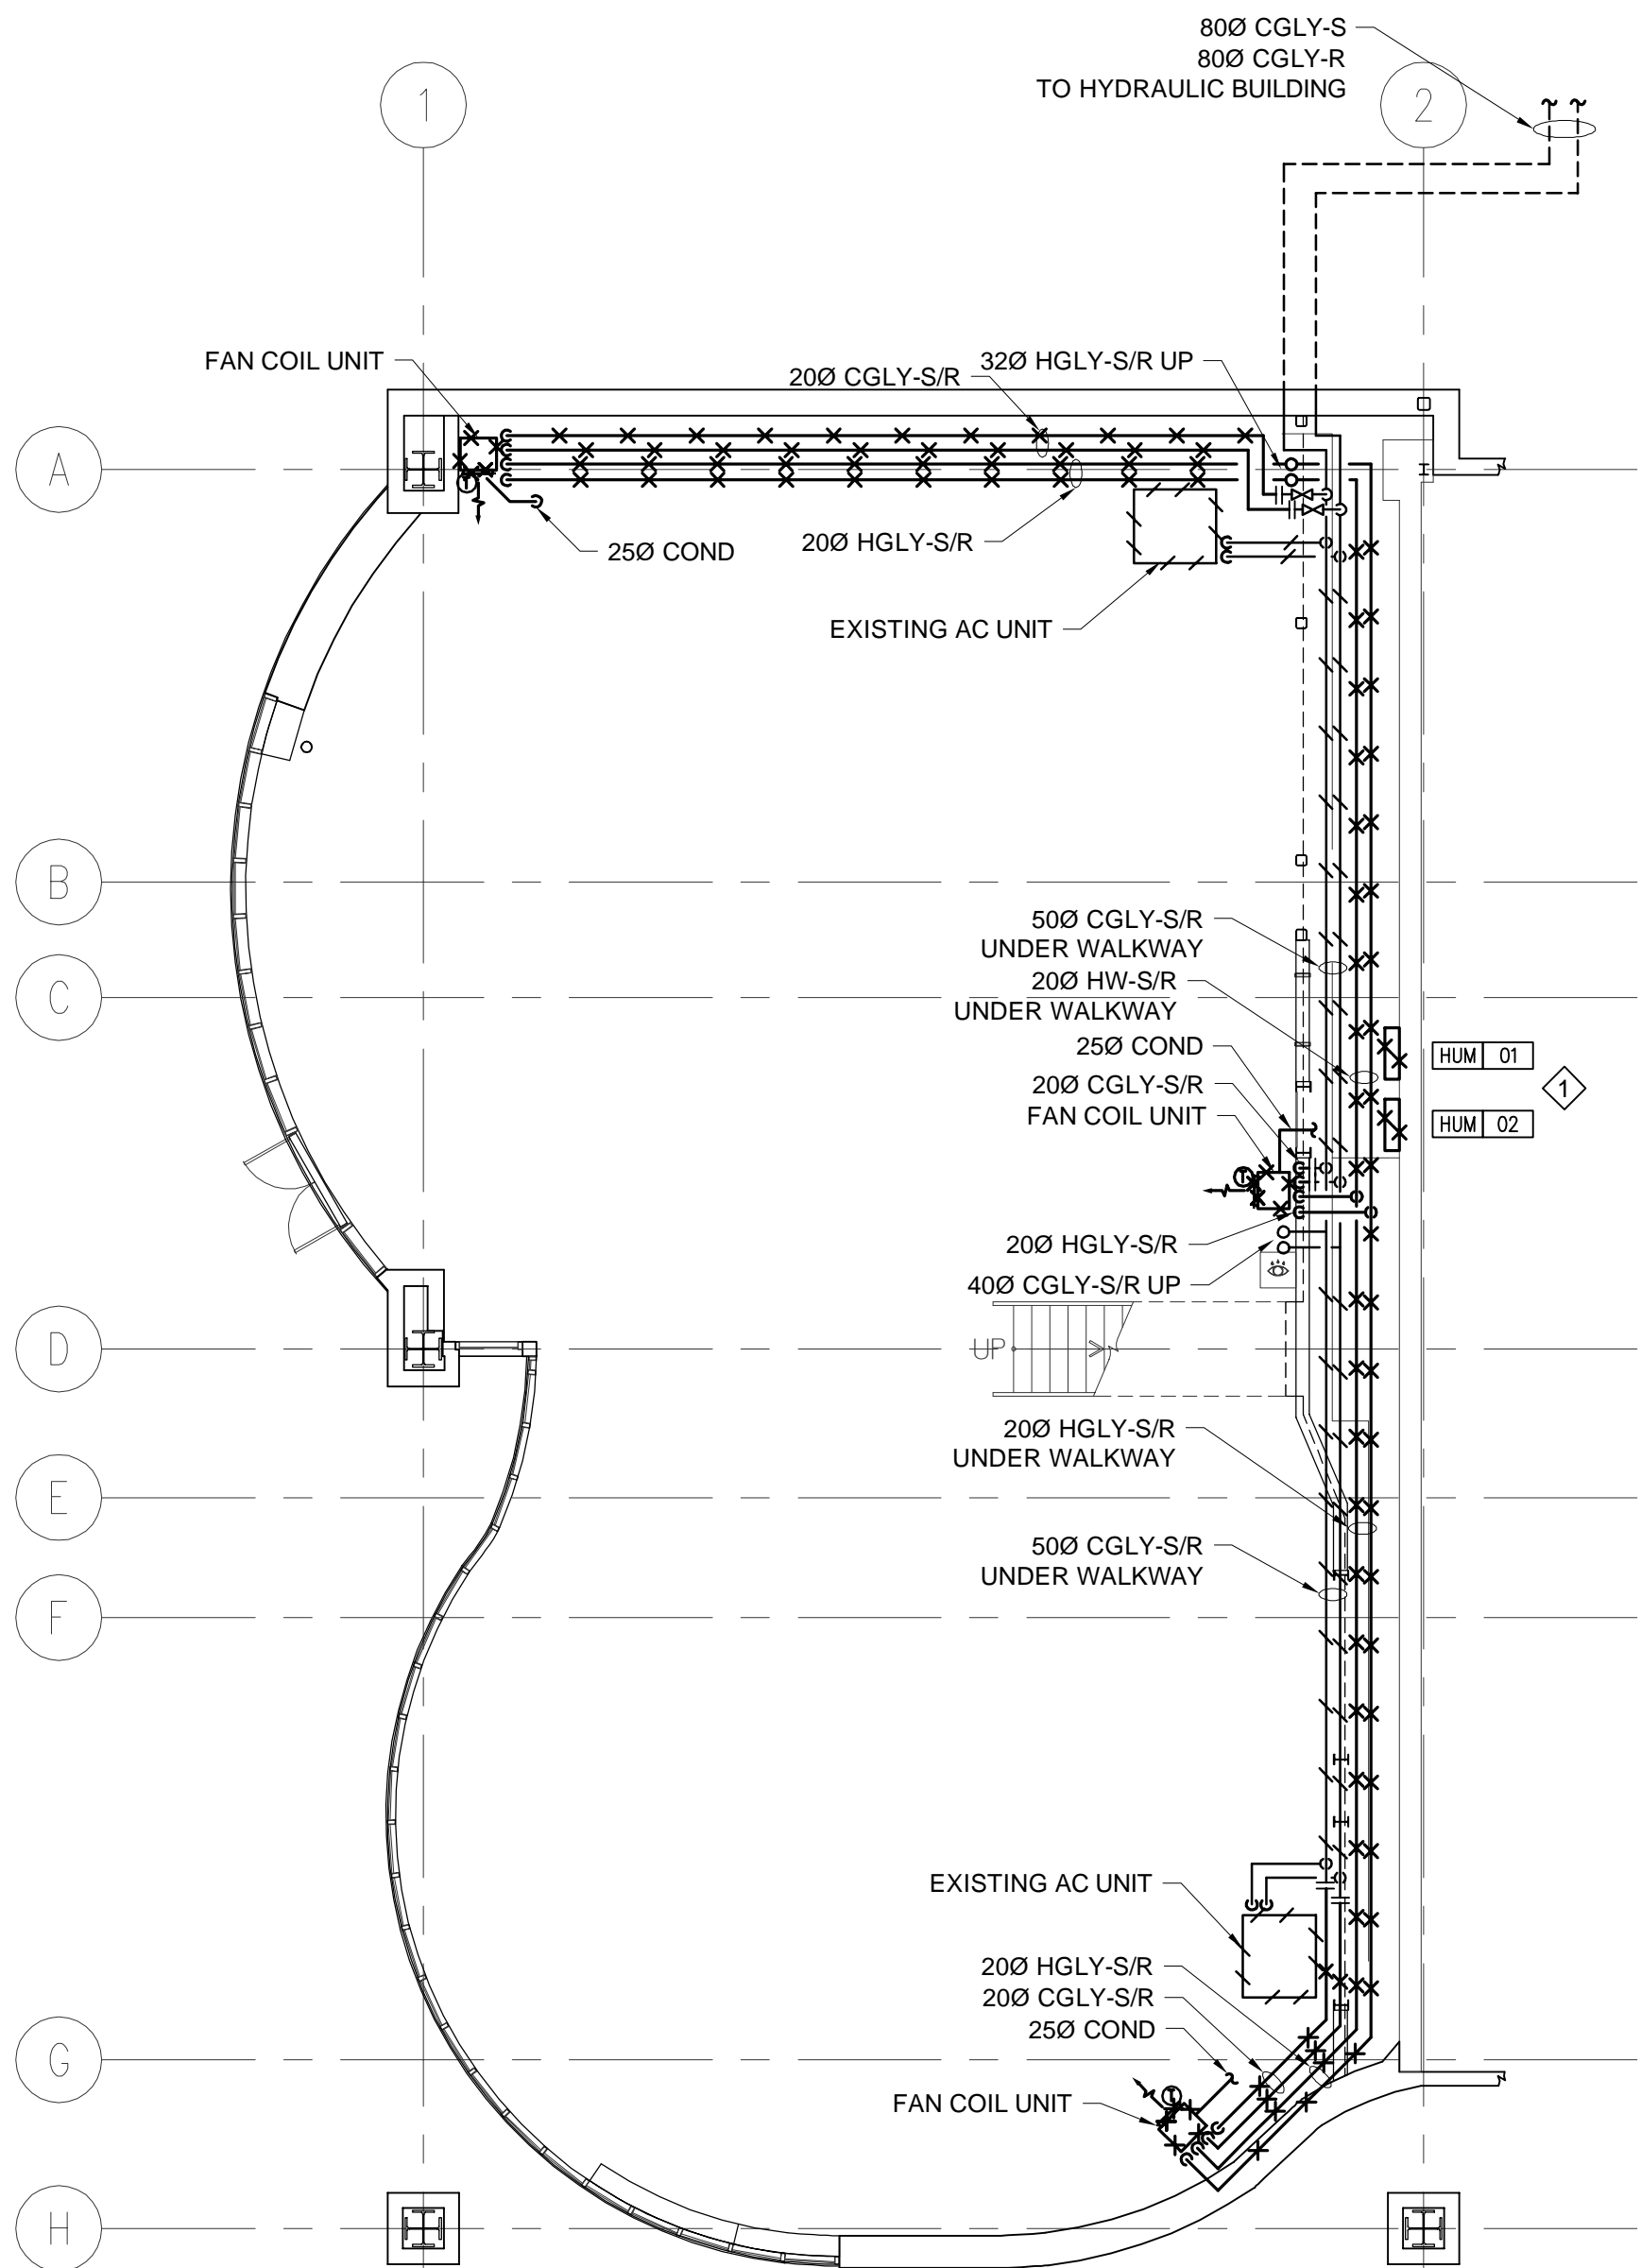

1 MAIN BUILDING – LOW LEVEL
HEATING AND COOLING DEMOLITION
SCALE 1:100
M304

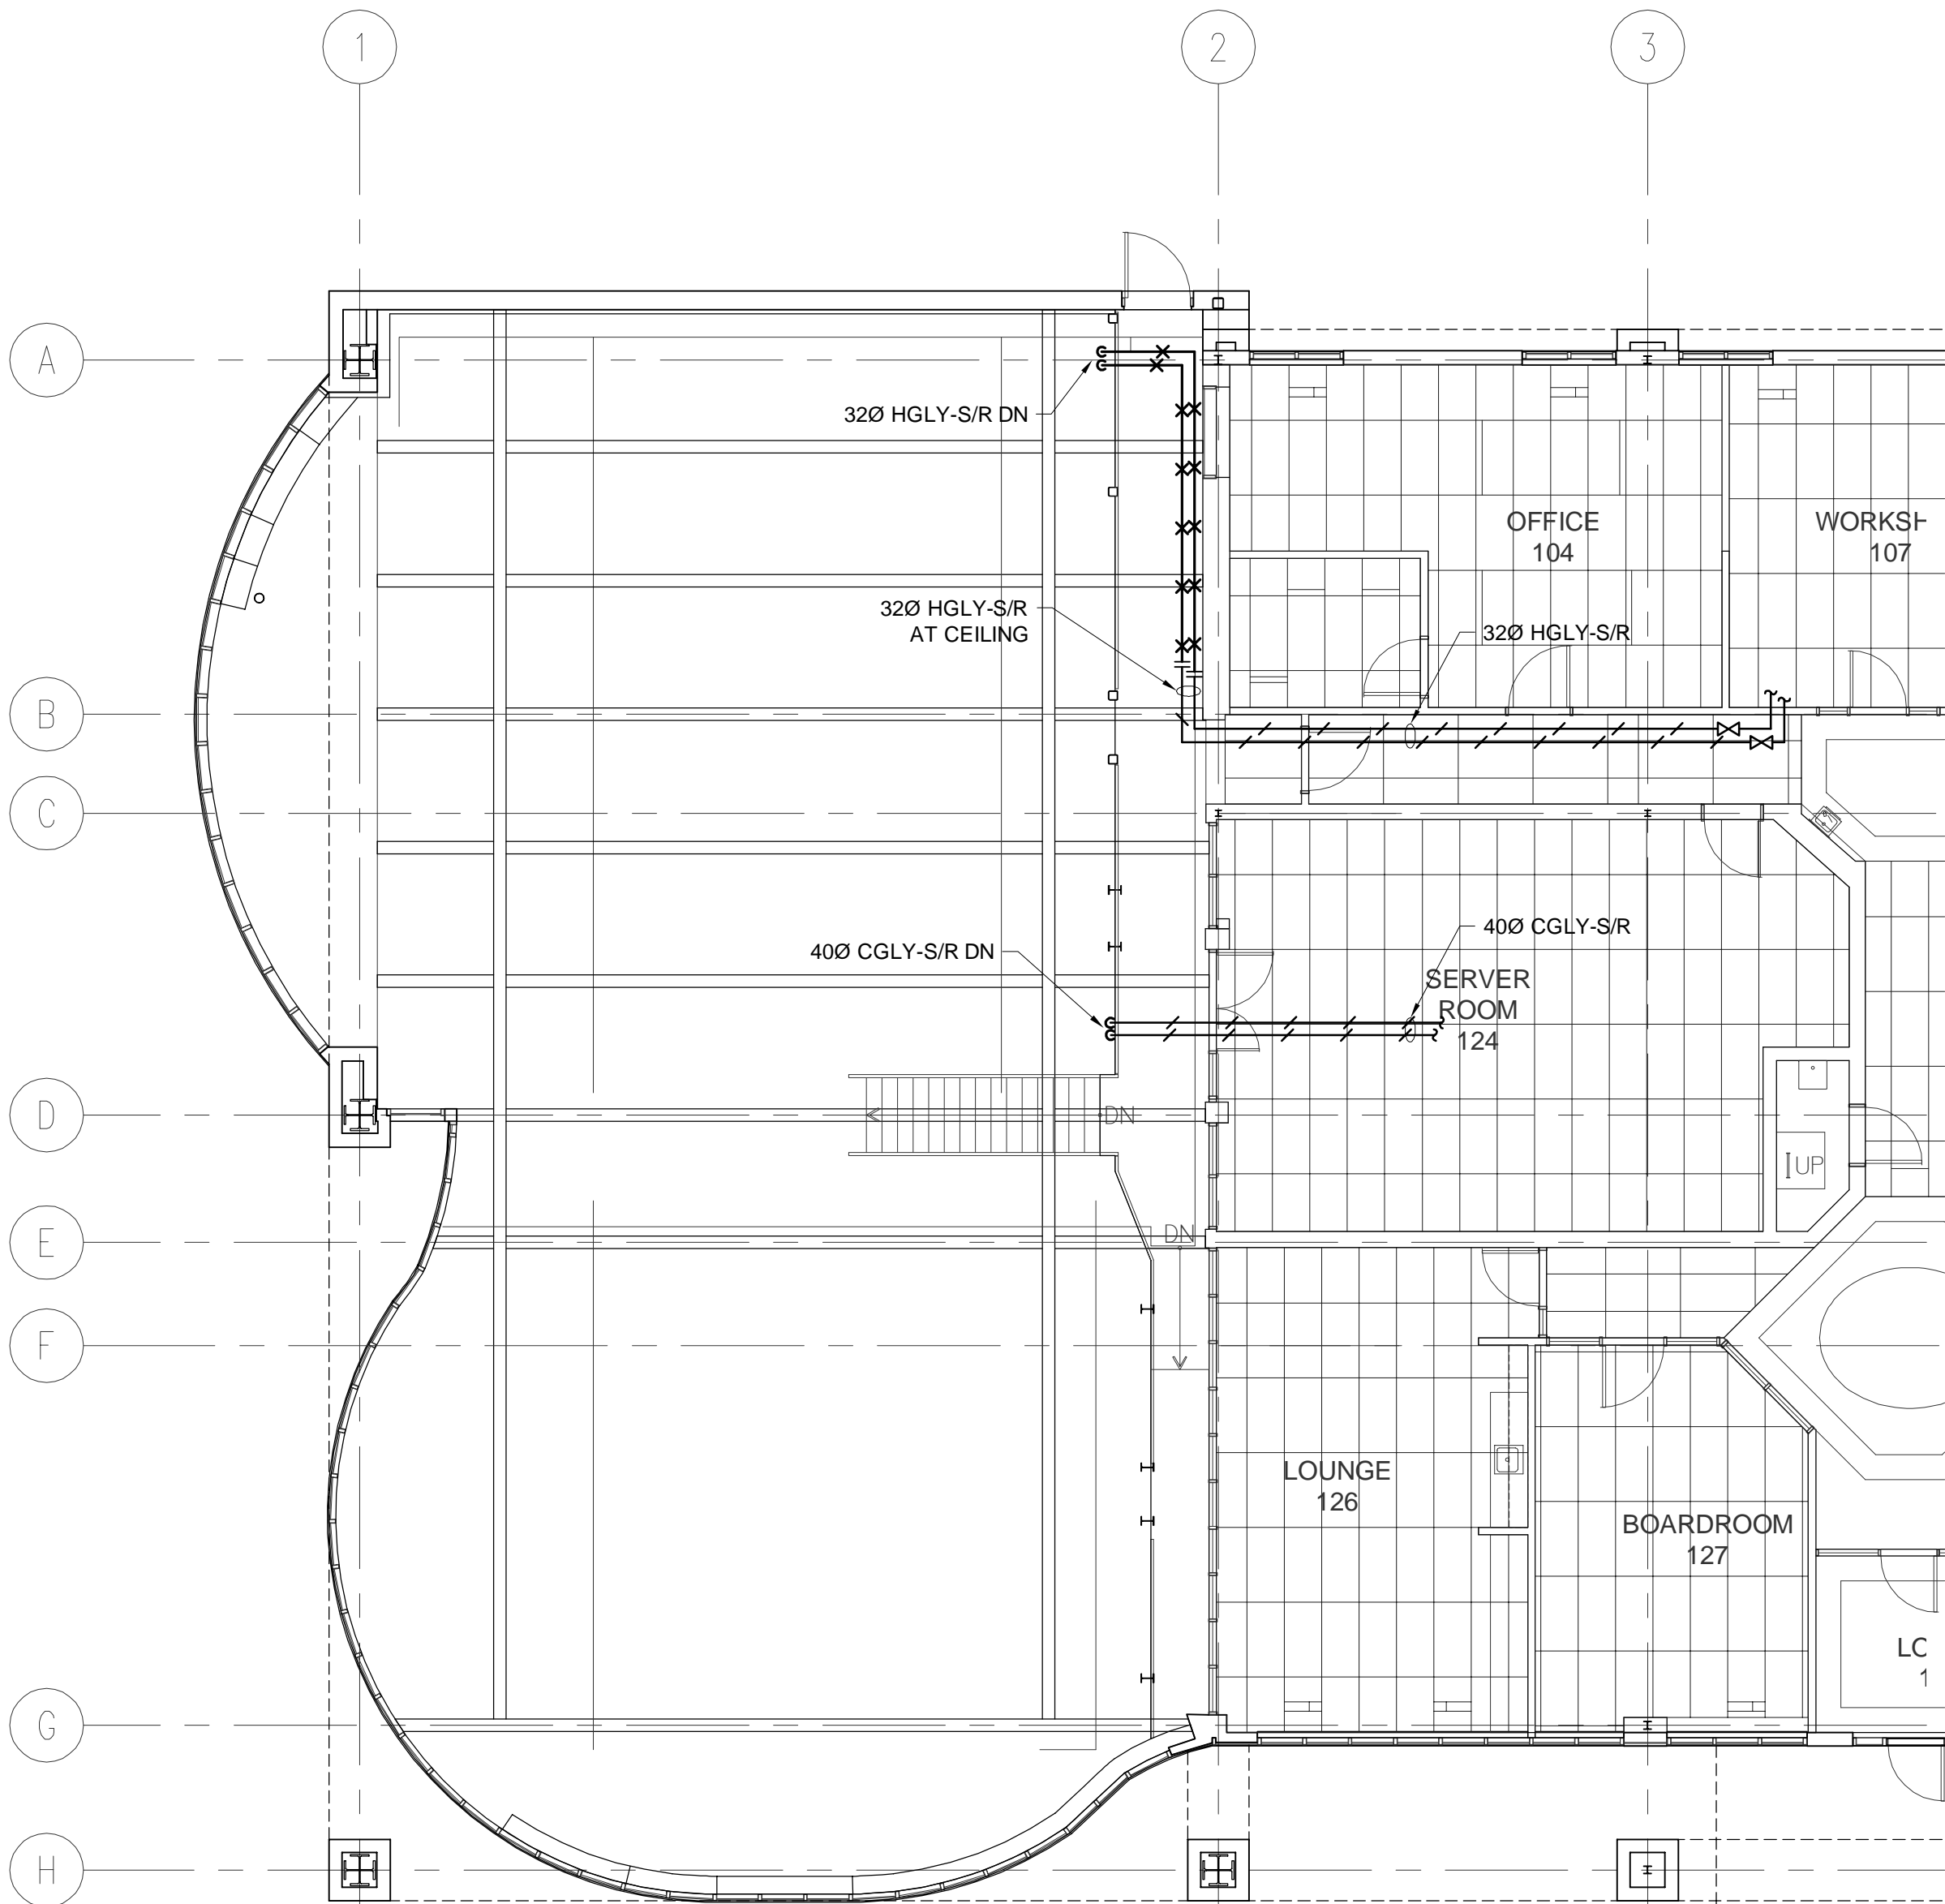

2 MAIN BUILDING – GROUND FLOOR
HEATING AND COOLING DEMOLITION
SCALE 1:100
M304

DRAWING NOTES:

- 1 DISMANTLE THE EXISTING HUMIDIFIERS, COORDINATE WITH DIVISION 26.
THE EXISTING MAKE-UP WATER, CONDENSATE DRAINAGE PIPING AND STEAM
PIPING CONNECTIONS ARE TO BE RE-USED FOR THE NEW HUMIDIFIERS.