


TYPICAL SECTION VIEW
NTS




TYPICAL SECTION VIEW
NTS

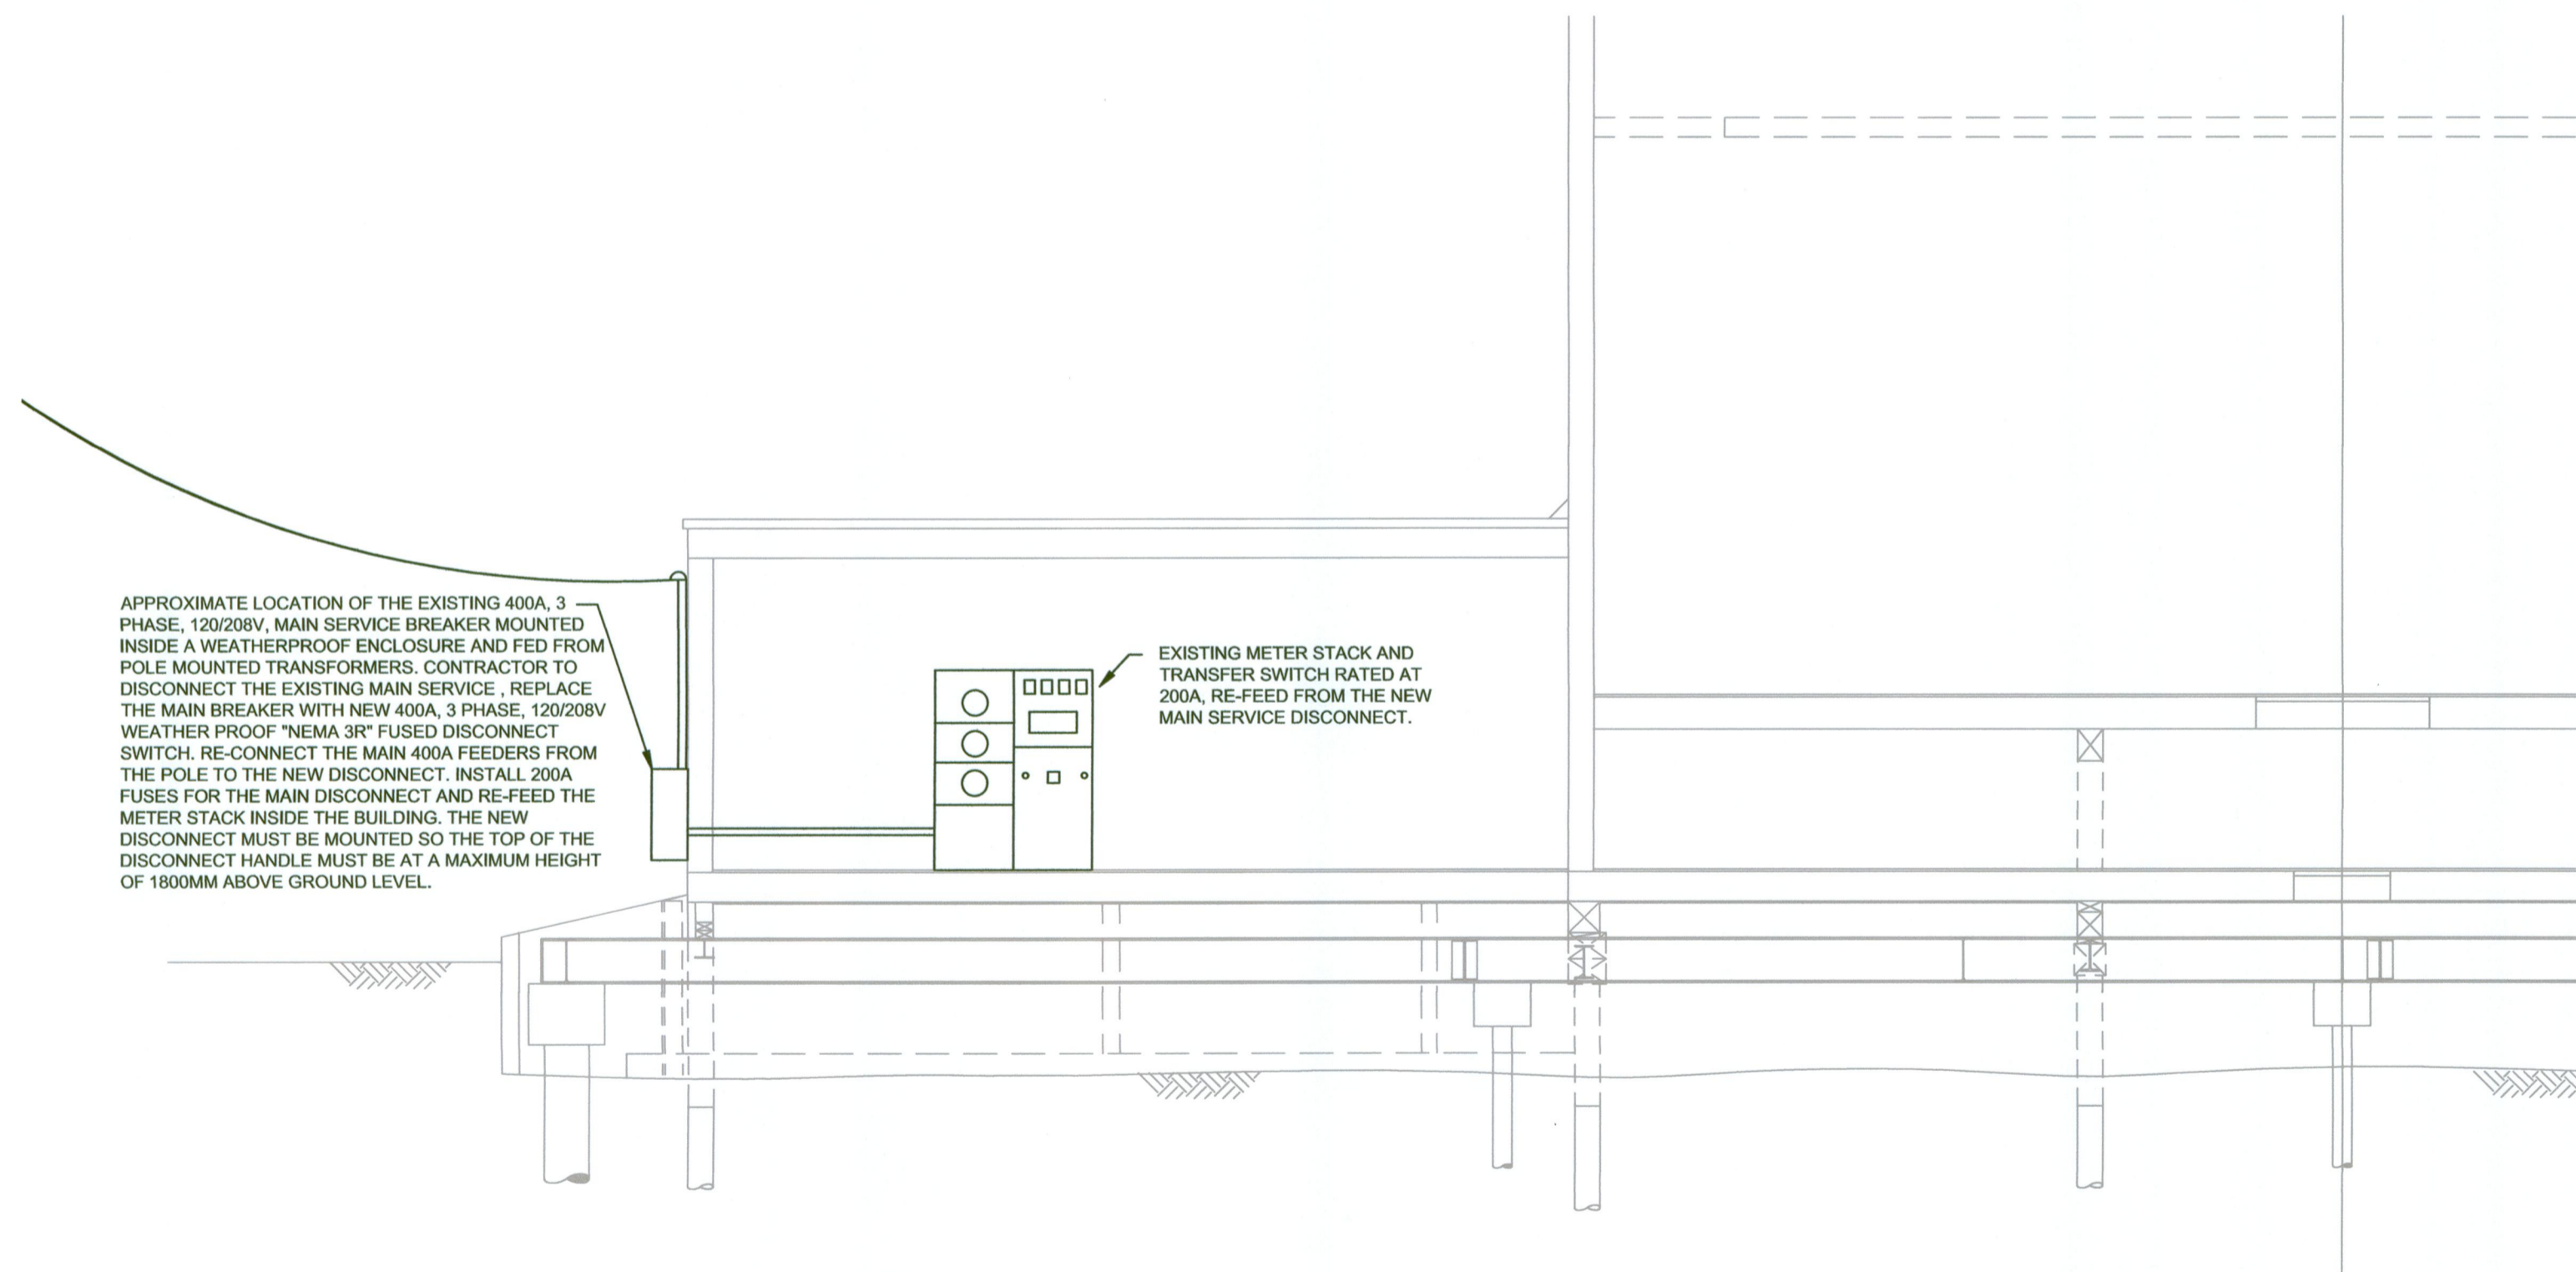

EXISTING 400A, 3 PHASE, 120/208V, MAIN SERVICE BREAKER MOUNTED INSIDE A WEATHERPROOF ENCLOSURE AND FED FROM POLE MOUNTED TRANSFORMERS. DISCONNECT AND REPLACE THE WITH NEW 400A, 3 PHASE, 120/208V WEATHER PROOF FUSED DISCONNECT SWITCH. RE-CONNECT THE MAIN 400A FEEDERS FROM THE POLE TO THE DISCONNECT. INSTALL 200A FUSES AND RE-FEED THE METER STACK INSIDE THE BUILDING. THE NEW FUSED DISCONNECT MUST BE MOUNTED ABOVE THE EXISTING LOCATION TO ALLOW FOR NEW CIVIL WORK. THE TOP OF THE DISCONNECT HANDLE MUST BE AT A MAXIMUM HEIGHT OF 1800MM ABOVE GROUND LEVEL.

CARRY THE COST OF ALL ELECTRICAL PERMITTING AND COORDINATE ALL WORK WITH YUKON ENERGY. COMPLETE WITH TERMINATIONS FOR OPERATIONAL SYSTEM. PROVIDE TEMPORARY POWER WHERE NEEDED FOR OTHER TRADES.

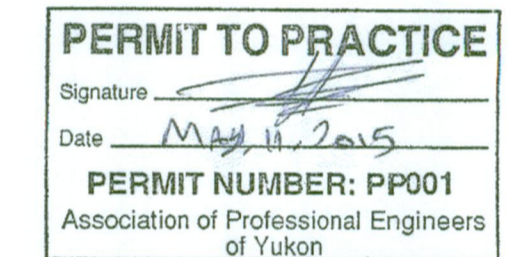

5		
4		
3		
2		
1		
0	ISSUED FOR TENDER	MAY - 2015
Revision/ Revision	Description/Description	Date/Date

A	A detail number numéro de détail	A
C	B source drawing no. de dessin no.	B C
	C detail on drawing no. détail sur dessin no.	

Client/client

PARK CANADA AGENCY

WESTERN AND NORTHERN REGION

Project title/Titre du projet
**DAWSON CITY
YUKON TERRITORY**

**PALACE GRAND THEATRE
FOUNDATION REPLACEMENT**

Consultant Signature Only

Designed by/Concept par
AD

Drawn by/Dessiné par
AD

PWSC Project Manager/Administrateur de Projets TPSGC
TOM DUNPHY

Regional Manager, Architectural and Engineering Services
Gestionnaire régionale, Services d'architectural et de génie, TPSGC

Drawing title/Titre du dessin
**ELECTRICAL MAIN SERVICE DEMO.
AND RE-INSTALLATION PLAN**

Project No./No. du projet R.068835.001	Sheet/Feuille E2 OF 2	Revision no./ La Révision no. 0
---	------------------------------------	---