



C RAINWATER STORAGE TANKS SECTION
C-007 1:50

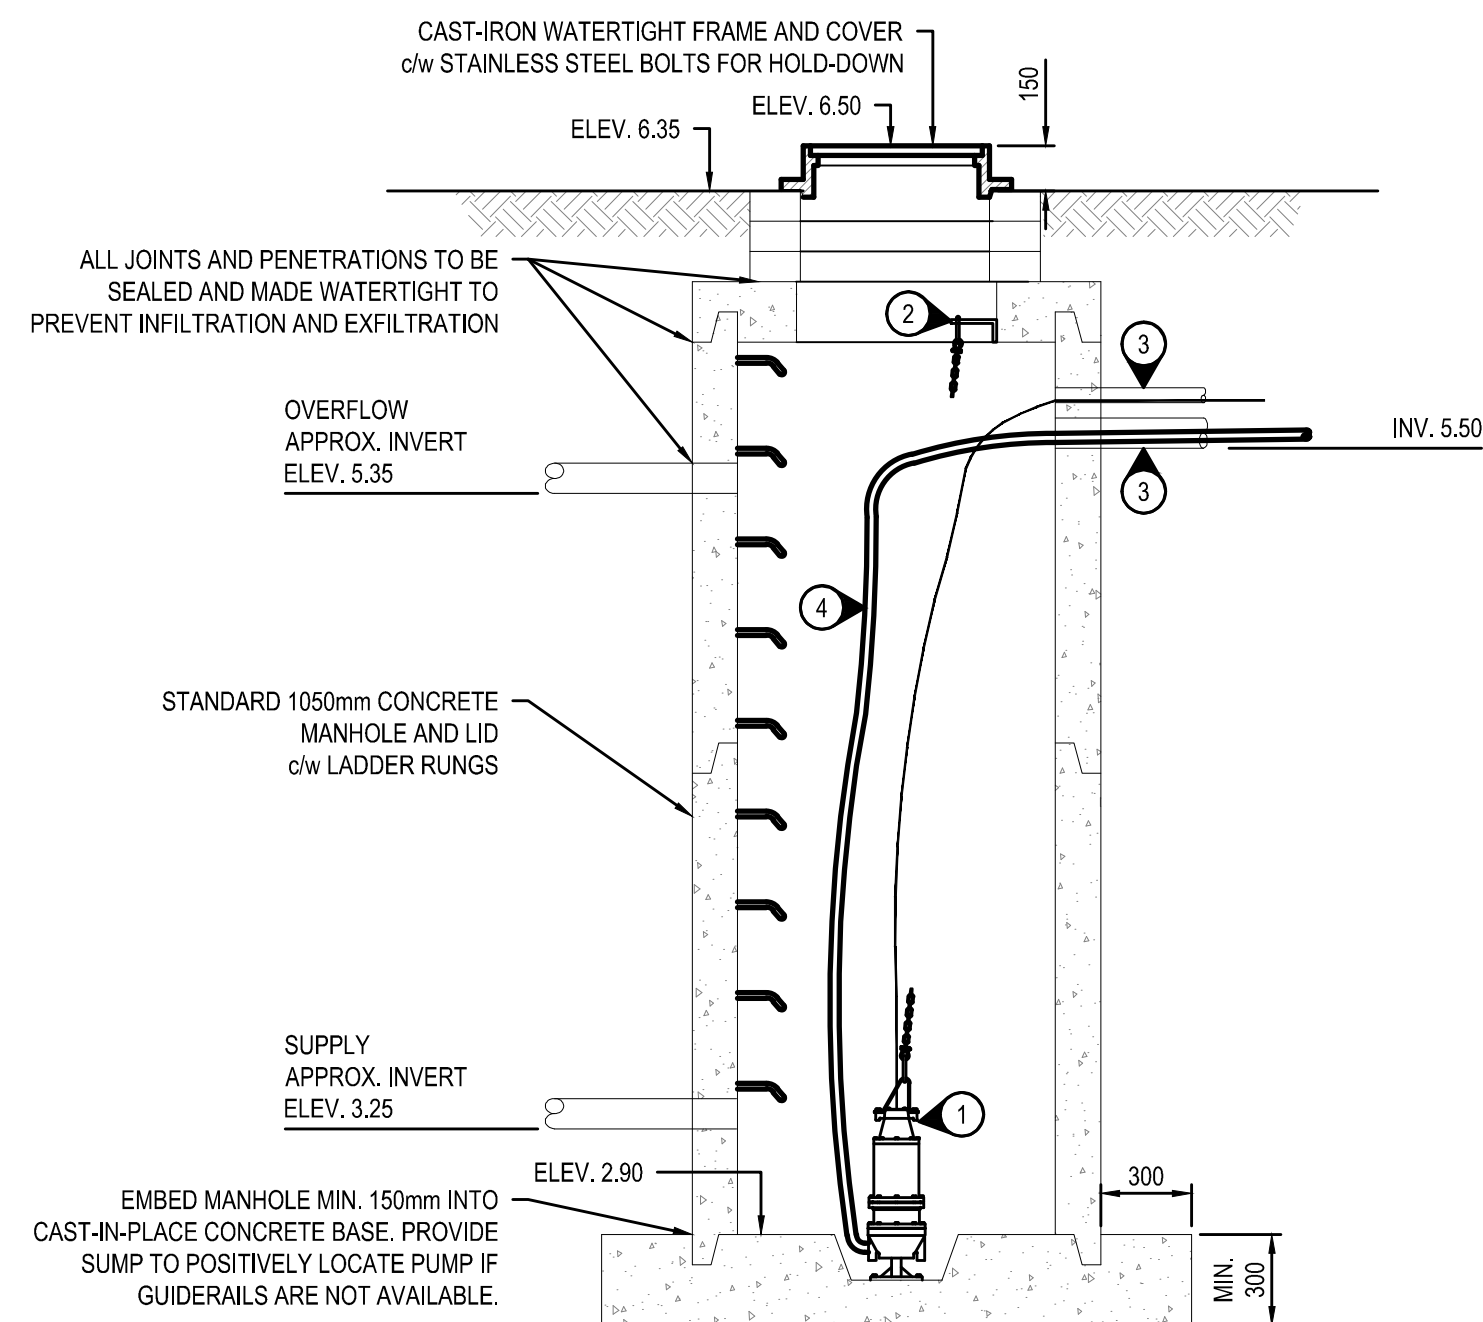

- KEYNOTES:
- SUBMERSIBLE SUPPLY PUMP c/w FLEXIBLE LOW-PRESSURE DISCHARGE HOSE, AND GUIDERAILS IF AVAILABLE.
 - LIFTING CHAIN AND BRACKETS.
 - 100mmØ DB2 FOR PUMP DISCHARGE AND 50mmØ DB2 FOR POWER CABLES.
 - HEAT TRACING TO EXTEND ALONG FULL LENGTH OF PUMP FORCEMAIN, EXTERIOR OF BUILDING
 - REMOTE ULTRASONIC LEVEL TRANSMITTER AND BRACKET. MOUNT IN TANK #8 TO PREVENT SIGNAL INTERFERENCE FROM INTERNAL COMPONENTS. RANGE 0.5m TO 3.0m. INCLUDE VISUAL READOUT AT CONTROL PANEL.

6 WATER PUMP CHAMBER
C-008 1:25

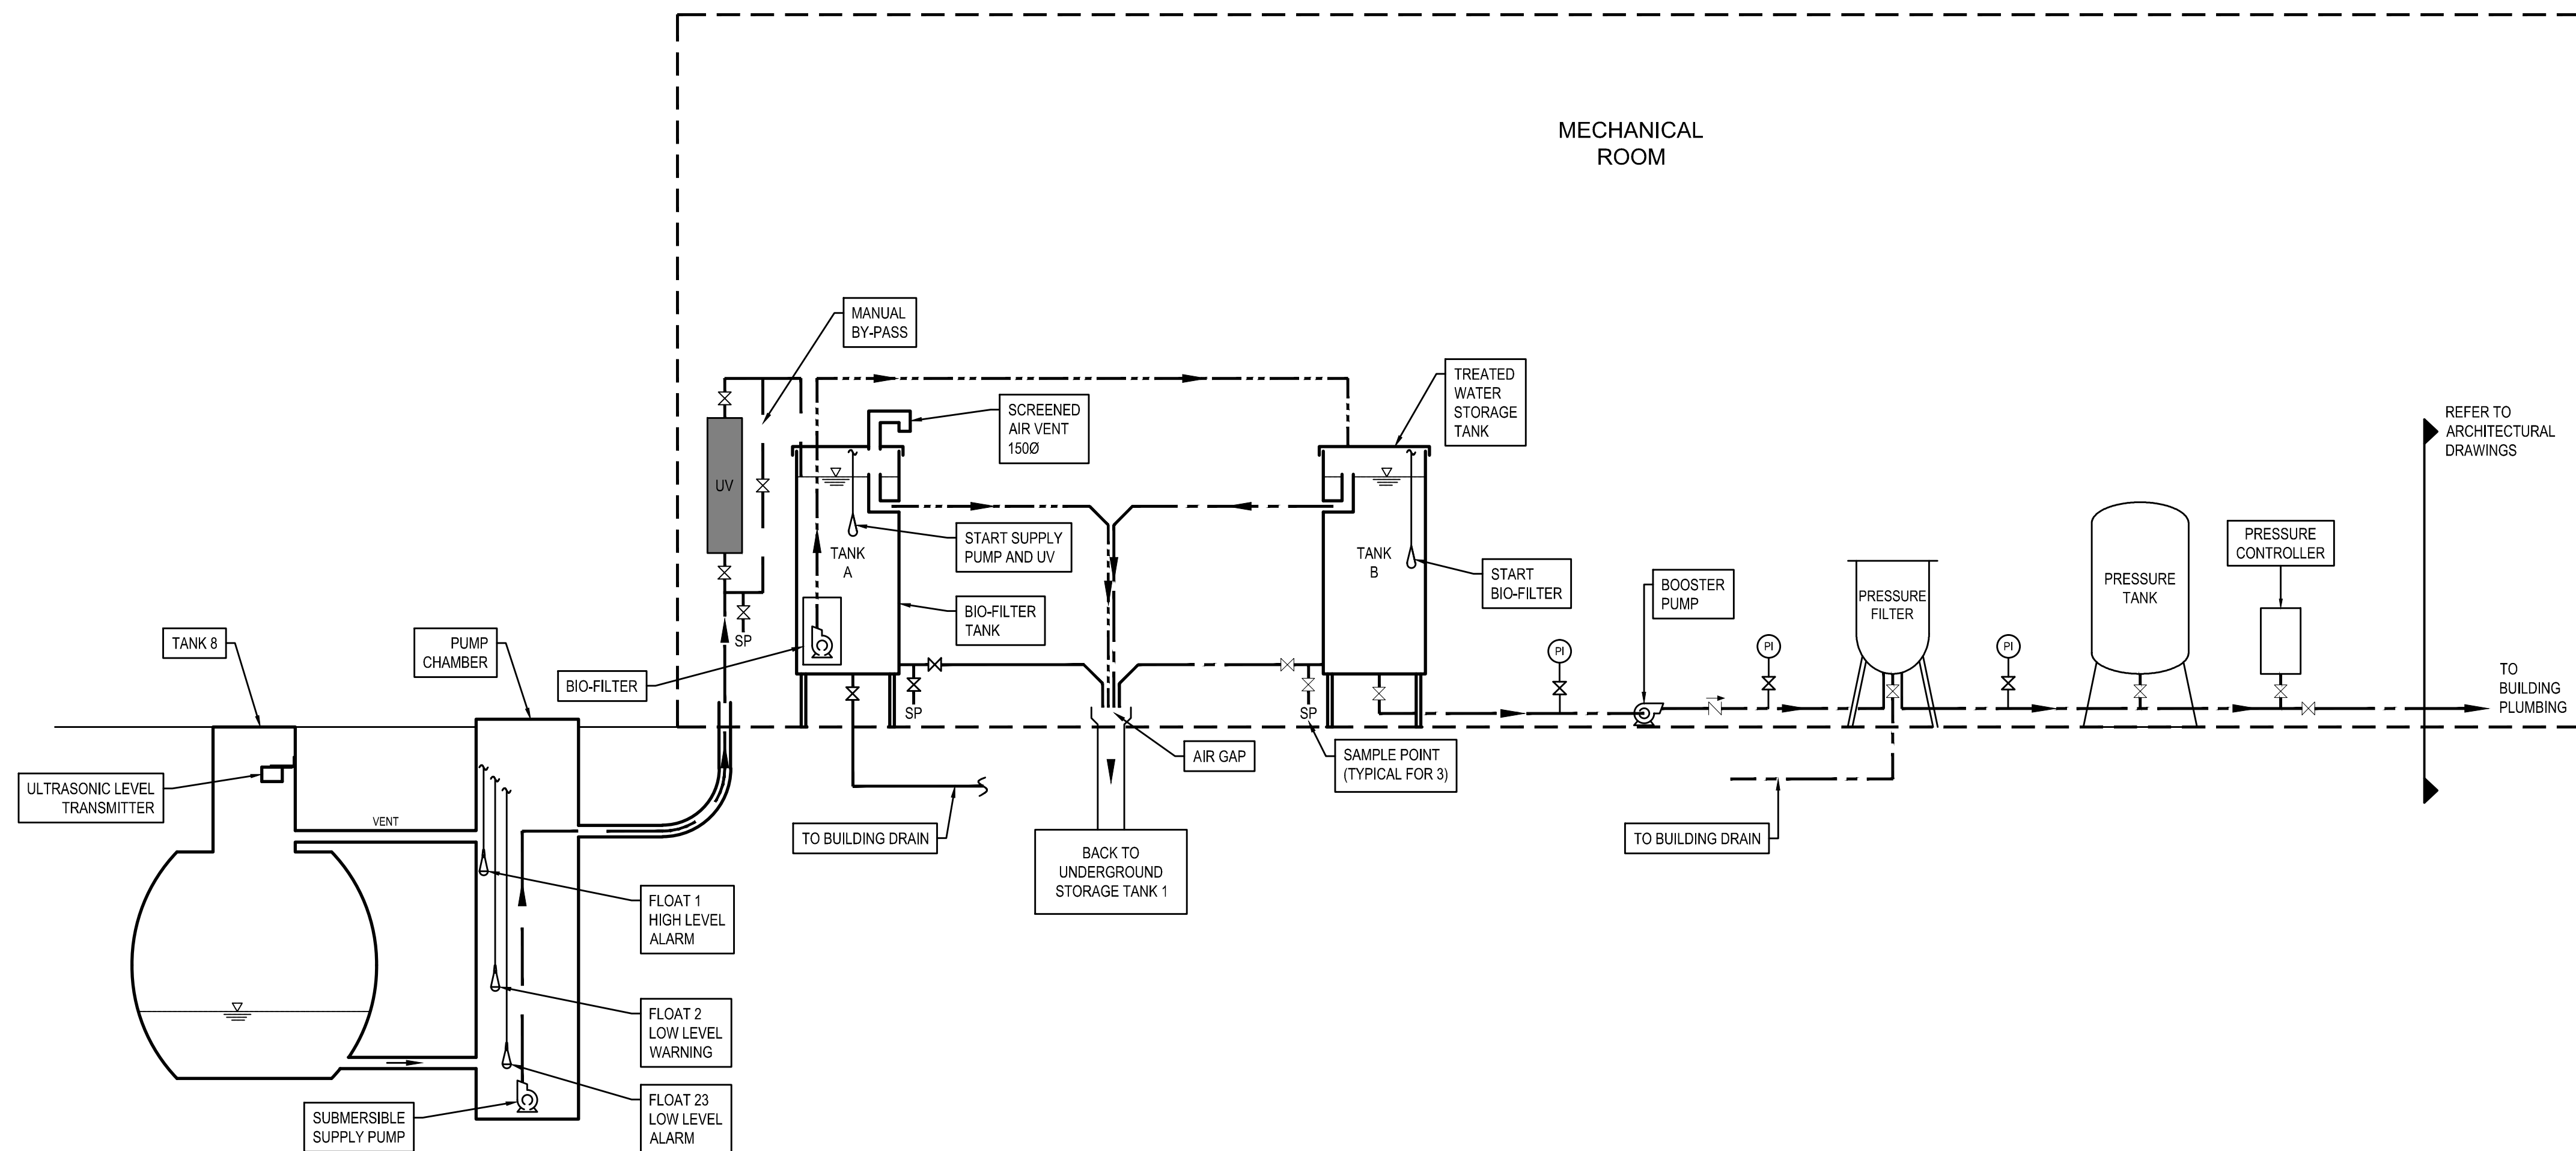

RAINWATER TREATMENT
PROCESS FLOW DIAGRAM
NTS

Public Works and Government Services Canada / Travaux publics et Services gouvernementaux Canada

REAL PROPERTY SERVICES Pacific Region / SERVICES IMMOBILIERS Région de Pacifique

PROJECT: 121-19597-05

Association of Professional Engineers and Geoscientists of the Province of British Columbia
H. J. P. CASTRATEN
ENGINEERING LICENSEE
Limited Licence
125381
2015-05-12

5		
4		
3	ISSUED FOR TENDER	15/05/08
2	N/A	
1	ISSUED FOR 99% REVIEW	15/01/30
0	ISSUED FOR 60% REVIEW	14/11/24
Revision/Revision	Description/Description	Date/Date

Client/client
CANADA BORDER SERVICES AGENCY

Project title/Titre du projet
STEWART PORT OF ENTRY REDEVELOPMENT STEWART, B.C.

Consultant Signature Only

Designed by/Concepté par
H.V. / E.C.P.

Drawn by/Dessiné par
S.G.

PWGC Project Manager/Administrateur de Projets TPSGC
Gestionnaire régionale, Services d'architecture et de génie, TPSGC

Drawing title/Titre du dessin
WATER STORAGE AND TREATMENT DETAILS

Project No./No. du projet	Sheet/Feuille	Revision no./La Révision no.
R.071365.001	C-008 9 OF 15	3