




- KEYNOTES:**
- TYPE 'F' FIXTURES TO BE RECESSED IN CANOPY SOFFIT.
 - PROVIDE TIMER IN LV-LPA PANEL TO PROVIDE SCHEDULED SHUTDOWN TO MEET ASHREA 90.1 REQUIREMENTS. COORDINATE SCHEDULE WITH OWNER.
 - CONNECT EXIT LIGHTS TO LV RELAY PANEL TO TURN ON DURING LOSS OF POWER AND EM1 FOR DC POWER (TYPICAL FOR ALL).
 - THESE THREE (3) SWITCHES SHALL BE KEYED.
 - DAMP LOCATION RATED.
 - PHOTOCELL SHALL BE MOUNTED AT 3048mm A.F.G. AND SHADED FROM ARTIFICIAL SOURCES OF LIGHT. PHOTOCELL SHALL CONTROL EXTERIOR WALL MOUNTED FIXTURES.
 - DAY LIGHT SENSORS SHALL PROVIDE AUTOMATIC DIMMING CONTROL FOR TYPE 'F' CANOPY FIXTURES.
 - PROVIDE CONDUIT FROM NEAREST DEVICE, JUNCTION BOX OR PANEL BOARD FOR ELECTRICAL DEVICES IN CANOPY BUILDING.

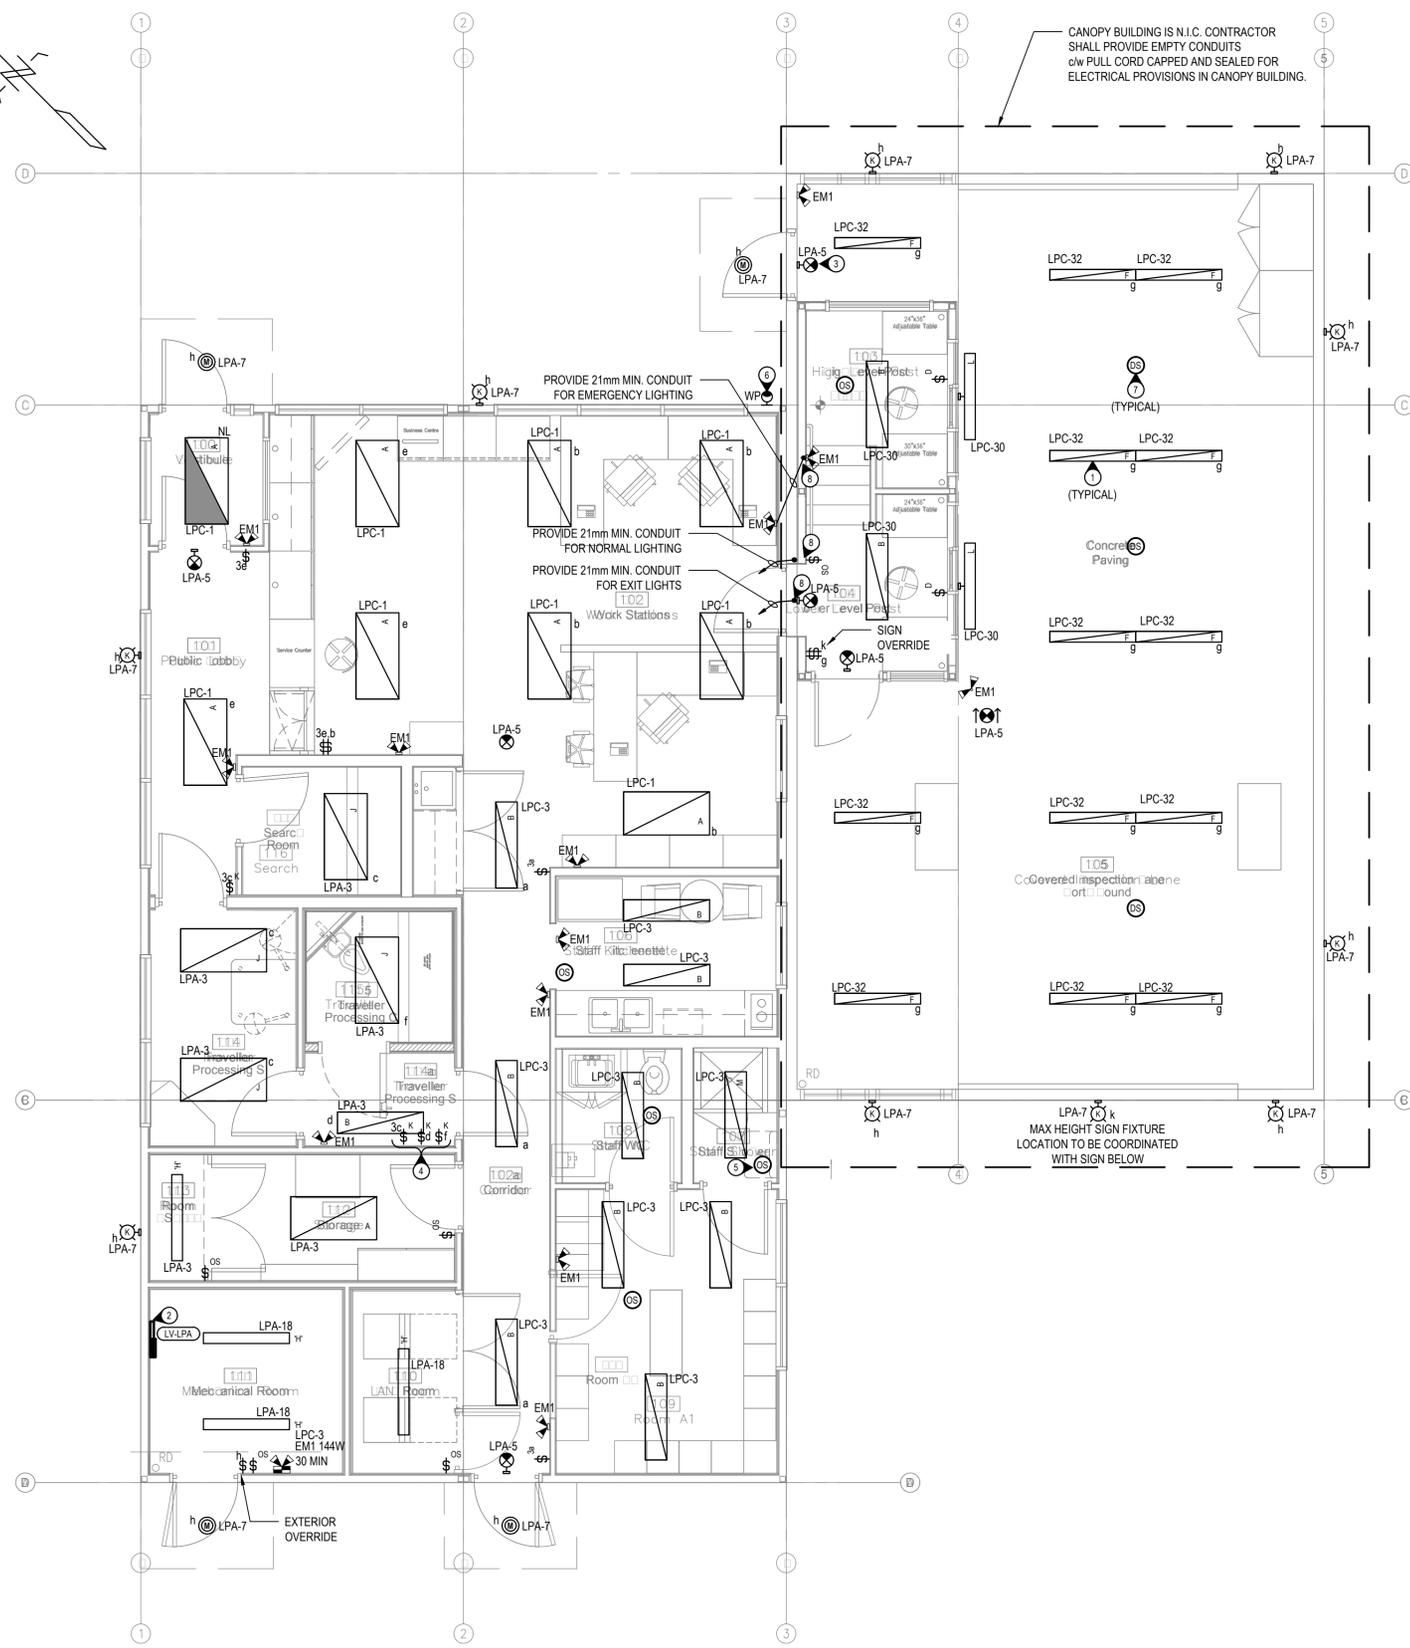

NOT FOR CONSTRUCTION FOR INFORMATION PURPOSES ONLY

Revision/	Description/Description	Date/Date
5		
4		
3	RE-ISSUED FOR CONCEPTUAL DESIGN	15/05/12
2	RE-ISSUED FOR CONCEPTUAL DESIGN	15/05/05
1	ISSUED FOR CONCEPTUAL DESIGN	15/04/21
0	ISSUED FOR 60% REVIEW	14/12/10

Client/client

CANADA BORDER SERVICES AGENCY

Project title/Titre du projet

STEWART PORT OF ENTRY REDEVELOPMENT STEWART, B.C.

Consultant Signature Only

Designed by/Concept par
J.d.B./T.D.

Drawn by/Dessiné par
T.D./P.P./S.G.

PWGSC Project Manager/Administrateur de Projets TPSGC
Julian Ho

Regional Manager, Architectural and Engineering Services
Gestionnaire régionale, Services d'architectural et de génie, TPSGC
Preetpal Paul

Drawing title/Titre du dessin

ELECTRICAL LIGHTING PLAN

Project No./No. du projet	Sheet/Feuille	Revision no./La Révision no.
R.071365.001	EB-002 OF 06	3

VA:\Projects\2013\131-12992-04_PWGSC_CBSA_Stewart_PoE_New_Building_Development_-_Elec_Prefabricated_Building_WSP_Data_Production\131-12992-04-E-002_12/05/2015_9:43 AM_TYLER.DAVIDSON

