


VA\Projects\2013\131-12992-04 PWGSC CBESA Stewart Port New Building Development - Elec\Prefabricated Building\WSP Data Production\131-12992-04-E-004- 5/05/2015 3:53 PM TYLER DAVIDSON



- KEYNOTES:**
- 1 DEVICE TO BE TAMPER PROOF OR SHALL HAVE TAMPER PROOF COVER.
 - 2 HORN STROBE SHALL ANNUNCIATE ONLY DURING INITIATION OF ALARM ZONE 5 DETECTORS LOCATED IN CONTAINED USE AREA. PROVIDE LAMICOID LABEL INDICATING CONTAINED USE AREA ALARM.
 - 3 PROVIDE CONDUIT FROM NEAREST DEVICE, JUNCTION BOX OR PANEL BOARD FOR ELECTRICAL DEVICES IN CANOPY BUILDING.

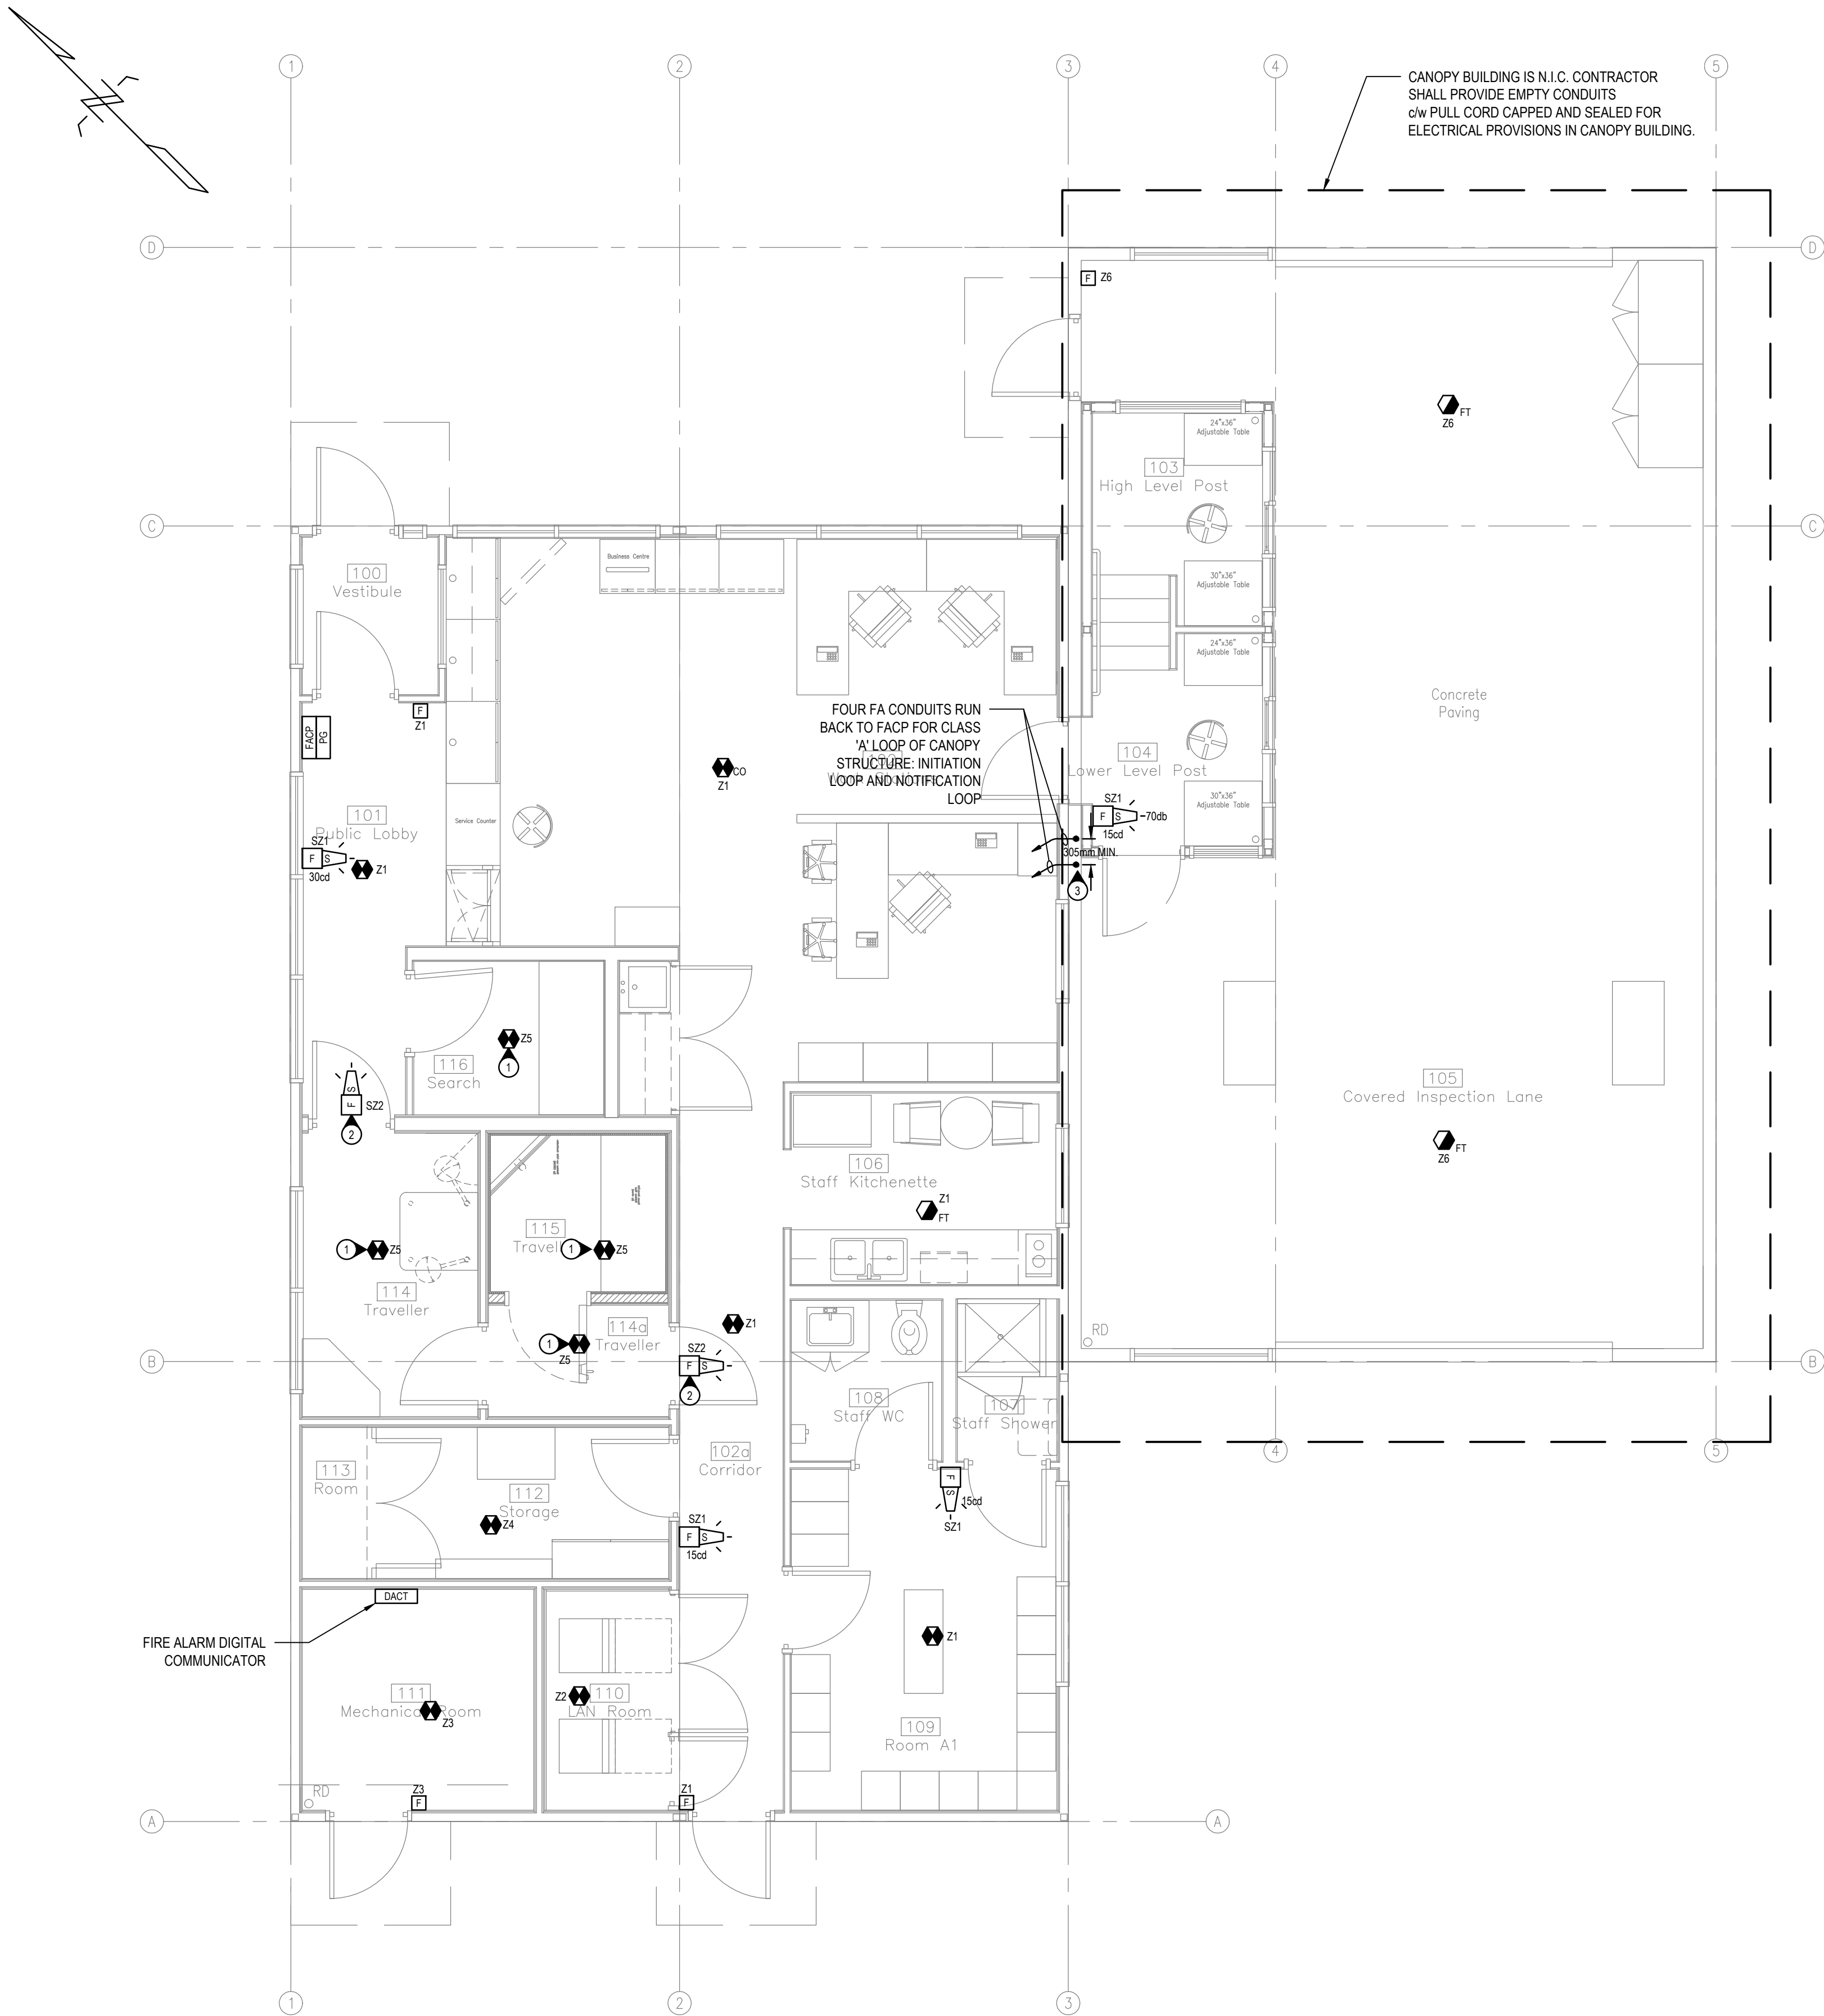

400-401 GARBALLY ROAD
VICTORIA (BRITISH COLUMBIA) CANADA V8T 5M3
TEL.: 250-384-5510 | FAX: 250-386-2844 | WWW.WSPGROUP.COM
PROJECT: 131-12992-04

**NOT FOR CONSTRUCTION FOR
INFORMATION PURPOSES ONLY**

5		
4		
3	RE-ISSUED FOR CONCEPTUAL DESIGN	15/05/12
2	RE-ISSUED FOR CONCEPTUAL DESIGN	15/05/05
1	ISSUED FOR CONCEPTUAL DESIGN	15/04/21
0	ISSUED FOR 60% REVIEW	14/12/10
Revision/ Revision	Description/Description	Date/Date

Client/client

**CANADA BORDER
SERVICES AGENCY**

Project title/Titre du projet

**STEWART PORT OF ENTRY
REDEVELOPMENT
STEWART, B.C.**

Consultant Signature Only

Designed by/Concept par

J.d.B./T.D.

Drawn by/Dessiné par

T.D./P.P./S.G.

PWGSC Project Manager/Administrateur de Projets TPSCG

Julian Ho

Regional Manager, Architectural and Engineering Services

Gestionnaire régionale, Services d'architecture et de génie, TPSCG

Principal Paul

Drawing title/Titre du dessin

**ELECTRICAL
FIRE ALARM SYSTEM**

Project No./No. du
projet

R.071365.001

Sheet/ Feuille

EB-004

OF 06

Revision no./
La Révision
no.

3