




LEGEND	
	POWER JUNCTION BOX, (SURFACE MOUNT)
	TELEPHONE/DATA JACK OUTLET. RUN 3/4" C/W CAT6 CABLE TO IT ROOM. REUSE EXISTING WHERE POSSIBLE, PROVIDE NEW WHERE REQUIRED.
	LOW VOLTAGE MECHANICAL THERMOSTAT.
	MOTOR DISCONNECT. SIZE AS PER CEC REQUIREMENTS.
	MOTOR MAGNETIC STARTER.
	MOTOR
	FIRE ALARM SPEAKER.
	PICTOGRAM "RUNNING MAN" EXIT SIGN. STANDARD OF ACCEPTANCE: READY-LITE RA SERIES.
	LOW VOLTAGE WALL MOUNTED LIGHT SWITCH.
	15A SINGLE POLE LIGHT TOGGLE SWITCH.
	EXISTING PULL STATION.
	EXISTING DISTRIBUTION PANEL.
	PHOTO ELECTRIC CELL C/W TIME CLOCK AND 4-20 AMP 120V CONTACTOR.
	PACK POLE.
	EXISTING 2 X 4 FLUORESCENT LIGHT FIXTURE LAY IN GRID. FIXTURE TO BE REUSED. ALLOW FOR WIRING EXTENSION, SEISMIC RETRAIN AND TERMINATIONS FOR COMPLETE OPERATIONAL SYSTEM. CHANGE CIRCUITING TO MATCH NEW LAYOUT AND SWITCHING.
	EXISTING 6" POT LIGHT FIXTURE RECESSED IN GRID. FIXTURE TO BE REUSED. ALLOW FOR WIRING EXTENSION, SEISMIC RETRAIN AND TERMINATIONS FOR COMPLETE OPERATIONAL SYSTEM. CHANGE CIRCUITING TO MATCH NEW LAYOUT AND SWITCHING.
	15A DUPLEX RECEPTACLE C/W GROUND.
	15A FOURPLEX RECEPTACLE C/W GROUND.
	15A SPLIT RECEPTACLE C/W GROUND. BREAKER PROTECTING THIS RECEPTACLE SHALL BE DOUBLE POLE.
	20A RECEPTACLE C/W GROUND. BREAKER PROTECTING THIS RECEPTACLE SHALL BE 20A-1P.
	EXISTING CAMERAS WITH COAX CABLE, RUN THE CABLES TO THE NEW DVR LOCATION.
	120" MOTION SENSOR
	WALLS TO BE REMOVED

GENERAL NOTE:
CONTRACTOR TO CARRY THE COST OF SHARED SERVICES CANADA (SSC) CERTIFIED CONTRACTOR TO DO ALL THE TEL/DATA STRUCTURAL WIRING, MAIN TERMINATIONS, CROSS CONNECT, PATCH PANELS AND ALL RELATED WORK IN THE BID PRICE. ONLY SSC CONTRACTOR IS ALLOWED TO DO THE STRUCTURAL WIRING AND TEL/DATA CABLING WORK AND THE TERMINATIONS IN THE RENOVATED SPACE. ALLOW FOR NEW TEL/DATA PLUGS INSIDE THE SPACE IN THE BID PRICE FOR COMPLETE OPERATIONAL SYSTEM. EXISTING EMPTY CONDUITS AND BOXES ONLY ALLOWED TO BE RE-USED FOR THE NEW TEL/DATA SYSTEM. INSTALL NEW CABLES AND ALL ACCESSORIES FOR THE NEW LOCATIONS AS SHOWN.



EXISTING EMPTY CONDUITS, WIRING, AND BOXES ARE ALLOWED TO BE RE-USED FOR THE NEW POWER SYSTEM. INSTALL NEW CABLES AND ALL ACCESSORIES FOR THE NEW LOCATIONS AS SHOWN. SPLICES EXISTING WIRING INSIDE JUNCTION BOXES AND EXTEND TO NEW LOCATION. RE-USE CIRCUITS AS SHOWN.

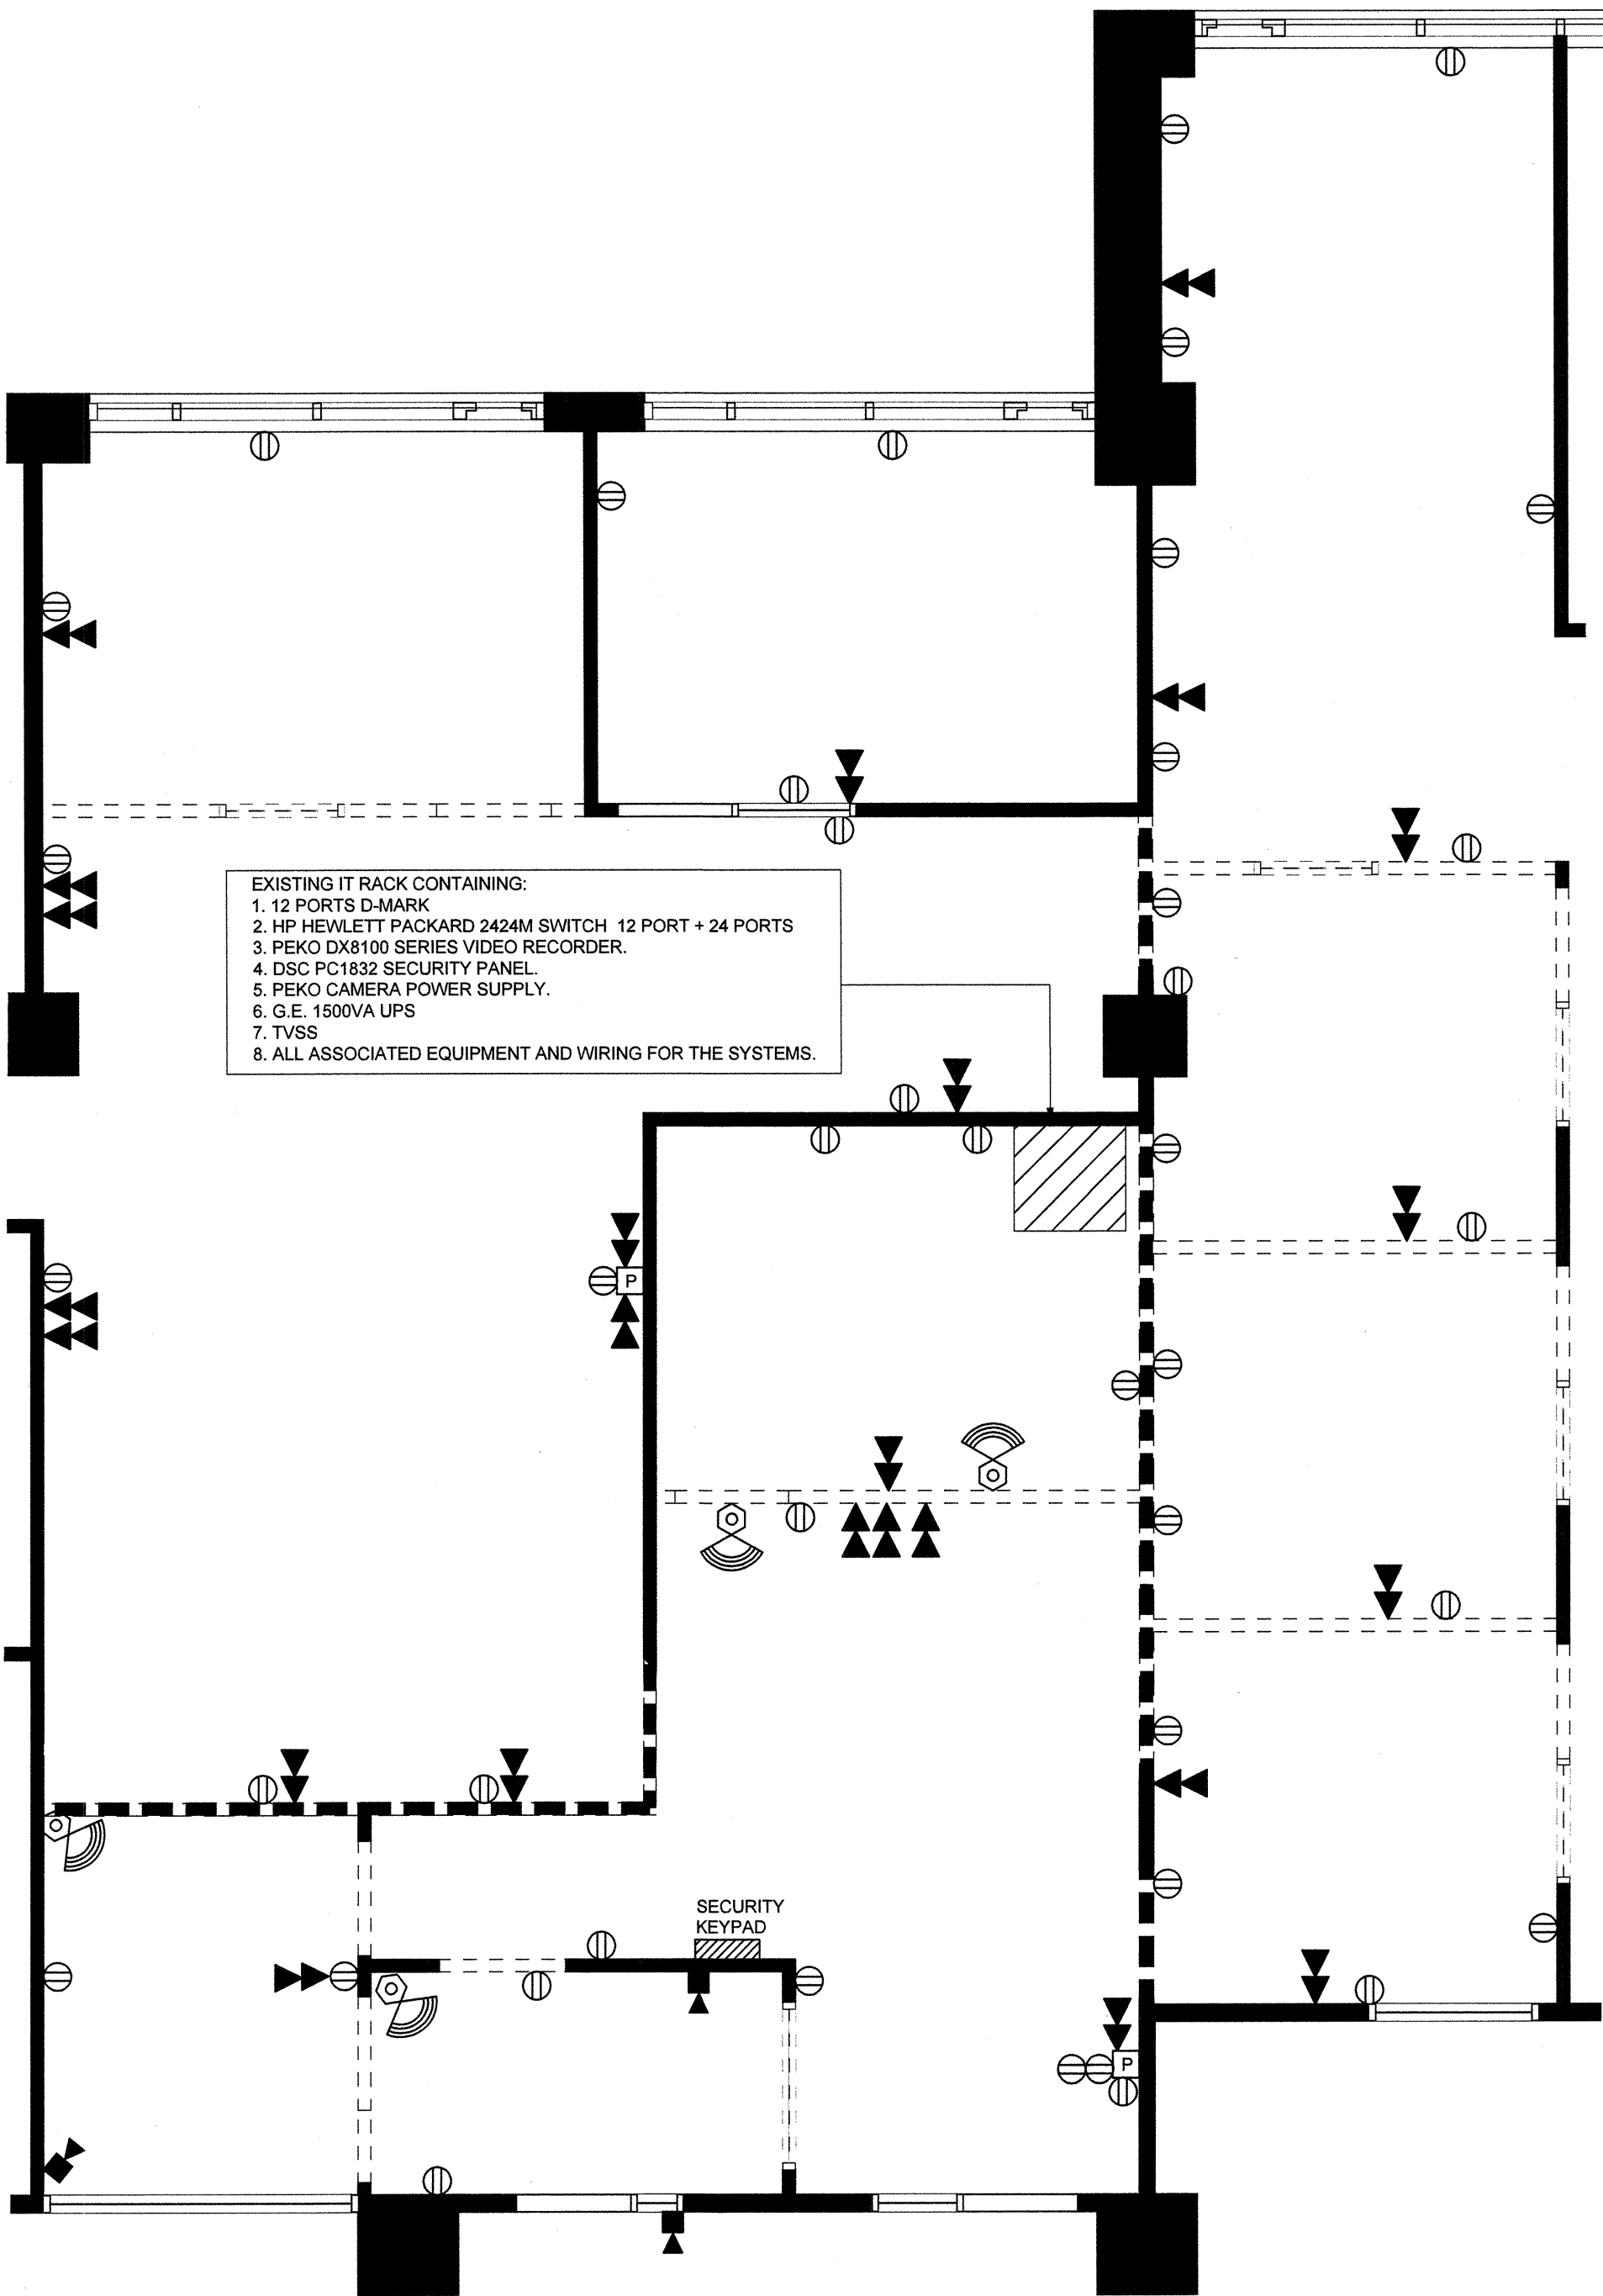

EXISTING POWER, TEL/DATA AND SECURITY PLAN /DEMOLISHING
SCALE 1:50

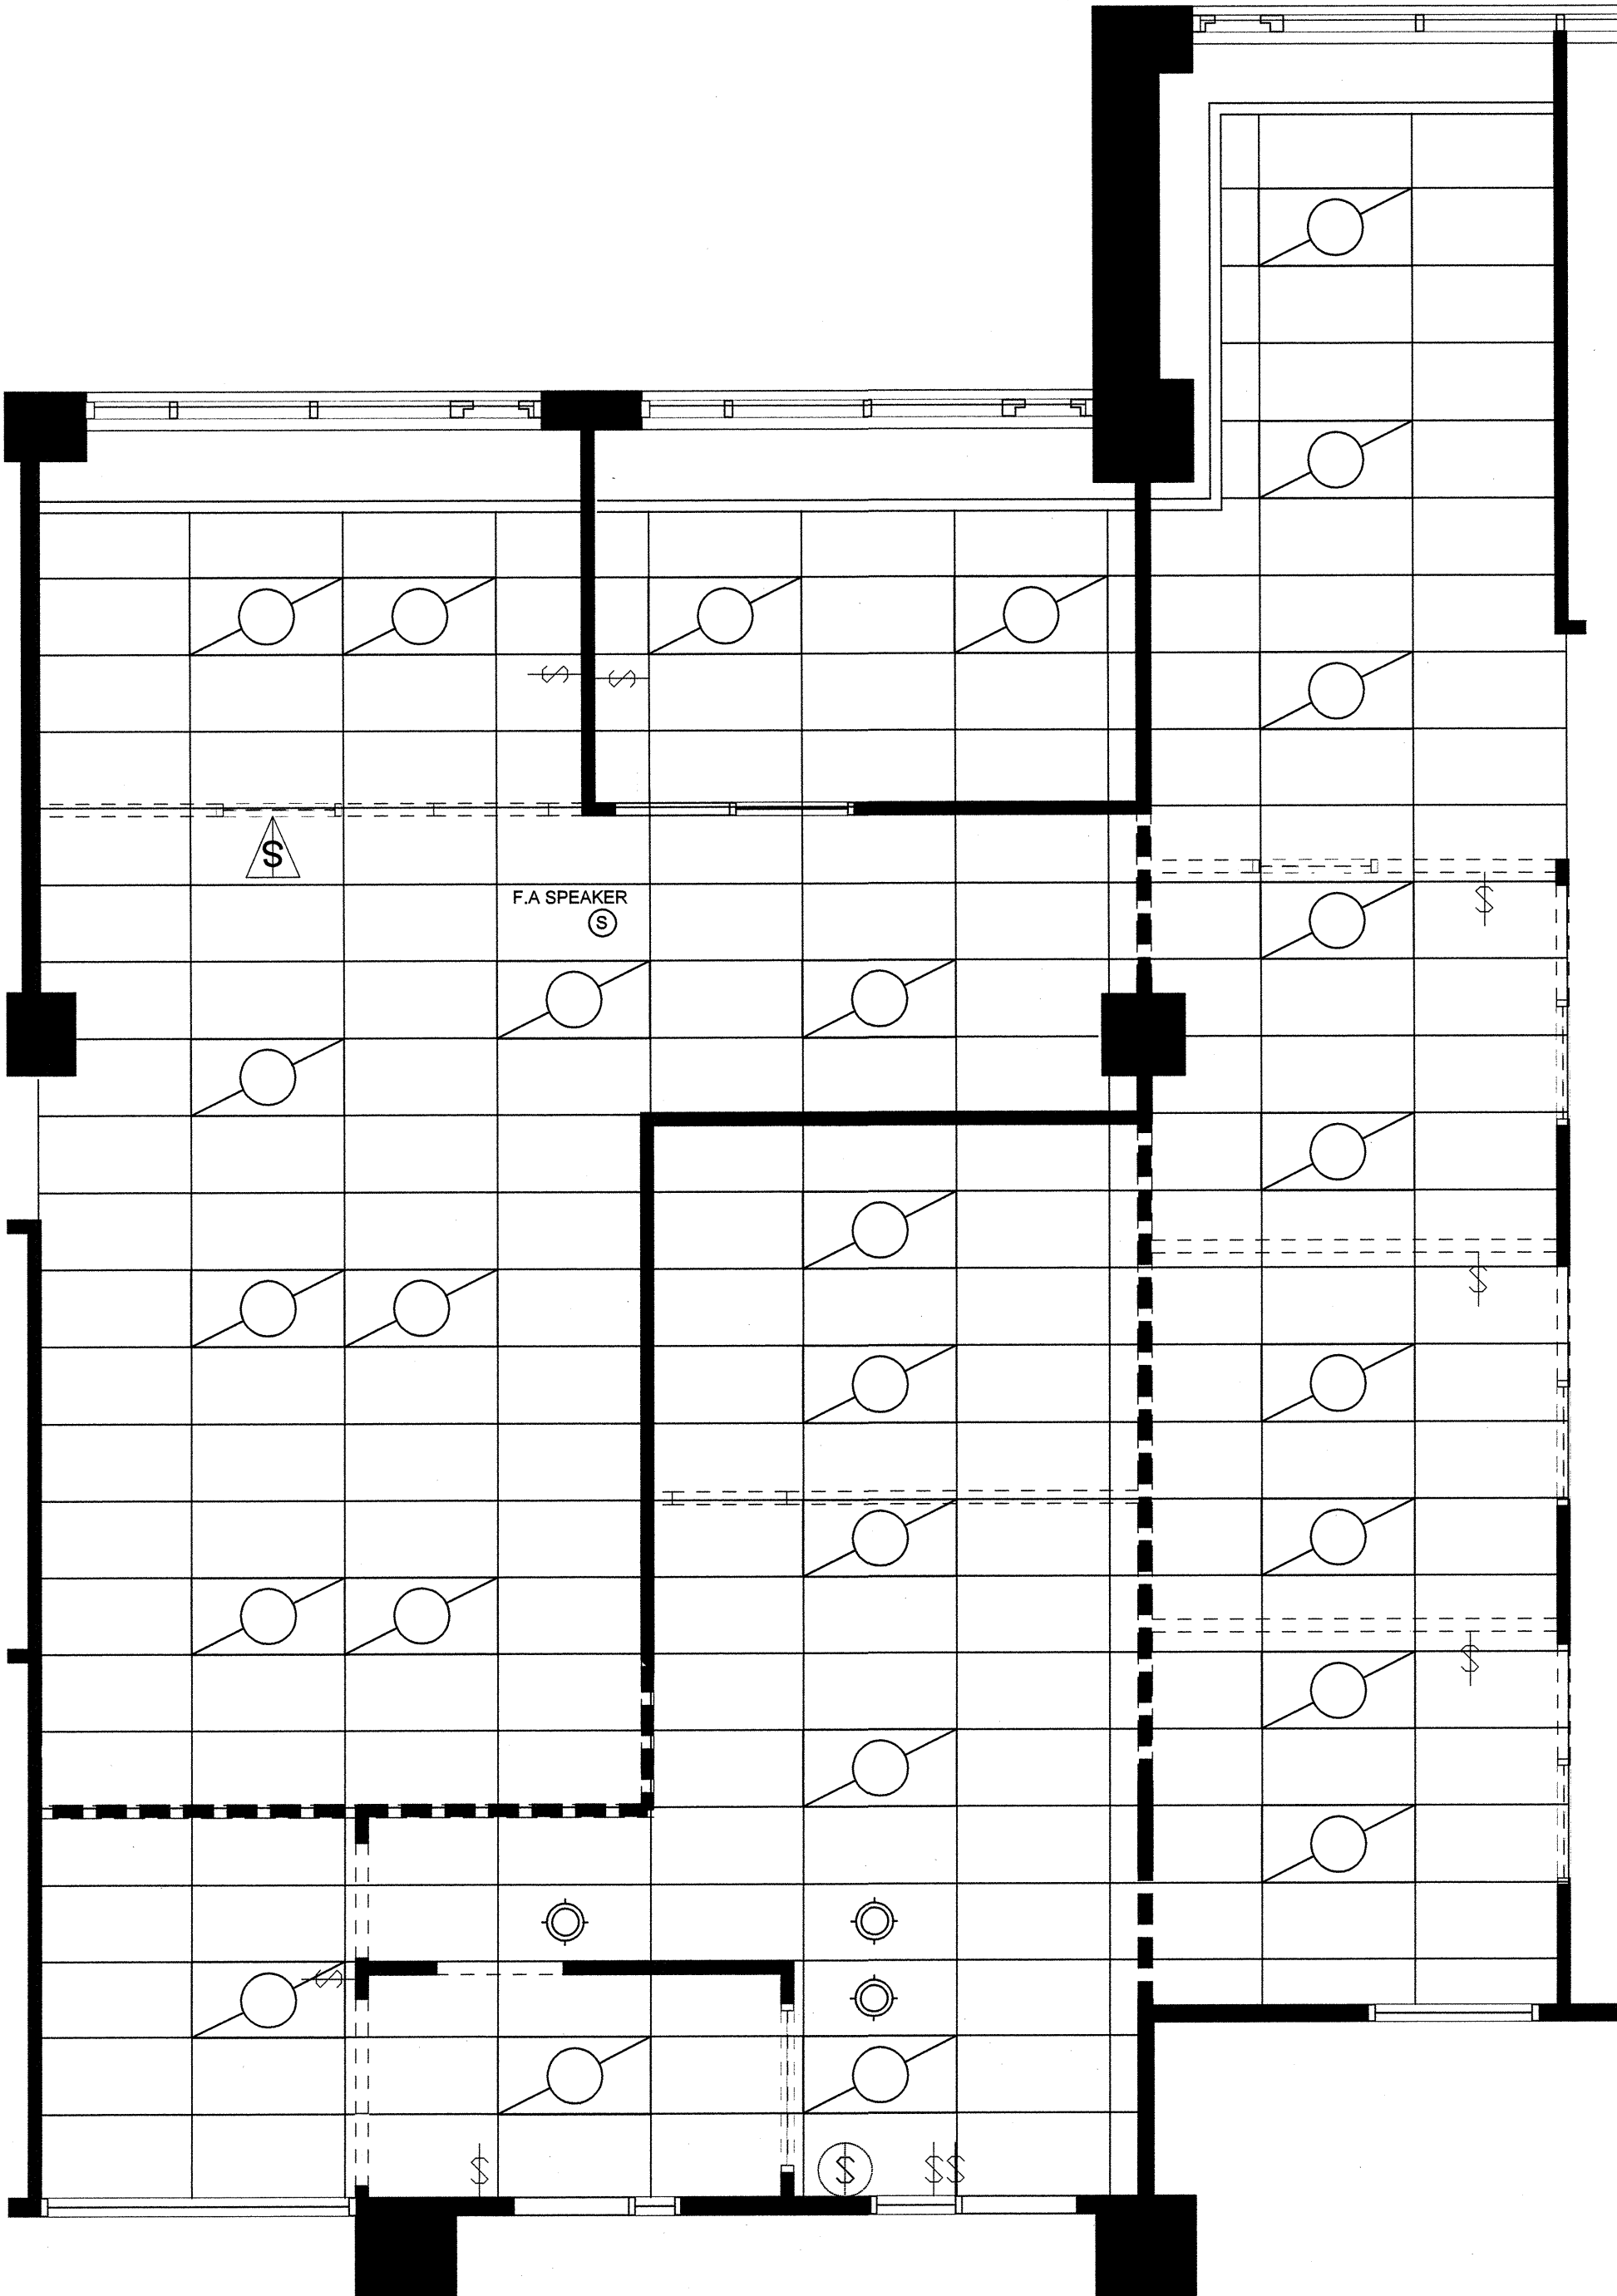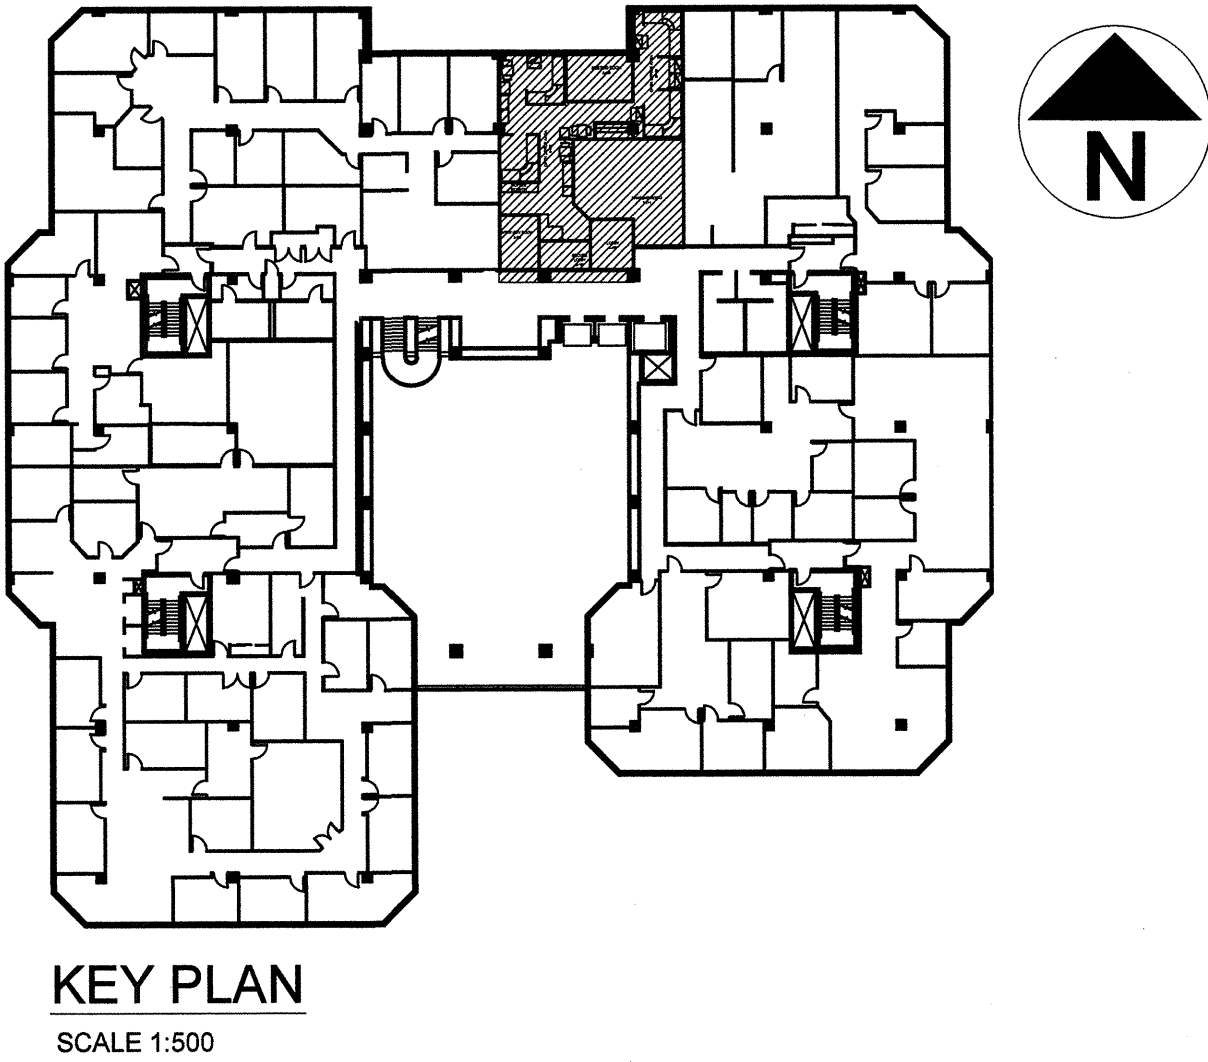

EXISTING LIGHTING PLAN/ DEMOLISHING
SCALE 1:50

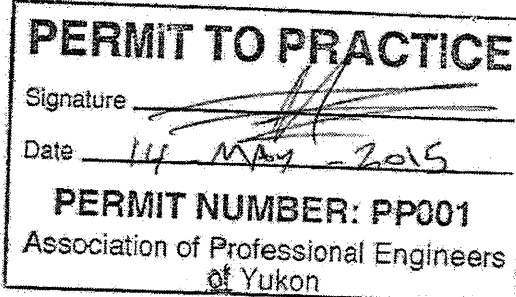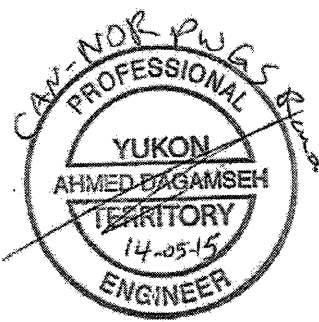

Revision/	Description/Description	Date/Date
4	ISSUED FOR TENDER	14-05-2015
3	REVISED 99% SUBMISSION	17-04-2015
2	99% SUBMISSION	07-04-2015
1	66% SUBMISSION	27-03-2015

CAN-NOR and PUBLIC WORKS & GOVERNMENT SERVICES

800 BARRARD ST.
VANCOUVER, BC

Project title/Titre du projet
2nd & 4th Floor - 300 Main Street
Whitehorse, YT

CAN-NOR Relocation Consolidated

Consultant Signature Only

Designed by/Concept par
AD

Drawn by/Dessine par
AD

PWGSC Project Manager/Administrateur de Projets TPWSC
Cyndi Oster

PWGSC, Architectural and Engineering Resources Manager/
Ressources Architectural et de Directeur d'ingénierie, TPWSC
Preetpal Paul

Client/client

CAN-NOR

Drawing title/Titre du dessin

2nd FLOOR TENANT IMPROVEMENT

EXISTING DATA/POWER/SECURITY AND LIGHTING PLANS

Project No./No. du projet
R.072738.001

Sheet/ Feuille
E1
OF 07

Revision no./ La Révision no.
0