



ORIGINAL TRIMMED SIZE 73" x 26"

0 1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 INCHES

16" FRAME SPACING  
FR. 30

13" FRAME SPACING 16" FRAME SPACING  
FR. 123

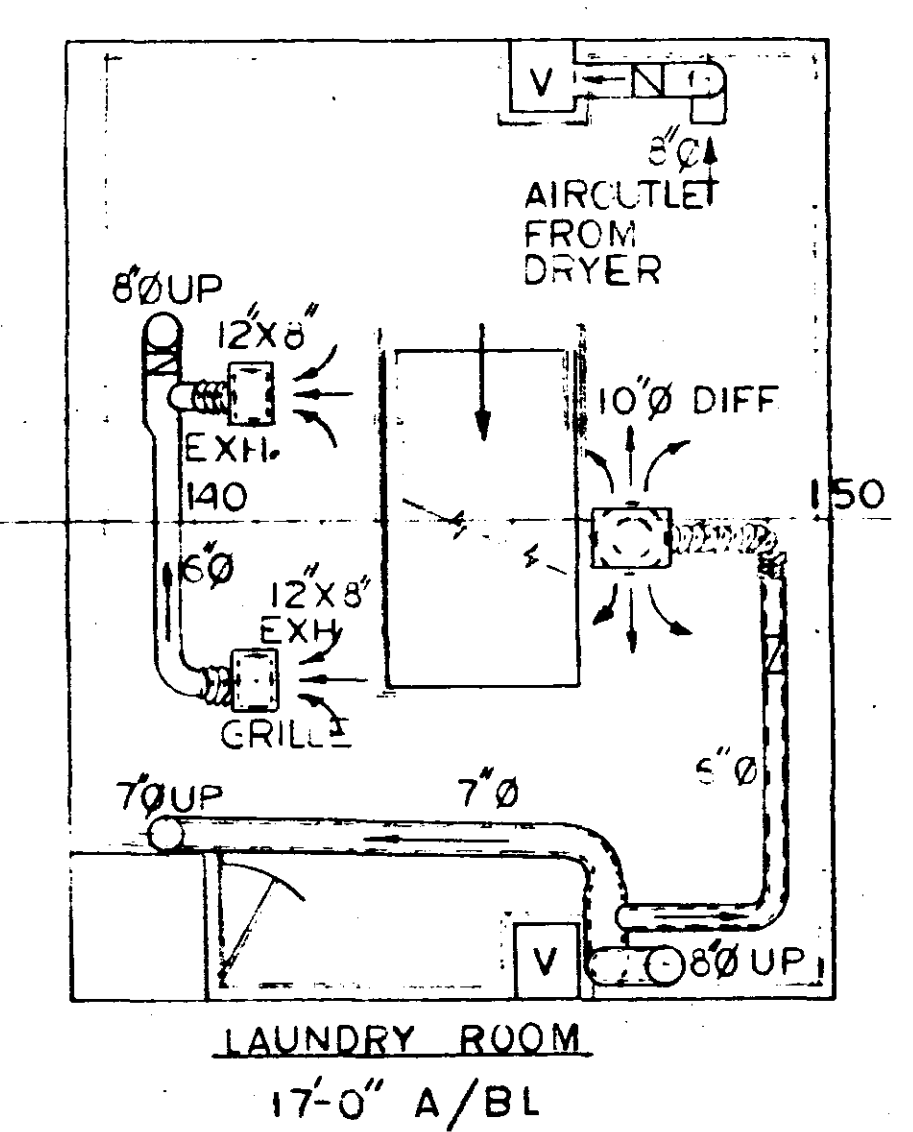

GENERAL ARRGT. OF VENTILATION ONLY  
PLAN-VIEW  
AT DECKHEAD

**LEGEND**

- INSULATED SUPPLY DUCTS
- EXHAUST DUCTS
- RETURN AIR DUCTS
- FLEXIBLE HOSE CONN.
- RE-HEATER
- EXHAUST BOX C/W GRILLE
- FLOOR MOUNTED RE-HEATER
- NON RETURN VALVE
- FIRE DAMPER

221-H-88/2

5-AS-FITTED HULL 221 BDD-1370			
4. REDRAWN		B.D.D. 7/1/77	
BY DATE			
DISTRIBUTION			
NO.	QTY.	REMARKS	QTY.
DIVISION			
HULL 221/222 JOB No. 270			
TITLE			
ACCOMMODATION A/C			
APPROVALS			
OWNERS D.S.S.	DATE	DESIGNED BY	ME GHERGHISHAN
C.S.I.	11/77	APPROVED BY	PUTZBECK
SCALE 1/4" = 1'-0"		DATE 7/1/77	
DWG. No. 221-H-88/2		REV. 5	