
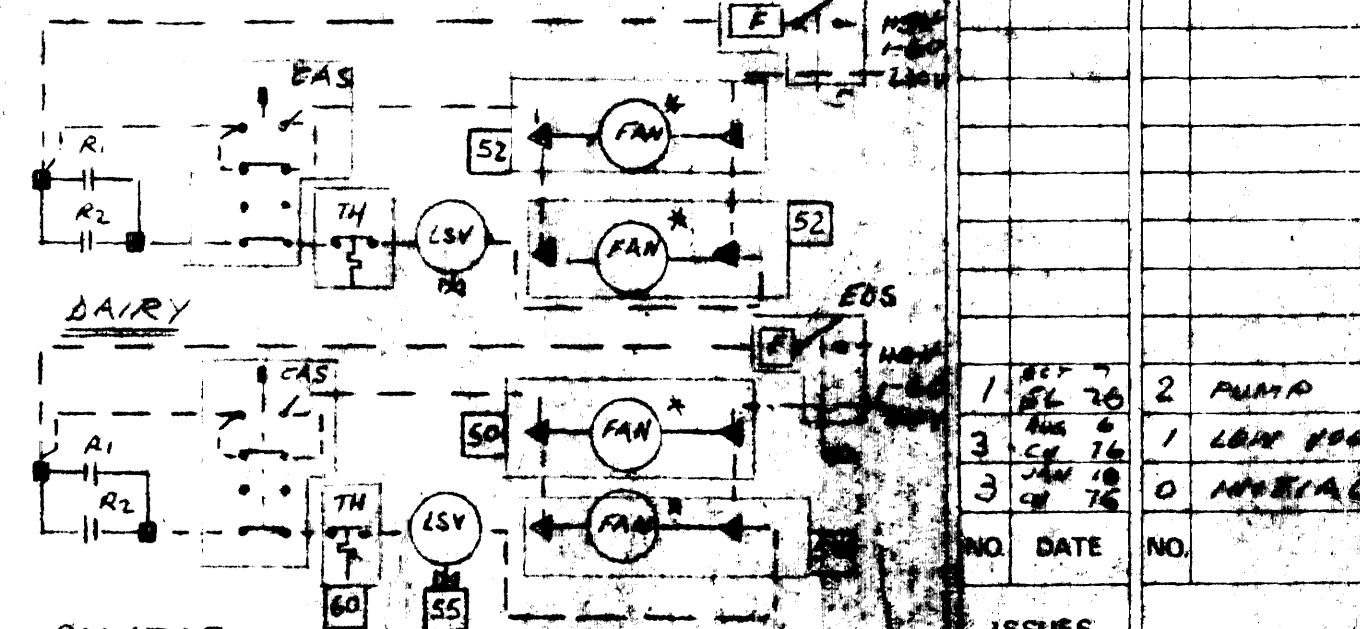
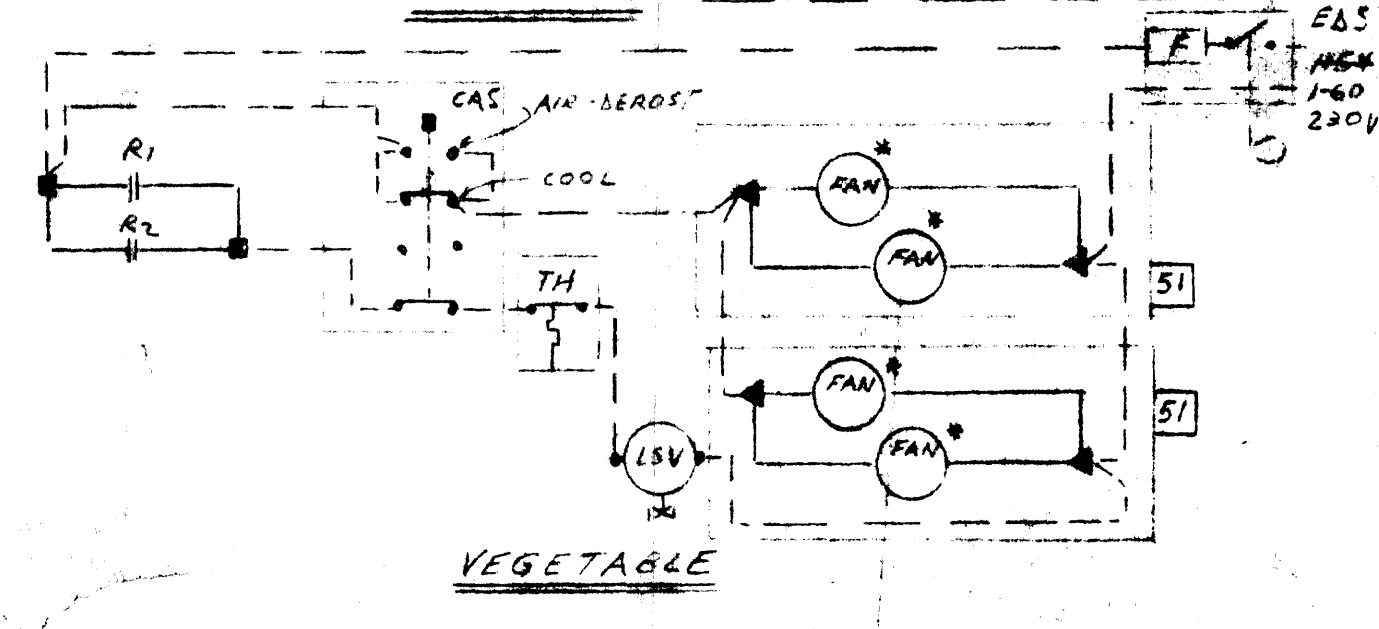
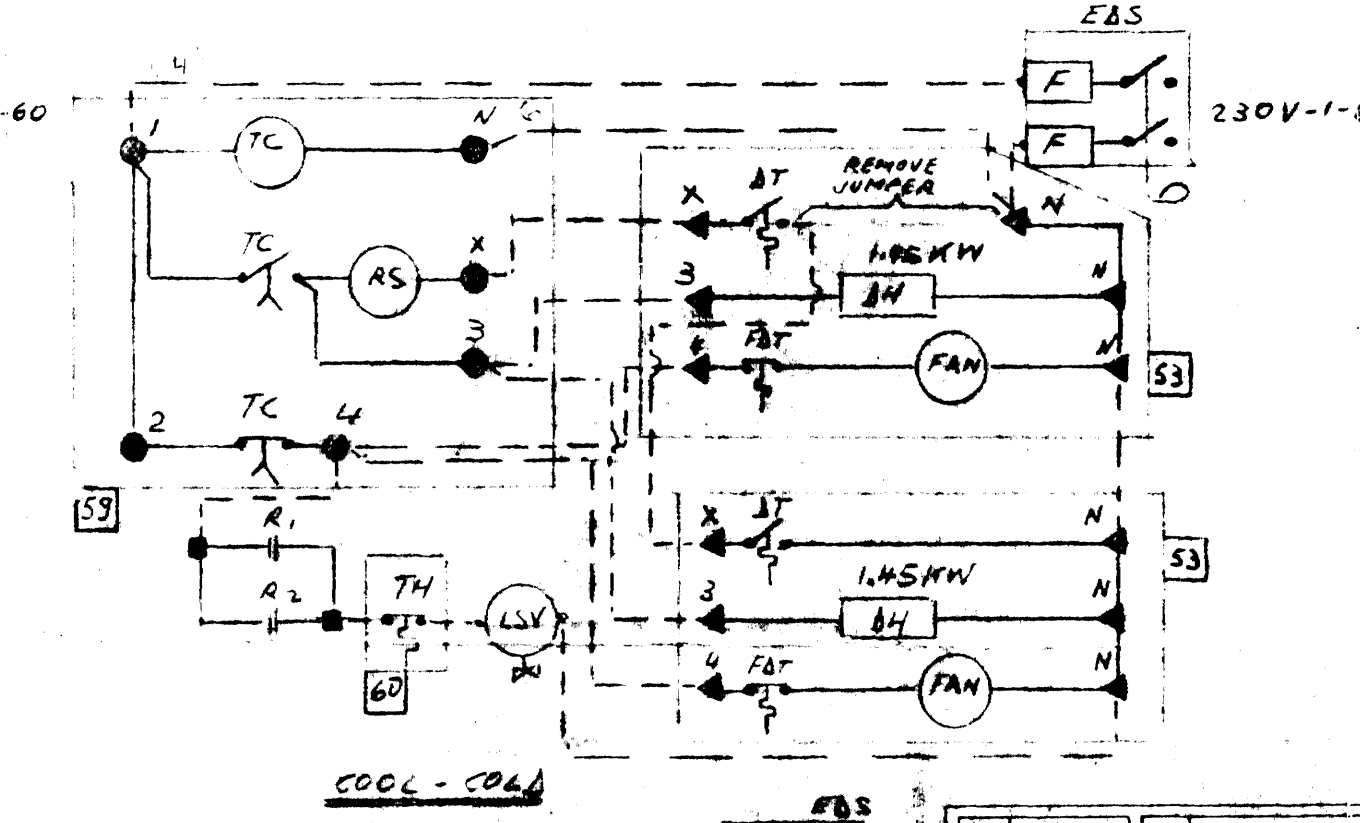


NOTES

- W STARTERS
- WIRING INSIDE CONTROL PANEL
- - - GALT WIRING ON UNIT (LIQUID SEAL CONDUIT)
- - - SHIPYARD WIRING
- TERMINAL ON GALT PANEL
- ⊙ TIME CLOCK TERMINAL
- ◀ TERMINAL ON UNIT COOLER
- * 230V-1-60 FIELD KIT AVAILABLE ORDERED CUSTOMER TO RETURN 115V KITS

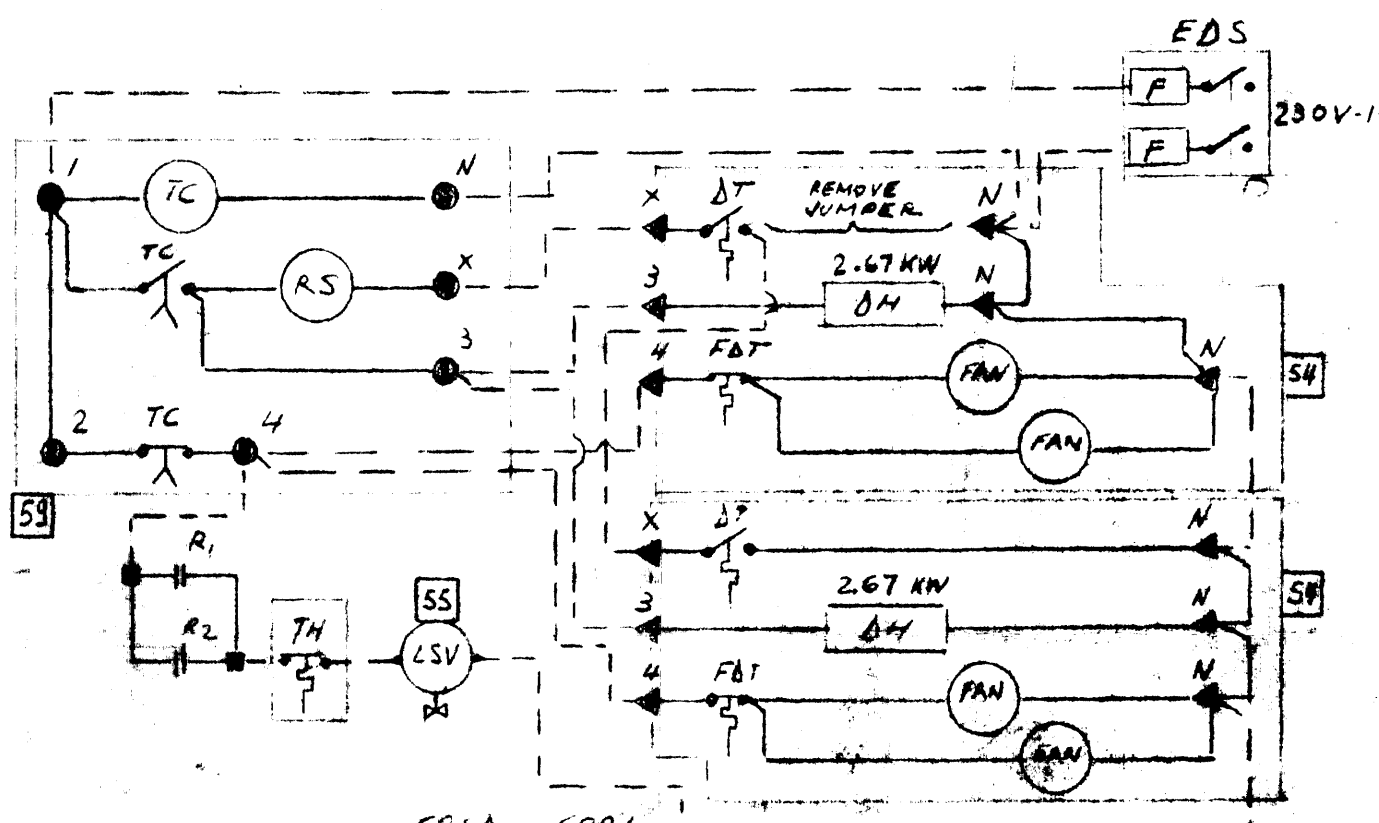

IL	2	INDICATING LIGHTS	
FB	2	FUSED DISC BLOCK	
NOA	2	HAND-OFF-AUTO	SPRING RETURN FROM HAND POSITION
AM	2	AMMETER	IN COVER
R	2	AUX. RELAY	6-NO CONTACT
TR	2	TIME DELAY RELAY	1-5 SEC ON DELAY RESET
ISN	1	DISCONNECT SWITCH	
CTR	1	CONTROL TRANSFORMER	
CP	2	COMPRESSOR STARTER	FULL VOLT.
	76	PUMP MOTOR	3HP 440V-3-60
		MARINE AP. REEFS	1750 RPM
TH	60	ROOM THERMOSTAT	
	59	DEFROST TIME CLOCK	
SSD	1	PUMP SEL. SW.	BY SHIPYARD
CAS	3	COOL - AIR DEFROST SWITCH	BY SHIPYARD
EAS	5	EVAP. DISC. SWITCH	BY SHIPYARD
P	2	PUMP STARTERS	BY SHIPYARD
LSV	55	LIQUID SOL. VALVE	230V-1-60
	54	UNIT COOLER 230V-1-60	KUC 1030 AD
DH		DEFROST HEATER 2.67KW	EACH
		TWO FAN EACH 1/15HP	1550 RPM 1/2 FLA EA
FAT		BUILT IN FAN DELAY	
DT		" " DEFROST CONTROL	
	53	UNIT COOLER 230V-1-60	KUC 510 AD
DH		DEFROST HEATER 1.45KW	EACH
		ONE FAN EACH 1/15HP	1550 RPM 1/2 FLA EA
FAT		BUILT IN FAN DELAY	
DT		" " DEFROST CONTROL	
	51	UNIT COOLER 115V-1-60	KUC 410
		EACH TWO FAN 1/15HP	1550 RPM 2.3 FLA EA
		INTERNAL PROTECT	
	50	UNIT COOLER 115V-1-60	KUC 410
	52	EACH ONE FAN 1/15HP	1550 RPM 2.3 FLA
		INTERNAL PROTECT	
ILT	1	INDICATING LIGHT W. TRANSFORMER	
F		FUSES	
	28	LOW PRESS. SWITCH	
	27	HIGH PRESS. SWITCH	
	26	OIL FAILURE CONTROL	
OL		OVERLOAD PROTECTION	
	25	ELECTRICAL CONTROL PANEL ON 2ND UNIT	
		2 COMP. MOTORS	10HP 440V-3-60
		"	1750 RPM
	2	FRANKENSE HEATER 110V	100 WATT EA

GALT EQUIPMENT LTD.
47 MARIE VICTORIN BLVD.
CANDIAC P.Q.

ELECTRICAL DIAGRAM
DOMESTIC

CUSTOMER: **BURRARD** MILL: **222**

SCALE: **1" = 1'** CONTRACT: **3-10-75**

DATE: **JAN. 17 75** DWG: **3-10-75**

NO.	DATE	DESCRIPTION	DATE	IN
1	JUL 17 74	2 PUMP 1750RPM 3HP (1750)		
2	AUG 6 74	1 LOW VOLT. REVERSE		
3	JAN 10 75	0 MODIFIED		