



SYM.	DESCRIPTION	QTY	REMARKS
FS	1823-2 AIR FLOW SWITCH 0-2" H ₂ O	1	DWYER
ATV	ATV 312 H ₂ TSN ₄ AC DRIVE 10 HP	1	SCHIEDER
TH ₂	150 S/W T' STAT DPDT.	1	IN H. PANEL
SV ₁	142 STEAM VALVE	1	
LSV ₁	124 LIQ. SOLENO. VALVE	1	
RES	RESISTOR	1	
OF	120 OIL FAILURE CONTROL	1	
LP	131 LOW PRESSURE CONTROL	1	
HP	130 HIGH PRESSURE CONTROL	1	
FM	101 EVAP. FAN MOTOR	1	
CM	101 COMPRESSOR MOTOR	1	
CH	102 CRANKCASE HEATER	1	
TH ₁	128 THERMOSTAT COOL.	1	
EF	EVAP FAN STARTER	1	
+	NORMALLY CLOSED SWITCH		
-	" " OPEN " "		
CR	AUXILIARY RELAY		
R	RUN HOLDING COIL	1	
IS	START COIL	1	
2S	" " " "	1	
TR	TIME RELAY (PNEUMATIC TYPE)	1	
SS	SWITCHES	2	
OL	OVERLOAD CURRENT PROTECTION	2	
IL	INDICATING LIGHTS	2	
AB	AUTO TRANSFORMER STARTER	1	WESTING.
ADR	ITEM DESCRIPTION	QTY	REMARKS

NOTES: ALL CABLING MUST BE STRANDED CONDUCTORS. B2D TO BE INFORMED OF THE TYPE OF CABLE BEING USED.

WIRING

AND  BY CUSTOMER.

 BY GALT.


■ TERMINAL ON STARTER PANEL

● TERMINAL ON LOCAL CONTROL SWITCH

HOLD BACK ON PANEL DOOR.

CUT-OUT CONTROL PANEL TYPE 12 1414 PH-K

NOTES: TH₁ BULB TO BE INSTALLED IN RETURN AIR PANEL. TH₂ BULB TO BE INSTALLED IN FRESH AIR DUCT.

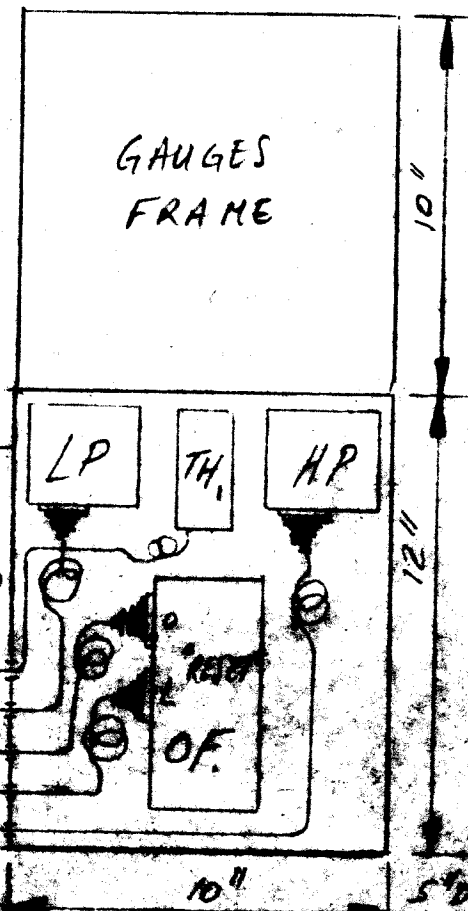

REV.	DATE	DESCRIPTION	DATE	BY
1	1971-12-15	INITIAL		
2	1972-01-15	ST. V. CIRCUIT + TH ₂ + EF		
3	1972-02-15	REVISION FROM CU NOTAT.		
4	1972-03-15	CHECK CONTROL PANEL		
5	1972-04-15	ADJUST AC DRIVE		

GALT EQUIPMENT LTD.
47 MARIE VICTORIA BLVD.
GANDIAC, P.Q.

ELECTRICAL WIRING DIAGRAM.
UNIT: 4

CUSTOMER: NORRIS WARRING
FOR BURRARD

SCALE: 1" = 1'-0"

DATE: SEP. 8, '76

3290