




DUMAC ENERGY LTD.
CONSULTING ENGINEERS
752 BEDFORD HIGHWAY
HALIFAX, N.S.

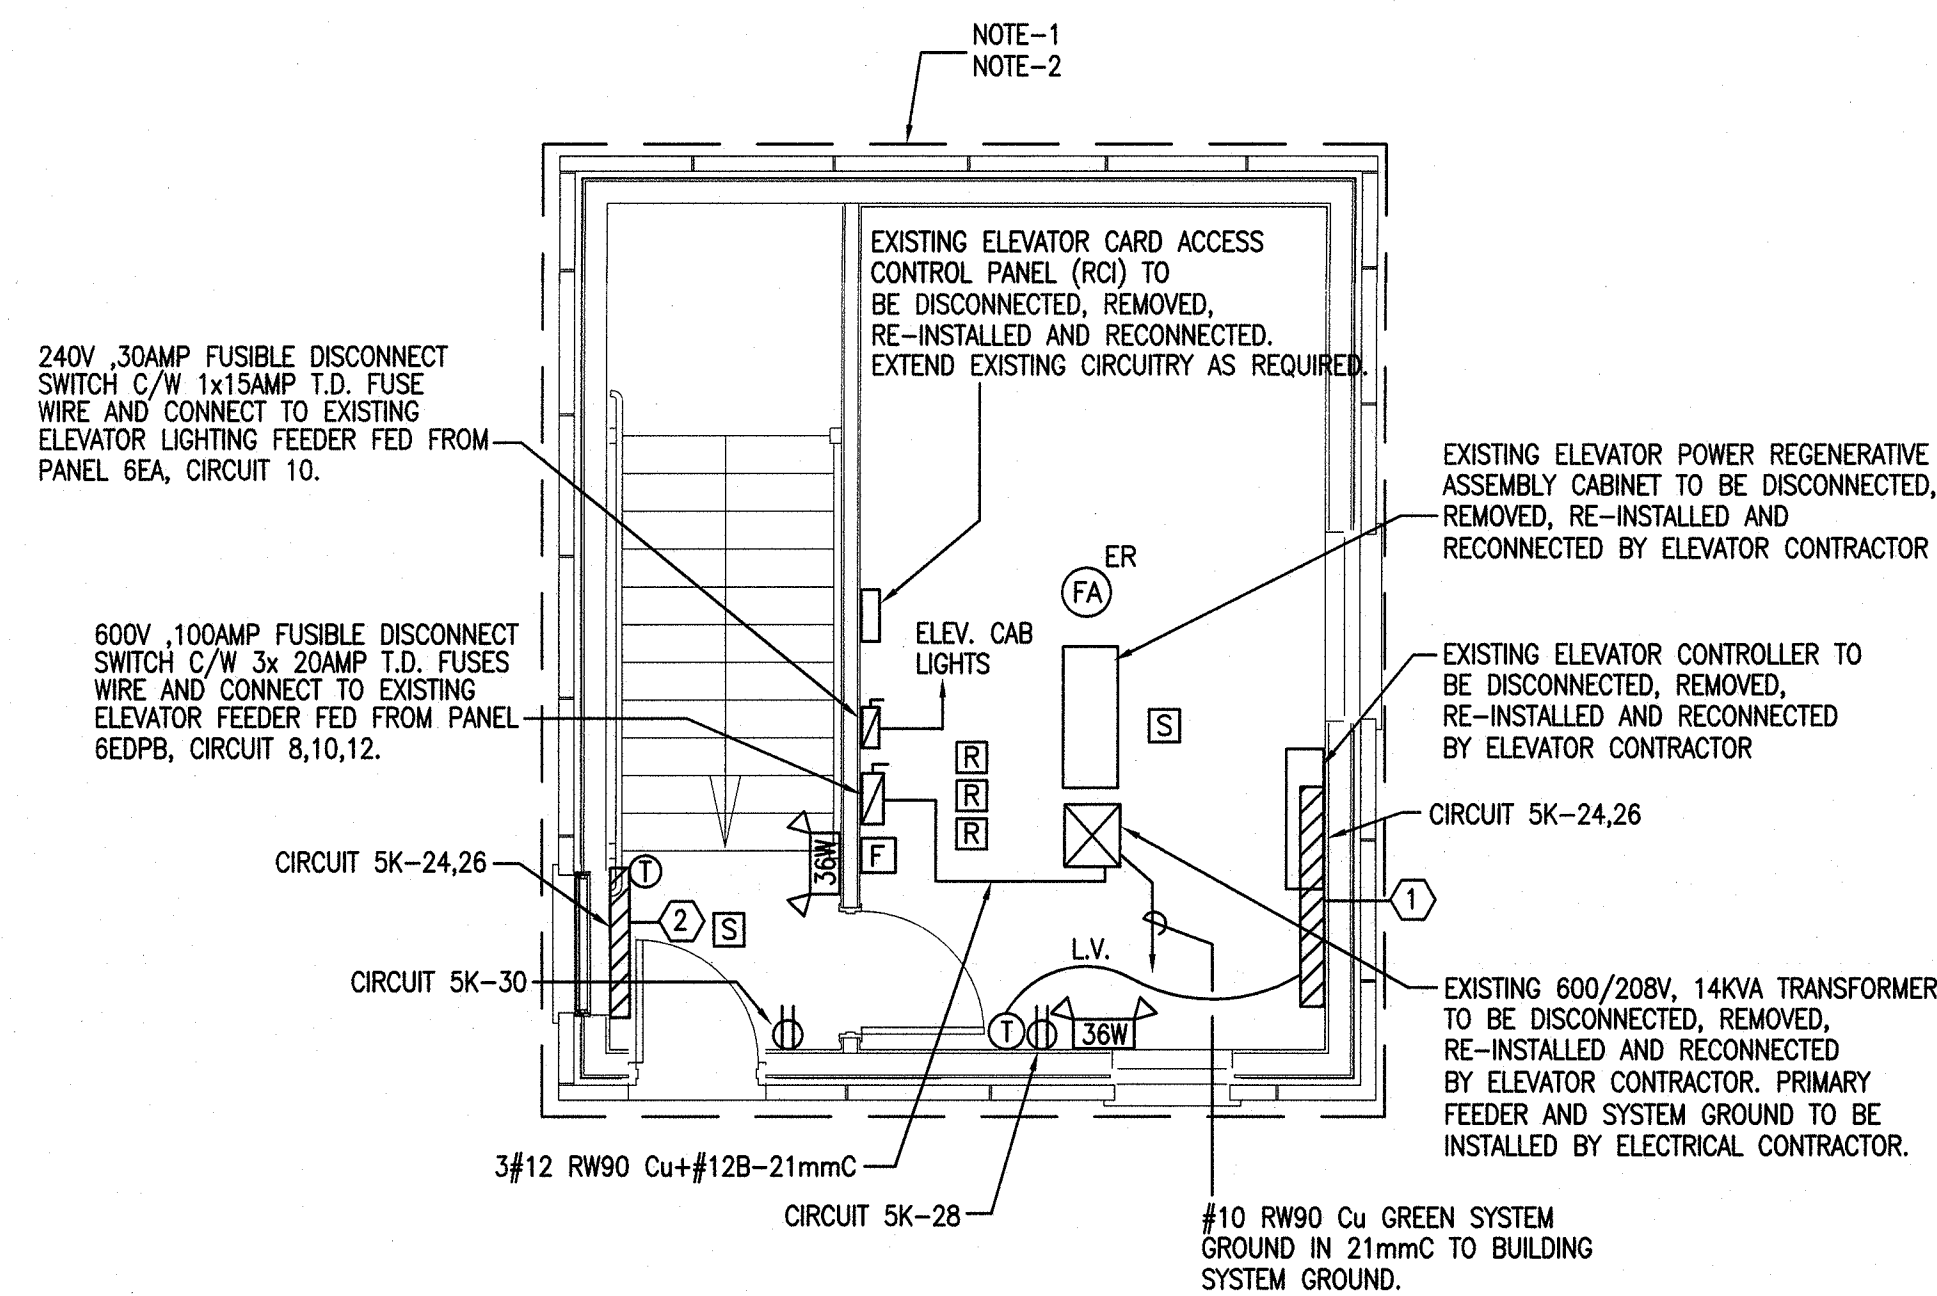

NOTE-1:
DISCONNECT AND REMOVE ALL EXISTING ELECTRICAL EQUIPMENT WITHIN
THE DASHED AREA (IE: DEVICES, DISC SWITCHES, CONDUIT, WIRE,
BOXES, CONTROLS, ETC) UNLESS NOTED OTHERWISE. ENSURE ALL
SERVICES TO REMAIN STAY ENERGIZED.

NOTE--2:
ALL EXISTING ELECTRICAL SERVICES WHICH ARE TO BE RE-USED
TO FEED EQUIPMENT IN NEW PENTHOUSE CONSTRUCTION SHALL BE
PROPERLY PROTECTED AND COILED UP IN CEILING SPACE BELOW
AS REQUIRED. VERIFY EXISTING EQUIPMENT ON SITE PRIOR TO CLOSE
OF TENDER.


1 PENTHOUSE P1 LAYOUT – POWER AND SYSTEMS
E102 SCALE 1:50

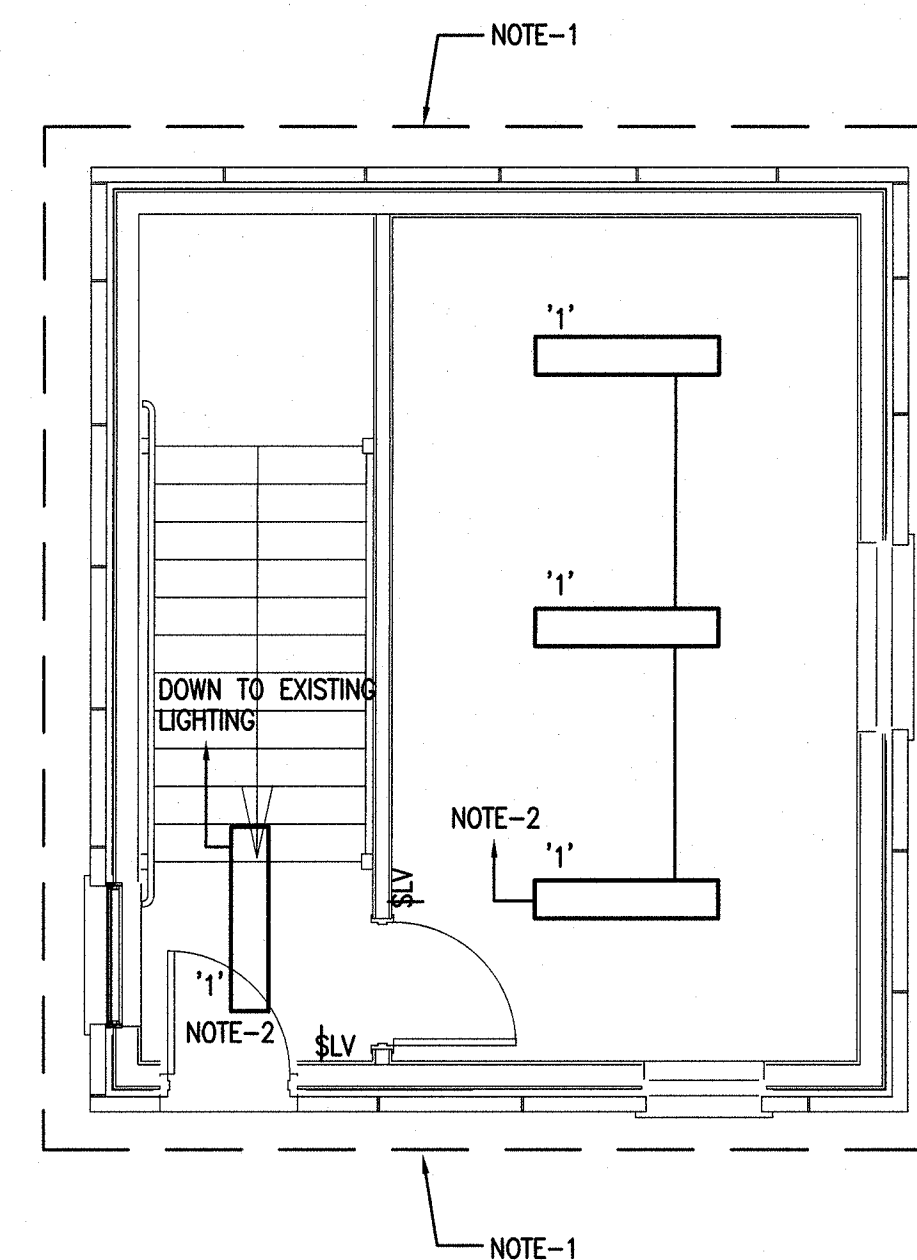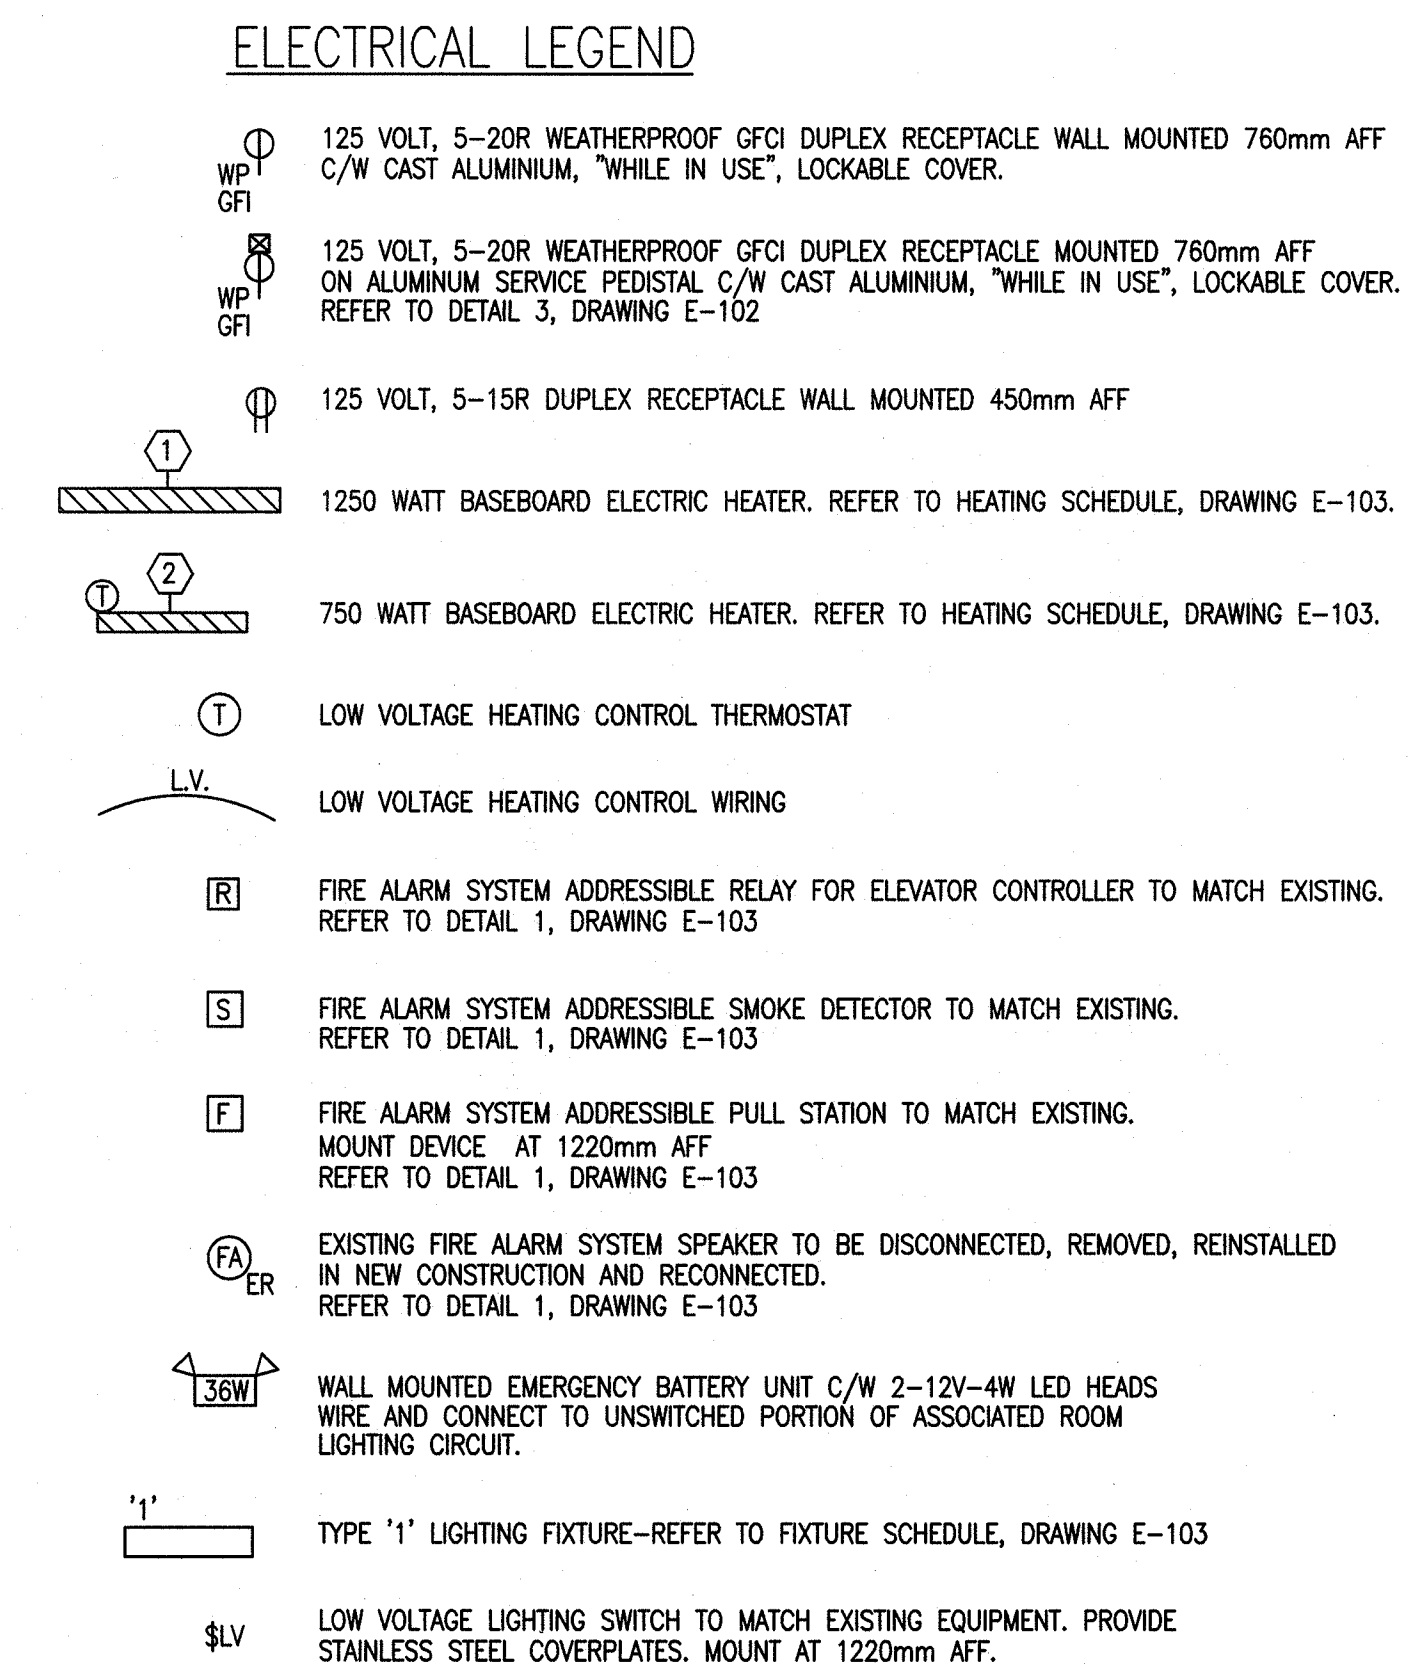


NOTE-1:
DISCONNECT AND REMOVE EXISTING LIGHTING EQUIPMENT WITHIN
THE DASHED AREA. REMOVE ALL ASSOCIATED REDUNDANT BOXES,
CONDUIT, WIRE, CONTROLS, ETC UNLESS OTHERWISE NOTED.

NOTE-2:
WIRE AND CONNECT NEW LIGHTING FIXTURES TO EXISTING LIGHTING
CIRCUIT AND RELAY CONTROL PANEL. EXTEND EXISTING CIRCUITRY
AS REQUIRED. SUPPLY AND INSTALL NEW LOCAL LOW VOLTAGE
CONTROL TO MATCH EXISTING. VERIFY EXISTING EQUIPMENT ON
SITE PRIOR TO CLOSE OF TENDER.

2 PENTHOUSE P1 LAYOUT – LIGHTING
E102 SCALE 1:50

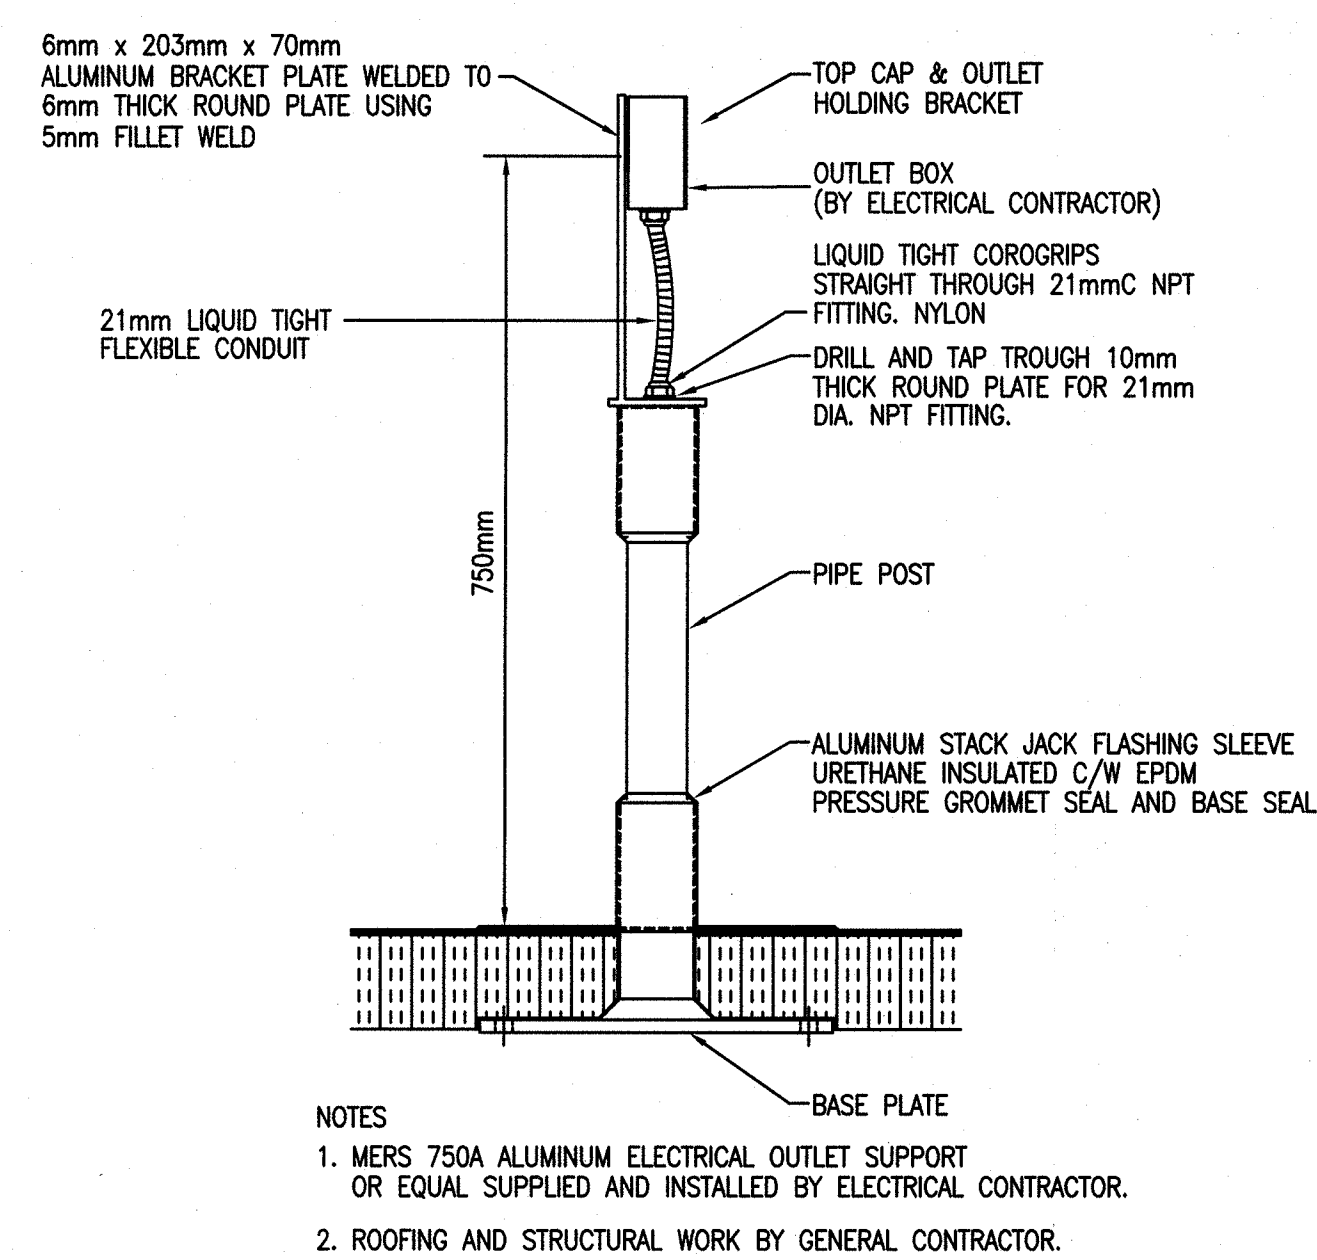

3 ROOF MOUNTED SERVICE RECEPTACLE DETAIL
E102 NOT TO SCALE

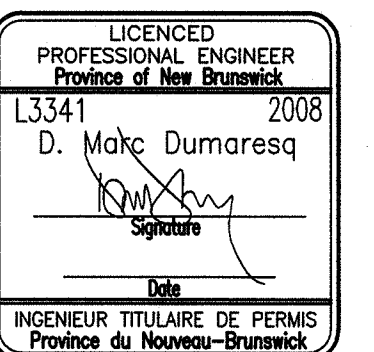

E	ISSUED FOR TENDER	MAR 19 2015
D	ADDITIONAL 99% REVIEW	FEB 16 2015
C	ISSUED FOR 99% REVIEW	JAN 16 2015
B	ISSUED FOR 66% REVIEW	NOV 03 2014
A	ISSUED FOR REVIEW	SEPT 30 2014
revisions		date

project	project
---------	---------

ROOF AND PENTHOUSE REHABILITATION

MONCTON GOCB
1081 MAIN STREET

drawing	dessin
---------	--------

PENTHOUSES P1 AND P3
FLOOR PLANS AND LEGEND
ELECTRICAL

designed EES	conçu
--------------	-------

date _____

drawn STAFF design

approved CL	approuvé
-------------	----------

date _____

2015/03/26

project number	no. du projet
----------------	---------------

R.063297.001

drawing no.	no. du dessin
5 102	

E-102

E-DRM/GDD-E: 490125