


TYPICAL CONCRETE SLAB AROUND TRANSFORMER FOOTING

SCALE: 1:20

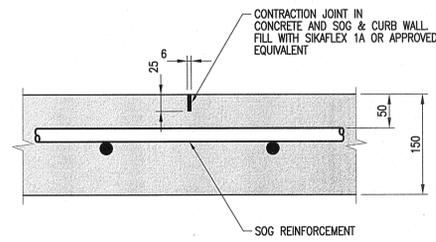


CONTRACTION JOINT

SCALE: 1:5


NOTES:

1. FOR GENERAL NOTES, SEE DWG. 32-18-282.
2. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS NOTED OTHERWISE.
3. JOINT SEALANT SHALL BE SIKAFLEX 1A BY SIKA CANADA OR APPROVED EQUIVALENT.
4. JOINT FILLER SHALL BE RODOFOAM GR GRADE BY STERNSON OR EQUIVALENT.
5. WATER STOP SHALL BE GREEN STEAK RIBBED WITH CENTER-BULB 961 PVC OR EQUIVALENT. FIELD JOINTS SHALL BE HEAT WELDED IN ACCORDANCE WITH MANUFACTURER'S PRINTED INSTRUCTIONS.
6. BACKFILL ON BOTH SIDES OF CONTAINMENT WALL SHALL BE CARRIED OUT SIMULTANEOUSLY. AT NO TIME SHALL THE BACKFILL ELEVATIONS ON EITHER SIDE OF WALL DIFFER BY 300mm.

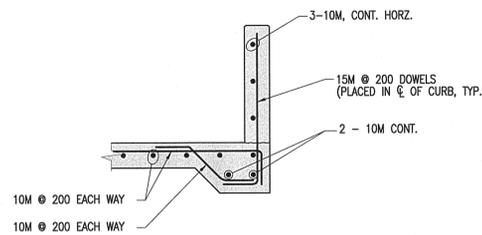


TYPICAL CONCRETE GRADE WALL

SCALE: 1:20

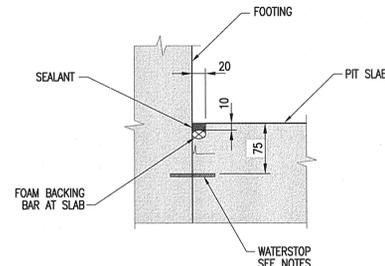


TYPICAL SEALANT DETAIL

SCALE: 1:5

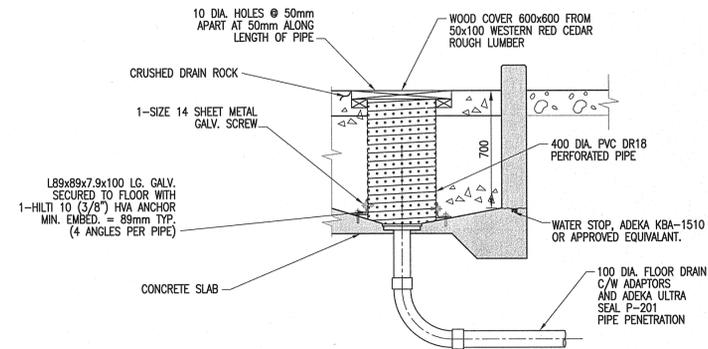


CONCRETE GRADE WALL AT DRAINAGE CORNER

SCALE: 1:20

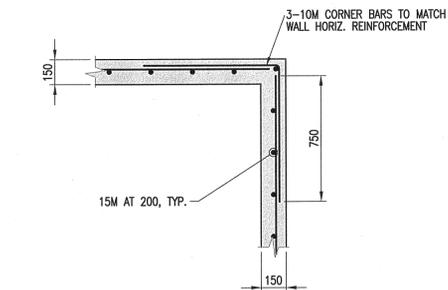


TYPICAL CONCRETE GRADE WALL CORNER REINFORCEMENT

SCALE: 1:20

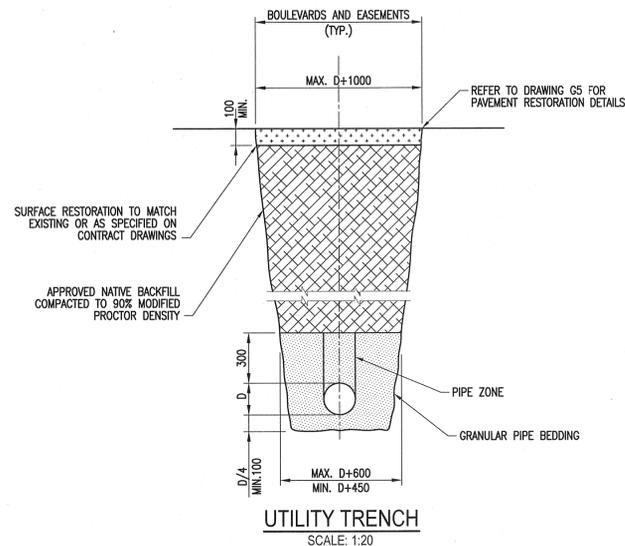

UTILITY TRENCH

SCALE: 1:20



PRELIMINARY

ISSUED FOR TENDER ONLY

PROFESSIONAL ENGINEER
M. MOUSAVI-JARRAH
33415
May 25, 15

Ausenco
PROJECT / DRAWING NO. 101101-02-0000-S-103

FISHERIES AND OCEANS CANADA
REAL PROPERTY AND TECHNICAL SUPPORT

CONUMA RIVER HATCHERY
CONTRACT NO. F1700-150694
138 KV SUBSTATION UPGRADE
OIL CONTAINMENT SYSTEM
DETAILS

SCALE AS SHOWN
DATE APRIL 2015
DRAWING NUMBER 32-18-286
REVISION 0

DWG. NO.	DRAWING REFERENCES	NOTES	NO.	DATE	REVISIONS	DESIGNED M. MOUSAVI	DRAWN K. LIN	CHECKED	RECOMMENDED	APPROVED J. LOPEZ
			0	MAY 25/2015	ISSUED FOR TENDER					