
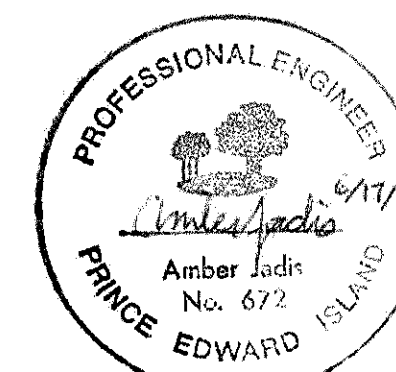


GENERAL NOTES

- SUPPLY AND INSTALL 28 NEW FLOOR TILE BOXES C/W COMMUNICATIONS OUTLETS AND DUPLEX RECEPTACLES IN RENOVATION ZONE C AS INDICATED. FLOOR TILE BOXES MAY BE PURCHASED FROM BROOKFIELD.
- ALL OBSOLETE CONDUIT, CABLING AND ASSOCIATED ELECTRICAL IS TO BE DISCONNECTED AND REMOVED BACK TO SOURCE.
- EXISTING FLOOR PLANS ARE ISSUED FOR INFORMATION AND SHOW MAJOR ITEMS ONLY. CONTRACTOR IS TO EXAMINE ALL ELECTRICAL, MECHANICAL AND ARCHITECTURAL DRAWINGS, VISIT THE SITE TO VERIFY EXISTING EQUIPMENT AND CONDITIONS AND SCOPE OF WORK PRIOR TO SUBMITTING A TENDER PRICE. EXTRAS WILL NOT BE CONSIDERED BECAUSE ACTUAL CONDITIONS DIFFER FROM DRAWINGS AND ALL COSTS RELATED TO EXISTING SITE CONDITIONS MUST BE INCLUDED IN TENDER PRICE.
- BRANCH CIRCUIT WIRING TO BE SIZED FOR A MAXIMUM VOLTAGE DROP OF 3% IN ACCORDANCE WITH THE CEC.
- ALL CABLING INSTALLED IN ACCESSIBLE FLOOR PLENUM SPACE TO BE PLENUM RATED.
- ALL EXPOSED CONDUIT IS TO BE PAINTED TO MATCH COLOR OF ADJACENT SURFACE.
- COORDINATE DRILLING INTO EXISTING CONCRETE CEILING WITH GENERAL CONTRACTOR TO ENSURE EXISTING RADIANT HEATING SYSTEMS ARE NOT DAMAGED.

NOTES

- DISCONNECT AND REMOVE ACCESS CONTROL DEVICES AS INDICATED INCLUDING ALL ASSOCIATED CONDUIT AND WIRING BACK TO SOURCE. TURN OVER REMOVED ACCESS CONTROL DEVICES TO DEPARTMENTAL REPRESENTATIVE.

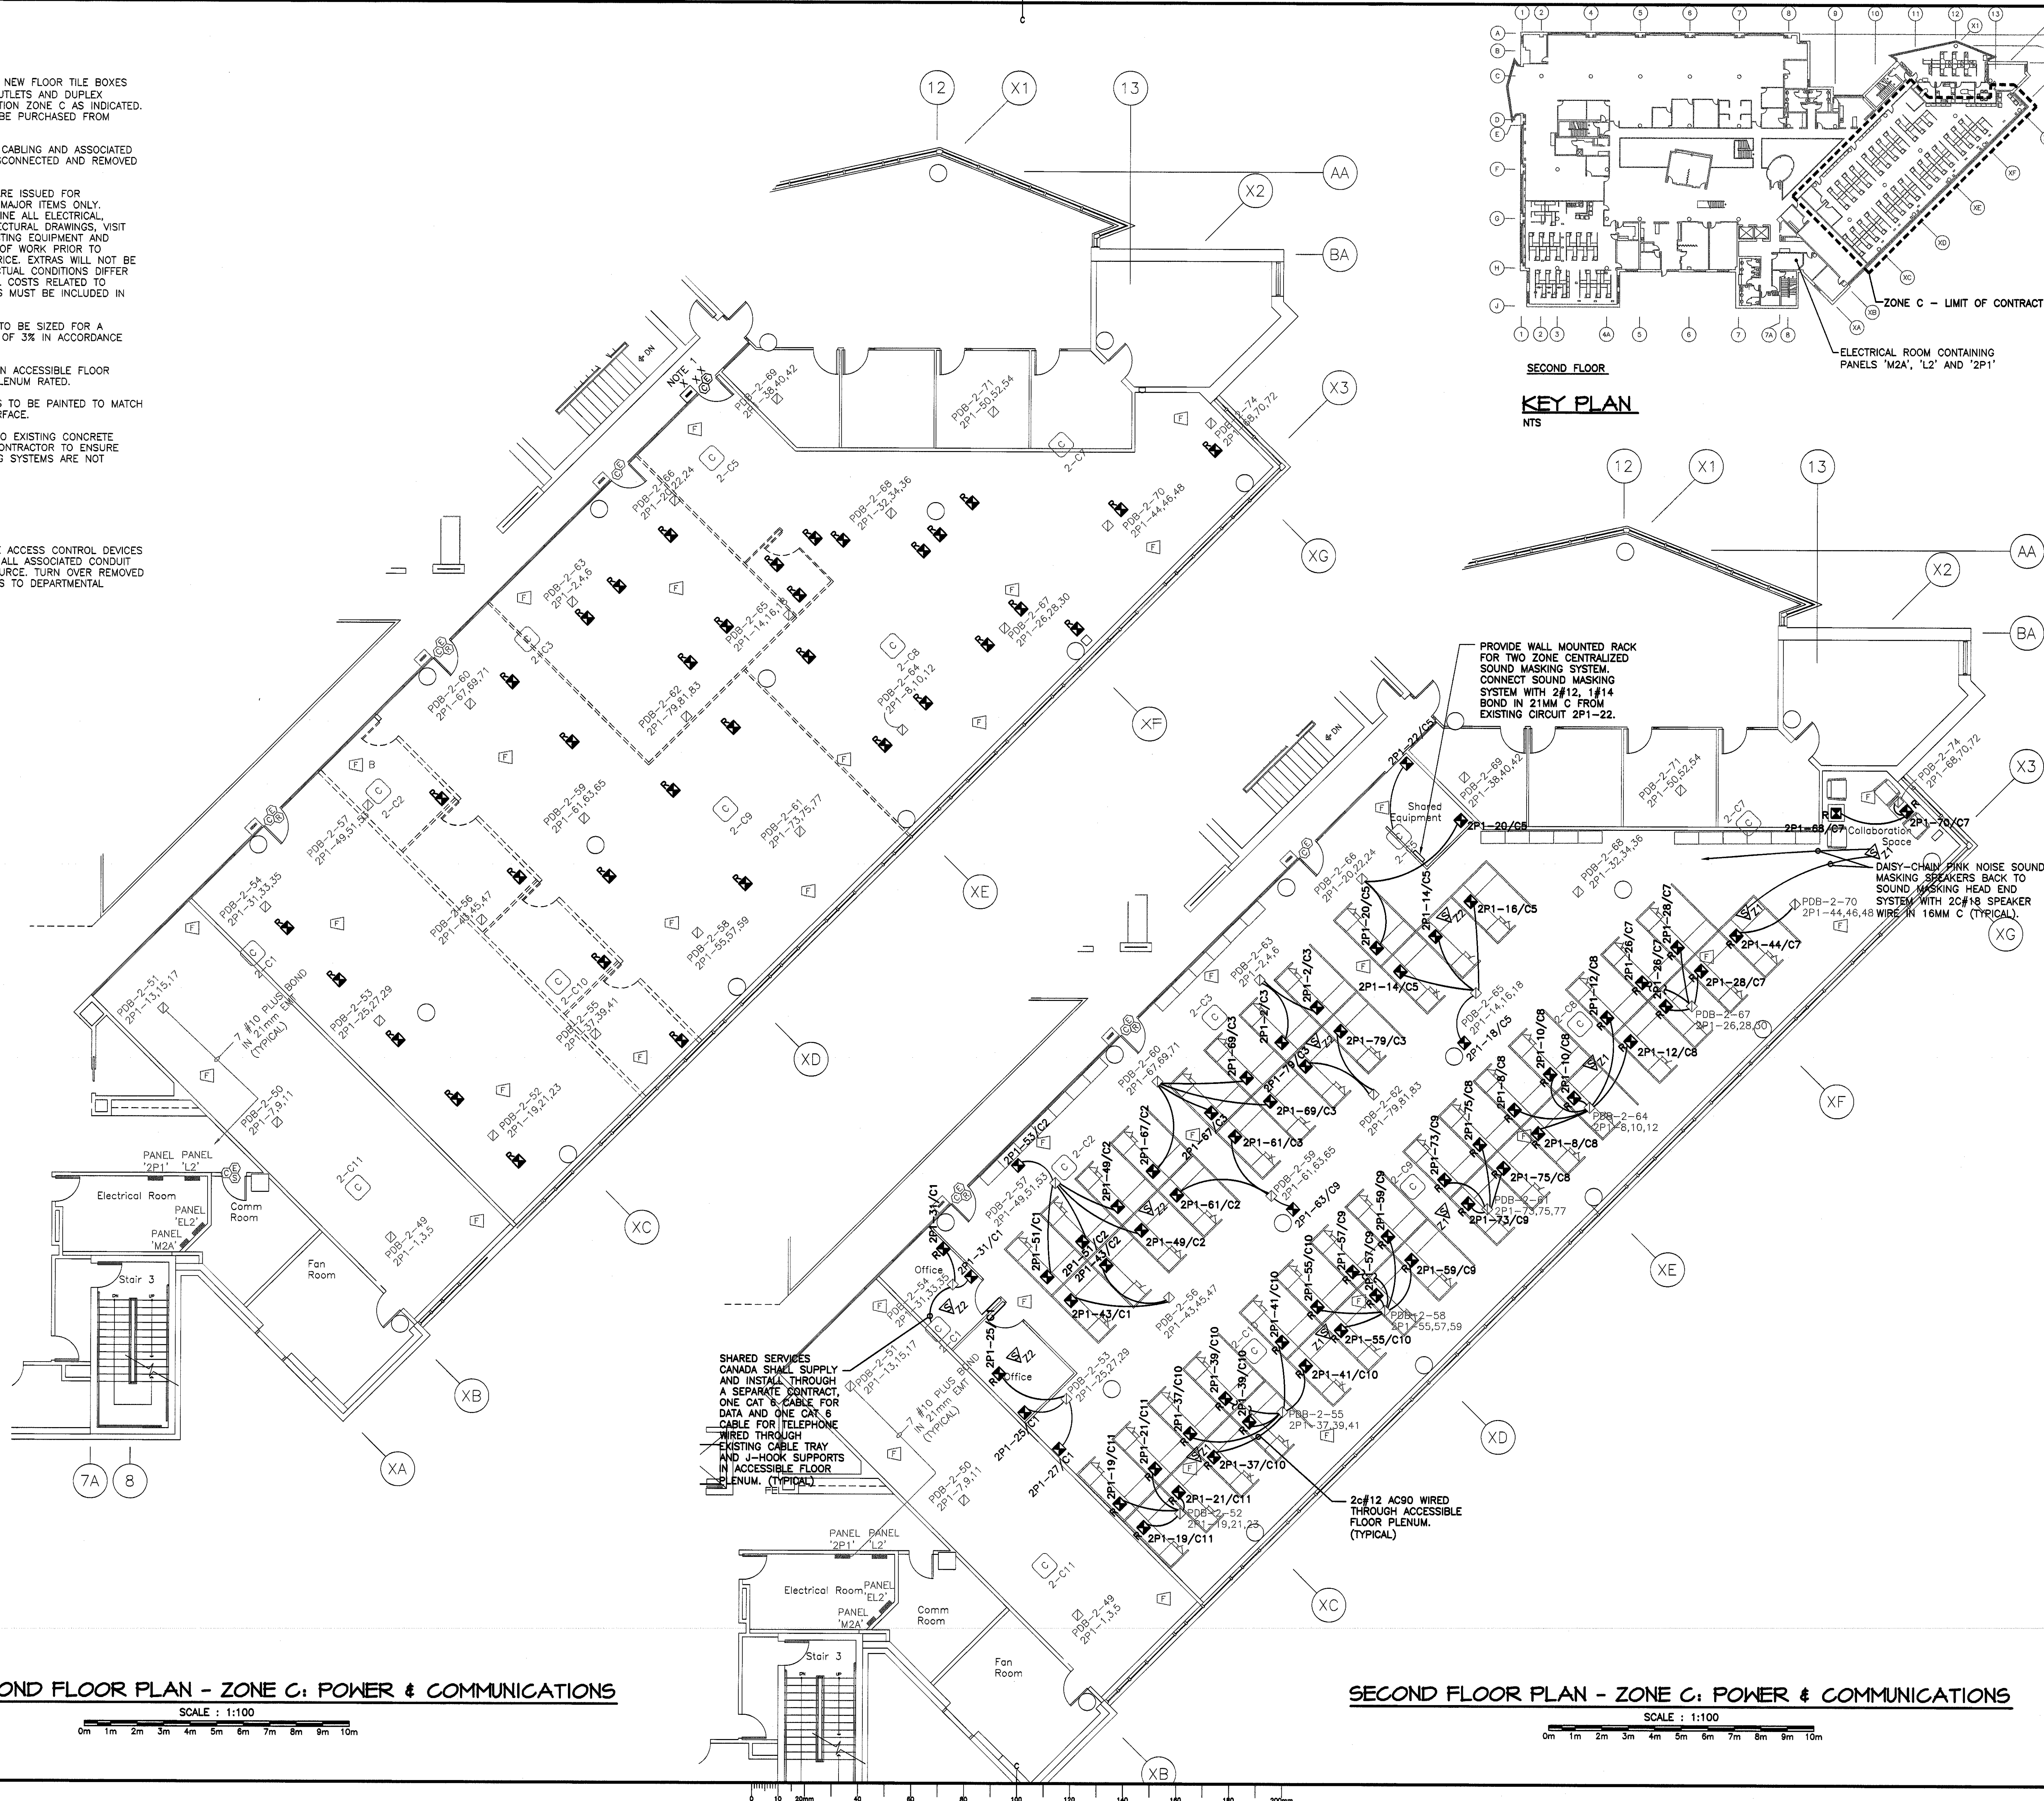

0	ISSUED FOR TENDER	June 17, 2015
revisions		date

project
**ESDC CONSOLIDATION
FIT-UP
JEAN CANFIELD
BUILDING
CHARLOTTETOWN, PEI**

drawing
**SECOND FLOOR PLAN
ZONE C
ELECTRICAL
POWER &
COMMUNICATIONS**

designed
E.S.C. P.ENG / A.D.J., P.ENG
2015-03-04

drawn
M.E.M., C.E.T.
2015-03-04

approved
Tender

date
PWSC Project Manager Administrateur de projets TPSGC
no. du projet

R.061033.001

drawing no.
E3 OF 4