




1 DETAIL — FIRE DAMPER INSTALLATION (TYP.)
SCALE : N.T.S.

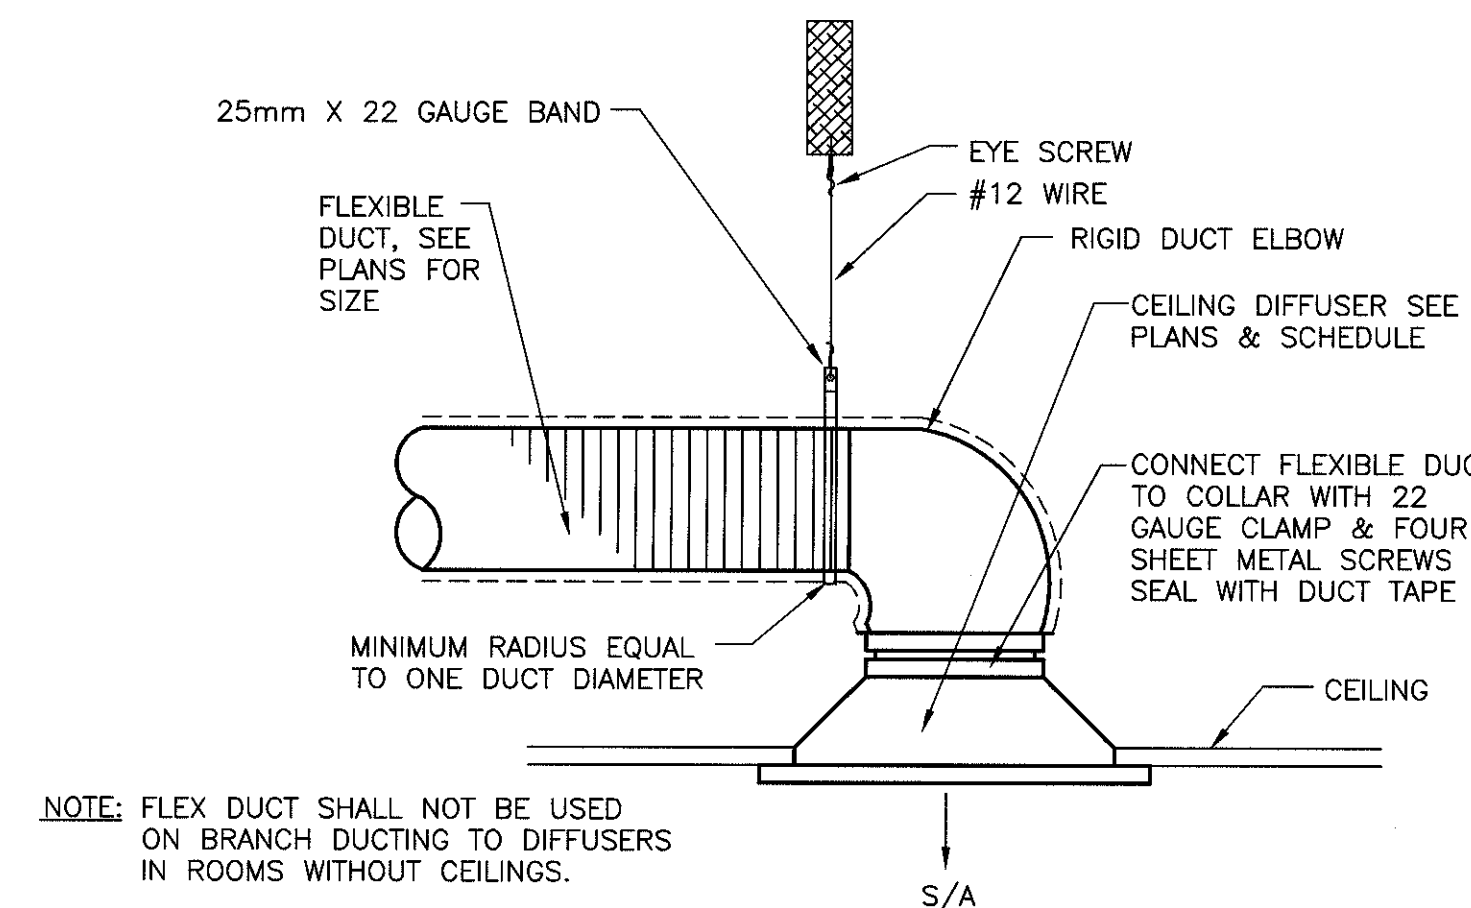


2 DETAIL — TYPICAL DIFFUSER
SCALE : N.T.S.

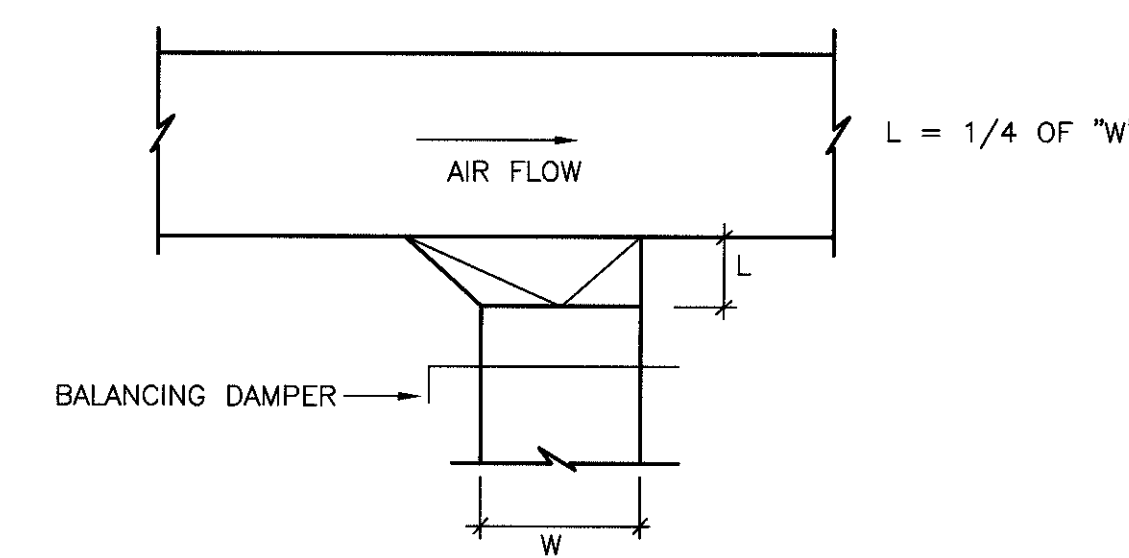


3 DETAIL — TYP. TAKE-OFF BOOT ON SUPPLY TO DIFFUSER
SCALE : N.T.S.

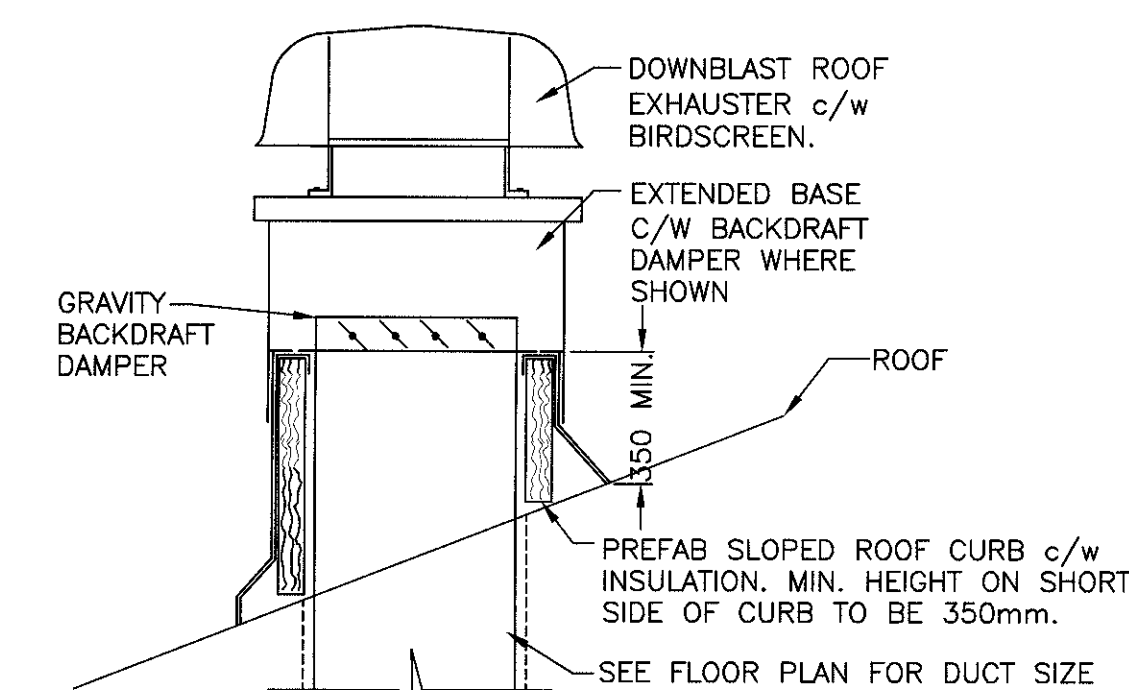


4 DETAIL — ROOF MOUNTED EXHAUST FAN
SCALE : N.T.S.
1. PROVIDE DISCONNECT SWITCH AT FAN.
2. PROVIDE SLOPED ROOF CURB WHERE REQUIRED, MIN. 350mm HIGH ON SHORT SLOPE. CURB TO MATCH COLOUR OF SIDING.
3. 350mm HIGH ON SHORT SLOPE. CURB TO MATCH COLOUR OF SIDING.
4. REFER TO ARCHITECTURAL DRAWINGS FOR ROOFING DETAILS.

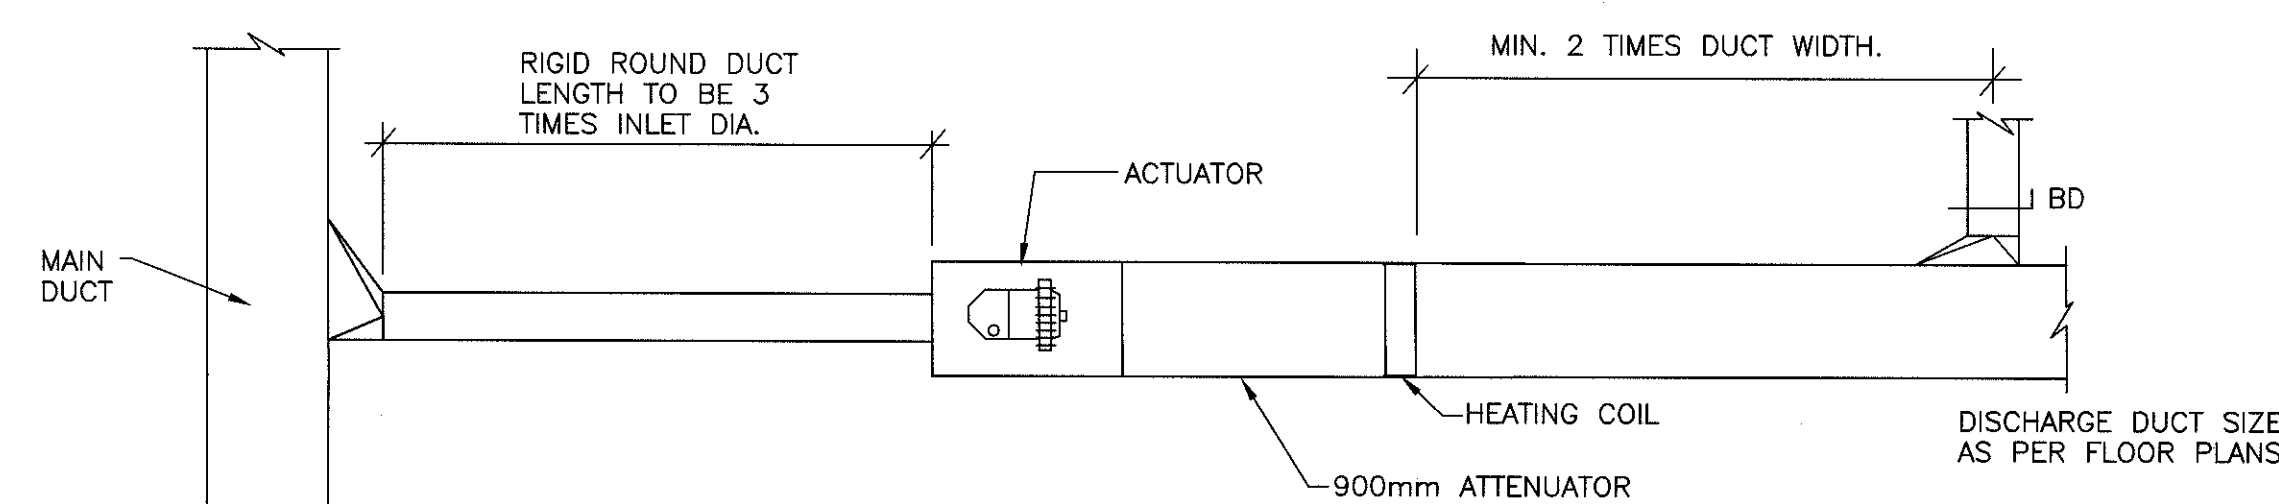


5 DETAIL — TYPICAL VAV TERMINAL UNIT CONNECTION
SCALE : N.T.S.

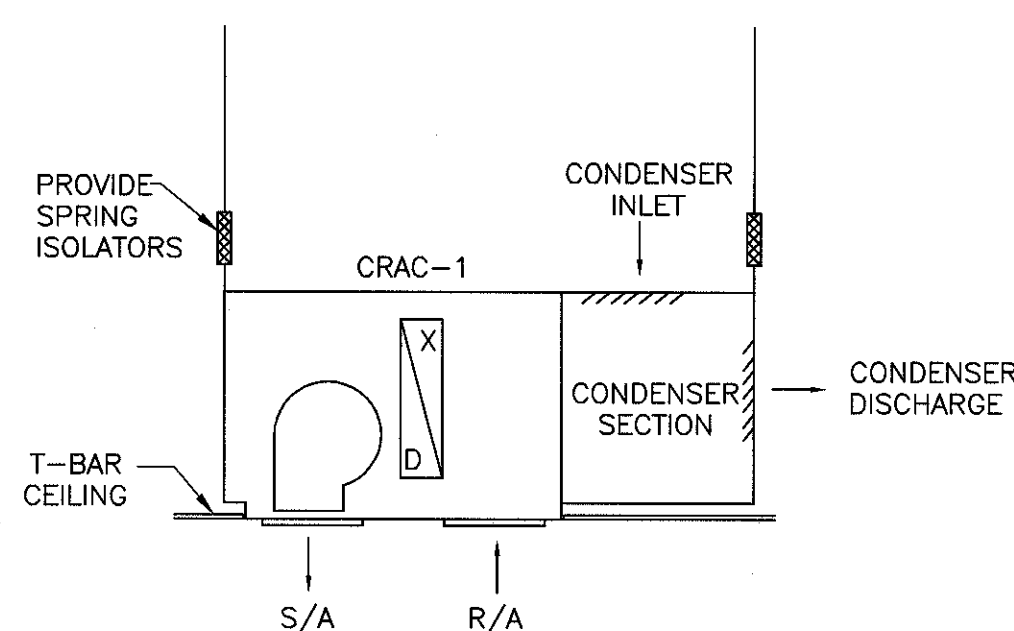

8 DETAIL — COMPUTER ROOM A/C UNIT
SCALE : N.T.S.

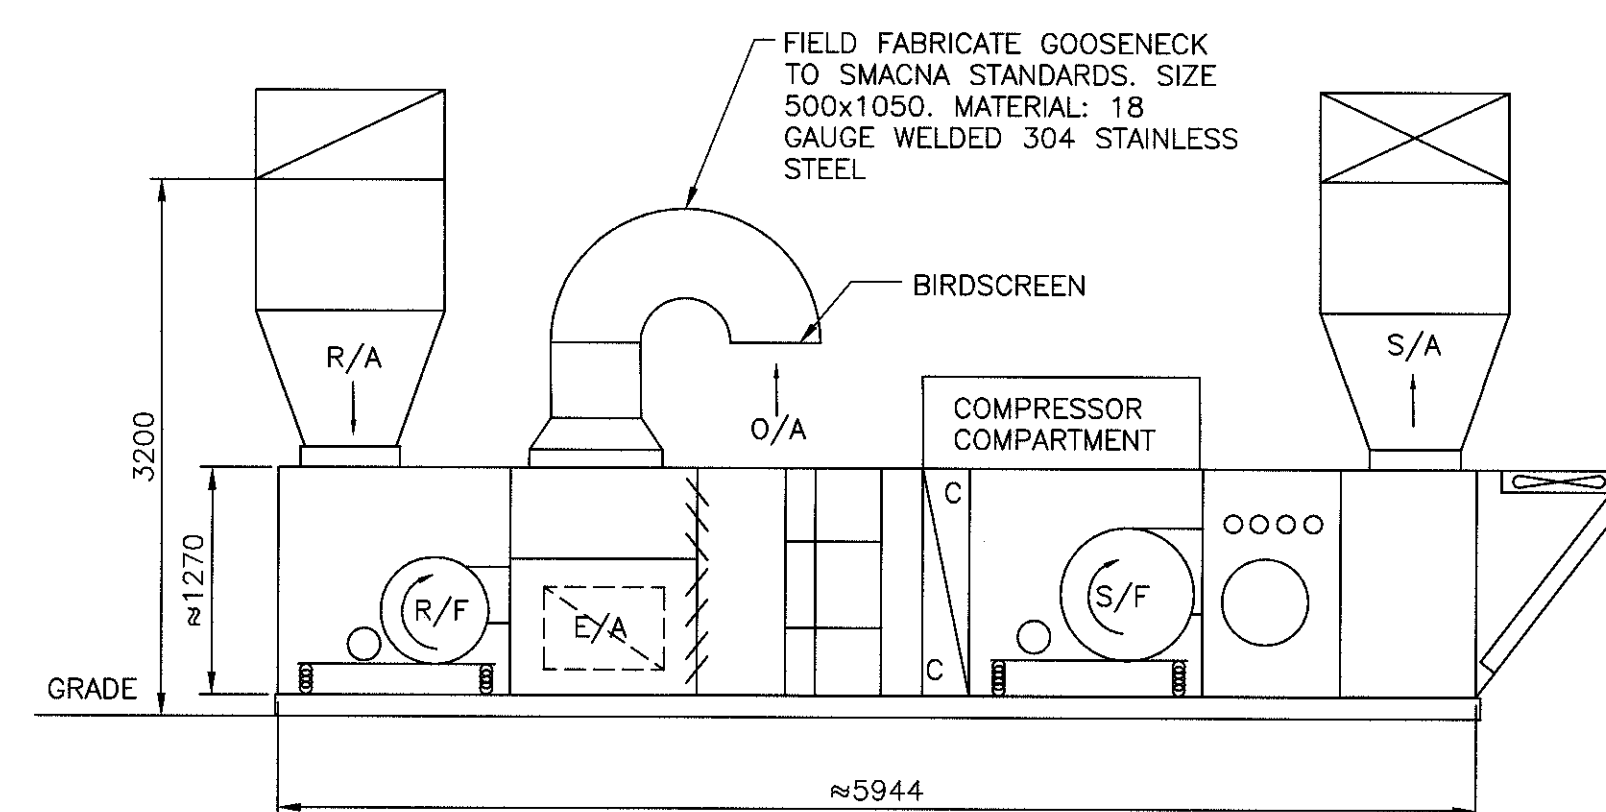


ELEVATION

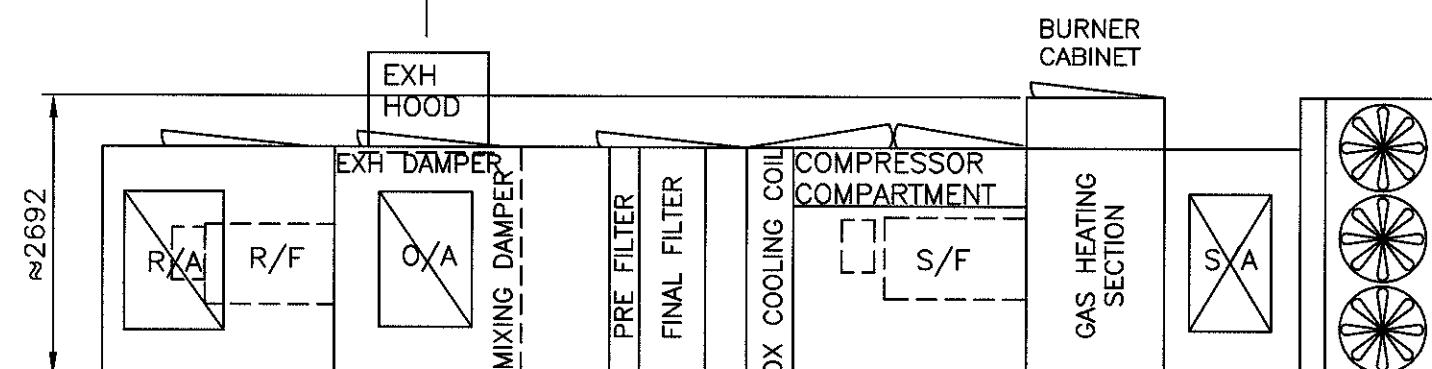

PLAN VIEW

6 DETAIL — AIR HANDLING UNIT AHU-1
SCALE : N.T.S.

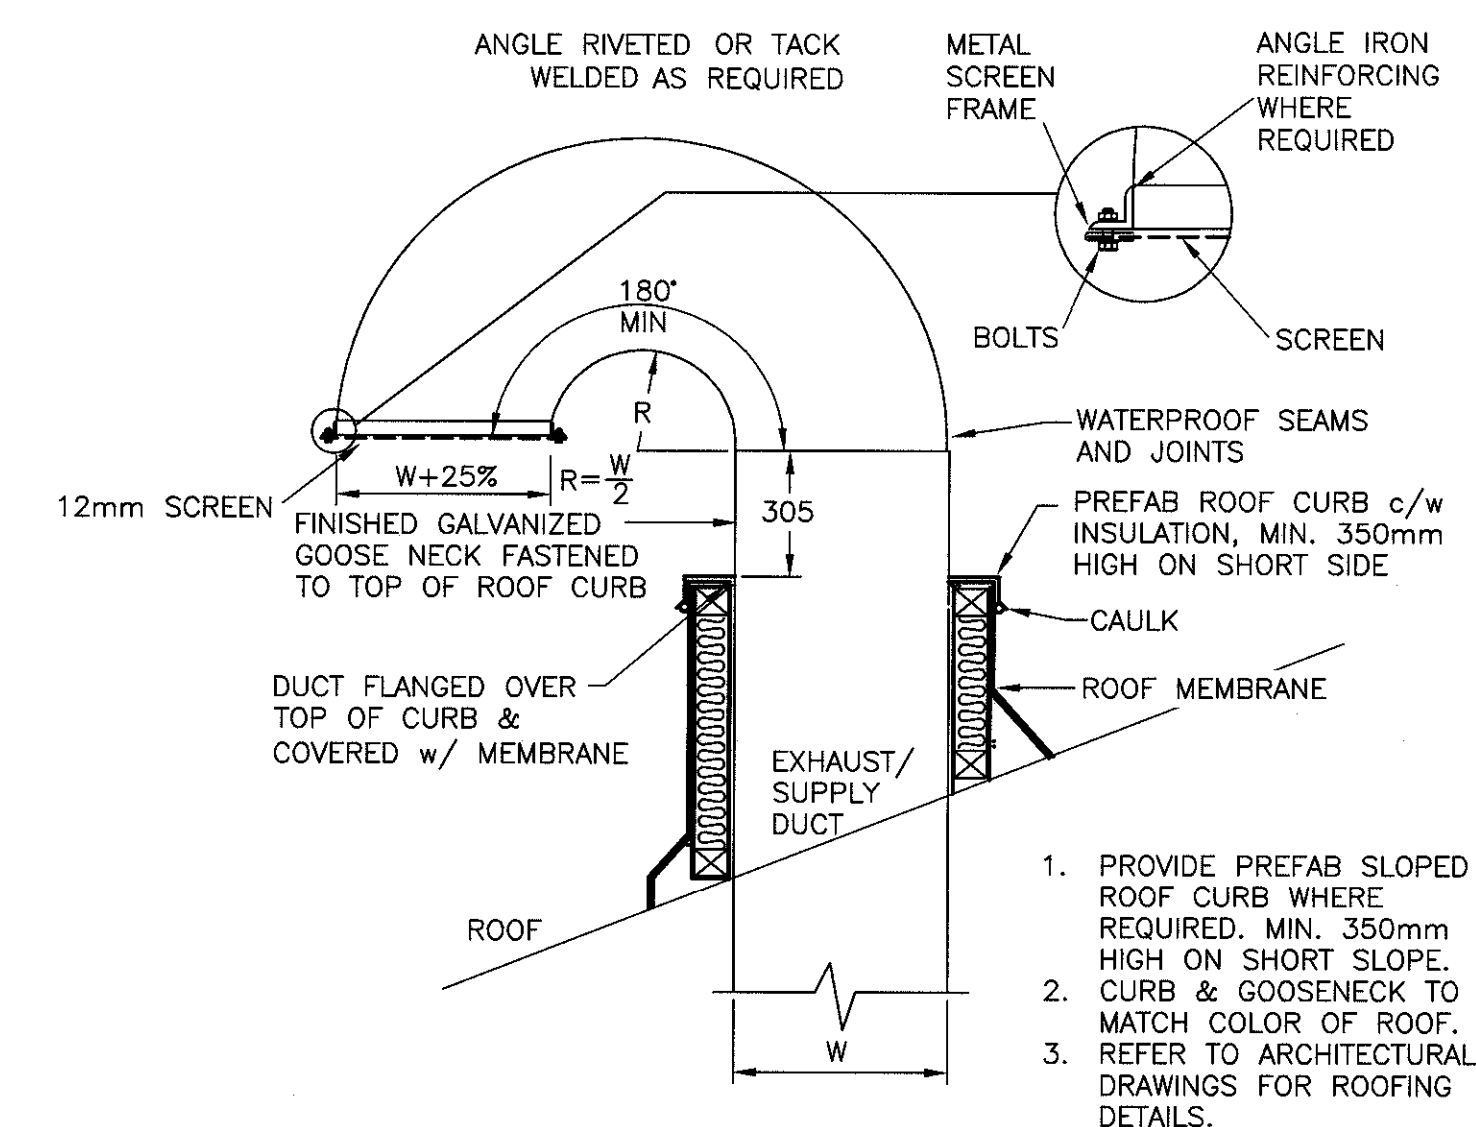

7 DETAIL — RECTANGULAR GOOSENECK
SCALE : N.T.S.

1	ISSUED FOR TENDER	JUN. 4 2015
revisions		date
project	ARGO BUILDING BEDFORD INSTITUTE OF OCEANOGRAPHY DARTMOUTH, NS	project

drawing	VENTILATION DETAILS	dessin
designed	CR	conçu
date	FEBRUARY 2015	
drawn	MEH	dessiné
date	FEBRUARY 2015	
approved		approuvé
date		
Tender	NS	Soumission
PWSC Project Manager	Administrateur de projets TPSGC	
project number	R.069793.001	no. du projet
drawing no.	H303	no. du dessin

