



LEGEND

- EXISTING PIPING/EQUIPMENT
- - - PIPING/EQUIPMENT TO BE DEMOLISHED
- CONTROL WIRE TO BE DEMOLISHED
- CH(S) CONDENSER WATER SUPPLY
- CH(R) CONDENSER WATER RETURN
- CHWS CHILLED WATER SUPPLY
- CHWR CHILLED WATER RETURN
- TP xx TIE-IN POINT

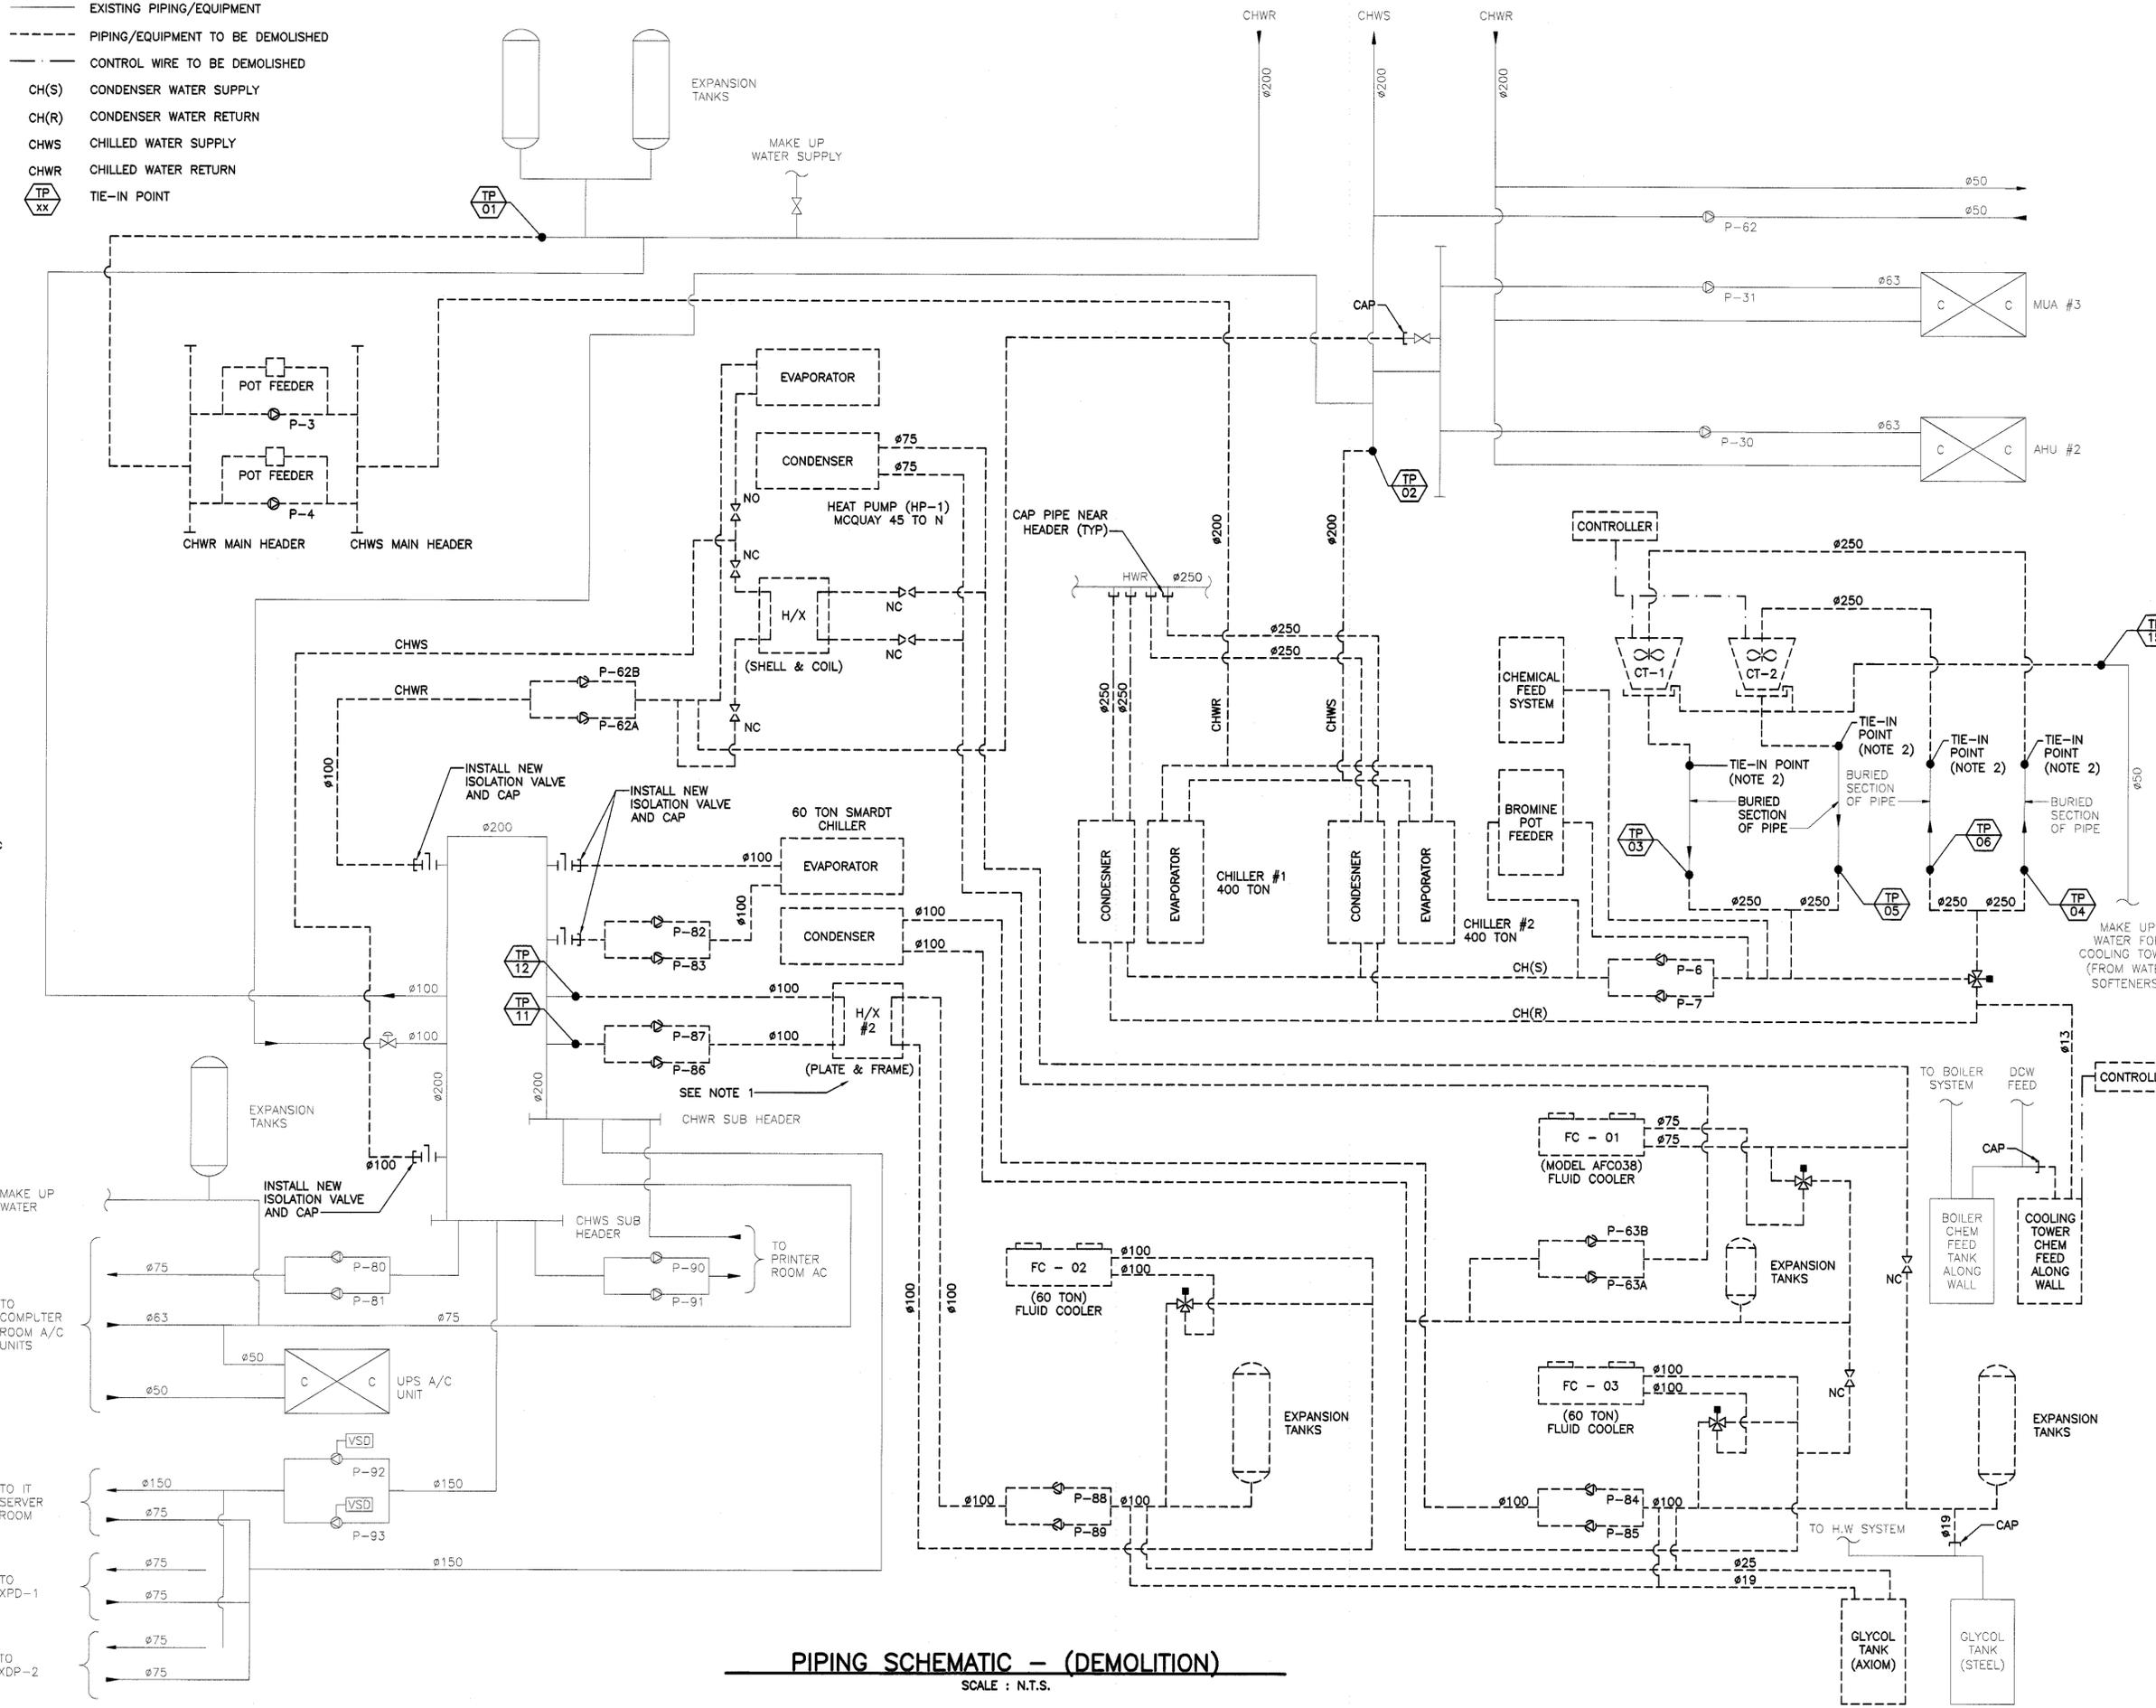

PIPING SCHEMATIC — (DEMOLITION)
SCALE : N.T.S.

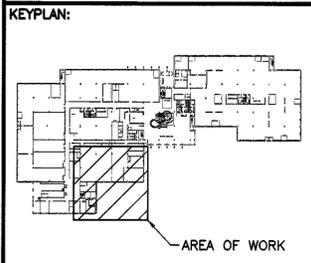

- NOTES**
- H/X#2 TO BE HANDED OVER TO PWGSC AFTER REMOVAL.
 - SEE CIVIL DRAWING C-1 FOR TIE-IN POINTS OF BURIED CONDENSER WATER PIPING.

The Association of Professional Engineers of the Province of Prince Edward Island
VALID FOR THE YEAR 2015

E.N. Tobin
No. 1293
DATE: June 18, 2015
LICENSED PROFESSIONAL ENGINEER
PROVINCE OF PRINCE EDWARD ISLAND

revisions	date
P4	ISSUED FOR TENDER JUN 19 2015
P3	ISSUED FOR 100% REVIEW MAY 4 2015
P2	ISSUED FOR 99% REVIEW MAR 23 2015
P1	ISSUED FOR 66% REVIEW FEB 12 2015

A	A detail no. du detail	A
C	B location drawing no. sur dessin no.	B
	C drawing no. dessin no.	C

project **JOSEPH A GHIZ BUILDING CHILLER PLANT REPLACEMENT** project
SUMMERSIDE, PEI
drawing **MECHANICAL PIPING SCHEMATIC (DEMOLITION)** dessin

designed SF
date JAN, 2015 concou
drawn TC
date JAN, 2015 dessine
approved PM
date JAN, 2015 approuve

Tender RYAN MCGUIRE Submission
PWC Project Manager Administrateur de projets TPC
project number **R055258.001** no. du projet
drawing no. **M-5** no. du dessin

Plot Scale:

