






KEYPLAN:



AREA OF WORK




| | | |
|-----------|------------------------|-------------|
| P4 | ISSUED FOR TENDER | JUN 19 2015 |
| P3 | ISSUED FOR 100% REVIEW | MAY 4 2015 |
| P2 | ISSUED FOR 99% REVIEW | MAR 23 2015 |
| P1 | ISSUED FOR 66% REVIEW | FEB 12 2015 |
| revisions | | date |



project: JOSEPH A GHIZ BUILDING CHILLER PLANT REPLACEMENT
SUMMERSIDE, PEI


drawing: MECHANICAL DETAILS

| | |
|---------------------|-------------------------------|
| designed SF | conçu |
| date JAN, 2015 | |
| drawn TC | dessiné |
| date JAN, 2015 | |
| approved PM | approuvé |
| date JAN, 2015 | |
| Tender RYAN MCGUIRE | Submission |
| PWC Project Manager | Administrateur de projets TPC |
| project number | no. du projet |
| R055258.001 | |
| drawing no. | no. du dessin |
| M-9 | |

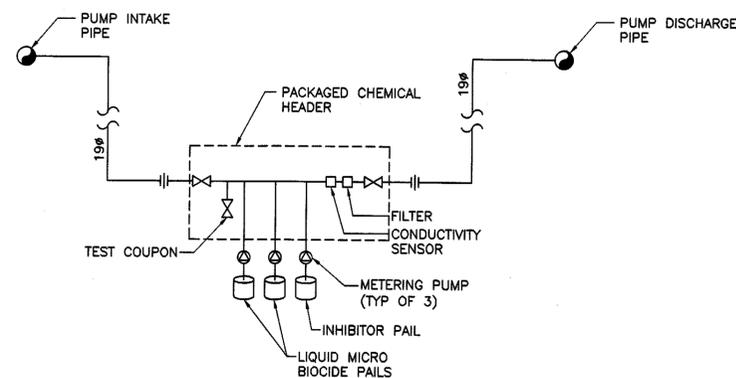


NOTE: WALL-MOUNTED - SEE PIPING PLAN DWG FOR LOCATION.


1 DETAIL- PACKAGED CHEMICAL HEADER
TYP. OF 3
SCALE: N.T.S.

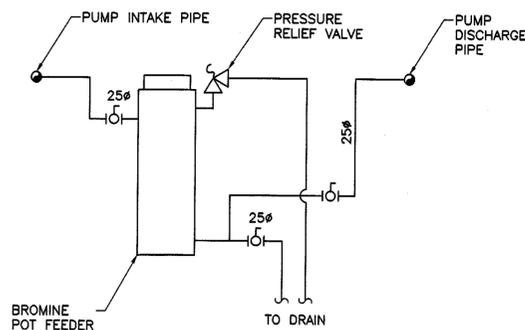


2 DETAIL- BROMINE POT FEEDER
TYPICAL FOR PUMP P-97, P-98, P-99
SCALE: N.T.S.

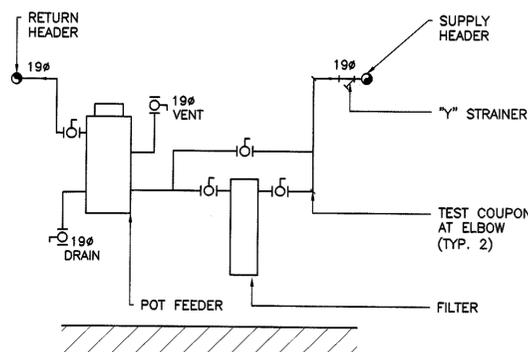

4 DETAIL- CHILLED WATER CHEMICAL TREATMENT POT FEEDER
TYPICAL FOR PUMP SETS: P3/P4, P62A/P62B, P82/P83
SCALE: N.T.S.

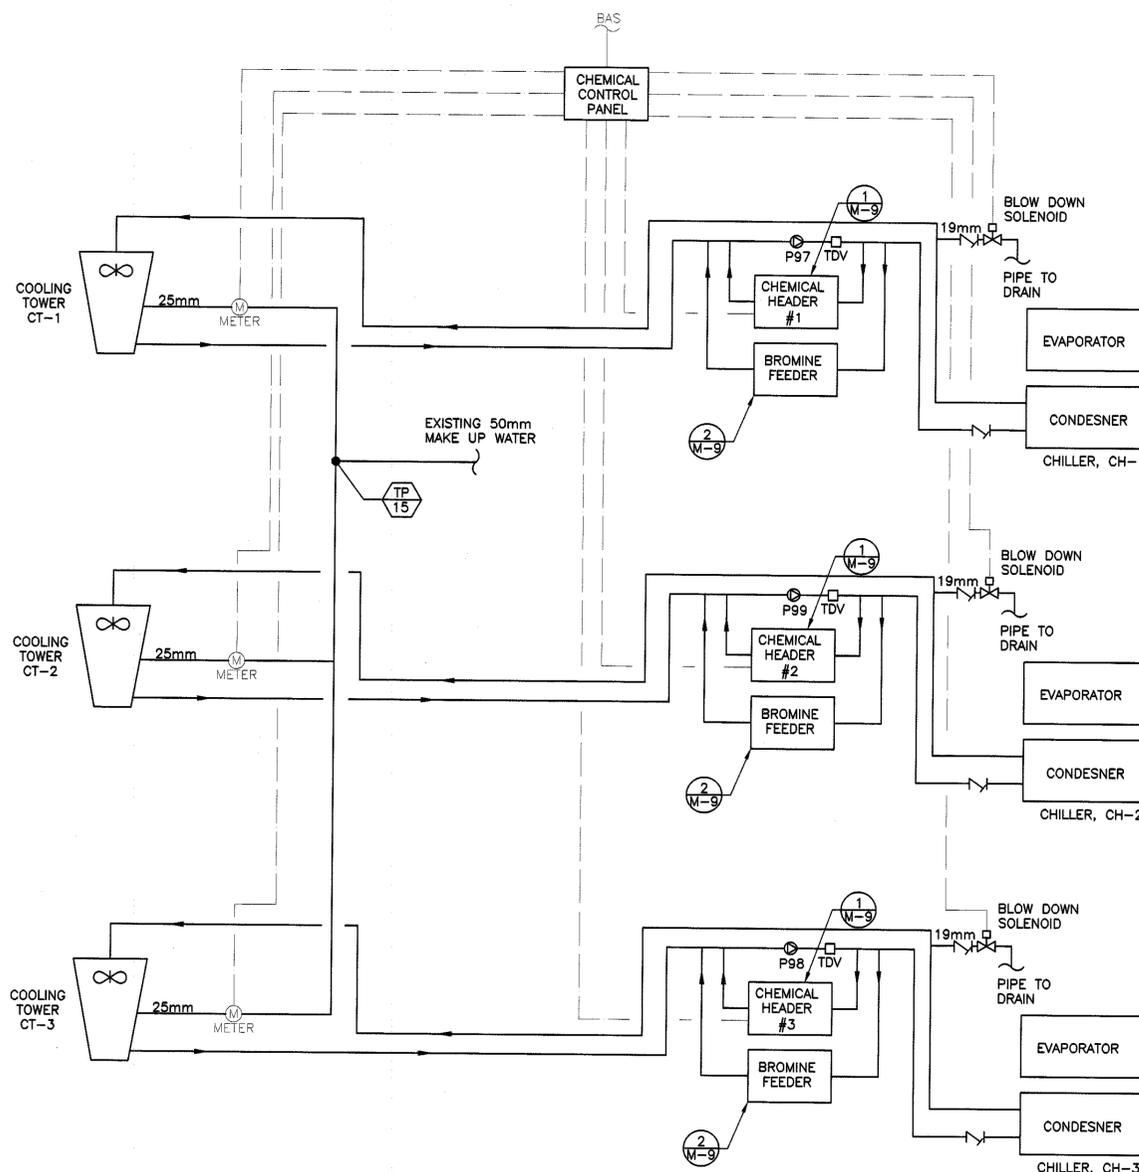

3 DETAIL- COOLING TOWER CHEMICAL TREATMENT SCHEMATIC
SCALE: N.T.S.

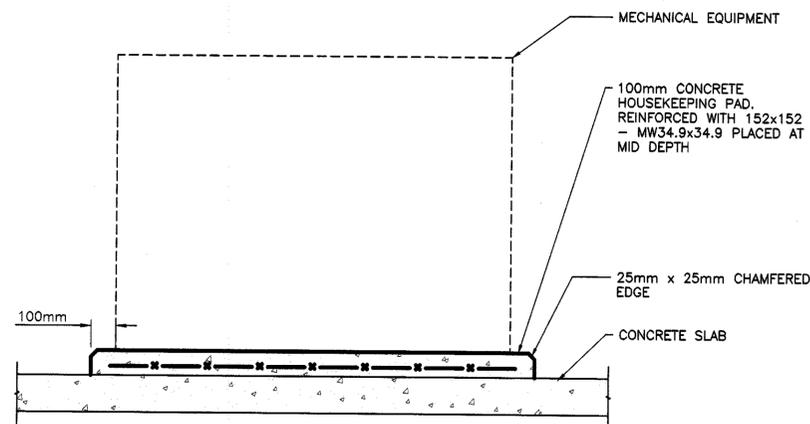

NOTE: CONCRETE TO CAN/CSA-A23.1-04 WITH F'c = 25 MPA AT 28 DAYS

5 DETAIL- HOUSEKEEPING PAD (TYPICAL)
SCALE: N.T.S.