


- NOTES
- SEE CIVIL DWG C-2 FOR TIE-IN POINTS OF BURIED CONDENSER WATER PIPING.
  - LOCK ACTUATOR OF CROSS OVER VALVE IN OPEN POSITION.

THE ASSOCIATION OF PROFESSIONAL ENGINEERS OF THE PROVINCE OF PRINCE EDWARD ISLAND  
 VALID FOR THE YEAR 2015  
 E.N. Tobin  
 No. 1293  
 DATE: June 18, 2015  
 LICENSED PROFESSIONAL ENGINEER  
 PROVINCE OF PRINCE EDWARD ISLAND


P4	ISSUED FOR TENDER	JUN 19 2015
P3	ISSUED FOR 100% REVIEW	MAY 4 2015
P2	ISSUED FOR 99% REVIEW	MAR 23 2015
P1	ISSUED FOR 66% REVIEW	FEB 12 2015
revisions		date



project projet  
**JOSEPH A GHIZ BUILDING CHILLER PLANT REPLACEMENT**  
 SUMMERSIDE, PEI

drawing dessin  
**MECHANICAL PIPING SCHEMATIC (NEW CONSTRUCTION)**

designed SF	concu
date JAN, 2015	
drawn TC	dessine
date JAN, 2015	
approved PM	approuve
date JAN, 2015	
Tender RYAN MCGUIRE	Soumission
PWC Project Manager	Administrateur de projets TPC
project number	no. du projet
<b>R055258.001</b>	
drawing no.	no. du dessin
<b>M-6</b>	

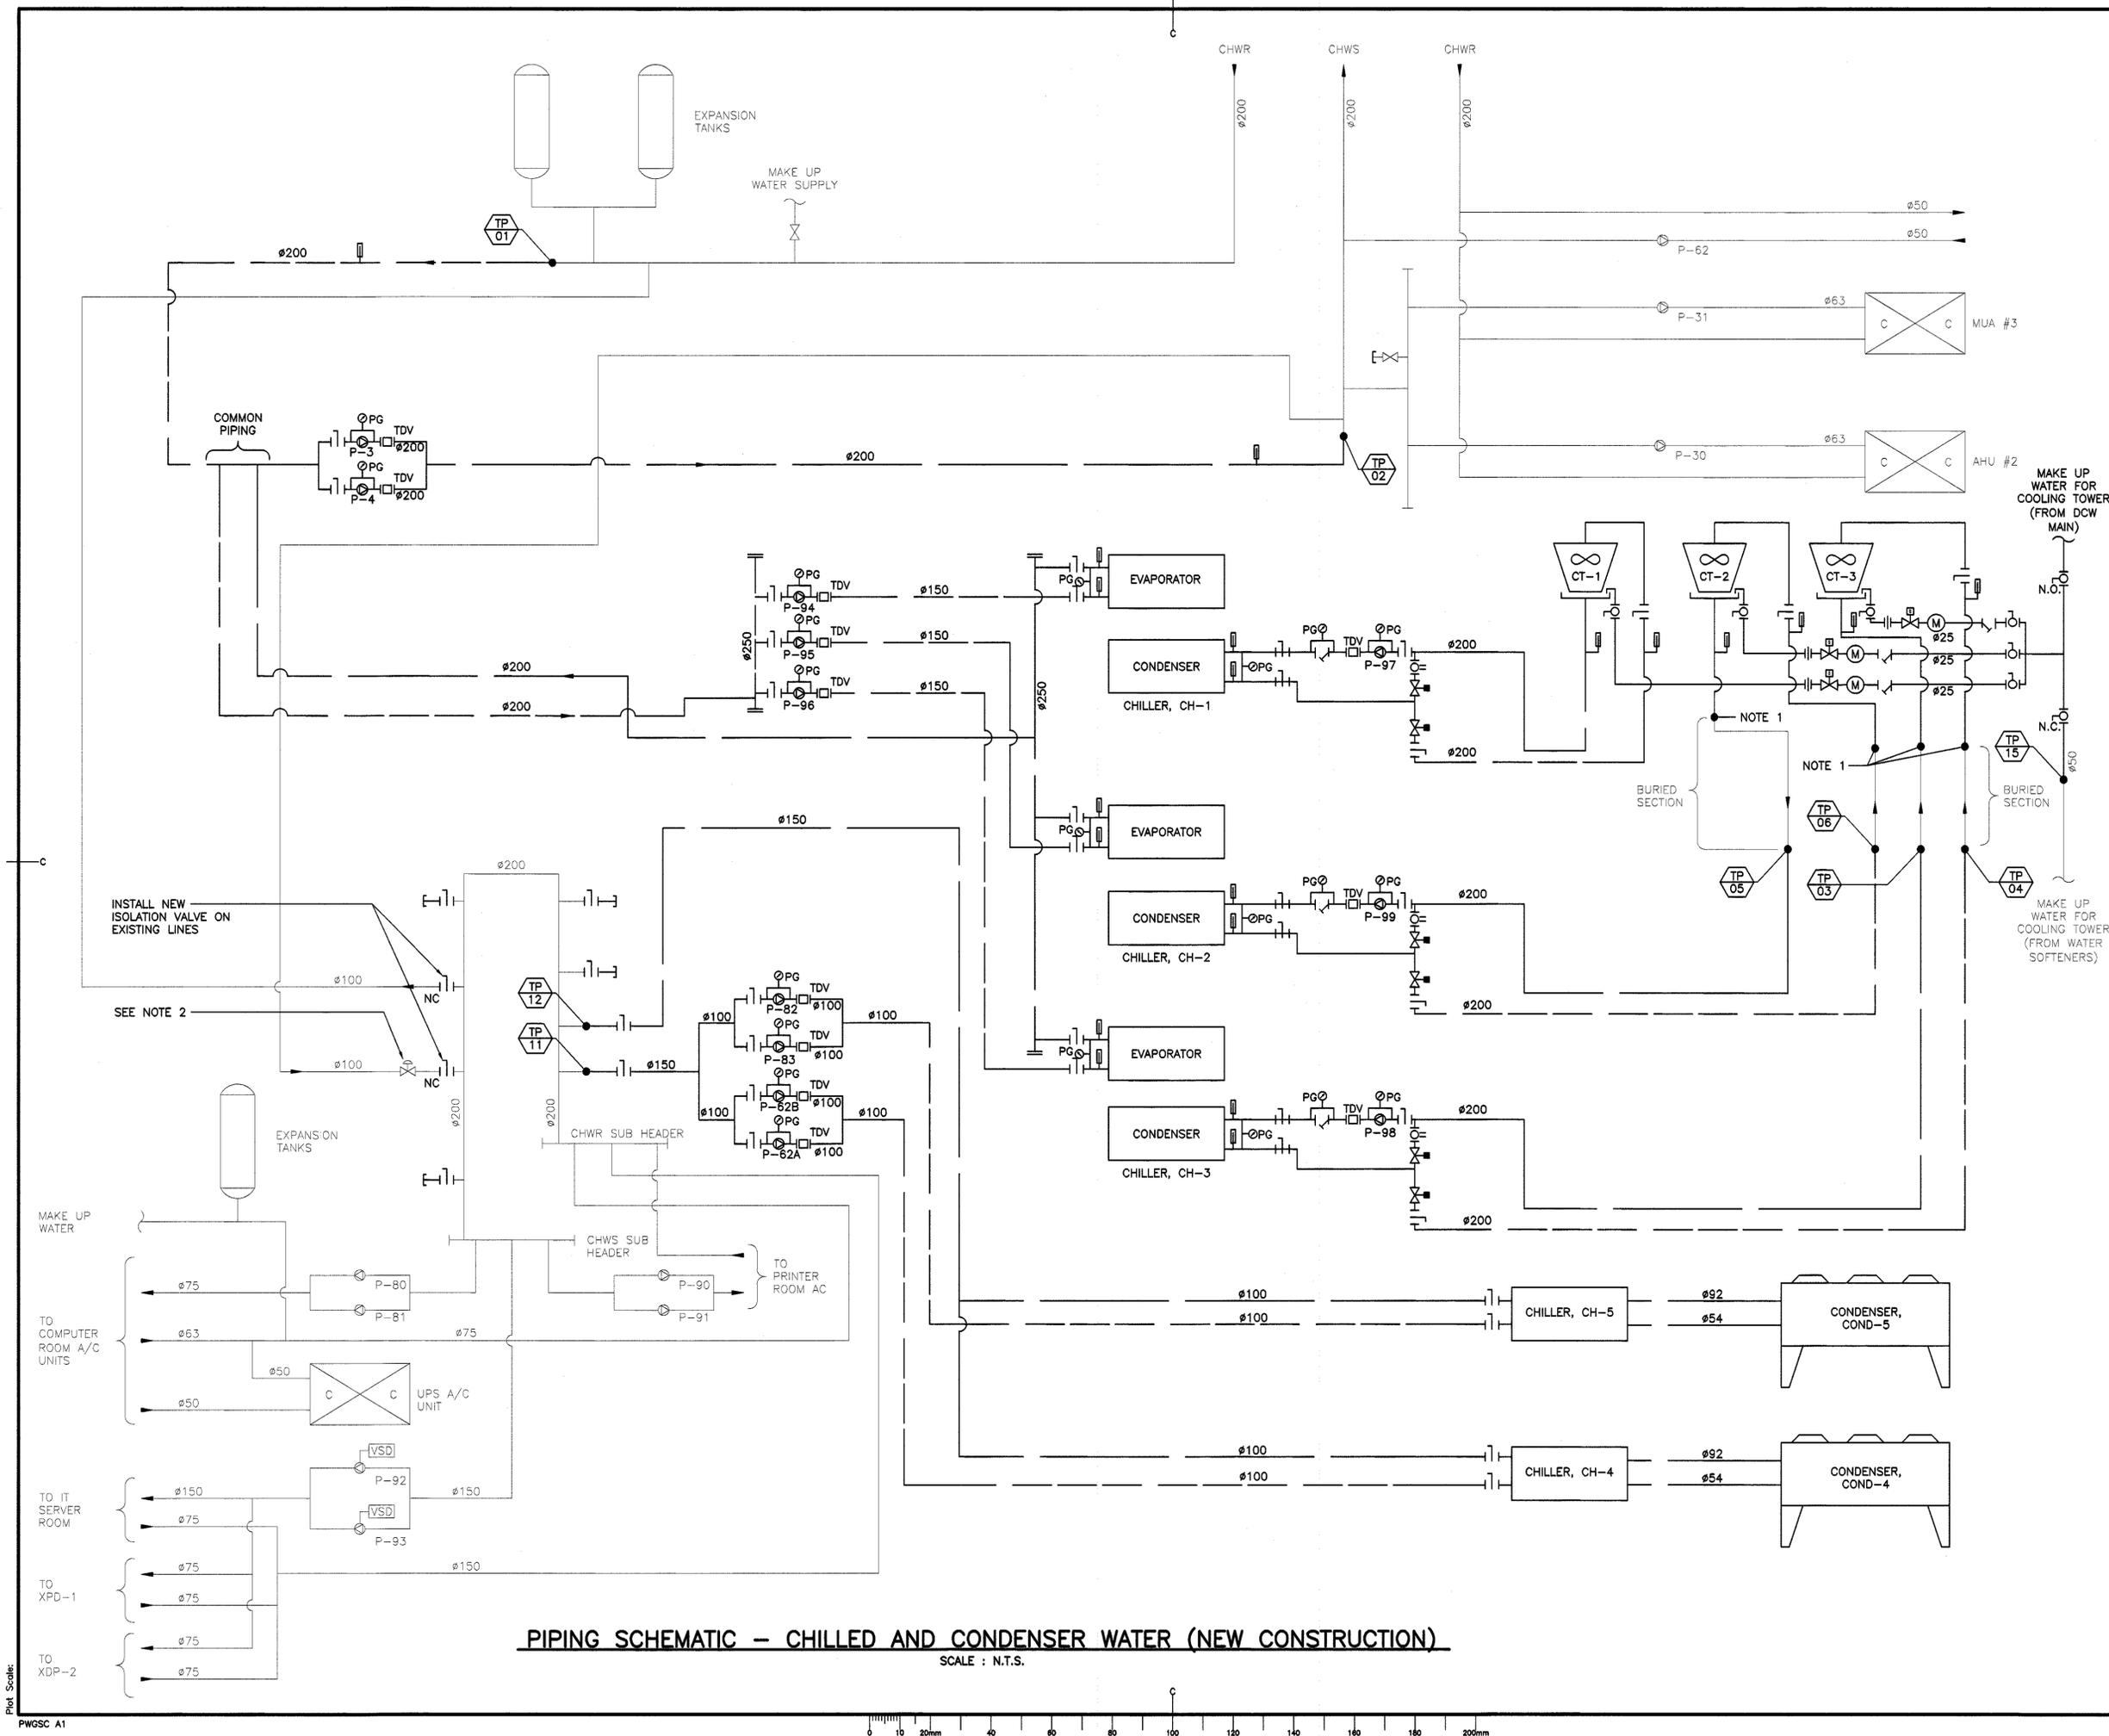

**PIPING SCHEMATIC - CHILLED AND CONDENSER WATER (NEW CONSTRUCTION)**  
 SCALE : N.T.S.

