


**PUBLIC WORKS AND GOVERNMENT SERVICES CANADA  
REAL PROPERTY CONTRACTING  
NL DIVISION**

---

# **SPECIFICATION**

**Monorail & Hoist System Replacement  
Wabush Airport, Wabush, NL  
SOLICITATION #: EC015-160696/A**


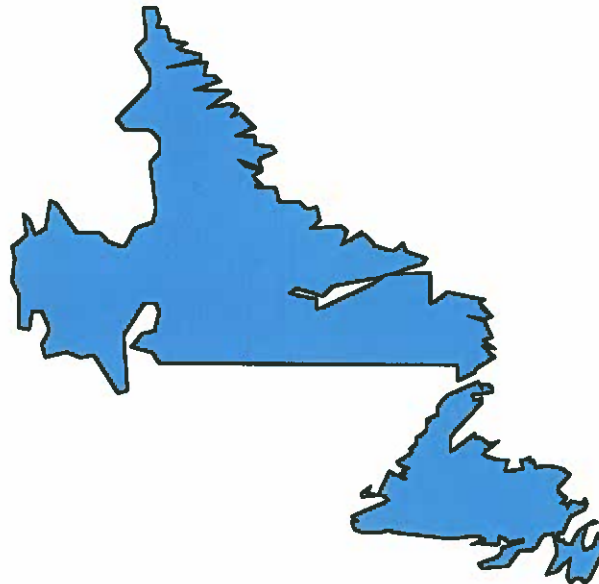


**A/Contracting Officer:**

Mary Carey  
Real Property Contracting  
10 Barter's Hill, P.O. Box 4600  
St. John's, NL A1C 5T2  
**Telephone: (709) 772-4754**  
**Facsimile: (709) 772-4603**

**PUBLIC WORKS AND GOVERNMENT SERVICES CANADA**  
**PROJECT NO. R.073048.001**  
**WABUSH AIRPORT MONORAIL & HOIST REPLACEMENT**  
**ISSUED FOR TENDER**

**June 30, 2015**

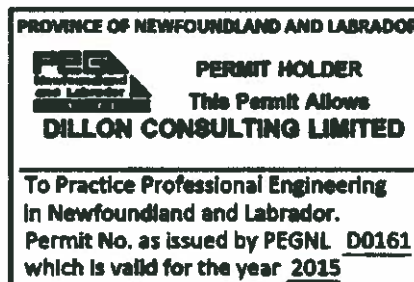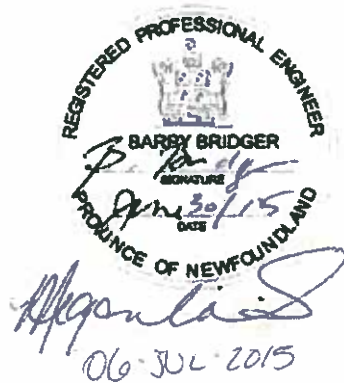

---

**Wabush Airport Monorail & Hoist Replacement****Wabush, NL****Project No. R.073048.001****Drawings and Specifications****Page 1 of 1**

---

**DRAWINGS:**

S1 OF 4      EXISTING PLANS AND SECTIONS  
S2 OF 4      NEW PLANS AND SECTIONS  
S3 OF 4      TRUSS TYPE ELEVATIONS  
S4 OF 4      DETAILS

**SPECIFICATIONS:**

<b><u>DIVISION</u></b>	<b><u>SECTION</u></b>	<b><u>NO. OF PAGES</u></b>
<b>Division 1 – General Requirements</b>	Section #01 11 00 - Summary of Works	2
	Section #01 14 00 - Work Restrictions	1
	Section #01 29 83 - Payment Procedures for Testing Laboratory Services	2
	Section #01 31 00 - Project Management and Coordination	4
	Section #01 32 00 - Construction Progress Documentation	3
	Section #01 33 00 - Submittal Procedures	5
	Section #01 35 29.06 - Health and Safety Requirements	12
	Section #01 35 43 - Environmental Procedures	2
	Section #01 35 99 - Dust Control Procedures	2
	Section #01 41 00 - Regulatory Requirements	2
	Section #01 42 00 - References	5
	Section #01 45 00 - Quality Control	3
	Section #01 51 00 - Temporary Utilities	3
	Section #01 52 00 - Construction Facilities	2
	Section #01 56 00 - Temporary Barriers and Enclosures	3
	Section #01 61 00 - Common Product Requirements	7
	Section #01 73 00 - Execution	3
	Section #01 74 11 - Cleaning	3
	Section #01 74 21 - Construction/Demolition Waste Management and Disposal	4
	Section #01 77 00 - Closeout Procedures	2
	Section #01 78 00 - Closeout Submittals	9
	Section #01 91 13 - Commissioning (Cx) Requirements	17
	Section #01 91 33 - Commissioning (Cx) Forms	2
	Section #01 91 41 - Commissioning (Cx) Training	3
<b>Division 2 - Existing Conditions</b>	Section #02 41 16 - Structure Demolition	5
<b>Division 5 - Metals</b>	Section #05 12 23 - Structural Steel for Buildings	6
	Section #05 50 00 - Metal Fabrications	4

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 11 00 – Summary of Works**

---

**Page 1 of 2**

**PART 1**      **GENERAL**

**1.1**            **SECTION INCLUDES**

- .1      Title and description of Work.
- .2      Contractor use of premises.
- .3      Owner occupancy.

**1.2**            **WORK COVERED BY CONTRACT DOCUMENTS**

- .1      Work of this Contract comprises general construction renovation of Wabush Airport Monorail and Hoist Replacement, located at Wabush, NL; and further identified as Monorail and Hoist Replacement.
- .2      Scope of work includes but not limited to:
  - .1      Demolition and removal of existing hoist and monorail. The existing electrical connection to the existing monorail shall be disconnected.
  - .2      Upgrade existing OWSJ members to accommodate new hoist.
  - .3      Supply and install new chain hoist and monorail system as indicated on drawings. The new chain hoist shall be connected into the existing electrical system by the Contractor.
- .3      Work covered by the contract documents includes Commissioning of the facility as per Section 01 91 13 – Commissioning (Cx) Requirements including engagement of third party structural engineer for verification of equipment structural support.

**1.3**            **CONTRACTOR USE OF PREMISES**

- .1      Contractor has restricted use of site. Building is in a secure area of the airport.
- .2      Coordinate use of premises under direction of Departmental Representative.
- .3      Obtain and pay for use of additional storage or work areas needed for operations under this Contract.
- .4      Remove or alter existing work to prevent injury or damage to portions of existing work which remain.
- .5      Repair or replace portions of existing work which have been altered during construction operations to match existing or adjoining work, as directed by Departmental Representative.

---

**Wabush Airport Monorail & Hoist Replacement  
Wabush, NL**

**Project No. R.073048.001**

Section 01 11 00 – Summary of Works

---

Page 2 of 2

**1.4            OWNER OCCUPANCY**

- .1      Owner will occupy premises during entire construction period for execution of normal operations.
- .2      Cooperate with Owner in scheduling operations to minimize conflict and to facilitate Owner usage.

**1.5            ON-SITE DOCUMENTS**

- .1      Maintain at job site documents as indicated in Section 01 31 00 – Project Management and Coordination.

**1.6            CONTRACT DOCUMENTS**

- .1      Legends and schedules in the Issued for Tender Drawings take precedence over the Technical Specifications with respect to products and materials identified.

**PART 2            PRODUCTS (NOT APPLICABLE)**

**PART 3            EXECUTION (NOT APPLICABLE)**

**END OF SECTION**

---

**Wabush Airport Monorail & Hoist Replacement**  
**Wabush, NL**  
**Project No. R.073048.001**  
**Section 01 14 00 – Work Restrictions**

---

Page 1 of 1

**PART 1**      **GENERAL**

**1.1**            **SECTION INCLUDES**

- .1      Connecting to existing services.
- .2      Special scheduling requirements.

**1.2**            **RELATED SECTIONS**

- .1      Section 01 32 00 – Construct Progress Documentation.
- .2      Section 01 56 00 - Temporary Barriers and Enclosures.

**1.3**            **EXISTING SERVICES**

- .1      Notify Departmental Representative and utility companies of intended interruption of services and obtain required permission.
- .2      Where Work involves breaking into or connecting to existing services, give Departmental Representative 72 hours of notice for necessary interruption of mechanical or electrical service throughout course of work. Keep duration of interruptions minimum. Carry out interruptions after normal working hours of occupants, preferably on weekends.
- .3      Provide for pedestrian and vehicular traffic.

**PART 2**      **PRODUCTS (NOT APPLICABLE)**

**PART 3**      **EXECUTION (NOT APPLICABLE)**

**END OF SECTION**

---

**Wabush Airport Monorail & Hoist Replacement  
Wabush, NL**

**Project No. R.073048.001**

Section 01 29 83 – Payment Procedures: Testing Laboratory Services

Page 1 of 2

---

**PART 1      GENERAL**

**1.1      SECTION INCLUDES**

- .1      Inspecting and testing by inspecting firms or testing laboratories designated by Departmental Representative

**1.2      RELATED REQUIREMENTS SPECIFIED ELSEWHERE**

- .1      Particular requirements for inspection and testing to be carried out by testing laboratory designated by Departmental Representative are specified under various sections.

**1.3      APPOINTMENT AND PAYMENT**

- .1      Departmental Representative will appoint and pay for services of testing laboratory except as follows:
  - .1      Inspection and testing required by laws, ordinances, rules, regulations or orders of public authorities.
  - .2      Inspection and testing performed exclusively for Contractor's convenience.
  - .3      Testing, adjustment and balancing of conveying systems, mechanical and electrical equipment and systems.
  - .4      Mill tests and certificates of compliance.
  - .5      Tests specified to be carried out by Contractor under the supervision of Departmental Representative.
  - .6      Additional tests specified in the following paragraph.
- .2      Where tests or inspections by designated testing laboratory reveal Work not in accordance with contract requirements, pay costs for additional tests or inspections as required by Departmental Representative to verify acceptability of corrected work.

**1.4      CONTRACTOR'S RESPONSIBILITIES**

- .1      Provide labour, equipment and facilities to:
  - .1      Provide access to Work to be inspected and tested.
  - .2      Facilitate inspections and tests.
  - .3      Make good Work disturbed by inspection and test.
  - .4      Provide storage on site for laboratory's exclusive use to store equipment.
- .2      Notify Departmental Representative sufficiently in advance of operations to allow for assignment of laboratory personnel and scheduling of test.
- .3      Where materials are specified to be tested, deliver representative samples in required quantity to testing laboratory.

---

**Wabush Airport Monorail & Hoist Replacement  
Wabush, NL**

**Project No. R.073048.001**

**Section 01 29 83 – Payment Procedures: Testing Laboratory Services**

**Page 2 of 2**

---

- .4 Pay costs for uncovering and making good Work that is covered before required inspection or testing is completed and approved by Departmental Representative.

**PART 2      PRODUCTS (NOT APPLICABLE)**

**PART 3      EXECUTION (NOT APPLICABLE)**

**END OF SECTION**



**PART 1      GENERAL**

**1.1      SECTION INCLUDES**

- .1      Coordination work with other contractors and subcontractors under administration of Departmental Representative.
- .2      Scheduled project meetings.

**1.2      RELATED SECTIONS**

- .1      Section 01 11 00 - Summary of Work.
- .2      Section 01 91 13 – General Commissioning (Cx) Requirements.

**1.3      DESCRIPTION**

- .1      Coordination of progress schedules, submittals, use of site, temporary utilities, construction facilities, and construction Work, with progress of Work of other contractors and subcontractors under instructions of Departmental Representative.

**1.4      PROJECT MEETINGS**

- .1      Project meetings to be held at times and locations as determined by Departmental Representative.
- .2      Departmental Representative will arrange project meetings and record and distribute minutes.

**1.5      CONSTRUCTION ORGANIZATION AND START-UP**

- .1      Within 10 days after award of Contract, request a meeting of parties in contract to discuss and resolve administrative procedures and responsibilities.
- .2      Establish time and location of meetings and notify parties concerned minimum 5 days before meeting.
- .3      Agenda to include following:
  - .1      Appointment of official representative of participants in Work.
  - .2      Schedule of Work, progress scheduling in accordance with Section 01 32 00 - Construction Progress Documentation.
  - .3      Schedule of submission of shop drawings, samples, colour chips in accordance with Section 01 33 00 - Submittal Procedures.
  - .4      Requirements for temporary facilities, site sign, offices, storage sheds, utilities, fences in accordance with Section 01 51 00 - Temporary Utilities.

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 31 00 - Project Management and Coordination**

**Page 2 of 4**

---

- .5 Delivery schedule of specified equipment in accordance with Section 01 32 00 - Construction Progress Documentation.
- .6 Site security in accordance with Section 01 52 00 - Construction Facilities.
- .7 Proposed changes, change orders, procedures, approvals required, mark-up percentages permitted, time extensions, overtime, and administrative requirements.
- .8 Record drawings in accordance with Section 01 78 00 - Closeout Submittals.
- .9 Maintenance manuals in accordance with Section 01 78 00 - Closeout Submittals.
- .10 Take-over procedures, acceptance, and warranties in accordance with Section 01 77 00 - Closeout Procedures and 01 78 00 - Closeout Submittals.
- .11 Monthly progress claims, administrative procedures, photographs, and holdbacks.
- .12 Appointment of inspection and testing agencies or firms in accordance with Section 01 45 00 - Quality Control.
- .13 Insurances and transcript of policies.
- .4 Comply with Departmental Representative's allocation of mobilization areas of site; for field offices and sheds, for access, traffic, and parking facilities.
- .5 During construction coordinate use of site and facilities through Departmental Representative's procedures for intra-project communications: Submittals, reports and records, schedules, coordination of drawings, recommendations, and resolution of ambiguities and conflicts.
- .6 Comply with instructions of Departmental Representative for use of temporary utilities and construction facilities.

**1.6 ON-SITE DOCUMENTS**

- .1 Maintain at job site, one copy each of the following:
  - .1 Contract drawings.
  - .2 Specifications.
  - .3 Addenda.
  - .4 Reviewed shop drawings.
  - .5 List of outstanding shop drawings.
  - .6 Change orders.
  - .7 Other modifications to Contract.
  - .8 Field test reports.
  - .9 Copy of approved Work schedule.
  - .10 Health and Safety Plan and other Safety related documents.
  - .11 Manufacturers' installation and application instructions.
  - .12 Labour conditions and wage schedules.
  - .13 Other documents as specified.

**1.7 SCHEDULES**

- .1 Submit preliminary construction progress schedule in accordance with Section 01 32 00 - Construction Progress Documents to Departmental Representative coordinated with Departmental Representative's project schedule. Schedule to show anticipated progress stages and final completion of work within time period required by contract documents.
- .2 After review, revise and resubmit schedule to comply with project schedule requirements.
- .3 During progress of Work revise and resubmit at project progress meetings or as directed by Departmental Representative.

**1.8 SUBMITTALS**

- .1 Make submittal to Departmental Representative for review.
- .2 Submit preliminary shop drawings, product data and samples in accordance with Section 01 33 00 – Submittal Procedures for review for compliance with Contract Documents; for field dimensions and clearances, for relation to available space, and for relation to Work of other contracts. After review, revise and resubmit for transmittal to Departmental Representative.
- .3 Submit requests for payment for review to Departmental Representative.
- .4 Submit requests for interpretation of Contract Documents, and obtain instructions through Departmental Representative.
- .5 Process change orders through Departmental Representative.
- .6 Deliver closeout submittals for review by Departmental Representative.

**1.9 COORDINATION DRAWINGS**

- .1 Provide information required by Departmental Representative for preparation of coordination drawings.
- .2 Review and approve revised drawings for submittal to Departmental Representative.
- .3 Departmental Representative may furnish additional drawings for clarification. These additional drawings have same meaning and intent as if they were included with plans referred to in contract documents.

**1.10 CLOSEOUT PROCEDURES**

- .1 Notify Departmental Representative when Work is considered ready for Substantial Performance.
- .2 Accompany Departmental Representative on preliminary inspection to determine items listed for completion or correction.

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 31 00 - Project Management and Coordination**

**Page 4 of 4**

---

- .3 Comply with Departmental Representative's instructions for correction of items of Work listed in executed certificate of Substantial Performance and for access to Owner-occupied areas.
- .4 Notify Departmental Representative of instructions of items of Work determined in Departmental Representative's final inspection.

**PART 2      PRODUCTS (NOT APPLICABLE)**

**PART 3      EXECUTION (NOT APPLICABLE)**

**END OF SECTION**

**PART 1**      **GENERAL**

**1.1**            **RELATED SECTIONS**

- .1      Section 01 77 00 - Closeout Procedures.

**1.2**            **SCHEDULES REQUIRED**

- .1      Submit schedules as follows:
  - .1      Construction Progress Schedule.
  - .2      Submittal Schedule for Shop Drawings and Product Data.
  - .3      Submittal Schedule for Samples.
  - .4      Product Delivery Schedule.
  - .5      Cash Allowance Schedule for purchasing Products.
  - .6      Shutdown or closure activity.

**1.3**            **FORMAT**

- .1      Prepare schedule in form of a horizontal bar chart.
- .2      Provide a separate bar for each major item of work, trade or operation.
- .3      Split horizontally for projected and actual performance.
- .4      Provide horizontal time scale identifying first work day of each week.
- .5      Format for listings: chronological order of start of each item of work.
- .6      Identification of listings: By Systems description.

**1.4**            **SUBMISSION**

- .1      Submit initial format of schedules within 15 working days after award of Contract.
- .2      Submit schedules in electronic format, forward on disc as PDF files.
- .3      Submit one opaque reproduction, plus 2 copies to be retained by Departmental Representative.
- .4      Departmental Representative will review schedule and return review copy within 10 days after receipt.
- .5      Resubmit finalized schedule within 7 days after return of review copy.
- .6      Submit revised progress schedule with each application for payment.
- .7      Distribute copies of revised schedule to:
  - .1      Job site office.

- .2 Subcontractors.
- .3 Other concerned parties.
- .8 Instruct recipients to report to Contractor within 10 days, any problems anticipated by timetable shown in schedule.

## **1.5 CRITICAL PATH SCHEDULING**

- .1 Include complete sequence of construction activities.
- .2 Include dates for commencement and completion of each major element of construction as follows.
  - .1 Mobilization.
  - .2 Preparation of Shop Drawings.
  - .3 Submission and Review of Shop Drawings.
  - .4 Demolition.
  - .5 Fabrication of Structural Steel.
  - .6 Installation of Structural Steel.
  - .7 Delivery of Hoist and Trolley.
  - .8 Installation of Hoist and Trolley.
  - .9 Commissioning.
- .3 Show projected percentage of completion of each item as of first day of month.
- .4 Indicate progress of each activity to date of submission schedule.
- .5 Show changes occurring since previous submission of schedule:
  - .1 Major changes in scope.
  - .2 Activities modified since previous submission.
  - .3 Revised projections of progress and completion.
  - .4 Other identifiable changes.
- .6 Provide a narrative report to define:
  - .1 Problem areas, anticipated delays, and impact on schedule.
  - .2 Corrective action recommended and its effect.
  - .3 Effect of changes on schedules of other prime contractors.

## **1.6 SUBMITTALS SCHEDULE**

- .1 Include schedule for submitting shop drawings, product data, and samples.
- .2 Indicate dates for submitting, review time, resubmission time, last date for meeting fabrication schedule.

---

**Wabush Airport Monorail & Hoist Replacement**  
**Wabush, NL**  
**Project No. R.073048.001**  
**Section 01 32 00 - Construction Progress Documentation**

---

**Page 3 of 3**

**PART 2**      **PRODUCTS (NOT APPLICABLE)**

**PART 3**      **EXECUTION (NOT APPLICABLE)**

**END OF SECTION**

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 33 00 – Submittal Procedures**

---

**Page 1 of 5**

**PART 1**      **GENERAL**

**1.1**            **SECTIONS INCLUDE**

- .1      Shop drawings and product data.
- .2      Samples.
- .3      Certificates and transcripts.

**1.2**            **RELATED SECTIONS**

- .1      Section 01 32 00 – Construction Progress Documentation.
- .2      Section 01 45 00 – Quality Control
- .3      Section 01 78 00 – Closeout Submittals

**1.3**            **ADMINISTRATIVE**

- .1      This section specifies general requirements and procedures for contractor's submissions of shop drawings, product data, samples and mock-ups to Departmental Representative for review. Submit promptly and in orderly sequence to not cause delay in Work. Failure to submit in ample time is not considered sufficient reason for an extension of Contract Time and no claim for extension by reason of such default will be allowed.
- .2      Do not proceed with work until relevant submissions are reviewed by Departmental Representative.
- .3      Present shop drawings, product data, samples and mock-ups in SI Metric units.
- .4      Where items or information is not produced in SI Metric units converted values are acceptable.
- .5      Review submittals prior to submission to Departmental Representative. This review represents that necessary requirements have been determined and verified, or will be, and that each submittal has been checked and co-ordinated with requirements of Work and Contract Documents. Submittals not stamped, signed, dated and identified as to specific project will be returned without being examined and shall be considered rejected.
- .6      Notify Departmental Representative, in writing at time of submission, identifying deviations from requirements of Contract Documents stating reasons for deviations.
- .7      Verify field measurements and affected adjacent Work are coordinated.
- .8      Contractor's responsibility for errors and omissions in submission is not relieved by Departmental Representative's review of submittals.



---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 33 00 – Submittal Procedures**

**Page 2 of 5**

---

- .9 Contractor's responsibility for deviations in submission from requirements of Contract Documents is not relieved by Departmental Representative review of submission, unless Departmental Representative gives written acceptance of specific deviations.
- .10 Make any changes in submissions which Departmental Representative may require consistent with Contract Documents and resubmit as directed by Departmental Representative. When resubmitting, notify Departmental Representative in writing of revisions other than those requested.
- .11 Notify Departmental Representative, in writing, when resubmitting, of any revisions other than those requested by Departmental Representative.
- .12 Keep one reviewed copy of each submission on site.

**1.4 SUBMITTALS**

- .1 The term "shop drawings" means drawings, diagrams, illustrations, schedules, performance charts, brochures and other data which are to be provided by Contractor to illustrate details of a portion of Work.
- .2 Coordinate each submission with requirements of work and Contract Documents. Individual submissions will not be reviewed until all related information is available.
- .3 Indicate materials, methods of construction and attachment or anchorage, erection diagrams, connections, explanatory notes and other information necessary for completion of Work. Where articles or equipment attach or connect to other articles or equipment, indicate that such items have been coordinated, regardless of Section under which adjacent items will be supplied and installed. Indicate cross references to design drawings and specifications.
- .4 Allow 10 days for Departmental Representative review of each submission.
- .5 Adjustments made on shop drawings by Departmental Representative are not intended to change contract price. If adjustments affect value of Work, state such in writing to Departmental Representative immediately after receipt of approval of shop drawings. If value of work is to change a change order must be issued prior to proceeding with work.
- .6 Accompany submissions with transmittal letter, containing:
  - .1 Date.
  - .2 Project title and number.
  - .3 Contractor's name and address.
  - .4 Identification and quantity of each shop drawing, product data and sample.
  - .5 Other pertinent data.
- .7 Submissions shall include:
  - .1 Date and revision dates.

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 33 00 – Submittal Procedures**

---

**Page 3 of 5**

- .2 Project title and number.
- .3 Name and address of:
  - .1 Subcontractor.
  - .2 Supplier.
  - .3 Manufacturer.
- .4 Contractor's stamp, signed by Contractor's authorized representative certifying approval of submissions, verification of field measurements and compliance with Contract Documents.
- .5 Details of appropriate portions of Work as applicable:
  - .1 Fabrication.
  - .2 Layout, showing dimensions, including identified field dimensions, and clearances.
  - .3 Setting or erection details.
  - .4 Capacities.
  - .5 Performance characteristics.
  - .6 Standards.
  - .7 Operating weight.
  - .8 Wiring diagrams.
  - .9 Single line and schematic diagrams.
  - .10 Relationship to adjacent work.
- .8 After Departmental Representative review, distribute copies.
- .9 Submit 3 prints plus one electronic copy in PDF format of shop drawings for each requirement requested in specification Sections and as Departmental Representative may reasonably request.
- .10 Submit electronic copy in PDF format of product data sheets or brochures for requirements requested in Specification Sections and as requested by Departmental Representative where shop drawings will not be prepared due to standardized manufacture of product.
- .11 Delete information not applicable to project.
- .12 Supplement standard information to provide details applicable to project.
- .13 Cross-reference product data information to applicable portions of Contract Documents.
- .14 If upon review by Departmental Representative, no errors or omissions are discovered or if only minor corrections are made, copies will be returned and fabrication and installation of work may proceed. If shop drawings are rejected, noted copy will be returned and resubmission of corrected shop drawings, through same procedure indicated above, must be performed before fabrication and installation of work may proceed.

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 33 00 – Submittal Procedures**

**Page 4 of 5**

---

- .15 Samples: examples of materials, equipment, quality, finishes, workmanship. Label samples with origin and intended use.
- .16 Notify Departmental Representative in writing, at time of submission of deviations in samples from requirements of contract documents.
- .17 Where colour, pattern or texture is criterion, submit full range of samples.
- .18 Adjustments made on samples by Departmental Representative are not intended to change Contract Price. If adjustments affect value of Work, state such in writing to Departmental Representative prior to proceeding with Work.
- .19 Make changes in samples, which Departmental Representative may require, consistent with Contract Documents.
- .20 Reviewed and accepted samples will become standard of workmanship and material against which installed Work will be verified.

**1.5 MOCK-UPS**

- .1 Erect mock-ups in accordance with Section 01 45 00 - Quality Control.

**1.6 PROGRESS PHOTOGRAPHS**

- .1 Progress photograph to be electronically formatted and labelled as to location and view.

**1.7 SHOP DRAWINGS REVIEW**

- .1 The review of shop drawings by Departmental Representative is for the sole purpose of ascertaining conformance with the general concept. This review shall not mean that Departmental Representative approves the detail design inherent in the shop drawings, responsibility for which shall remain with the Contractor submitting same, and such review shall not relieve the Contractor of responsibility for errors or omissions in the shop drawings or of responsibility for meeting all requirements of the construction and contract documents. Without restricting the generality of the foregoing, the Contractor is responsible for dimensions to be confirmed and correlated at the job site, for information that pertains to fabrication processes or to techniques of construction and installation and for co-ordination of the work of all sub-trades.

**1.8 STRUCTURAL ATTACHMENTS**

- .1 Contractor to engage a third party Professional Structural Engineer, licensed to practice in the Province of Newfoundland and Labrador, for submission of stamped and signed shop drawings indicating acceptable mounting procedures for all equipment which is suspended, mounted or otherwise attached, as per Section 01 91 13 – Commissioning (Cx) Requirements. The Structural Engineer to also verify correct installation of the equipment.

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 33 00 – Submittal Procedures**

---

**Page 5 of 5**

**PART 2      PRODUCTS (NOT APPLICABLE)**

**PART 3      EXECUTION (NOT APPLICABLE)**

**END OF SECTION**

**PART 1**      **GENERAL**

**1.1**            **REFERENCES**

- .1      Canadian Standards Association (CSA)
  - .1      CAN/CSA-Z259.1 Body Belts and Saddles for Work Positioning and Travel Restraint.
  - .2      CAN/CSA-Z259.10 Full body Harnesses.
  - .3      CAN/CSA-Z259.11 Energy Absorbers and Lanyards.
  - .4      CAN/CSA-Z259.2.1 Fall Arresters, Vertical Lifelines and Rails.
  - .5      FCC No. 301 Standard for Construction Operations.
  - .6      CSA Z797, Code of Practice for Access Scaffold.
- .2      FCC No. 302 Standard for Welding and Cutting.
- .3      Transportation of Dangerous Goods Act Regulations.
- .4      Newfoundland Occupational Health and Safety Act, Amended
- .5      Consolidated Newfoundland and Regulations 1149 WMIS Regulations Under the Occupational Health and Safety Act
- .6      Consolidated Newfoundland and Regulations Occupational Health and Safety Regulations under the Occupational Health and Safety Act.
- .7      Canada Labour Code, Part 2.
- .8      National Building Code of Canada.
- .9      Department of Transportation and Works Occupational Health and Safety Manual.

**1.2**            **RELATED SECTIONS**

- .1      Section 01 33 00 - Submittal Procedures.
- .2      Section 01 35 43 - Environmental Procedures.
- .3      Section 01 41 00 - Regulatory Requirements.

**1.3**            **SUBMITTALS**

- .1      Submit copy of Letter of Good Standing from Provincial Workers Compensation or other department of labour organization.
  - .1      Submit update of Letter of Good Standing whenever expiration date occurs during the period of Work.

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 35 29.06 – Health and Safety Requirements**

**Page 2 of 12**

---

- .2 At least 10 (ten) working days prior to commencing any site work: submit to Departmental Representative copies of:
  - .1 A complete Site Specific Health and Safety Plan.
- .3 Acceptance of the Site Specific Health and Safety Plan and other submitted documents by the Departmental Representative shall only be viewed as acknowledgement that the contractor has submitted the required documentation under this specification section.
- .4 Departmental Representative makes no representation and provides no warranty for the accuracy, completeness and legislative compliance of the Site Specific Health and Safety Plan and other submitted documents by this acceptance.
- .5 Responsibility for errors and omissions in the Site Specific Health and Safety Plan and other submitted documents is not relieved by acceptance by Departmental Representative.

**1.4 OCCUPATIONAL HEALTH AND SAFETY (SITE SPECIFIC HEALTH AND SAFETY PLANS)**

- .1 Conduct operations in accordance with latest edition of the Newfoundland Occupational Health and Safety (OH&S) Act and Regulations, with specific reference to codes and standards referenced therein, and the Department of Transportation and Works Occupational Health and Safety Manual ([http://www.tw.gov.nl.ca/publications/ohs\\_full.pdf](http://www.tw.gov.nl.ca/publications/ohs_full.pdf)).
- .2 Prepare a detailed Site Specific Health and Safety Plan that shall identify, evaluate and control job specific hazards and the necessary control measures to be implemented for managing hazards.
- .3 Provide a copy of the Site Specific Health and Safety Plan upon request to Occupational Health and Safety Branch, Services NL, Province of Newfoundland and Labrador and the Departmental Representative.
- .4 The written Site Specific Health and Safety Plan shall incorporate the following:
  - .1 Hazard assessment results.
  - .2 Engineering and administrative demonstrative controls (work-practices and procedures) to be implemented for managing identified and potential hazards, and comply with applicable federal and provincial legislation and more stringent requirements that have been specified in these specifications.
  - .3 An organizational structure which shall establish the specific chain of command and specify the overall responsibilities of contractor's employees at the work site.
  - .4 A comprehensive work plan which shall:
    - .1 define work tasks and objectives of site activities/operations and the logistics and resources required to reach these tasks and objectives.
    - .2 establish personnel requirements for implementing the plan.

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 35 29.06 – Health and Safety Requirements**

**Page 3 of 12**

---

- .5 A personal protected equipment (PPE) Program which shall detail PPE:
  - .1 Selection criteria based on site hazards.
  - .2 Use, maintenance, inspection and storage requirements and procedures.
  - .3 Decontamination and disposal procedures.
  - .4 Inspection procedures prior to, during and after use, and other appropriate medical considerations.
  - .5 Limitations during temperature extremes, heat stress and other appropriate medical consideration.
- .6 An emergency response procedure, refer to Clause 1.5 Supervision and Emergency Response Procedure of this section for requirements.
- .7 A hazard communication program for informing workers, visitors and individuals outside of the work area as required. This will include but not be limited to a visitor safety and orientation policy and program that will include education on hazards, required PPE and accompaniment while on site.
- .8 A hearing conservation program in accordance with the OHS Regulations.
- .9 A recent (current year) inspection form for all powered mobile equipment that will be used in fulfilling the terms of the contract. The inspection form shall, at a minimum, state that the equipment is in a safe operating condition.
- .10 An acceptable parking policy for all powered mobile equipment to be used on this project. The policy shall, at a minimum, be based on a hazard assessment that considers factors such as equipment type, potential for roll over, load capacity of the parking area, pedestrian and vehicular traffic, and potential for equipment tampering, equipment energy, and equipment contact with power lines.
- .11 A health and safety training program which includes a safety training matrix.
- .12 General safety rules.
- .5 Periodically review and modify as required each component of the Site Specific Health and Safety Plan when a new hazard is identified during completion of work and when an error or omission is identified in any part of the Site Specific Health and Safety Plan.
- .6 Review the completeness of the hazard assessment immediately prior to commencing work, when a new hazard is identified during completion of work and when an error or omission is identified.
  - .1 Be solely responsible for investigating, evaluating and managing any report of actual or potential hazards.
  - .2 Clearly define accident incident investigation procedures.
  - .3 Clearly define policy and processes for early and safe return to work.
  - .4 Retain copies of all completed hazard assessments at the project site and make available to the Departmental Representative immediately upon request.
- .7 Implement all requirements of the Site Specific Health and Safety Plan.

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 35 29.06 – Health and Safety Requirements**

**Page 4 of 12**

---

- .1 Ensure that every person entering the project site is informed of requirements under the Site Specific Health and Safety Plan.
- .2 Take all necessary measures to immediately implement any engineering controls, administrative controls, personal protective equipment required or termination of work procedures to ensure compliance with the Site Specific Health and Safety Plan.

**1.5**

**SUPERVISION AND EMERGENCY RESCUE PROCEDURE**

- .1 Carry out work under the direct supervision of competent persons responsible for safety by ensuring the work complies with the appropriate section of OH&S Act and Regulations
- .2 Assign a sufficient number of supervisory personnel to the work site.
  - .1 Any person assigned to supervisory duties shall not conduct significant work in relation to the contract that inhibits them from the ability to properly supervise the work site.
- .3 Provide a suitable means of communications and check-in for workers required to work alone.
- .4 Develop an emergency rescue plan for the job site and ensure that supervisors and workers are trained in the emergency rescue plan.
- .5 The emergency response plan shall address, as a minimum:
  - .1 Pre-emergency planning.
  - .2 Personnel roles, lines of authority and communication.
  - .3 Emergency recognition and prevention.
  - .4 Safe distances and places of refuge.
  - .5 Site security and control
  - .6 Evacuation routes and procedures
  - .7 Decontamination procedures which are not covered by the site specific safety and health plan.
  - .8 Emergency medical treatment and first aid.
  - .9 Emergency alarm, notification and response procedures including procedures for reporting incidents to local, provincial and federal government departments.
  - .10 PPE and emergency equipment.
  - .11 Procedures for handling emergency incidents.
  - .12 Site specific emergency response training requirements and schedules.
- .6 The emergency response procedures shall be rehearsed regularly as part of the overall training program.



- .7 Provide adequate first aid facilities for the jobsite and ensure that a minimum number of workers are trained in first aid in accordance with the Occupational Health and Safety First Aid Regulations.

**1.6 HEALTH AND SAFETY COMMITTEE**

- .1 Establish an Occupational Health and Safety Committee where ten or more workers are employed on the job site as per the OH&S Act and Regulations.

**1.8 RESPONSIBILITY**

- .1 Be responsible for health and safety of persons on site, safety of property on site and for protection of persons adjacent to site and environment to extent that they may be affected by conduct of Work.
- .2 Comply with and enforce compliance by employees with safety requirements of Contract Documents, applicable federal, provincial, territorial and local statutes, regulations, and ordinances, and with Site Specific Health and Safety Plan.
- .3 Where safety risks exist, the contractor must stop the work until such time as the risk can be mitigated to a safe level.
- .4 Take appropriate steps to ensure that the hazards are mitigated to a safe level, workers are notified of the hazards and how to protect themselves. As well, workers must be provided with any new safe work practices or information regarding mitigation of the risk.

**1.9 UNFORSEEN HAZARDS**

- .1 Should any unforeseen or peculiar safety-related factor, hazard, or condition become evident during performance of Work, follow procedures in place for Employee's Right to Refuse Work in accordance with Acts and Regulations of Province having jurisdiction. Advise Departmental Representative verbally and in writing.

**1.10 INSTRUCTION AND TRAINING**

- .1 Workers shall not participate in or supervise any activity on the work site until they have been trained to a level required by this job function and responsibility. Training shall as a minimum thoroughly cover the following:
  - .1 Federal and Provincial Health and Safety Legislation requirements including roles and responsibilities of workers and person(s) responsible for implementing, monitoring and enforcing health and safety requirements.
  - .2 Safety and health hazards associated with working on a contaminated site including recognition of symptoms and signs which might indicate over exposure to hazards.
  - .3 Limitations, use, maintenance and disinfection-decontamination of personal protective equipment associated with completing work.

- .4 Limitations, use, maintenance and care of engineering controls and equipment.
- .5 Limitations and use of emergency notifications and response equipment including emergency response protocol.
- .6 Work practices and procedures to minimize the risk of an accident and hazardous occurrence from exposure to a hazard.
- .2 Provide and maintain training of workers, as required, by Federal and Provincial legislation.
- .3 Provide copies of all training certificates to Departmental Representative for review, before a worker is to enter the work site.
- .4 Authorized visitors shall not access the work site until they have been:
  - .1 Notified of the names of persons responsible for implementing, monitoring and enforcing the Site Specific Health and Safety Plan.
  - .2 Briefed on safety and health hazards present on the site.
  - .3 Instructed in the proper use and limitations of personal protective equipment.
  - .4 Briefed as the emergency response protocol including notification and evacuation process.
  - .5 Informed of practices and procedures to minimize risks from hazards and applicable to activities performed by visitors.
  - .6 Accompanied while on site, and provided with the appropriate PPE.
- .5 All workers will be instructed and trained on the hazards associated with work they will perform and how to protect themselves. This will include a review of all safe work practices, the reporting and documentation of hazards, reporting accidents and injuries as well as, formal training in areas of high risk (i.e. fall protection, power line hazards, traffic control persons training).
- .6 The work site shall have the appropriate number of persons trained in emergency and Standard First Aid according to the First Aid Regulations.

#### **1.11 CONSTRUCTION SAFETY MEASURES**

- .1 Observe construction safety measures of National Building Code, latest edition, Provincial Government, OH&S Act and Regulations, Workplace Health and Safety Compensation Commission and Municipal Authority provided that in any case of conflict or discrepancy more stringent requirements shall apply.
- .2 Administer the project in a manner that will ensure, at all times, full compliance with Federal and Provincial Acts, regulations and applicable safety codes and the Site Specific Health and Safety Plan.
- .3 Provide Departmental Representative with copies of all orders, directions and any other documentation, issued by the Occupational Health and Safety Branch, Services NL, immediately after receipt.

**1.12 POSTING OF DOCUMENTS**

- .1 Ensure applicable items, articles, notices and orders are posted in conspicuous location on site in accordance with Acts and Regulations of Province and authority having jurisdiction, and in consultation with Departmental Representative.

**1.13 HEALTH AND SAFETY MONITORING**

- .1 Periodic inspections of the contractor's work may be carried out by the Departmental Representative to maintain compliance with the Health and Safety Program. Inspections will include visual inspections as well as testing and sampling as required.
- .2 The contractor shall be responsible for any and all costs associated with delays as a result of contractor's failure to comply with the requirements outlined in this section.

**1.14 NOTIFICATION**

- .1 For all projects, the contractor shall, prior to the commencement of work, notify in writing the Occupational Health and Safety Branch, Services NL with the following information:
  - .1 Name and location of construction site.
  - .2 Company name and mailing address of contractor doing the work.
  - .3 The number of workers to be employed.
  - .4 A copy of the Site Specific Health and Safety Plan if requested.

**1.15 CORRECTION OF NON-COMPLIANCE**

- .1 Immediately address health and safety non-compliance issues identified by authority having jurisdiction or by Departmental Representative.
- .2 Provide Departmental Representative with written report of action taken to correct non-compliance of health and safety issues identified within ten (10) working days.
- .3 Departmental Representative may stop work if non-compliance of health and safety regulations is not corrected.

**1.16 WHMIS**

- .1 Ensure that all controlled products are in accordance with the Workplace Hazardous Materials Information System (WHMIS) Regulations and Chemical Substances of the OH&S Act and Regulations regarding use, handling, labelling, storage, and disposal of hazardous materials.
- .2 Deliver copies of relevant Material Safety Data Sheets (MSDS) to job site and the Departmental Representative. The MSDS must be acceptable to Labour Canada and Health and Welfare Canada for all controlled products that will be used in the performance of this work. All MSDS should be located in accessible locations for all workers and visitors throughout the site, bound and organized in binders.

- .3 Train workers required to use or work in close proximity to controlled products as per OH&S Act and Regulations.
- .4 Label controlled products at jobsite as per OH&S and Regulations and WHMIS.
- .5 Provide appropriate emergency facilities as specified in the MSDS where workers might be exposed to contact with chemicals, e.g. eye-wash facilities, emergency shower.
  - .1 Workers to be trained in use of such emergency equipment.
- .6 Contractor shall provide appropriate personal protective equipment as specified in the MSDS where workers are required to use controlled products.
  - .1 Properly fit workers for personal protective equipment
  - .2 Train workers in care, use and maintenance of personal protective equipment.
- .7 No controlled products are to be brought on-site without prior approved MSDS.
- .8 The MSDS are to remain on site at all times.

**1.17 OVERLOADING**

- .1 The Contractor's Full Time CSO and/or Site Superintendent shall ensure no part of work or associated equipment is subjected to loading that will endanger its safety or will cause permanent deformation.

**1.18 FALSEWORK**

- .1 Design and construct falsework in accordance with CSA S269.1.

**1.19 SCAFFOLDING**

- .1 Design, erect, inspect, operate, modify, and dismantle scaffolding in accordance with CSA Z797, the OH&S Act and Regulations, and the scaffold manufacturer's written instructions.
- .2 Provide trained and certified Competent Scaffold Erectors for all scaffold erection, modification and dismantling. Training certification must be valid at time of erection, modification and dismantling of scaffold.
- .3 Conduct and document daily inspections of scaffolding by trained and certified Competent Scaffold Inspectors or Erectors. Training certification must be valid at the time of inspection.
- .4 Provide a scaffold tagging system as described in CSA Z797.
- .5 Ensure that all industry best practices for safe scaffold usage, including fall protection, proper loading, safe access, electrical hazards, exit door management and other concerns are strictly adhered to.

**1.20 WORKING AT HEIGHTS**

- .1 Ensure that fall restraint or fall arrest devices are used by all workers working at elevations greater than 2.4 meters above grade or floor level in accordance with CSA Z259, where alternate fall protection systems are not provided in accordance with Occupational Health and Safety Act and Regulations.
- .2 All workers performing work at height and who will be required to utilize a fall arrest system must be trained in a fall protection program certified by the WHSCC. Training must be current and valid at the time of use.
- .3 Prior to working at height workers shall be instructed in a Contractor Safe Work Practice for working at height and associated Rescue Plan for working at heights, developed specific to the work to be performed, locations and risks.

**1.21 PERSONAL PROTECTIVE EQUIPMENT**

- .1 Ensure workers on the jobsite use personal protective equipment appropriate to the hazards identified in the Site Specific Health and Safety Plan and those workers are trained in the proper care, use, and maintenance of such equipment.
- .2 PPE selections shall be based on an evaluation of the performance characteristics of the PPE relative to the requirements and limitations of the site, task-specific conditions, duration and hazards and potential hazards identified on site. PPE must also be fitted for the worker.
- .3 Provide workers and visitors to the site with proper respiratory protection equipment.
  - .1 No work shall be performed in an area where an airborne contaminant exceeds recommendations of the ACGIH, do not meet the appropriate standards for the specific contaminants or are not in accordance with the OHS regulations..
  - .2 Respiratory protection shall be provided in accordance with the requirements of the Occupational Health and Safety Branch, Services NL and these specifications.
  - .3 Establish, implement and maintain a respirator inspection and maintenance program in accordance with the CSA standard identified in the OHS Regulations.
  - .4 Copies of all respirator owners' maintenance manuals shall be kept at all times at the contractor's site office.
- .4 Provide and maintain a supply of dermal protection equipment to allow visitors and all workers proper dermal protection.
  - .1 Dermal protection shall be sufficient to act as a protective barrier between the skin and an airborne contaminant or hazardous material. Dermal protection shall also be provided for all physical hazards.

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 35 29.06 – Health and Safety Requirements**

**Page 10 of 12**

---

- .2 Dermal protection equipment shall not be used after exceeding 75% of the break through time. The break through time shall be based on the contaminant which requires the least amount of time to break through the protective equipment
- .3 Copies of all dermal protection user specifications, owners and maintenance manuals shall be kept at all times at the contractor's site office.
- .4 Establish, implement and maintain air inspection program to ensure proper dermal protection in accordance with CSA, NIOSH, U.S. EPA and manufacturer's requirements.
- .5 Provide all workers and up to five (5) visitors to the site with proper hearing protection. Workers and visitors shall not be exposed to noise levels greater than 85 dB (A) over an eight hour shift without proper hearing protection, in accordance with the Hearing Conservation Program.
- .6 Provide all workers and up to five (5) visitors to the site with CSA approved eye protection sufficient to act as a protective barrier between the eye and airborne contaminants, hazardous materials and physical hazard.
- .7 Provide workers and up to five (5) visitors to the site with CSA approved hard hats meeting the CSA Z94.1.
- .8 Provide high visibility apparel as defined in Occupational Health and Safety Regulations.
- .9 Provide CSA approved safety boots meeting CSA Z195.
- .10 Provide other personal protective equipment, as may be required by the owner, depending on duties being performed.

**1.22 TRAFFIC CONTROL**

- .1 Provide traffic control measures when working on, or adjacent to, roadways in accordance with the "Traffic Control Manual for Roadwork Operations", Department of Transportation and Works.

**1.23 CONFINED SPACE WORK**

- .1 Comply with the Newfoundland and Labrador Occupational Health and Safety Regulations.
- .2 Ensure a hazard assessment has been conducted related to the confined space and the work to be performed within the space.
- .3 Provide approved air monitoring equipment where workers are working in confined spaces and ensure any test equipment to be used is calibrated, in good working order and used by trained persons.

- .4 Ensure all required PPE is provided to the workers and workers are trained in its use, care and selection.
- .5 Develop a confined space entry (CSE) program specific to the nature of work performed and in accordance with OH&S Act and Regulations and ensure supervisors and workers are trained in the confined space entry program. This shall include training on the CSE permit system, rescue plan, testing, communication equipment and all equipment and safe work procedures conducted in and around the confined space.
  - .1 Ensure that personal protective equipment and emergency rescue equipment appropriate to the nature of the work being performed is provided and used.
- .6 Provide and maintain training of workers through a provider certified by the WHSCC.
- .7 Provide Departmental Representative with a copy of an “Entry Permit” for each entry into the confined space to ensure compliance Provincial Legislation.

#### **1.24 HAZARDOUS MATERIALS**

- .1 Should material resembling hazardous materials (e.g. asbestos/mould) not previously identified/documentated be encountered during the execution of work, stop work and notify Departmental Representative. Do not proceed until written instructions have been received from Departmental Representative.
- .2 Unless otherwise noted the services of a recognized Environmental Consultant to provide all air monitoring and testing services required by regulatory requirements for hazardous materials abatement and repair.

#### **1.25 HEAVY EQUIPMENT**

- .1 Ensure mobile equipment used on jobsite is of the type specified in OH&S Act and Regulations fitted with a Roll Over Protective (ROP) Structure and Falling Object Protective (FOP) Structure.
- .2 Provide certificate of training in Power Line Hazards for operators of heavy equipment.
- .3 Obtain written clearance from the power utility where equipment is used in close proximity to (within 5.5 metres) overhead or underground power lines.
- .4 Equip cranes with:
  - .1 A mechanism which will effectively prevent the hook assembly from running into the top boom pulley.
  - .2 A legible load chart.
  - .3 A maintenance log book.

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 35 29.06 – Health and Safety Requirements**

**Page 12 of 12**

---

**1.26**

**WORK STOPPAGE**

- .1 Give precedence to safety and health of public and site personnel and protection of environment over cost and schedule considerations of Work.

**PART 2**

**PRODUCTS (NOT APPLICABLE)**

**PART 3**

**EXECUTION (NOT APPLICABLE)**

**END OF SECTION**



**PART 1**      **GENERAL**

**1.1**      **FIRES**

- .1      Fires and burning of rubbish on site not permitted.

**1.2**      **DISPOSAL OF WASTES**

- .1      Do not bury rubbish and waste materials on site.
- .2      Do not dispose of waste or volatile materials, such as mineral spirits, oil or paint thinner into waterways, storm or sanitary sewers.

**1.3**      **POLLUTION CONTROL**

- .1      Maintain temporary erosion and pollution control features installed under this contract.
- .2      Control emissions from equipment and plant to local authorities emission requirements.
- .3      Prevent sandblasting and other extraneous materials from contaminating air beyond application area, by providing temporary enclosures.
- .4      Cover or wet down dry materials and rubbish to prevent blowing dust and debris. Provide dust control for temporary roads.

**1.4**      **NOTIFICATION**

- .1      Departmental Representative will notify Contractor in writing of observed non-compliance with Federal, Provincial or Municipal environmental laws or regulations, permits, and other elements of environmental protection. Contractor: after receipt of such notice, inform Departmental Representative of proposed corrective action and take such action as approved by Departmental Representative.
- .2      Departmental Representative may issue stop order of work until satisfactory corrective action has been taken.
- .3      No time extensions will be granted or equitable adjustments allowed to Contractor for such suspensions.

---

**Wabush Airport Monorail & Hoist Replacement**  
**Wabush, NL**  
**Project No. R.073048.001**  
**Section 01 35 43 – Environmental Procedures**

---

Page 2 of 2

**PART 2**      **PRODUCTS (NOT APPLICABLE)**

**PART 3**      **EXECUTION (NOT APPLICABLE)**

**END OF SECTION**

**PART 1      GENERAL**

**1.1      SUMMARY**

- .1      Where building related projects involve work that could potentially disturb asbestos or lead based paints, disturbances must be carefully controlled by registered abatement contractors in accordance with the Occupational Health and Safety Regulations (OHS) and other applicable Sections in this Contract. The purpose of this procedure is to ensure that nuisance dust, not containing asbestos or lead, is controlled in an effective manner.
- .2      Section includes:
  - .1      Ensuring any maintenance, repair, construction or renovation activity that impacts building materials or creates dust is performed in such a way as to eliminate, minimize, contain and clean up any and all dust generated by the activity. This applies to work preparation, work activities and post-work activities.
  - .2      This applies to, but is not limited to, the following types of dust generating activities:
    - .1      Disturbing gypsum board, plaster or other surfacing materials.
    - .2      Disturbing concrete or wood containing materials.
    - .3      Handling or disturbing fibrous building insulation.
    - .4      Generating welding fumes: in addition to the requirements of this procedure, a hot work permit is also required to be completed by the contractor and submitted to the Departmental Representative for review if hot work is required in an occupied building.

**1.2      RELATED WORK**

- .1      Division 1 – General Requirements.

**1.3      REFERENCES**

- .1      Canadian General Standards Board (CGSB)
  - .1      CAN/CGSB-1.205, Sealer for Application to Asbestos-Fibre-Releasing Materials.
- .2      Canadian Standards Association (CSA)
  - .1      CAN/CSA Z317.13-F07, Infection Control During Construction, Renovation and Maintenance of Health Care Facilities.

**PART 2      PRODUCTS (NOT APPLICABLE)**

**PART 3      EXECUTION**

**3.1      PRE-WORK ACTIVITIES**

- .1      The contractor shall ensure the following prior to commencing work:
  - .1      Specific dust generating activities and associated controls shall be addressed in the Site Specific Health and Safety Plan.
  - .2      Workforce, including sub-contractors, must be made aware of the site dust control requirements.
  - .3      Check the various work zones within the building and adjacent areas to confirm the area are clean.
  - .4      Access to all active work areas shall be restricted to authorized contractors.
  - .5      For occupied buildings, dust generating activities shall be performed after normal hours of operations, unless prior permission is received from the Departmental Representative.

**3.2      WORK ACTIVITIES**

- .1      Dust producing projects shall be classified as small scale, medium scale or large scale projects, as detailed in paragraph 3.3.
- .2      For all dust generating activities, Contractor is required to have Site Safety Officer present to ensure dust control procedures are properly followed.
- .3      Any dust related complaints brought to the Contractors attention, must be immediately reported to Departmental Representative, and an incident investigation must be initiated to prevent reoccurrence.
- .4      Where practical, dust generation should be eliminated or minimized through the use of proper engineering controls (i.e. containment at source such as drilling wall surface through a wet sponge, wet suppression, use of HEPA vacuum equipped tools, etc).
- .5      Dust generating power tools shall be equipped with HEPA filtered dust collectors where practical. Power tools capable of generating dust without dust collection shall only be used in conjunction with suitable work area containment and with Departmental Representative approval.
- .6      Walk-off mats shall be employed for medium and large scale dust generating projects at all worker entrances/exits. Purpose of these mats is to trap dust from equipment and shoes of personnel leaving the dust contaminated work zone. Mats shall be vacuumed daily, or more frequently as necessary, using HEPA filtered vacuums. Mats shall be of sufficient size to place both feet on mat at once.

**END OF SECTION**

**PART 1**      **GENERAL**

**1.1**            **REFERENCES AND CODES**

- .1      Perform Work in accordance with National Building Code of Canada (NBC) including all amendments up to tender closing date and other codes of provincial or local application provided that in case of conflict or discrepancy, more stringent requirements apply.
- .2      Meet or exceed requirements of:
  - .1          Contract documents.
  - .2          Specified standards, codes and referenced documents.

**1.2**            **HAZARDOUS MATERIAL DISCOVERY**

- .1      Asbestos: stop work immediately should materials believed to contain asbestos be encountered in during the execution of the work and notify Departmental Representative. Do not proceed until written instructions have been received from Departmental Representative. Perform asbestos abatement and repair in accordance with Newfoundland and Labrador Asbestos Abatement Regulations, Latest Edition.
- .2      Mould: stop work immediately should material resembling mould be encountered during the execution of work and notify Departmental Representative. Do not proceed until written instructions have been received from Departmental Representative.

**1.3**            **BUILDING SMOKING ENVIRONMENT**

- .1      Comply with smoking restrictions.

**1.4**            **RELICS AND ANTIQUITIES**

- .1      Protect relics, antiquities, items of historical or scientific interest such as cornerstones and contents, commemorative plaques, inscribed tablets, and similar objects found during course of work.
- .2      Give immediate notice to Departmental Representative and await Departmental Representative's written instructions before proceeding with work in this area.
- .3      Relics, antiquities and items of historical or scientific interest remain Her Majesty's property.

---

**Wabush Airport Monorail & Hoist Replacement**  
**Wabush, NL**  
**Project No. R.073048.001**  
**Section 01 41 00 – Regulatory Requirements**

---

Page 2 of 2

**PART 2**      **PRODUCTS (NOT APPLICABLE)**

**PART 3**      **EXECUTION (NOT APPLICABLE)**

**END OF SECTION**

**PART 1      GENERAL**

**1.1      RELATED DOCUMENTS**

- .1 Drawings and general provisions of this contract, including General and Supplementary Conditions and other Division 1 Specification Sections, apply to this section.

**1.2      INDUSTRY STANDARDS**

- .1 Unless the Contract Documents include more stringent requirements, applicable construction industry standards have the same force and effect as if bound or copied directly into the Contract Documents to the extent referenced. Such standards are made part of the Contract Documents by reference.
- .2 All construction industry standards referenced in this specification to meet the edition of the standard referenced by the National Building Code of Canada (NBC). If the construction industry standard is not referenced in the National Building Code of Canada (NBC), the latest edition of the standard shall apply.
- .3 Each entity engaged in construction on this Project must be familiar with construction industry standards applicable to its construction activity. Copies of applicable standards are not bound with the Construction Documents.
  - .1 Where copies of construction industry standards are needed to perform a required construction activity, obtain copies directly from publication source and make them available upon request.

**1.3      ABBREVIATIONS AND ACRONYMS FOR INDUSTRY ORGANIZATIONS**

- .1 Where abbreviations and acronyms are used, they shall mean the recognized name of the entities in the following list. Names are believed to be accurate and up-to-date as of the date of the Contract Documents.
- .2 Industry Organizations:
  - .1 Air Conditioning and Mechanical Contractors Association (AMCA).
  - .2 Air Conditioning and Refrigeration Institute (ARI).
  - .3 Americans with Disability Act (ADA).
  - .4 Air Movement and Control Association (AMCA).
  - .5 The Aluminum Association, Inc. (AA).
  - .6 American Architectural Manufacturers Association (AAMA).
  - .7 American Association of State Highway and Transportation Officials (AASHTO).
  - .8 American Association of Textile Chemists and Colourists (AATCC).
  - .9 American Bearing Manufacturers Association (ABMA).

---

**Wabush Airport Monorail & Hoist Replacement  
Wabush, NL**

**Project No. R.073048.001  
Section 01 42 00 – References**

---

Page 2 of 5

- .10 American Boiler Manufacturer's Association (ABMA).
- .11 American Concrete Institute (ACI).
- .12 American Industrial Hygiene Association (AIHA).
- .13 American Institute of Steel Construction (AISC).
- .14 American Iron & Steel Institute (AISI).
- .15 American National Standards Institute (ANSI).
- .16 American Petroleum Institute (API).
- .17 American Society of Heating, Refrigerating and Air Conditioning Engineers (ASHRAE).
- .18 American Society of Mechanical Engineers (ASME).
- .19 American Society of Sanitary Engineer's (ASSE).
- .20 American Society for Testing and Materials (ASTM).
- .21 American Water Works Association (AWWA).
- .22 American Welding Society (AWS).
- .23 American Wood-Preservers' Association (AWPA).
- .24 Architectural Woodwork Institute (AWI).
- .25 Architectural Woodwork Manufacturers Association of Canada (AWMAC).
- .26 Asphalt Institute (AI).
- .27 Associated Air Balance Council (AABC).
- .28 Association of the Wall and Ceilings Industries International (AWEI).
- .29 Atomic Energy Control Board Regulations.
- .30 Brick Industry Association (BIA).
- .31 Building Industry Consulting Services International (BICSI).
- .32 Canada Green Building Council (CaGCB).
- .33 Canada Labour Code.
- .34 Canadian Council of Ministers of the Environment (CCME).
- .35 Canadian Code for Preferred Packaging.
- .36 Canadian Construction Materials Centre (CCMC).
- .37 Canadian Environmental Protection Act (CEPA).
- .38 Canadian Gas Association (CGA).
- .39 Canadian General Standards Board (CGSB).
- .40 Canadian Institute of Steel Construction (CISC).
- .41 Canadian Nursery Landscape Association (CNLA).
- .42 Canadian Paint Manufacturer's Association (CPMA).
- .43 Canadian Roofing Contractors' Association (CRCA).
- .44 Canadian Sheet Steel Building Institute (CSSBI).
- .45 Canadian Standards Association (CSA).
- .46 Canadian Steel Door and Frame Manufacturers' Association (CSDFMA).



---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 42 00 – References**

---

**Page 3 of 5**

- .47 Canadian Urethane Foam Contractors' Association Inc. (CUFCA).
- .48 Carpet and Rug Institute (CRI).
- .49 Ceramic Tile Institute (CTI).
- .50 Consumer Electronics Association (CEA).
- .51 Cooling Technology Institute (CTI).
- .52 Department of Justice Canada (Jus).
- .53 Electrical and Electronic Manufacturers' Association of Canada (EEMAC).
- .54 Electronic Industries Alliance (EIA).
- .55 Environment Canada (EC).
- .56 The Environmental Choice Program.
- .57 Environmental Protection Agency (EPA).
- .58 Environmental Protection Services (EPS).
- .59 ETL Listing Laboratories (ETL).
- .60 Factory Mutual (FM).
- .61 Federal Communications Commission (FCC).
- .62 Flat Glass Manufacturers Association (FGMA).
- .63 Green Seal Environmental Standards.
- .64 Health Canada - Workplace Hazardous Materials Information System (WHMIS).
- .65 Hydraulics Institute (HI).
- .66 Hydronic Institute of Boiler and Radiator Manufacturers (IBR).
- .67 Industry Canada - Terminal Attachment Program.
- .68 Institute of Electrical and Electronics Engineers (IEEE).
- .69 Institute for Research in Construction (IRC).
- .70 Insulated Cable Engineers Association (ICEA).
- .71 International ElectroTechnical Commission (IEC).
- .72 International Masonry Industry All-Weather Council (IMIAC).
- .73 International Standards Organization (ISO).
- .74 Laminators Safety Glass Association (LSGA).
- .75 Manufacturer's Standardization Society of the Valve and Fittings Industry (MSS).
- .76 Master Painters Institute (MPI).
- .77 National Energy Code of Canada for Buildings (NECB).
- .78 National Association of Architectural Metal Manufacturers (NAAMM).
- .79 National Association of Corrosion Engineers (NACE).
- .80 National Building Code of Canada (NBC).
- .81 National Bureau of Standards/Products Standard (NBS/PS).
- .82 National Electrical Manufacturers Association (NEMA).
- .83 National Environmental Balancing Bureau (NEBB).

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 42 00 – References**

---

**Page 4 of 5**

- .84 National Fire Code of Canada (NFC).
- .85 National Fire Protection Association (NFPA).
- .86 National Floor Covering Association (NFCA).
- .87 National Hardwood Lumber Association (NHLA).
- .88 National Lumber Grades Authority (NLGA).
- .89 National Plumbing Code of Canada (NPC).
- .90 National Research Council Canada (NRC).
- .91 National Roofing Contractors Association (NRCA).
- .92 National Sanitation Foundation (NSF).
- .93 Newfoundland Occupational Health and Safety Act.
- .94 Plumbing and Drainage Institute (PDI).
- .95 Province of Newfoundland and Labrador Building Accessibility Regulations.
- .96 Provincial Boiler, Pressure Vessel and Compressed Gas Regulations.
- .97 Scientific Equipment and Furniture Association (SEFA).
- .98 Sealant and Waterproofer's Institute.
- .99 Sheet Metal and Air Conditioning Contractors' National Association (SMACNA).
- .100 Society of Automotive Engineers (SAE).
- .101 The Society for Protective Coatings (SSPC).
- .102 South Coast Air Quality Management District (SCAQMD).
- .103 Telecommunications Distribution Methods Manual (TDMM).
- .104 Telecommunications Industries Association (TIA).
- .105 Terrazzo Tile and Marble Association of Canada (TTMAC).
- .106 Thermal Insulation Association of Canada (TIAC).
- .107 Transport Canada (TC).
- .108 Transport Canada - Marine Safety (TCMS).
- .109 Treasury Board of Canada (TB).
- .110 Treasury Board Information Technology Standard (TBITS).
- .111 Truss Plate Institute of Canada (TPIC).
- .112 Underwriters' Laboratories Inc. (UL).
- .113 Underwriter's Laboratories of Canada (ULC).
- .114 United States Federal Trade Commission (US Federal Trade Commission).
- .115 U.S. Coast Guard Equipment List (USCG).
- .116 U.S. Department of Transportation (DOT).

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 42 00 – References**

---

**Page 5 of 5**

**PART 2      PRODUCTS (NOT APPLICABLE)**

**PART 3      EXECUTION (NOT APPLICABLE)**

**END OF SECTION**

**PART 1**      **GENERAL**

**1.1**            **SECTIONS INCLUDE**

- .1      Inspection and testing, administrative and enforcement requirements.
- .2      Tests and mix designs.
- .3      Mock-ups.
- .4      Mill tests.
- .5      Equipment and system adjust and balance.

**1.2**            **RELATED SECTIONS**

- .1      Section 01 33 00 – Submittal Procedures
- .2      Section 01 78 00 – Closeout Submittals

**1.3**            **INSPECTION**

- .1      Allow Departmental Representative access to Work. If part of Work is in preparation at locations other than Place of Work, allow access to such Work whenever it is in progress.
- .2      Give timely notice requesting inspection if Work is designated for special tests, inspections or approvals by Departmental Representative instructions.
- .3      If Contractor covers or permits to be covered Work that has been designated for special tests, inspections or approvals before such is made, uncover such Work, have inspections or tests satisfactorily completed and make good such Work.
- .4      Departmental Representative may order any part of Work to be examined if Work is suspected to be not in accordance with Contract Documents. If, upon examination such work is found not in accordance with Contract Documents, correct such Work and pay cost of examination and correction. If such Work is found in accordance with Contract Documents, Departmental Representative shall pay cost of examination and replacement.

**1.4**            **INDEPENDENT INSPECTION AGENCIES**

- .1      Independent Inspection/Testing Agencies may be engaged by Departmental Representative for purpose of inspecting and/or testing portions of Work.
- .2      Provide equipment required for executing inspection and testing by appointed agencies.

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 45 00 – Quality Control**

**Page 2 of 3**

---

.3 Employment of inspection/testing agencies does not relax responsibility to perform Work in accordance with Contract Documents.

.4 If defects are revealed during inspection and/or testing, appointed agency will request additional inspection and/or testing to ascertain full degree of defect. Correct defect and irregularities as advised by Departmental Representative at no cost to Departmental Representative. Pay costs for retesting and reinspection.

**1.5 ACCESS TO WORK**

.1 Allow inspection/testing agencies access to Work, off site manufacturing and fabrication plants.

.2 Co-operate to provide reasonable facilities for such access.

**1.6 PROCEDURES**

.1 Notify appropriate agency and Departmental Representative in advance of requirement for tests, in order that attendance arrangements can be made.

.2 Submit samples and/or materials required for testing, as specifically requested in specifications. Submit with reasonable promptness and in an orderly sequence so as not to cause delay in Work.

.3 Provide labour and facilities to obtain and handle samples and materials on site. Provide sufficient space to store and cure test samples.

**1.7 REJECTED WORK**

.1 Remove defective Work, whether result of poor workmanship, use of defective products or damage and whether incorporated in Work or not, which has been rejected by Departmental Representative as failing to conform to Contract Documents. Replace or re-execute in accordance with Contract Documents.

.2 Make good other Contractor's work damaged by such removals or replacements promptly.

.3 If in opinion of Departmental Representative it is not expedient to correct defective Work or Work not performed in accordance with Contract Documents, the Department may deduct from Contract Price difference in value between Work performed and that called for by Contract Documents, amount of which shall be determined by Departmental Representative.

**1.8 REPORTS**

.1 Submit 3 copies of inspection and test reports to Departmental Representative, plus electronic copies in PDF format.

- .2 Provide copy to Subcontractor of work being inspected or tested, manufacturer or fabricator of material being inspected or tested.
- .3 Include copy of all inspection and test reports in Commissioning Manuals.

**1.9 MOCK-UPS**

- .1 Prepare mock-ups for Work specifically requested in specifications. Include for Work of all Sections required to provide mock-ups.
- .2 Construct in all locations acceptable to Departmental Representative as specified in specific Section.
- .3 Prepare mock-ups for Departmental Representative review with reasonable promptness and in an orderly sequence, so as not to cause any delay in Work.
- .4 Failure to prepare mock-ups in ample time is not considered sufficient reason for an extension of Contract Time and no claim for extension by reason of such default will be allowed.
- .5 Remove mock-up at conclusion of Work or when acceptable to Departmental Representative
- .6 Specification section identifies whether mock-up may remain as part of Work or if it is to be removed and when.
- .7 Reviewed and accepted mock-ups will become standards of workmanship and material against which installed work will be verified.
- .8 Mock-ups may remain as part of Work.

**1.10 EQUIPMENT AND SYSTEMS**

- .1 Submit adjustment and balancing reports for mechanical, electrical and building equipment systems.
- .2 Mechanical – coordinate with mechanical division.
- .3 Electrical – Coordinate with electrical division.

**PART 2      PRODUCTS (NOT APPLICABLE)**

**PART 3      EXECUTION (NOT APPLICABLE)**

**END OF SECTION**

**PART 1      GENERAL**

**1.1      RELATED SECTIONS**

- .1      Section 01 52 00 - Construction Facilities.
- .2      Section 01 56 00 - Temporary Barriers and Enclosures.

**1.2      INSTALLATION AND REMOVAL**

- .1      Provide temporary utilities controls in order to execute work expeditiously.
- .2      Remove from site all such work after use.

**1.3      TEMPORARY VENTILATION**

- .1      Pay for costs of ventilation used during construction, including costs of installation, fuel operation, maintenance and removal of equipment.
- .2      Provide temporary ventilation in enclosed areas as required to:
  - .1      Facilitate progress of Work.
  - .2      Protect Work and products against dampness and cold.
  - .3      Prevent moisture condensation on surfaces.
  - .4      Provide ambient temperatures and humidity levels for storage, installation and curing of materials.
  - .5      Provide adequate ventilation to meet health regulations for safe working environment.
- .3      Ventilating:
  - .1      Prevent accumulations of dust, fumes, mists, vapours or gases in areas occupied during construction.
  - .2      Provide local exhaust ventilation to prevent harmful accumulation of hazardous substances into atmosphere of occupied areas.
  - .3      Dispose of exhaust materials in manner that will not result in harmful exposure to persons.
  - .4      Ventilate storage spaces containing hazardous or volatile materials.
  - .5      Ventilate temporary sanitary facilities.
  - .6      Continue operation of ventilation and exhaust system for time after cessation of work process to assure removal of harmful contaminants.
- .4      Maintain strict supervision of operation of temporary ventilating equipment to:
  - .1      Conform with applicable codes and standards.
  - .2      Enforce safe practices.

- .3 Prevent abuse of services.
- .4 Prevent damage to finishes.
- .5 Vent direct-fired combustion units to outside.

**1.4 FIRE PROTECTION**

- .1 Provide and maintain temporary fire protection equipment during performance of Work required by insurance companies having jurisdiction and governing codes, regulations and bylaws.
- .2 Burning rubbish and construction waste materials is not permitted on site.

**1.5 TEMPORARY COMMUNICATION FACILITIES**

- .1 Provide and pay for temporary telephone, fax, data hook up, lines and equipment necessary for own use and use of Departmental Representative.

**1.6 SITE SIGN AND NOTICES**

- .1 Contractor is responsible for the construction of job sign frame and the installation of the plywood job sign. Timber frame shall be constructed as specified and detailed on "Job Sign Support Frame Detail". Plywood job sign shall be as per layout on "Job Sign Detail". These drawings documents are published at <http://www.tw.gov.nl.ca/works> under the Project Signs Link and is to be picked up by contractor at the Sign Shop, Dept of Transportation and Works, White Hills, St. John's, Newfoundland and Labrador. Plywood job sign and timber frame shall remain the property of the Owner and shall be disposed of at the discretion of the Department.
- .2 Locate job sign as directed by Departmental Representative so as to ensure good visibility by passing traffic.
- .3 Construct timber job sign frame using two (2) 140 x 140mm timber posts set vertically in concrete to a ground depth of 1000mm or below the frost line, whichever is greater. Install three (3) 38 x 89mm horizontal timber braces, all as shown on "Job Sign Support Frame Detail" published at <http://www.tw.gov.nl.ca/works> under the Project Signs Link. Attach plywood sign to timber frame using galvanized nails. Paint timber frame with two (2) coats of white paint if using untreated timber. Backfill compact and level ground around job sign frame to the satisfaction of the Departmental Representative.

**1.7 REMOVAL OF TEMPORARY FACILITIES**

- .1 Remove temporary facilities from site when directed by Departmental Representative.
- .2 When project is closed down at end of construction season keep temporary facilities operational until close down or removal is approved by Departmental Representative.



---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 51 00 – Temporary Utilities**

---

**Page 3 of 3**

**PART 2      PRODUCTS (NOT APPLICABLE)**

**PART 3      EXECUTION (NOT APPLICABLE)**

**END OF SECTION**

**PART 1**      **GENERAL**

**1.1**            **SECTION INCLUDES**

- .1      Construction aids.
- .2      Office and sheds.
- .3      Parking.
- .4      Project identification.

**1.2**            **RELATED SECTIONS**

- .1      Section 01 35 29.06 – Health and Safety Requirements
- .2      Section 01 51 00 - Temporary Utilities.
- .3      Section 01 56 00 - Temporary Barriers and Enclosures.

**1.3**            **INSTALLATION AND REMOVAL**

- .1      Provide construction facilities in order to execute work expeditiously.
- .2      Remove from site all such work after use.

**1.4**            **SCAFFOLDING**

- .1      Provide and maintain scaffolding in rigid, secure and safe manner.
- .2      Erect scaffolding independent of walls. Remove promptly when no longer required.  
Refer to Section 01 35 29.06 – Health and Safety Requirements.

**1.5**            **HOISTING**

- .1      Provide, operate and maintain hoists cranes required for moving of workers, materials and equipment. Make financial arrangements with Subcontractors for use thereof.
- .2      Hoists cranes shall be operated by certified operator.

**1.6**            **SITE STORAGE/LOADING**

- .1      Confine work and operations of employees by Contract Documents. Do not unreasonably encumber premises with products.
- .2      Do not load or permit to load any part of Work with a weight or force that will endanger the Work.

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 52 00 – Construction Facilities**

**Page 2 of 2**

---

**1.7 CONSTRUCTION PARKING**

- .1 Parking will be permitted on site provided it does not disrupt performance of work.
- .2 Provide and maintain adequate access to project site.
- .3 If authorized to use existing roads for access to project site, maintain such roads for duration of Contract and make good damage resulting from Contractor's use of roads.

**1.8 EQUIPMENT, TOOL AND MATERIALS STORAGE**

- .1 Provide and maintain, in a clean and orderly condition, lockable weatherproof sheds for storage of tools, equipment and materials.
- .2 Locate materials not required to be stored in weatherproof sheds on site in a manner to cause least interference with work activities.

**1.9 CLEAN-UP**

- .1 Remove construction debris, waste materials, packaging material from work site daily.
- .2 Clean dirt or mud tracked onto paved or surfaced roadways.
- .3 Store materials resulting from demolition activities that are salvageable.

**PART 2 PRODUCTS (NOT APPLICABLE)**

**PART 3 EXECUTION (NOT APPLICABLE)**

**END OF SECTION**

---

**Wabush Airport Monorail & Hoist Replacement  
Wabush, NL**

**Project No. R.073048.001**

Section 01 56 00 – Temporary Barriers and Enclosures

---

Page 1 of 3

**PART 1      GENERAL**

**1.1      SECTION INCLUDES**

- .1      Barriers.
- .2      Environmental Controls.
- .3      Traffic Controls.
- .4      Fire Routes.

**1.2      RELATED SECTIONS**

- .1      Section 01 51 00 – Temporary Utilities.
- .2      Section 01 52 00 – Construction Facilities.

**1.3      INSTALLATION AND REMOVAL**

- .1      Provide temporary controls in order to execute Work expeditiously.
- .2      Remove from site all such work after use.

**1.4      HOARDING**

- .1      Erect temporary site enclosures using 38 x 89 mm construction grade lumber framing at 600 mm centres, installed on 89 x 89 mm wood posts at 2400 mm centres or 50 mm dia. steel posts at 2400 mm centres. Posts to be place in post holes filled with concrete to minimum 900 mm depth. Finish temporary site enclosures with 1200 x 2400 x 13 mm exterior grade fir plywood to CSA O121 or chain link fence fabric to Section 32 31 13 – Chain Link Fences and Gates.
- .2      Apply plywood panels or chain link fence fabric vertically flush and butt jointed.
- .3      Provide one lockable truck entrance gate and at least one pedestrian door as directed and conforming to applicable traffic restrictions on adjacent streets. Equip gates with locks and keys.
- .4      Erect and maintain pedestrian walkways including roof and side covers, complete with signs and electrical lighting as required by law.
- .5      Paint public side of site enclosure in selected colours with one coat primer to CGSB 1.189M and one coat exterior paint to CGSB 1.59. Maintain public side of enclosure in clean condition.

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 56 00 – Temporary Barriers and Enclosures**

**Page 2 of 3**

---

- .6 Provide barriers around trees and plants designated to remain. Protect from damage by equipment and construction procedures.

**1.5 GUARD RAILS AND BARRICADES**

- .1 Provide secure, rigid guard rails and barricades around deep excavations, open shafts, open stair wells, open edges of floors and roofs.
- .2 Provide as required by governing authorities.

**1.6 DUST TIGHT SCREENS**

- .1 Provide dust tight screens or insulated partitions to localize dust generating activities, and for protection of workers, finished areas of Work and public.
- .2 Maintain and relocate protection until such work is complete.

**1.7 FIRE ROUTES**

- .1 Maintain access to property including overhead clearances for use by emergency response vehicles.

**1.8 PROTECTION FOR OFF-SITE AND PUBLIC PROPERTY**

- .1 Protect surrounding private and public property from damage during performance of Work.
- .2 Be responsible for damage incurred.

**1.9 PROTECTION OF BUILDING FINISHES**

- .1 Provide protection for finished and partially finished building finishes and equipment during performance of Work.
- .2 Provide necessary screens, covers, and hoardings.
- .3 Confirm with Departmental Representative locations and installation schedule 3 days prior to installation.
- .4 Be responsible for damage incurred due to lack of or improper protection.

---

**Wabush Airport Monorail & Hoist Replacement**  
**Wabush, NL**  
**Project No. R.073048.001**  
Section 01 56 00 – Temporary Barriers and Enclosures

---

Page 3 of 3

**PART 2**      **PRODUCTS (NOT APPLICABLE)**

**PART 3**      **EXECUTION (NOT APPLICABLE)**

**END OF SECTION**

**PART 1**      **GENERAL**

**1.1**            **SECTION INCLUDES**

- .1      Product quality, availability, storage, handling, protection, and transportation.
- .2      Manufacturer's instructions.
- .3      Quality of Work, coordination and fastenings.

**1.2**            **RELATED SECTIONS**

- .1      Section 01 45 00 – Quality Control.
- .2      Section 01 73 00 – Execution.

**1.3**            **REFERENCES**

- .1      Within text of each specifications section, reference may be made to reference standards. Conform to these reference standards, in whole or in part as specifically requested in specifications.
- .2      Conform to latest date of issue of referenced standards in effect on date of submission of Tenders, except where specific date or issue is specifically noted.

**1.4**            **QUALITY**

- .1      Products, materials, equipment and articles (referred to as products throughout specifications) incorporated in Work shall be new, not damaged or defective, and of best quality (compatible with specifications) for purpose intended. If requested, furnish evidence as to type, source and quality of products provided.
- .2      Defective products, whenever identified prior to completion of Work, will be rejected, regardless of previous inspections. Inspection does not relieve responsibility, but is precaution against oversight or error. Remove and replace defective products at own expense and be responsible for delays and expenses caused by rejection.
- .3      Should any dispute arise as to quality or fitness of products, decision rests strictly with Departmental Representative based upon requirements of Contract Documents.
- .4      Within 7 (seven) days of written request by Departmental Representative, submit following information for material and equipment proposed for supply:
  - .1      Name and address of manufacturer.
  - .2      trade name, model and catalogue number,
  - .3      performance, descriptive and test data,

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 61 00 – Common Product Requirements**

---

Page 2 of 7

- .4 manufacturer's installation or application instructions,
- .5 evidence of arrangements to procure.
- .5 Use products of one manufacturer for material and equipment of same type or classification unless otherwise specified.
- .6 Permanent labels, trademarks and nameplates on products are not acceptable in prominent locations, except where required for operating instructions, or when located in mechanical or electrical rooms.

**1.5 AVAILABILITY**

- .1 Immediately upon signing Contract, review product delivery requirements and anticipate foreseeable supply delays for any items. If delays in supply of products are foreseeable, notify Departmental Representative of such, in order that substitutions or other remedial action may be authorized in ample time to prevent delay in performance of work.
- .2 In event of failure to notify Departmental Representative at commencement of Work and should it subsequently appear that Work may be delayed for such reason, Departmental Representative reserves right to substitute more readily available products of similar character, at no increase in Contract Price or Contract Time.

**1.6 STORAGE, HANDLING AND PROTECTION**

- .1 Handle and store products in manner to prevent damage, adulteration, deterioration and soiling and in accordance with manufacturer's instructions when applicable.
- .2 Store packaged or bundled products in original and undamaged condition with manufacturer's seal and labels intact. Do not remove from packaging or bundling until required in Work.
- .3 Store products subject to damage from weather in weatherproof enclosures.
- .4 Store cementitious products clear of earth or concrete floors, and away from walls.
- .5 Keep sand, when used for grout or mortar materials, clean and dry. Store sand on wooden platforms and cover with waterproof tarpaulins during inclement weather.
- .6 Store sheet materials, lumber on flat, solid supports and keep clear of ground. Slope to shed moisture.
- .7 Store and mix paints in heated and ventilated room. Remove oily rags and other combustible debris from site daily. Take every precaution necessary to prevent spontaneous combustion.
- .8 Remove and replace damaged products at own expense and to satisfaction of Departmental Representative.



---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 61 00 – Common Product Requirements**

**Page 3 of 7**

---

- .9 Touch-up damaged factory finished surfaces to Departmental Representative satisfaction. Use touch-up materials to match original. Do not paint over name plates.

**1.7 TRANSPORTATION**

- .1 Pay costs of transportation of products required in performance of Work.

**1.8 MANUFACTURER'S INSTRUCTIONS**

- .1 Unless otherwise indicated in specifications, install or erect products in accordance with manufacturer's instructions. Do not rely on labels or enclosures provided with products. Obtain written instructions directly from manufacturers.
- .2 Notify Departmental Representative in writing, of conflicts between specifications and manufacturer's instructions, so that Departmental Representative may establish course of action.
- .3 Improper installation or erection of products, due to failure in complying with these requirements, authorizes Departmental Representative to require removal and re-installation at no increase in Contract Price or Contract Time.

**1.9 QUALITY OF WORK**

- .1 Ensure Quality of Work is of highest standard, executed by workers experienced and skilled in respective duties for which they are employed. Immediately notify Departmental Representative if required Work is such as to make it impractical to produce required results.
- .2 Do not employ anyone unskilled in their required duties. Departmental Representative reserves right to require dismissal from site, workers deemed incompetent or careless.
- .3 Decisions as to standard or fitness of Quality of Work in cases of dispute rest solely with Departmental Representative, whose decision is final.

**1.10 CO-ORDINATION**

- .1 Ensure cooperation of workers in laying out Work. Maintain efficient and continuous supervision.
- .2 Be responsible for coordination and placement of openings, sleeves and accessories.

**1.11 CONCEALMENT**

- .1 In finished areas, conceal pipes, ducts and wiring in floors, walls and ceilings, except where indicated otherwise.
- .2 Before installation, inform Departmental Representative if there is interference. Install as directed by Departmental Representative.

**1.12            REMEDIAL WORK**

- .1      Perform remedial work required to repair or replace parts or portions of Work identified as defective or unacceptable. Coordinate adjacent affected Work as required.
- .2      Perform remedial work by specialists familiar with materials affected. Perform in a manner to neither damage nor put at risk any portion of Work.

**1.13            LOCATION OF FIXTURES**

- .1      Consider location of fixtures, outlets, and mechanical and electrical items indicated as approximate.
- .2      Locate equipment, fixtures and distribution systems to provide minimum interference and maximum usable space and in accordance with manufacturer's recommendations for safety, access and maintenance.
- .3      Inform Departmental Representative of conflicting installation. Install as directed.
- .4      Submit field drawings to indicate relative position of various services and equipment when required by Departmental Representative.

**1.14            FASTENINGS GENERAL**

- .1      Provide metal fastenings and accessories in same texture, colour and finish as base metal in which they occur. Prevent electrolytic action between dissimilar metals. Use non-corrosive fasteners, anchors and spacers for securing exterior work, unless stainless steel or other material is specifically requested in affected specification section.
- .2      Space anchors within individual load limit or shear capacity and ensure they provide positive permanent anchorage. Wood plugs are not acceptable.
- .3      Conceal fasteners where indicated. Space evenly and lay out neatly.
- .4      Fastenings which cause Spalding or cracking are not acceptable.
- .5      Obtain Departmental Representative's approval before using explosive actuated fastening devices. If approval is obtained comply with CSA Z166.

**1.15            FASTENINGS - EQUIPMENT**

- .1      Use fastenings of standard commercial sizes and patterns with material and finish suitable for service.
- .2      Use heavy hexagon heads, semi-finished unless otherwise specified. Use No. 304 stainless steel for exterior areas.
- .3      Bolts may not project more than one diameter beyond nuts.

- .4 Use plain type washers on equipment, sheet metal and soft gasket lock type washers where vibrations occur. Use resilient washers with stainless steel.

**1.16 PROTECTION OF WORK IN PROGRESS**

- .1 Prevent overloading of any part of building. Do not cut, drill or sleeve any load bearing structural member, unless specifically indicated without written approval of Departmental Representative.

**1.17 EXISTING UTILITIES**

- .1 When breaking into or connecting to existing services or utilities, execute work at times directed by local governing authorities, with minimum of disturbance to work.
- .2 Protect, relocate or maintain existing active services. When services are encountered, cap off in manner approved by authority having jurisdiction. Stake and record location of capped service.
- .3 Submit schedule to and obtain approval from Departmental Representative for any shut-down or closure of active services or facility. Adhere to approved schedule and provide notice to affected parties.
- .4 Where unknown services are encountered, immediately advise Departmental Representative and confirm findings in writing.
- .5 Remove abandoned services lines within 2m of structures. Cap or otherwise seal lines at cut-off points as directed by Departmental Representative.

**1.18 SELECTION OF MATERIAL AND EQUIPMENT**

- .1 Material and equipment will be specified in the tender documents, and selected by Contractor, by one or more of the following methods:
  - .1 Specification by reference to a relevant Standard, such as CSA, ASTM, ULC, etc., select any material or equipment that meets or exceeds the specified.
  - .2 Specification by reference to an accepted product evaluation publication, such as the CGSB “Qualified Products List”, or CCMC Registry of Product Evaluations”, - select any manufacturer’s product so listed.
  - .3 Specification by Prescriptive or Performance specification – select any material or equipment meeting or exceeding specification.
  - .4 Specification by identification of one or more Manufacturer’s specific product(s) as an “Acceptable Product”, along with a listing of other manufacturers who may offer equivalent products – select any product so named, or select from equivalent product(s) of other listed manufacturers.
- .2 “Acceptable Product” is deemed to be a complete and working commodity as described by a manufacturer’s name, catalogue number, trade name, or any combination thereof, and will constitute the minimum standard of acceptance.

---

**Wabush Airport Monorail & Hoist Replacement**  
**Wabush, NL**  
**Project No. R.073048.001**

Section 01 61 00 – Common Product Requirements

Page 6 of 7

---

- .3 Departmental Representative will determine acceptability of Contractor's selection of material and equipment at time of Shop Drawing review.
- .4 When material or equipment is specified by a Standard, Prescriptive or Performance specification, upon request of the Departmental Representative, obtain from manufacturer an independent laboratory reporting, showing that material or equipment meets or exceeds the specified requirements.

**1.19 SUBSTITUTION OF MATERIAL AND EQUIPMENT**

- .1 **Prior to Tender** closing bidders may propose addition of other manufacturer's names to those listed in the tender documents providing requests are made in writing at least 7 days prior to tender closing date or bid depository where bid depository is used. Departmental Representative will inform all prospective bidders of decision by addendum, issued at least 5 days prior to the tender closing date.

Where no manufacturer's names are listed, the onus is on contractor to provide material and equipment to meet performance specification.

- .2 **After Contract award** substitutions of material or equipment, other than as selected by Contractor from those specified, will be considered by Departmental Representative only if:
  - .1 material or equipment selected from those specified are not available
  - .2 delivery date of material or equipment selected from those specified would unduly delay completion of the Contract; or
  - .3 alternative material or equipment to those specified, provided they are determined by the Departmental Representative to be equivalent to or better than those specified, will result in a credit to the Contract amount.
- .3 Requests for substitutions after Contract award must be accompanied by sufficient information in the form of shop drawings, manufacturer's literature, samples or other data to permit proper investigation of the substitutes used. Requests must also include statements of respective costs of material or equipment originally specified and the proposed substitution.
- .4 Should a proposed substitution be accepted after Contract award either in part or in whole, assume full responsibility and costs when substitution affects other work on Project. Contractor to pay for design or drawing changes required as a result of the substitution.
- .5 Amounts of all credits arising from approval of substitutions after Contract award will be determined by Departmental Representative and the Contract amount will be reduced accordingly.

---

**Wabush Airport Monorail & Hoist Replacement**  
**Wabush, NL**  
**Project No. R.073048.001**  
**Section 01 61 00 – Common Product Requirements**

---

Page 7 of 7

**PART 2**      **PRODUCTS (NOT APPLICABLE)**

**PART 3**      **EXECUTION (NOT APPLICABLE)**

**END OF SECTION**

**PART 1**      **GENERAL**

**1.1**            **SECTION INCLUDES**

- .1      Requirements and limitations for cutting and patching the Work.

**1.2**            **RELATED SECTIONS**

- .1      Section 01 11 00 - Summary of Work.
- .2      Section 01 33 00 - Submittal Procedures.

**1.3**            **SUBMITTALS**

- .1      Submit written request in advance of cutting or alteration which affects:
  - .1      Structural integrity of any element of Project.
  - .2      Integrity of weather-exposed or moisture-resistant elements.
  - .3      Efficiency, maintenance, or safety of any operational element.
  - .4      Visual qualities of sight-exposed elements.
  - .5      Work of Owner or separate contractor.
- .2      Include in request:
  - .1      Identification of Project.
  - .2      Location and description of affected Work.
  - .3      Statement on necessity for cutting or alteration.
  - .4      Description of proposed Work, and products to be used.
  - .5      Alternatives to cutting and patching.
  - .6      Effect on Work of Owner or separate contractor.
  - .7      Written permission of affected separate contractor.
  - .8      Date and time work will be executed.

**1.4**            **PREPARATION**

- .1      Inspect existing conditions, including elements subject to damage or movement during cutting and patching.
- .2      After uncovering, inspect conditions affecting performance of Work.
- .3      Beginning of cutting or patching means acceptance of existing conditions.
- .4      Provide supports to assure structural integrity of surroundings; provide devices and methods to protect other portions of project from damage.

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 73 00 – Execution**

---

Page 2 of 3

- .5 Provide protection from elements for areas which may be exposed by uncovering work; maintain excavations free of water.
- .6 Obtain Departmental Representative's approval before cutting, boring or sleeving load-bearing members.

**1.5 EXECUTION**

- .1 Execute cutting, fitting, and patching including excavation and fill, to complete Work.
- .2 Fit several parts together, to integrate with other Work.
- .3 Uncover Work to install ill-timed Work.
- .4 Remove and replace defective and non-conforming Work.
- .5 Provide openings in non-structural elements of Work for penetrations of mechanical and electrical Work.
- .6 Execute Work by methods to avoid damage to other Work, and which will provide proper surfaces to receive patching and finishing.
- .7 Employ original installer to perform cutting and patching for weather-exposed and moisture-resistant elements, and sight-exposed surfaces.
- .8 Cut rigid materials using masonry saw or core drill. Pneumatic or impact tools not allowed on masonry work without prior approval.
- .9 Restore work with new products in accordance with requirements of Contract Documents.
- .10 Fit Work to pipes, sleeves, ducts, conduit, and other penetrations through surfaces.
- .11 Refinish surfaces to match adjacent finishes: For continuous surfaces refinish to nearest intersection; for an assembly, refinish entire unit.
- .12 Conceal pipes, ducts and wiring in floor, wall and ceiling construction of finished areas except where indicated otherwise.
- .13 Make cuts with clean, true, smooth edges.
- .14 Where new work connects with existing, and where existing work is altered, cut, patch and make good to match existing work.

**1.6 WASTE MANAGEMENT AND DISPOSAL**

- .1 Separate waste materials in accordance with Section 01 74 21 – Construction/Demolition Waste Management and Disposal.

---

**Wabush Airport Monorail & Hoist Replacement**  
**Wabush, NL**  
**Project No. R.073048.001**  
**Section 01 73 00 – Execution**

---

Page 3 of 3

**PART 2**      **PRODUCTS (NOT APPLICABLE)**

**PART 3**      **EXECUTION (NOT APPLICABLE)**

**END OF SECTION**



**PART 1      GENERAL**

**1.1            GENERAL**

- .1      Conduct cleaning and disposal operations to comply with local ordinances and anti-pollution laws.
- .2      Store volatile waste in covered metal containers and remove from premises at end of each working day.
- .3      Provide adequate ventilation during use of volatile or noxious substances. Use for building ventilation systems is not permitted for this purpose.

**1.2            RELATED SECTION**

- .1      Section 01 77 00 - Closeout Procedures.

**1.3            PROJECT CLEANLINESS**

- .1      Maintain Work in tidy condition, free from accumulation of waste products and debris, other than that caused by Owner or other Contractors.
- .2      Remove waste materials and debris from site at the end of each working day. Do not burn waste materials on site.
- .3      Make arrangements with and obtain permits from authorities having jurisdiction for disposal of waste and debris.
- .4      Provide on-site containers for collection of waste materials and debris.
- .5      Clean interior areas prior to start of finish work, maintain areas free of dust and other contaminants during finishing operations.
- .6      Store volatile waste in covered metal containers, and remove from premises at end of each working day.
- .7      Provide adequate ventilation during use of volatile or noxious substances. Use of building ventilation systems is not permitted for this purpose.
- .8      Use only cleaning materials recommended by manufacturer of surface to be cleaned, and as recommended by cleaning material manufacturer.
- .9      Schedule cleaning operations so that resulting dust, debris and other contaminants will not fall on wet, newly painted surfaces nor contaminate building systems.

**1.4 FINAL CLEANING**

- .1 Refer to General Conditions.
- .2 When Work is Substantially Performed, remove surplus products, tools, construction machinery and equipment not required for performance of remaining Work.
- .3 Remove waste products and debris other than that caused by others, and leave Work clean and suitable for occupancy.
- .4 When the Work is Totally Performed, remove surplus products, tools, construction machinery and equipment. Remove waste products and debris other than that caused by the Owner or other Contractors.
- .5 Remove waste materials from the site at regularly scheduled times or dispose of as directed by the Departmental Representative. Do not burn waste materials on site.
- .6 Make arrangements with and obtain permits from authorities having jurisdiction for disposal of waste and debris.
- .7 Leave the work broom clean before the inspection process commences.
- .8 Clean and polish glass, mirrors, hardware, wall tile, stainless steel, chrome, porcelain enamel, baked enamel, plastic laminate, and mechanical and electrical fixtures. Replace broken, scratched or disfigured glass.
- .9 Remove stains, spots, marks and dirt from decorative work, electrical and mechanical fixtures, furniture fitments, walls, floors and ceilings.
- .10 Clean lighting reflectors, lenses, and other lighting surfaces.
- .11 Vacuum clean and dust building interiors, behind grilles, louvres and screens.
- .12 Wax, seal, shampoo or prepare floor finishes, as recommended by manufacturer.
- .13 Inspect finishes, fitments and equipment and ensure specified workmanship and operation.
- .14 Broom clean and wash exterior walks, steps and surfaces; rake clean other surfaces of grounds.
- .15 Remove dirt and other disfiguration from exterior surfaces.
- .16 Clean and sweep roofs.
- .17 Sweep and wash clean paved areas.
- .18 Clean equipment and fixtures to a sanitary condition; clean or replace filters of mechanical equipment.

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 74 11 – Cleaning**

---

**Page 3 of 3**

- .19 Remove snow and ice from access to building.

**1.5 WASTE MANAGEMENT AND DISPOSAL**

- .1 Separate waste materials in accordance with Section 01 74 21 - Construction/Demolition Waste Management and Disposal.

**PART 2      PRODUCTS (NOT APPLICABLE)**

**PART 3      EXECUTION (NOT APPLICABLE)**

**END OF SECTION**

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 74 21 – Construction/Demolition Waste Management and Disposal**      **Page 1 of 4**

---

**PART 1**      **GENERAL**

**1.1**      **SECTION INCLUDES**

- .1      Text, schedules and procedures for systematic Waste Management Program for construction, deconstruction, demolition, and renovation projects, including:
  - .1      Diversion of Materials.
  - .2      Waste Audit (WA) - Schedule A.
  - .3      Waste Reduction Workplan (WRW) - Schedule B.
  - .4      Demolition Waste Audit (DWA) - Schedule C.
  - .5      Cost/Revenue Analysis Workplan (CRAW) - Schedule D.
  - .6      Materials Source Separation Program (MSSP).
  - .7      Canadian Governmental Responsibility for the Environment Resources - Schedule E.

**1.2**      **DEFINITIONS**

- .1      Demolition Waste Audit (DWA): Relates to actual waste generated from project.
- .2      Materials Source Separation Program (MSSP): Consists of series of ongoing activities to separate reusable and recyclable waste material into material categories from other types of waste at point of generation.
- .3      Recyclable: Ability of product or material to be recovered at end of its life cycle and re-manufactured into new product for reuse by others.
- .4      Recycle: Process by which waste and recyclable materials are transformed or collected for purpose of being transferred into new products.
- .5      Recycling: Process of sorting, cleansing, treating and reconstituting solid waste and other discarded materials for purpose of using in altered form. Recycling does not include burning, incinerating, or thermally destroying waste.
- .6      Reuse: Repeated use of product in same form but not necessarily for same purpose. Reuse includes:
  - .1      Salvaging reusable materials from re-modelling projects, before demolition stage, for resale, reuse on current project or for storage for use on future projects.
  - .2      Returning reusable items including pallets or unused products to vendors.
- .7      Salvage: Removal of structural and non-structural materials from deconstruction/disassembly projects for purpose of reuse or recycling.
- .8      Separate Condition: Refers to waste sorted into individual types.

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 74 21 – Construction/Demolition Waste Management and Disposal**    **Page 2 of 4**

---

- .9      Source Separation: Acts of keeping different types of waste materials separate beginning from first time they became waste.

**1.3                    MATERIALS SOURCE SEPARATION PROGRAM (MSSP)**

- .1      Prepare MSSP and have ready for use prior to project start-up.
- .2      Implement MSSP for waste generated on project in compliance with approved methods and as reviewed by authorities having jurisdiction.
- .3      Provide on-site facilities for collection, handling, and storage of anticipated quantities of reusable and recyclable materials.
- .4      Provide containers to deposit reusable and recyclable materials.
- .5      Locate containers in locations, to facilitate deposit of materials without hindering daily operations.
- .6      Locate separated materials in areas which minimize material damage.
- .7      Collect, handle, store on-site, and transport off-site, salvaged materials in separate condition.
  - .1      Transport to recycling facility.

**1.4                    STORAGE, HANDLING AND PROTECTION**

- .1      Unless specified otherwise, materials for removal become Contractor's property.
- .2      Protect, stockpile, store and catalogue salvaged items.
- .3      Separate non-salvageable materials from salvaged items. Transport and deliver non-salvageable items to approved local facility.
- .4      Protect structural components not removed for demolition from movement or damage.
- .5      Support affected structures. If safety of building is endangered, cease operations and immediately notify Department having jurisdiction.
- .6      Protect surface drainage, mechanical and electrical from damage and blockage.
- .7      Separate and store materials produced during dismantling of structures in designated areas.
- .8      Prevent contamination of materials to be salvaged and recycled and handle materials in accordance with requirements for acceptance by designated facilities.
  - .1      On-site source separation is recommended.

---

**Wabush Airport Monorail & Hoist Replacement  
Wabush, NL**

**Project No. R.073048.001**

Section 01 74 21 – Construction/Demolition Waste Management and Disposal    Page 3 of 4

---

**1.5                    DISPOSAL OF WASTES**

- .1       Do not bury rubbish or waste materials.
- .2       Do not dispose of any waste into waterways, storm, or sanitary sewers.
- .3       Remove materials from deconstruction as deconstruction/disassembly Work progresses.
- .4       Prepare project summary to verify destination and quantities on a material-by-material basis as identified in pre-demolition material audit.

**1.6                    USE OF SITE AND FACILITIES**

- .1       Execute work with least possible interference or disturbance to normal use of premises.
- .2       Provide security measures approved by Departmental Representative.

**1.7                    SCHEDULING**

- .1       Coordinate Work with other activities at site to ensure timely and orderly progress of Work.

**PART 2                PRODUCTS (NOT APPLICABLE)**

**PART 3                EXECUTION**

**3.1                    APPLICATION**

- .1       Handle waste materials not reused, salvaged, or recycled in accordance with appropriate regulations and codes.

**3.2                    CLEANING**

- .1       Remove tools and waste materials on completion of Work, and leave work area in clean and orderly condition.
- .2       Clean-up work area as work progresses.
- .3       Source separate materials to be reused/recycled into specified sort areas.

**3.3                    DIVERSION OF MATERIALS**

- .1       From following list, separate materials from general waste stream and stockpile in separate piles or containers, as reviewed by Departmental Representative and consistent with applicable fire regulations.

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 74 21 – Construction/Demolition Waste Management and Disposal**    **Page 4 of 4**

---

- .1      Mark containers or stockpile areas.
- .2      Provide instruction on disposal practices.
- .2      On-site sale or distribution of salvaged materials to third parties is not permitted.

**END OF SECTION**

**PART 1      GENERAL**

**1.1      RELATED SECTIONS**

- .1      Section 01 74 11 - Cleaning.
- .2      Section 01 78 00 - Closeout Submittals.
- .3      Section 01 91 13 – General Commissioning (Cx) Requirements.

**1.2      FINAL INSPECTION AND DECLARATION PROCEDURES**

- .1      Contractor's Inspection: The Contractor and all Subcontractors shall conduct an inspection of Work, identify deficiencies and defects; repair as required. Notify the Departmental Representative in writing of satisfactory completion of the Contractor's Inspection and that corrections have been made. Request an Departmental Representative's Consultant's Inspection.
- .2      Departmental Representative's Inspection: Departmental Representative and the Contractor will perform an inspection of the Work to identify obvious defects or deficiencies. The contractor shall correct Work accordingly.
- .3      Completion: submit written certificate that the following have been performed:
  - .1      Work has been completed and inspected for compliance with Contract Documents.
  - .2      Defects have been corrected and deficiencies have been completed.
  - .3      Equipment and systems have been tested, adjusted and balanced and are fully operational.
  - .4      Certificates required by Fire Commissioner, Utility companies have been submitted.
  - .5      Operation of systems have been demonstrated to Departmental personnel.
  - .6      Work is complete and ready for Final Inspection.
- .4      Final Inspection: When items noted above are completed, request final inspection of Work by the Departmental Representative, representative of DTW and the Contractor. If Work is deemed incomplete by the Departmental Representative, complete outstanding items and request a reinspection.
- .5      Declaration of Substantial Performance: When the Departmental Representative considers deficiencies and defects have been corrected and it appears requirements of Contract have been substantially performed, make application for Certificate of Substantial Performance. Refer to General Conditions for specifics to application.



---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 77 00 – Closeout Procedures**

**Page 2 of 2**

---

- .6 Commencement of Lien and Warranty Periods: The date of DTW acceptance of the submitted declaration of Substantial Performance shall be the date for commencement for the warranty period and commencement of the lien period.
- .7 Declaration of Total Performance: When the Departmental Representative considers final deficiencies and defects have been corrected and it appears requirements of the Contract have been totally performed, make application for certificate of Total Performance. Refer to General Conditions for specifics to application. If Work is deemed incomplete by the Consultant, complete the outstanding items and request a reinspection.

**1.3 REINSPECTION**

- .1 Should status of work require reinspection by Departmental Representative due to failure of work to comply with Contractor's claims for inspection, the Department will deduct amount of compensation for reinspection services from payment to Contractor.

**PART 2      PRODUCTS (NOT APPLICABLE)**

**PART 3      EXECUTION (NOT APPLICABLE)**

**END OF SECTION**

**PART 1**      **GENERAL**

**1.1**            **SECTION INCLUDES**

- .1      As-built, samples, and specifications.
- .2      Equipment and systems.
- .3      Product data, materials and finishes, and related information.
- .4      Operation and maintenance data.
- .5      Spare parts, special tools and maintenance materials.
- .6      Warranties and bonds.
- .7      Final site survey.

**1.2**            **RELATED SECTIONS**

- .1      Section 01 33 00 – Submittal Procedures.
- .2      Section 01 45 00- Quality Control.
- .3      Section 01 77 00 - Closeout Procedures.
- .4      Section 01 91 13 – General Commissioning (Cx) Requirements.

**1.3**            **SUBMISSION**

- .1      Prepare instructions and data using personnel experienced in maintenance and operation of described products.
- .2      Submit one copy of completed volumes in final form 15 days prior to final inspection.
- .3      Copy will be returned after final inspection, with Departmental Representative's comments.
- .4      Revise content of documents as required prior to final submittal.
- .5      Two weeks prior to Substantial Performance of the Work, submit to the Departmental Representative, two final copies of operating and maintenance manuals.

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 78 00 – Closeout Submittals**

---

**Page 2 of 9**

- .6 Ensure spare parts, maintenance materials and special tools provided are new, undamaged or defective, and of same quality and manufacture as products provided in Work.
- .7 If requested, furnish evidence as to type, source and quality of products provided.
- .8 Defective products will be rejected, regardless of previous inspections. Replace products at own expense.
- .9 Pay costs of transportation.

**1.4 FORMAT**

- .1 Organize data in the form of an instructional manual.
- .2 Binders: vinyl, hard covered, 3 'D' ring, loose leaf 219 x 279 mm with spine and face pockets.
- .3 When multiple binders are used, correlate data into related consistent groupings. Identify contents of each binder on spine.
- .4 Cover: Identify each binder with type or printed title 'Project Record Documents'; list title of project and identify subject matter of contents.
- .5 Arrange content under Section numbers and sequence of Table of Contents.
- .6 Provide tabbed fly leaf for each separate product and system, with typed description of product and major component parts of equipment.
- .7 Text: Manufacturer's printed data, or typewritten data.
- .8 Drawings: provide with reinforced punched binder tab. Bind in with text; fold larger drawings to size of text pages.
- .9 Provide CAD files in DWG format on CD. Also provide electronic files in PDF format.

**1.5 CONTENTS - EACH VOLUME**

- .1 Table of Contents: provide title of project; names, addresses, and telephone numbers of Consultant and Contractor with name of responsible parties; schedule of products and systems, indexed to content of volume.
- .2 For each product or system:
  - .1 List names, addresses and telephone numbers of subcontractors and suppliers, including local source of supplies and replacement parts.
- .3 Product Data: mark each sheet to clearly identify specific products and component parts, and data applicable to installation; delete inapplicable information.

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 78 00 – Closeout Submittals**

---

**Page 3 of 9**

- .4 Drawings: supplement product data to illustrate relations of component parts of equipment and systems, to show control and flow diagrams.
- .5 Typewritten Text: as required to supplement product data. Provide logical sequence of instructions for each procedure, incorporating manufacturer's instructions specified in Section 01 45 00 - Quality Control.
- .6 Training: Refer to Section 01 91 13 – General Commissioning (Cx) Requirements.

**1.6 AS-BUILTS AND SAMPLES**

- .1 In addition to requirements in General Conditions, maintain at the site for Departmental Representative one record copy of:
  - .1 Contract Drawings.
  - .2 Specifications.
  - .3 Addenda.
  - .4 Change Orders and other modifications to the Contract.
  - .5 Reviewed shop drawings, product data, and samples.
  - .6 Field test records.
  - .7 Inspection certificates.
  - .8 Manufacturer's certificates.
- .2 Store record documents and samples in field office apart from documents used for construction. Provide files, racks, and secure storage.
- .3 Label record documents and file in accordance with Section number listings in List of Contents of this Project Manual. Label each document "PROJECT RECORD" in neat, large, printed letters.
- .4 Maintain record documents in clean, dry and legible condition. Do not use record documents for construction purposes.
- .5 Keep record documents and samples available for inspection by Departmental Representative.

**1.7 RECORDING ACTUAL SITE CONDITIONS**

- .1 Record information on set of blue line opaque drawings, provided by Departmental Representative.
- .2 Provide felt tip marking pens, maintaining red color pens for recording information.
- .3 Record information concurrently with construction progress. Do not conceal Work until required information is recorded.

- .4 Contract Drawings and shop drawings: legibly mark each item to record actual construction, including:
  - .1 Measured depths of elements of foundation in relation to finish first floor datum.
  - .2 Measured horizontal and vertical locations of underground utilities and appurtenances, referenced to permanent surface improvements.
  - .3 Measured locations of internal utilities and appurtenances, referenced to visible and accessible features of construction.
  - .4 Field changes of dimension and detail.
  - .5 Changes made by change orders.
  - .6 Details not on original Contract Drawings.
  - .7 References to related shop drawings and modifications.
- .5 Specifications: legibly mark each item to record actual construction, including:
  - .1 Manufacturer, trade name, and catalogue number of each product actually installed, particularly optional items and substitute items.
  - .2 Changes made by Addenda and change orders.
- .6 Other Documents: submit manufacturer's certifications, inspection certifications, field test records, required by individual specifications sections.
- .7 At completion of project provide all recorded information on print drawings or alternatively transfer to CAD files in DWG format. Submit DWG files, also with electronic files in PDF format as part of the Closeout Submittals..

## **1.8 EQUIPMENT AND SYSTEMS**

- .1 Each Item of Equipment and Each System: include description of unit or system, and component parts. Give function, normal operation characteristics, and limiting conditions. Include performance curves, with engineering data and tests, and complete nomenclature and commercial number of replaceable parts.
- .2 Panel board circuit directories: provide electrical service characteristics, controls, and communications.
- .3 Include installed colour coded wiring diagrams.
- .4 Operating Procedures: include start-up, break-in, and routine normal operating instructions and sequences. Include regulation, control, stopping, shut-down, and emergency instructions. Include summer, winter, and any special operating instructions.
- .5 Maintenance Requirements: include routine procedures and guide for trouble-shooting; disassembly, repair, and reassembly instructions; and alignment, adjusting, balancing, and checking instructions.
- .6 Provide servicing and lubrication schedule, and list of lubricants required.

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 78 00 – Closeout Submittals**

---

**Page 5 of 9**

- .7 Include manufacturer's printed operation and maintenance instructions.
- .8 Include sequence of operation by controls manufacturer.
- .9 Provide original manufacturer's parts list, illustrations, assembly drawings, and diagrams required for maintenance.
- .10 Provide installed control diagrams by controls manufacturer.
- .11 Provide Contractor's coordination drawings, with installed colour coded piping diagrams.
- .12 Provide charts of valve tag numbers, with location and function of each valve, keyed to flow and control diagrams.
- .13 Provide list of original manufacturer's spare parts, current prices, and recommended quantities to be maintained in storage.
- .14 Include test and balancing reports
- .15 Additional requirements: As specified in individual specification sections.

**1.9 MATERIALS AND FINISHES**

- .1 Building Products, Applied Materials, and Finishes: include product data, with catalogue number, size, composition, and colour and texture designations. Provide information for re-ordering custom manufactured products.
- .2 Instructions for cleaning agents and methods, precautions against detrimental agents and methods, and recommended schedule for cleaning and maintenance.
- .3 Moisture-protection and Weather-exposed Products: include manufacturer's recommendations for cleaning agents and methods, precautions against detrimental agents and methods, and recommended schedule for cleaning and maintenance.
- .4 Additional Requirements: as specified in individual specifications sections.

**1.10 SPARE PARTS**

- .1 Provide spare parts, in quantities specified in individual specification sections.
- .2 Provide items of same manufacture and quality as items in Work.
- .3 Deliver to site location as directed; place and store.
- .4 Receive and catalogue all items. Submit inventory listing to Departmental Representative. Include approved listings in Maintenance Manual.
- .5 Obtain receipt for delivered products and submit prior to final payment.

**1.11 MAINTENANCE MATERIALS**

- .1 Provide maintenance and extra materials, in quantities specified in individual specification sections.
- .2 Provide items of same manufacture and quality as items in Work.
- .3 Deliver to site location as directed; place and store.
- .4 Receive and catalogue all items. Submit inventory listing to Departmental Representative. Include approved listings in Maintenance Manual.
- .5 Obtain receipt for delivered products and submit prior to final payment.

**1.12 SPECIAL TOOLS**

- .1 Provide special tools, in quantities specified in individual specification section.
- .2 Provide items with tags identifying their associated function and equipment.
- .3 Deliver to project site place and store.
- .4 Receive and catalogue all items. Submit inventory listing to Departmental Representative. Include approved listings in Maintenance Manual.

**1.13 STORAGE, HANDLING AND PROTECTION**

- .1 Store spare parts, maintenance materials, and special tools in manner to prevent damage or deterioration.
- .2 Store in original and undamaged condition with manufacturer's seal and labels intact.
- .3 Store components subject to damage from weather in weatherproof enclosures.
- .4 Store paints and freezable materials in a heated and ventilated room.
- .5 Remove and replace damaged products at own expense and to satisfaction of Departmental Representative.

**1.14 WARRANTIES AND BONDS**

- .1 Develop warranty management plan to contain information relevant to Warranties.
- .2 Submit warranty management plan to Departmental Representative's approval.
- .3 Warranty management plan to include required actions and documents to assure that the Department receives warranties to which it is entitled.

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 78 00 – Closeout Submittals**

**Page 7 of 9**

---

- .4 Provide plan in narrative form and contain sufficient detail to make it suitable for use by future maintenance and repair personnel.
- .5 Assemble approved information in binder and submit upon acceptance of work. Organize binder as follows:
  - .1 Separate each warranty or bond with index tab sheets keyed to Table of Contents listing.
  - .2 List subcontractor, supplier, and manufacturer, with name, address, and telephone number of responsible principal.
  - .3 Obtain warranties and bonds, executed in duplicate by subcontractors, suppliers, and manufacturers, within ten days after completion of the applicable item of work.
  - .4 Except for items put into use with Departmental permission, leave date of beginning of time of warranty until the Date of Substantial Performance is determined.
  - .5 Verify that documents are in proper form, contain full information, and are notarized.
  - .6 Co-execute submittals when required.
  - .7 Retain warranties and bonds until time specified for submittal.
- .6 Include information contained in warranty management plan as follows:
  - .1 Roles and responsibilities of personnel associated with warranty process, including points of contact and telephone numbers within the organizations of Contractors, subcontractors, manufacturers or suppliers involved.
  - .2 Listing and status of delivery of Certificates of Warranty for extended warranty items, to include chain hoist and motorized trolley system.
  - .3 Provide list for each warranted equipment, item, feature of construction or system indicating:
    - .1 Name of item.
    - .2 Model and serial numbers.
    - .3 Location where installed.
    - .4 Name and phone numbers of manufacturers or suppliers.
    - .5 Names, addresses and telephone numbers of sources of spare parts.
    - .6 Warranties and terms of warranty: include one-year overall warranty of construction. Indicate items that have extended warranties and show separate warranty expiration dates.
    - .7 Cross-reference to warranty certificates as applicable.
    - .8 Starting point and duration of warranty period.
    - .9 Summary of maintenance procedures required to continue warranty in force.
    - .10 Cross-Reference to specific pertinent Operation and Maintenance manuals.



---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 78 00 – Closeout Submittals**

**Page 8 of 9**

---

- .11 Organization, names and phone numbers of persons to call for warranty service.
- .12 Typical response time and repair time expected for various warranted equipment.
- .4 Procedure and status of tagging of equipment covered by extended warranties.
- .5 Post copies of instructions near selected pieces of equipment where operation is critical for warranty and/or safety reasons.
- .7 Respond in a timely manner to oral or written notification of required construction warranty repair work.
- .8 Written verification will follow oral instructions. Failure to respond will be cause for the Departmental Representative to proceed with action against Contractor.

**1.15 PRE-WARRANTY CONFERENCE**

- .1 Meet with Departmental Representative to develop understanding of requirements of this section. Schedule meeting prior to contract completion, and at time designated by Departmental Representative.
- .2 Departmental Representative will establish communication procedures for:
  - .1 Notification of construction warranty defects.
  - .2 Determine priorities for type of defect.
  - .3 Determine reasonable time for response.

**1.16 WARRANTY TAGS**

- .1 Tag, at time of installation, each warranted item. Provide durable, oil and water resistant tag approved by Departmental Representative.
- .2 Leave date of acceptance until project is accepted for occupancy.
- .3 Indicate following information on tag:
  - .1 Type of product/material.
  - .2 Model number.
  - .3 Serial number.
  - .4 Contract number.
  - .5 Warranty period.
  - .6 Inspector's signature.
  - .7 Construction Contractor.

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 78 00 – Closeout Submittals**

---

**Page 9 of 9**

**PART 2      PRODUCTS (NOT APPLICABLE)**

**PART 3      EXECUTION (NOT APPLICABLE)**

**END OF SECTION**

**PART 1**      **GENERAL**

**1.1**            **SUMMARY**

- .1      Section Includes
  - .1      General requirements relating to commissioning of project's components and systems, specifying general requirements for Installation Verification and Performance Verification of components, equipment, sub-systems, systems, and integrated systems.
- .2      Acronyms
  - .1      CxA – Commissioning Authority.
  - .2      Cx – Commissioning.
  - .3      EMCS – Energy Monitoring and Control Systems.
  - .4      O&M – Operation and Maintenance.
  - .5      PV – Performance Verification.
  - .6      TAB – Testing, Adjusting and Balancing.
  - .7      GC – General Contractor
  - .8      TSI – Technical Services Inspector
  - .9      LEED - Leadership in Energy and Environmental Design

**1.2**            **COMMISSIONING INTENT**

- .1      Undertake Cx to bring the facility to a fully operational state and free of deficiencies in the most effective and timely manner available, ensuring the design intent is met by all systems.
- .2      Cx incorporates inspection and quality assurance activities as construction progresses, including start up, installation verification, performance verification, fine tuning, and operator training.
- .3      Bear all costs associated with the required personnel and test equipment as outlined in specification sections and Cx Manual and all costs with organizing and managing the activities of the applicable subtrades as identified in this section.
- .4      Fully document all tests and inspections performed during the construction, at start up, installation verification and performance verification and fine tuning. Incorporate into final commissioning documentation.
- .5      Provide direct training to designated staff responsible for the operation and maintenance of the building equipment and systems.

**1.3**            **RELATED SECTIONS**

- .1      Section 01 45 00 - Quality Control.

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 91 13 – Commissioning (Cx) Requirements**

**Page 2 of 17**

---

- .2 Section 01 77 00 - Closeout Procedures.
- .3 Section 01 78 00 - Closeout Submittals.
- .4 Section 01 91 33 - Commissioning (Cx) Forms.
- .5 Section 01 91 41 - Commissioning (Cx) Training.

**1.4 COMMISSIONING OVERVIEW**

- .1 Cx is a planned program of tests, procedures and checks carried out systematically on systems and integrated systems of the finished project.
- .2 Cx is an intensive quality assurance process that begins at the beginning of the project and continues through to the first year of occupancy. The process focuses upon verifying and documenting that the facility and all of its systems and assemblies are planned, designed, installed, tested, operated, and maintained to meet the Department's Project Requirements.
- .3 Cx activities supplement field quality and testing procedures described in relevant technical sections.
- .4 Cx identifies issues in Planning and Design stages which are addressed during Construction and Cx stages to ensure the built facility is constructed and proven to operate satisfactorily under weather, environmental and occupancy conditions to meet functional and operational requirements. Cx activities include transfer of critical knowledge to facility operational personnel.
- .5 Complete inspection and verification activities as required by the specifications and Cx Manual as construction progresses.
- .6 Take responsibility to:
  - .1 Review the Cx manual with the commissioning team.
  - .2 Complete all items as identified in the Cx manual. This includes work by subcontractors, test agencies, equipment representatives and manufacturer agents.
  - .3 Review Contract Documents and inspect the Work to ensure completeness of the Work and compliance with the Contract Documents.
  - .4 Correct deficiencies resulting from installation and performance verifications.
  - .5 Test, adjust and balance equipment and systems identified in Divisions 2-44.
  - .6 Submit the completed manual and project record documents as specified.
  - .7 Update the documentation manuals prior to each project meeting.
- .7 The Substantial Completion Certificate will not be issued until the commissioning process is completed and the final reports and commissioning documentation are received.

- .8 The Cx Manual provides direction for the Cx process during design and construction, provides resolution for issues such as scheduling, roles and responsibilities, lines of communication and reporting, approvals and coordination.

## **1.5 COMMISSIONING TEAM**

- .1 The commissioning team shall consist of: *(as applicable to project)*
- .1 Department Representative(s):
    - .1 Design Manager (DM).
    - .2 Construction Manager (CM).
    - .3 Project Coordinator (PC).
    - .4 Engineer/Architect/Consultant (AE).
    - .5 Technical Services Inspectors (TSI).
  - .2 User Representatives/Department.
  - .3 General Contractor (GC):
    - .1 Mechanical Contractor.
    - .2 Fire Protection Contractor.
    - .3 Controls Contractor (CC).
    - .4 Electrical Contractor.
    - .5 Fire Alarm Contractor.
    - .6 Security Systems Contractor.
    - .7 Communications Systems Contractor.
  - .4 Commissioning Authority (CxA).
  - .5 Manufacturer's Technicians.
  - .6 Testing Agencies.
  - .7 Building Manager (BM).
  - .8 Design Consultant (DC).
- .2 Roles of the commissioning team shall be as follows:
- .1 CxA (Commissioning Authority):
    - .1 Reviews Departmental Project Requirements, Basis of Design and design documents at all stages of submittal and provides comments to the DM.
    - .2 Records all comments as history for the project commissioning.
    - .3 Produces the Commissioning Manual for review by the DM and DC, and modifies based on their comments as necessary.
    - .4 Provides "Issued for Construction" Commissioning Manual to the DM.
    - .5 Provides guidance on the Commissioning Process, and responsibilities of Commissioning Team members.
    - .6 Reviews contractor shop drawings for related commissioning information.

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 91 13 – Commissioning (Cx) Requirements**

**Page 4 of 17**

---

- .7 Coordinates and chairs (in person or via teleconference) the commissioning kick-off meeting and progress meetings.
- .8 Prepares and distributes the meeting agenda and minutes.
- .9 Attends when necessary Installation Verification.
- .10 Reviews completed Installation Verification checklists and signs off.
- .11 Attends Performance Verification and signs off on check lists.
- .12 Attends owner training sessions.
- .13 Verifies that training is complete.
- .14 Reviews completed Cx manual as submitted by the contractor.
- .15 Prepares Summary Commissioning Report and submits to the CM.
- .16 Prepares letter for CM indicating acceptance of the completed commissioning activities.
- .17 Verifies that seasonal or deferred Commissioning is completed.
- .18 Coordinates ten (10) month building review and issues occupant survey.

**.2 DM (Design Manager):**

- .1 Reviews Departmental Project Requirements, Basis of Design and design documents at all stages of submittal. Compiles all comments from all reviewers and submits to document originator.
- .2 Submits all documentation required by the CxA in a timely manner.
- .3 Identifies Cx team members.
- .4 Provides a list of equipment and systems included in the design to the CxA for inclusion in preliminary manual.
- .5 Reviews Cx manual in draft and final revisions. Provides comments to the CxA as necessary on the Commissioning Manual.
- .6 Forwards the Cx Manual for review by the DC, receives comments and issues them to the CxA.
- .7 Ensures that the Cx Manual is issued with the tender documents.
- .8 Issues IFC Cx Manual to the CM.
- .9 Reviews contractor shop drawings and provide comments to the CM.
- .10 Attends Cx kick-off meeting during the design phase.
- .11 Attends commissioning progress meetings as required.
- .12 Attends Installation Verification as required.
- .13 Attends Cx Performance Verification or provides representative.
- .14 Attends training sessions or sends representative knowledgeable in the design.
- .15 Assists with ten (10) month building review.

**.3 CM (Construction Manager):**

- .1 Main contact for CxA during construction phase.
- .2 Distributes "Issued for Construction" Cx Manual to GC.

---

**Wabush Airport Monorail & Hoist Replacement  
Wabush, NL**

**Project No. R.073048.001**

**Section 01 91 13 – Commissioning (Cx) Requirements**

Page 5 of 17

---

- .3 Notifies CxA of any Cx related issues raised during construction (i.e. change orders).
  - .4 Provides times during any project meetings to discuss Cx with the entire team.
  - .5 Attends Cx meetings (construction phase).
  - .6 Coordinates Cx schedule for Installation Verification and Performance Verification with GC and ensures all TW representatives are available to witness testing as required for Installation Verification and Performance Verification.
  - .7 Attend Performance Verification.
  - .8 Ensures Cx Team is following/completing Cx Manual.
  - .9 Coordinates training schedules, and arranges for video recording of sessions if required.
  - .10 Reviews project record documents.
  - .11 Ensures that O&M manuals, maintenance materials, as-built drawings and warranties have been submitted and reviewed.
  - .12 Provides CxA with reviewed As Built documents, O&M Manuals, and Warranties for inclusion in the Summary Commissioning Report.
  - .13 Receives the completed Cx Manual from the GC and submits to the CxA for review.
  - .14 Receives the Summary Commissioning Report from the CxA and submits to the Department.
  - .15 Coordinates ten (10) month building review and issues occupant survey.
  - .16 Verifies that all maintenance materials, spare parts and tools are received from the GC as per specifications.
- .4 **BM (Building Manager):**
- .1 Reviews the Basis of Design developed by the DC and provides comments to the DM.
  - .2 Reviews all design documents and provides comments to the DM.
  - .3 Coordinates maintenance staff participation in Cx activities.
  - .4 Reviews O&M documentation and attends training.
  - .5 Attends all training sessions.
  - .6 Receives and retains a copy of the Commissioning Summary Report.
  - .7 Provides maintenance representatives to facilitate the 10 month building review as necessary.
  - .8 Attends commissioning meetings as necessary.
- .5 **GC (General Contractor):**
- .1 Maintains as-built drawings on site during construction.

---

**Wabush Airport Monorail & Hoist Replacement  
Wabush, NL**

**Project No. R.073048.001**

**Section 01 91 13 – Commissioning (Cx) Requirements**

---

Page 6 of 17

- .2 Submits shop drawing in accordance with the specifications.
- .3 Ensures the Cx Manual is on site and being completed and kept up to date by all sub-trades.
- .4 Executes the Cx process ensuring that sub-trades perform their responsibilities and integrate Cx into the construction process.
- .5 Ensures equipment manufacturers and vendors provide documentation to facilitate the Commissioning work and perform startups.
- .6 Coordinates and schedules Cx activities, submits schedule for review and comment by TW staff.
- .7 Conducts Installation Verification and signs off checklists.
- .8 Provides written confirmation all systems are operational prior to start of Performance Verification.
- .9 Conducts Performance Verification with all required Commissioning Team members present.
- .10 Ensures that all required personal are available for the verification.
- .11 Maintains an up to date version of the Cx manual on site with checklists completed on installed/operational systems.
- .12 Provides all required training.
- .13 Coordinates location, schedule.
- .14 Provides facilities (location, materials).
- .15 Ensures qualified factory trained technicians are available to facilitate training.
- .16 Provides copies of all training material.
- .17 Obtains occupancy approvals/permits.
- .18 Submits completed manual to CM.
- .19 Provides the following information for inclusion in the Commissioning Summary Report.
  - .20 Training Records.
  - .21 Operation and Maintenance Manuals.
  - .22 Warranties.
  - .23 Completed commissioning Checklists.
  - .24 List of spare parts turned over.
  - .25 Supplies maintenance materials and tools as per specification.
  - .26 Attends all commissioning meetings.
- .6 PC (Project Coordinator):
  - .1 If there is no PC assigned to the project, then these duties are completed by the CM.
  - .2 Attends Installation Verification and Performance Verification demonstrations.
  - .3 Ensures Cx manual is on site and kept up to date by the GC.



---

**Wabush Airport Monorail & Hoist Replacement  
Wabush, NL**

**Project No. R.073048.001**

**Section 01 91 13 – Commissioning (Cx) Requirements**

Page 7 of 17

---

- .4 Verifies maintenance materials are provided by the GC as per the contract documents.
  - .5 Ensures GC is maintaining as-built drawings on site during construction.
  - .6 Attends training sessions as necessary and directed by the CM.
  - .7 Attends all commissioning meetings.
- .7 TSI (Technical Services Inspector):
- .1 Attends Installation Verification and Performance Verification for equipment within their discipline.
  - .2 Signs off on commissioning checklists within their discipline.
  - .3 Attends training sessions as necessary and directed by the CM.
  - .4 Attends all commissioning meetings.
- .8 Sub Trades:
- .1 Demonstrates correct system performance.
  - .2 Perform commissioning duties as directed by the GC.
- .9 DC (Design Consultant):
- .1 Reviews the Departmental Project Requirements and provides comment to the DM.
  - .2 Produces the Basis of Design and submits to the DM for review and comment. Revise as necessary based on comments and changes in Departmental Project Requirements.
  - .3 Develops system descriptions and forwards to the CxA, for inclusion in the Cx Manual.
  - .4 Reviews drafts of the Cx Manual, including the installation and Performance Verification checklists, and provides comments to the DM.
  - .5 Provides project narrative for inclusion in the Cx Manual.
  - .6 The DC shall provide to the CxA a complete list of all equipment and information required to populate the commissioning checklists with the following information:
    - .1 identification number.
    - .2 location.
    - .3 type, proposed manufacture, make, model.
    - .4 operating parameter (max, normal, min).
    - .5 electrical requirements.
    - .6 control comments.
    - .7 other pertinent information.
  - .7 Incorporates commissioning specification into the project documents.
  - .8 Reviews contractor shop drawing submittals.

---

**Wabush Airport Monorail & Hoist Replacement  
Wabush, NL**

**Project No. R.073048.001**

**Section 01 91 13 – Commissioning (Cx) Requirements**

---

Page 8 of 17

- .9 Attends periodic site visits to ensure systems meet the design intent and operate as outline in the specifications.
  - .10 Attends and signs off checklist for Installation Verification.
  - .11 Attends Performance Verification and signs off on checklists for the appropriate discipline.
  - .12 Develops and submits Systems Manuals to the CM (these will be included in the Commissioning Summary Report).
  - .13 Provides system overview during training.
  - .14 Attends training as required.
  - .15 Attends commissioning meetings.
  - .16 Attends ten (10) month building review activities.
- .10 Department:
- .1 Produces the Departmental Project Requirements and submits to the DM.
  - .2 Reviews the Basis of Design developed by the DC and provides comments to the DM.
  - .3 Reviews all design documents and provides comments to the DM.
  - .4 Coordinates maintenance staff participation in Cx activities.
  - .5 Reviews O&M documentation and attends training.
  - .6 Attends all training sessions.
  - .7 Receives and retains a copy of the Commissioning Summary Report.
  - .8 Provides maintenance representatives to facilitate the ten (10) month building review as necessary.
  - .9 Attends commissioning meetings as necessary .

**1.6 NON-CONFORMANCE TO PERFORMANCE VERIFICATION REQUIREMENTS**

- .1 During Cx, should equipment, system components, and associated controls be identified as incorrectly installed, malfunctioning or not performing as per specifications, the contractor shall correct deficiencies, re-verify equipment and components within the system, including related systems as deemed necessary by Engineer/Architect, to ensure effective and accurate operation.
- .2 Minor deficiencies may be corrected at the time of identification. For systems requiring major repairs, the Commissioning Team shall move on to the next system to be commissioning. The Contractor shall notify the CM when the work is complete.
- .3 Costs for corrective work, additional tests, inspections, to determine acceptability and proper performance of such items to be borne by Contractor.

**1.7 CONFLICTS**

- .1 Report conflicts between requirements of this section, other sections, and the Cx Manual to the CM to obtain clarification prior to the start of work.
- .2 Failure to report conflict and obtain clarification will result in application of most stringent requirement.

**1.8 SUBMITTALS**

- .1 Prior to starting Cx the Contractor shall provide a set of equipment and system submittals. These submittals are supplemented by the installation and start-up procedures, O&M data, performance data, control drawings and any changes that may affect commissioned systems.
- .2 Submit no later than four (4) weeks after award of Contract:
  - .1 Name of Contractor's Cx coordinator.
  - .2 Preliminary Cx schedule. Submit final Cx schedule to CxA for review prior to performance verification.
  - .3 Submit the names of all personnel for approval by the CxA. Designate who has managerial responsibilities for coordination of installation verification and performance verification.
  - .4 Submit documentation to confirm personnel compliance with quality assurance provisions.
- .3 Any changes to the information submitted must be re-submitted. Ensure certified trades persons, certified testing agencies and/or factory authorized personnel participate in commissioning tasks.
- .4 Prior to start of Performance Verification:
  - .1 Submit TAB report to CxA for review.
  - .2 Submit start-up documentation to CxA for review.
  - .3 Submit completed Installation Verification checklists.
- .5 Fifteen (15) days prior to application for Substantial Completion:
  - .1 Submit three (3) copies of final commissioning manual and applicable forms to the CM for review.
  - .2 Submit reports of performance verifications postponed due to seasonal, climatic, occupancy, or other reasons beyond the Contractor's control, promptly after execution of those services.
- .6 Ensure each form bears the required signatures as indicated on the form.
- .7 Submit as-built drawings, schematics, O&M manuals, maintenance materials and warranties to CM for review.

---

**Wabush Airport Monorail & Hoist Replacement  
Wabush, NL**

**Project No. R.073048.001**

**Section 01 91 13 – Commissioning (Cx) Requirements**

Page 10 of 17

---

- .8 Where structurally attached equipment is included in the scope of work, engage a third party Professional Structural Engineer, licensed to practice in the Province of Newfoundland and Labrador, for submission of stamped and signed shop drawings indicating acceptable mounting procedures for all equipment which is suspended, mounted or otherwise attached. The Structural Engineer to also verify correct installation of the equipment. This equipment will include but is not limited:

.1 Monorail and support structural steel.

#### **1.9 COMMISSIONING DOCUMENTATION**

- .1 Refer to Section 01 91 33 - Commissioning (Cx) Forms for requirements and instructions for use as well as the Cx Manual
- .2 Checklists will be provided to the Contractor by the CM during the construction stage.
- .3 Installing subcontractors are to date and initial the checklists as construction and verifications are completed.
- .4 The general contractor is to submit completed checklists to the CxA for review and acceptance.
- .5 Once all documents have been reviewed and accepted the general contractor shall submit final commissioning documents in electronic form (PDF) and original signed copies.

#### **1.10 COMMISSIONING SCHEDULE**

- .1 Submit preliminary Cx schedule in Gantt Chart format to CxA no later than four (4) weeks after award of contract. A sample Cx Schedule is provided in the Cx Manual.
- .2 Submit final Cx schedule in Gantt Chart format to CxA for review four (4) weeks prior to performance verification. A sample Cx Schedule is provided in the Cx Manual.
- .3 Provide adequate time for Cx activities prescribed in technical sections, commissioning sections and the Cx manual including all on site activities as well as documentation procedures. Time should be allowed for re-verification should any system be rejected upon completion of initial verification.
- .4 Provide adequate time for training.

#### **1.11 COMMISSIONING MEETINGS**

- .1 The CM will convene Cx meeting consisting of all members of the design and construction teams to address building systems to be commissioned. Items to be discussed will include commissioning requirements, completion and start-up schedules, and roles and responsibilities.
- .2 CxA to make necessary updates and changes to the CxManual and deliver to the CM who will distribute to all other parties as necessary.

---

**Wabush Airport Monorail & Hoist Replacement  
Wabush, NL**

**Project No. R.073048.001**

**Section 01 91 13 – Commissioning (Cx) Requirements**

Page 11 of 17

---

- .3 Convene Cx meetings following project meetings and as specified herein to resolve issues, monitor progress and identify deficiencies relating to Cx.
- .4 Continue Cx meetings on regular basis until commissioning deliverables have been addressed.
- .5 At 60% construction completion stage CxA to call a separate Cx meeting to review progress, discuss schedule of equipment start-up activities and prepare for Cx. Issues at meeting to include:
  - .1 Review duties and responsibilities of Contractor and subcontractors, addressing delays and potential problems.
  - .2 Determine the degree of involvement of trades and manufacturer's representatives in the commissioning process.
- .6 Thereafter Cx meetings to be held until project completion and as required during equipment start-up and functional testing period.
- .7 Meetings will be chaired by the CxA or CM, meeting minutes will be prepared and issued by the CxA or CM. Clarifications to the minutes must be submitted within 5 days of issue, after which, the issued set becomes the official project record.
- .8 Ensure subcontractors and relevant manufacturer representatives are present at 60% and subsequent Cx meetings and as required.

**1.12 STARTING AND TESTING**

- .1 Contractor assumes liabilities and costs for inspections, including disassembly and re-assembly after approval, starting, testing and adjusting, and supply of testing equipment, and all associated costs of installation and performance verification.

**1.13 WITNESSING OF STARTING AND TESTING**

- .1 Provide twenty eight (28) days' notice prior to commencement.
- .2 Departmental Representative to witness start-up and testing.
- .3 Contractor's Cx Coordinator to be present at tests performed and documented by sub-trades, suppliers and equipment manufacturers.

**1.14 MANUFACTURER'S INVOLVEMENT**

- .1 The Contractor shall obtain manufacturers installation, start-up and operations instructions prior to start-up of components, equipment and systems..
  - .1 Compare completed installation with manufacturer's published data, record discrepancies, and review with manufacturer.
  - .2 Modify procedures detrimental to equipment performance and review same with manufacturer before start-up.

- .2 Integrity of warranties:
  - .1 Use manufacturer's trained start-up personnel where specified elsewhere in other divisions or required to maintain integrity of warranty.
  - .2 Verify with manufacturer that testing as specified will not void warranties.
- .3 Qualifications of manufacturer's personnel:
  - .1 Experienced in design, installation and operation of equipment and systems.
  - .2 Ability to interpret test results accurately.
  - .3 Ability to report results in clear, concise, logical manner.

**1.15 PROCEDURES**

- .1 Verify that equipment and systems are complete, clean, and operating in normal and safe manner prior to conducting Performance Verification.
- .2 Conduct Commissioning in following distinct phases:
  - .1 Included in delivery and installation:
    - .1 Verification of conformity to specification, approved shop drawings and completion of product information report forms.
    - .2 Visual inspection of quality of installation.
  - .2 Installation Verification: follow accepted start-up procedures.
  - .3 Performance Verification: document equipment performance. Include repetition of tests after correcting deficiencies.
  - .4 Post-substantial performance verification: to include fine-tuning.
- .3 Correct deficiencies and obtain approval from CxA after distinct phases have been completed and before commencing next phase.
- .4 Document required tests on checklists provided in the Cx Manual as well on any supplied Manufacturer forms.
- .5 Failure to follow accepted Commissioning Processes will result in re-evaluation of equipment by an independent testing agency selected by CxA. If results reveal that equipment Commissioning Process was not in accordance with requirements, and resulted in damage to equipment, implement following:
  - .1 Minor equipment/systems: if evaluation report concludes that damage is minor, implement corrective measures approved by CxA.
  - .2 Major equipment/systems: If evaluation report concludes that major damage has occurred, CxA shall reject equipment to be removed from site and replaced with new.
  - .3 Subject new equipment/systems to specified Commissioning Process

---

**Wabush Airport Monorail & Hoist Replacement  
Wabush, NL**

**Project No. R.073048.001**

Section 01 91 13 – Commissioning (Cx) Requirements

Page 13 of 17

---

**1.16 COMMISSIONING DOCUMENTATION**

- .1 Assemble Installation Verification documentation and submit to CxA for approval before commencement of Performance Verification.
- .2 Installation Verification documentation to include:
  - .1 Factory and on-site test certificates for specified equipment.
  - .2 Inspection reports.
  - .3 Signed Installation Verification check lists.
  - .4 Start-up reports.
  - .5 Step-by-step description of complete start-up procedures, to permit the contractor or CxA to repeat start-up at any time.

**1.17 OPERATION AND MAINTENANCE OF EQUIPMENT AND SYSTEMS**

- .1 After Performance Verification, operate and maintain equipment and systems as directed by equipment/system manufacturer.
- .2 With assistance of manufacturer develop written maintenance program and submit to CxA for approval before implementation.
- .3 Operate and maintain systems for minimum twenty one (21) days for commissioning to be completed.
- .4 After completion of commissioning, operate and maintain systems until issuance of Substantial Completion

**1.18 TEST RESULTS**

- .1 If start-up, testing and/or performance verification produce unacceptable results, repair, replace or repeat specified starting and/or performance verification procedures until acceptable results are achieved.
- .2 Provide personnel, resources and materials, assume all costs for re-verification.

**1.19 INSTRUMENTS / EQUIPMENT**

- .1 Submit to CxA for review and approval:
  - .1 Complete list of instruments proposed to be used.
  - .2 Listed data including, serial number, current calibration certificate, calibration date, calibration expiry date and calibration accuracy.
- .2 Provide all required equipment to complete commissioning.

**1.20 PERFORMANCE VERIFICATION**

- .1 Notify CxA at least twenty eight (28) days prior to start of Performance Verifications.

- .2 Start Performance Verification after elements of building affecting start-up and performance verification of systems have been completed.
- .3 Ensure all HVAC systems have been thoroughly cleaned.
- .4 Conduct performance verification once identified pre-requisite activities are completed for a system and approved by the CxA.
- .5 Test all building systems including architectural, structural, civil, mechanical and electrical components and operating procedures by challenging these systems to realistic operating conditions and train operational staff.
- .6 Run systems through all sequences of operation and verify response of components.
- .7 Notwithstanding all-inclusive requirements specified in this section, additional separate commissioning may be required at a later date for equipment and systems whose full operation is dependent on seasonal conditions. Job conditions for Peak Performance Verification are as follows:
  - .1 Summer sequence commissioning to take place between June 1<sup>st</sup> and September 15<sup>th</sup> when outside ambient temperatures are at least 22°C;
  - .2 Winter sequence commissioning to take place between November 1<sup>st</sup> and March 31<sup>st</sup> when outside ambient temperature is no greater than minus 10°C.
- .8 Carry out Cx:
  - .1 Under actual operating conditions, over entire operating range, in all modes.
  - .2 On independent systems and interacting systems.
- .9 Cx procedures to be repeatable and reported results are to be verifiable.
- .10 Follow equipment manufacturer's operating instructions.
- .11 EMCS trending to be available as supporting documentation for performance verification.
- .12 Contractor to obtain all documentation, including updated points list, controls sequences and setpoints, and submit documentation to commissioning authority for review. At completion of commissioning, scan completed manuals to electronic format on CD(s) in PDF format as required and submit to CxA.

## **1.21 WITNESSING COMMISSIONING**

- .1 CxA along with designated representatives to witness activities and verify results.

## **1.22 AUTHORITIES HAVING JURISDICTION**

- .1 Where specified start-up, testing or commissioning procedures duplicate verification requirements of authority having jurisdiction, arrange for authority to witness procedures so as to avoid duplication of tests and to facilitate expedient acceptance of facility.



- .2 If the CxA is not available to witness, the certificates of approval from the Authority Having Jurisdiction will be accepted as adequate.
- .3 Obtain certificates of approval, acceptance and compliance with rules and regulation of authority having jurisdiction.
- .4 Provide copies to CxA within 5 days of test and with Cx report.

**1.23 REPEAT VERIFICATIONS**

- .1 Assume costs incurred by Department's Commissioning representatives for second and subsequent verifications where:
  - .1 Verification of reported results fails to receive CxA's approval.
  - .2 Repetition of second verification again fails to receive approval.
  - .3 CxA deems Contractor's request for second verification was premature.

**1.24 DEFICIENCIES, FAULTS, DEFECTS**

- .1 Report problems, faults or defects affecting Cx to Engineer/Architect in writing. Stop Cx until problems are rectified. Proceed with written approval from CxA.
- .2 Correct deficiencies found during start-up and Cx to satisfaction of CxA.

**1.25 COMPLETION OF COMMISSIONING**

- .1 Upon completion of Cx leave systems in normal operating mode.
- .2 Except for warranty and seasonal verification activities, complete Cx prior to application for Substantial Completion.
- .3 Cx to be considered complete when all Cx deliverables have been submitted and accepted by CxA.
- .4 The CxA is to compile a Final Commissioning Report summarizing all tasks, findings and documentation of the commissioning process. The Final Commissioning Report is to incorporate all test reports by sub-contractors, manufacturer's and controlling authorities including the following list. The Contractor shall turn over all materials per this specification.
  - .1 Evaluation of operating condition of the systems at the time of functional test completion.
  - .2 Deficiencies that were discovered and measures taken to correct them.
  - .3 Functional test procedures and results.
  - .4 Documentation of all commissioning field activities as they progressed.
  - .5 Description and estimated schedule of required deferred testing.
- .5 The Contractor to provide O&M manuals, maintenance materials, warranties and training records.

**1.26            ACTIVITIES UPON COMPLETION OF COMMISSIONING**

- .1        When changes are made to baseline components or system settings established during Cx process notify the CxA. The CxA will update and provide Cx forms for affected item.

**1.27            TRAINING**

- .1        In accordance with Section 01 91 41 - Commissioning (Cx) – Training, the Cx Manual and respective technical sections.

**1.28            MAINTENANCE MATERIALS, SPARE PARTS, SPECIAL TOOLS**

- .1        Supply, deliver, and document maintenance materials, spare parts, and special tools as specified in contract. Provide transmittal documenting all materials provided.

**1.29            OCCUPANCY**

- .1        Cooperate fully with CxA during stages of acceptance and occupancy of facility.

**1.30            PERFORMANCE VERIFICATION TOLERANCES**

- .1        Application tolerances:
  - .1            Specified range of acceptable deviations of measured values from specified values or specified design criteria, except for special areas, to be within +/- 5 % of specified values.
- .2        Instrument accuracy tolerances:
  - .1            To be of higher order of magnitude than equipment or system being tested.
- .3        Measurement tolerances during verification:
  - .1            Unless otherwise identified, recorded values to be within +/- 2 % of specified values.

**1.31            DEPARTMENT'S PERFORMANCE TESTING**

- .1        Performance testing of equipment or system by CxA will not relieve Contractor from compliance with specified start-up and testing procedures.

**PART 2            PRODUCTS (NOT APPLICABLE)**

**PART 3            EXECUTION**

**3.1            SCHEDULE**

- .1        Provide a detailed schedule as per this section for on-site verification activities by the commissioning team based on the Cx Manual provided by the CxA. Be responsible for

---

**Wabush Airport Monorail & Hoist Replacement  
Wabush, NL**

**Project No. R.073048.001**

**Section 01 91 13 – Commissioning (Cx) Requirements**

**Page 17 of 17**

---

resource allocation respecting the exact number and duration for personnel required to perform the tasks required.

- .2 This schedule shall be submitted with the general construction schedule monthly. The level of detail shall increase as the construction progresses.

**3.2 COMMISSIONING TASKS**

- .1 Refer to the Cx Manual provided by the CxA for a list of tasks to be conducted for the commissioning process. Further specifics are provided within applicable specification sections.

**END OF SECTION**

**PART 1      GENERAL**

**1.1            SECTION INCLUDES**

- .1      Commissioning forms to be completed for equipment, systems and integrated systems.

**1.2            RELATED SECTIONS**

- .1      Section 01 78 00 – Closeout Submittals.
- .2      Section 01 91 13 – Commissioning (Cx) Requirements.
- .3      Section 01 91 41 – Commissioning (Cx) Training.

**1.3            INSTALLATION VERIFICATION CHECK LISTS**

- .1      Prior to initiation of Performance Verification the CxA will develop and provide to the contractor the required project specific Cx Manual which will include the Installation Verification check lists. .
- .2      Completed Installation Verification Checklists to be submitted to CxA for review and approval.
- .3      Include the following data:
  - .1      Product manufacturer's installation instructions and recommended checks.
  - .2      Special procedures as specified in relevant technical sections.
  - .3      Items considered good installation and engineering industry practices deemed appropriate for proper and efficient operation.
- .4      Equipment manufacturer's installation/start-up check lists are acceptable for use in conjunction with installation verification check lists forming part of the Cx manual. Manufacturer's check sheets used must be attached to final document submittals.
- .5      Installer to sign check lists upon completion, certifying stated checks and inspections have been performed. Completed check lists to be submitted by the contractor at completion of the Commissioning Process.
- .6      Use of check lists will be considered part of commissioning process.

**1.4            PERFORMANCE VERIFICATION CHECK LISTS**

- .1      The CxA will develop and provide to the Contractor the required project specific Cx Manual including the Performance Verification check lists.
- .2      Completed Performance Verification Checklists to be submitted to CxA for review and approval.
- .3      Strategy for Use:

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 9 1 33 – Commissioning (Cx) Forms**

---

**Page 2 of 2**

- .1 Contractor will provide required shop drawings information and verify correct installation and operation of items indicated on these forms.
  - .2 Confirm operation as per design criteria and intent.
  - .3 Identify variances between design and operation and reasons for variances.
  - .4 Verify operation in specified normal and emergency modes and under specified load conditions.
  - .5 Record analytical and substantiating data.
  - .6 Verify reported results.
  - .7 Form to bear signatures of recording technician and reviewed and signed off by General Contractor, Installing Contractor, Consultant, DTW Representative, and the Commissioning Agent.
  - .8 Reported results in true measured SI (metric) unit values.
  - .9 Maintain copy on site during start-up, testing and commissioning period.
  - .10 Forms to be both hard copy and electronic format.
- 
- .4 Upon completion of Performance Verification the contractor shall submit all completed checklists to the CxA.
- 
- .5 Final submittal shall include all Installation Verification, Performance Verification check lists, training records, maintenance materials transmittals, written warranties and a list of all Cx activities postponed due to seasonal, climatic, occupancy, or other reasons beyond the contractor's control.

**PART 2**      **PRODUCTS (NOT APPLICABLE)**

**PART 3**      **EXECUTION (NOT APPLICABLE)**

**END OF SECTION**

**PART 1**      **GENERAL**

**1.1**            **SECTION INCLUDES:**

- .1      This Section specifies roles and responsibilities of Commissioning Training.

**1.2**            **RELATED SECTIONS:**

- .1      Section 01 78 00 – Closeout Submittals.
- .2      Section 01 91 13 – Commissioning (Cx) Requirements.
- .3      Section 01 91 33 – Commissioning (Cx) Forms.

**1.3**            **TRAINEES**

- .1      Trainees: personnel selected for operating and maintaining this facility including, but not limited to, Facility Manager, building operators, maintenance staff, security staff, and technical specialists as required.
- .2      Trainees may be available for training during any stage of construction.

**1.4**            **INSTRUCTORS**

- .1      The Cx Manual will contain:
  - .1      Descriptions of systems.
  - .2      Instruction on design philosophy, design criteria, and design intent.
- .2      Contractor and certified factory-trained manufacturers' personnel: to provide instruction on the following:
  - .1      Start-Up, operation, shut-down and maintenance of equipment, components and systems.
  - .2      Control features and reasons for, results of, implications on associated systems of adjustment of set points of control and safety devices.
  - .3      Instructions on servicing, maintenance and adjustment of systems, equipment and components.
  - .4      Training to be completed after Installation and Performance Verification are completed.

**1.5**            **TRAINING OBJECTIVES**

- .1      Training to be detailed and of sufficient duration to ensure:
  - .1      Safe, reliable, cost-effective, energy-efficient operation of systems in normal and emergency modes under all conditions.
  - .2      Effective on-going inspection, measurements of system performance.
  - .3      Proper preventive maintenance, diagnosis, trouble-shooting and maintenance.
  - .4      Ability to update documentation.

- .5 Ability to operate equipment and systems under emergency conditions until appropriate qualified assistance arrives.

## **1.6 TRAINING MATERIALS**

- .1 Instructors to be responsible for content and quality. Provide copies for all those in attendance.
- .2 Training materials to include:
  - .1 "As-Built" Contract Documents.
  - .2 Operating Manual.
  - .3 Maintenance Manual.
  - .4 Testing, adjusting and balancing and performance verification reports where applicable.
- .3 Departmental Representative will review training manuals.
- .4 Training materials to be in a format that permits future training procedures to the same degree of detail with or without the instructor.

## **1.7 SCHEDULING**

- .1 Contractor to include in schedule time for training. Provide a detailed commissioning schedule indicating all Cx tasks and training.
- .2 Deliver training during regular working hours, training sessions to be determined in Commissioning meetings.
- .3 Training to be completed prior to Substantial Completion.

## **1.8 RESPONSIBILITIES**

- .1 Be responsible for:
  - .1 Implementation of training activities,
  - .2 Coordination among instructors,
  - .3 Quality of training, training materials,
- .2 Departmental Representative will evaluate training and materials.
- .3 Upon completion of training, provide written report, signed by Instructors, witnessed by Departmental Representative. Include list of those in attendance. The Cx manual will provide templates for these submittals.

## **1.9 TRAINING CONTENT**

- .1 Training to include demonstrations by Instructors using the installed equipment and systems.
- .2 Content includes:
  - .1 Review of facility and occupancy profile.

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 01 91 41 - Commissioning (Cx) Training**

---

**Page 3 of 3**

- .2 Functional requirements.
  - .3 System philosophy, limitations of systems and emergency procedures.
  - .4 Review of system layout, equipment, components and controls.
  - .5 Equipment and system start-up, operation, monitoring, servicing, maintenance and shut-down procedures.
  - .6 System operating sequences, including step-by-step directions for starting up, shut-down, operation of valves, dampers, switches, adjustment of control settings and emergency procedures.
  - .7 Maintenance and servicing.
  - .8 Trouble-shooting diagnosis.
  - .9 Inter-Action among systems during integrated operation.
  - .10 Review of O&M documentation.
- .3 Provide specialized training as specified in relevant Technical Sections of the construction specifications.

**PART 2**      **PRODUCTS (NOT APPLICABLE)**

**PART 3**      **EXECUTION (NOT APPLICABLE)**

**END OF SECTION**



**PART 1      GENERAL**

**1.1      SECTION INCLUDES**

- .1      Methods and procedures for demolition of structures and parts of structures.
- .2      Demolition and removal will consist of but not necessarily be limited to the following:
  - .1      Removal of existing hoist and monorail. The electrical supply to the existing hoist shall be disconnected. The existing hoist and monorail shall be disposed of off site by the contractor.
  - .2      Removal/re-location of existing mechanical and electrical (lights, fans, etc.) required for installation of new monorail. The existing fan and light shall be relocated or replaced as directed by the Departmental Representative.

**1.2      RELATED SECTIONS**

- .1      Section 01 11 00 – Summary of Work
- .2      Section 01 35 29.06 - Health and Safety Requirements
- .3      Section 01 35 43 - Environmental Procedures
- .4      Section 01 52 00 – Construction Facilities
- .5      Section 01 56 00 - Temporary Barriers and Enclosures
- .6      Section 01 74 21 – Construction/Demolition Waste Management and Disposal

**1.3      REFERENCES**

- .1      Canadian Standards Association (CSA).
  - .1      CSA S350, Code of Practice for Safety in Demolition of Structures

**1.4      QUALITY ASSURANCE**

- .1      Prior to start of Work arrange for site visit with Departmental Representative to examine existing site conditions adjacent to demolition work
- .2      Hold project meetings every month.
- .3      Ensure key personnel, site supervisor, project manager, subcontractor representatives, attend.

**1.5 WASTE MANAGEMENT AND DISPOSAL**

- .1 Separate waste materials in accordance with Section 01 74 21 – Construction/Demolition Waste Management and Disposal.

**1.6 EXISTING CONDITIONS**

- .1 Should material resembling spray or trowel applied asbestos or any other designated substance be encountered in course of demolition, stop work, take preventative measures, and notify Departmental Representative immediately. Do not proceed until written instructions have been received.
- .2 Structures to be demolished to be based on their condition on date that tender is accepted.
- .3 Salvage items as identified by Departmental Representative. Remove, protect and store salvaged items as directed by Departmental Representative. Deliver to Owner as directed.

**1.7 DEMOLITION DRAWINGS**

- .1 Where required by authorities having jurisdiction, submit for approval drawings, diagrams or details showing sequence of demolition work and supporting structures and underpinning.
- .2 Submit drawings stamped and signed by qualified professional engineer licensed in Province of Newfoundland and Labrador, Canada.

**1.8 ENVIRONMENTAL PROTECTION**

- .1 Ensure work is done in accordance with Section 01 35 43 – Environmental Procedures.
- .2 Prevent movement, settlement or damage of adjacent structures, services, walks, paving, trees, landscaping, adjacent grades and parts of existing building to remain.
- .3 Support affected structures and, if safety of structure being demolished or adjacent structures or services appears to be endangered cease operations and notify Departmental Representative.
- .4 Prevent debris from blocking surface drainage system, elevators, mechanical and electrical systems which must remain in operation.
- .5 Ensure that demolition work does not adversely affect adjacent watercourses, groundwater and wildlife, or contribute to excess air and noise pollution.
- .6 Fires and burning of waste or materials is not permitted on site.
- .7 Do not bury waste or materials on site.

---

**Wabush Airport Monorail & Hoist Replacement**  
**Wabush, NL**  
**Project No. R.073048.001**  
**Section 02 41 16 - Structure Demolition**

---

Page 3 of 5

- .8 Do not dispose of waste or volatile materials such as mineral spirits, oil, petroleum based lubricants, or toxic cleaning solutions into watercourses, storm or sanitary sewers. Ensure proper disposal procedures are maintained throughout project.
- .9 Do not pump water containing suspended materials into watercourses, storm or sanitary sewers, or onto adjacent properties.
- .10 Prevent extraneous materials from contaminating air beyond application area, by providing temporary enclosures during demolition work.

**1.9 SCHEDULING**

- .1 Ensure project time lines are met without compromising specified minimum rates of material diversion. Notify Departmental Representative in writing of delays.

**PART 2 PRODUCTS (NOT APPLICABLE)**

**PART 3 EXECUTION**

**3.1 PREPARATION**

- .1 Do work in accordance with 01 35 29.06 – Health and Safety Requirements.
- .2 Disconnect electrical supply to existing hoist to be removed.
- .3 Do not disrupt active or energized utilities designated to remain undisturbed.
- .4 Remove rodent and vermin as required by Departmental Representative.

**3.2 SAFETY CODE**

- .1 Do demolition work in accordance with Section 01 56 00 – Temporary Barriers and Enclosures.
- .2 Blasting operations not permitted during demolition.

**3.3 DEMOLITION**

- .1 Remove existing equipment, services, and obstacles where required for refinishing or making good of existing surfaces, and replace as work progresses.
- .2 At end of each day's work, leave Work in safe and stable condition. Protect interiors of parts not to be demolished from exterior elements at all times.
- .3 Demolish to minimize dusting. Keep materials wetted as directed by Departmental Representative.

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 02 41 16 - Structure Demolition**

---

**Page 4 of 5**

- .4 Remove structural framing.
- .5 Contain all fibrous materials (e.g. Insulation) to minimize release of airborne fiber while being transported to waste disposal site or alternative disposal location.
- .6 Only dispose of material specified by selected alternative disposal option as directed by Departmental Representative.
- .7 Ensure that these materials will not be disposed of in landfill or waste stream destined for landfill.
- .8 Remove and dispose of demolished materials except where noted otherwise and in accordance with authorities having jurisdiction.
- .9 Environmental:
  - .1 Remove contaminated or dangerous materials as defined by authorities having jurisdiction, relating to environmental protection, from site and dispose of in safe manner to minimized danger at site or during disposal.
- .10 Prior to the start of any demolition work remove contaminated or hazardous materials as defined by authorities having jurisdiction, from site and dispose of at designated disposal facilities.
- .11 Use natural lighting to work by wherever possible. Shut off all lighting except those required for security purposes at the end of each day.

**3.4 STOCKPILING**

- .1 Stockpile materials in a location as directed by Departmental Representative.
- .2 Designate appropriate security resources/measures to prevent vandalism, damage and theft.
- .3 Separate from general waste stream each of the following materials. Stockpile materials in neat and orderly fashion in location and as directed by Departmental Representative for alternate disposal. Stockpile materials in accordance with applicable fire regulations.
  - .1 Wiring and conduit.
  - .2 Outlets/Switches
  - .3 Floor receptacles.
  - .4 Metal duct work, baffles, HVAC equipment.
  - .5 Miscellaneous metals.
- .4 Supply separate, clearly-marked disposal bins for all categories of waste material. Do not remove bins from site until inspected and approved by Departmental Representative.
- .5 Provide collection areas for collection of miscellaneous metals in the area of demolition.

**3.5 REMOVAL FROM SITE**

- .1 Notify Departmental Representative in writing of any materials identified as not suitable for alternate disposal. Provide reasons prior to approval for disposal.
- .2 Dispose of materials as directed by Departmental Representative.
- .3 Remove stockpiled material as directed by Departmental Representative when it interferes with operations of project construction.
- .4 Remove stockpiles of like materials by an alternate disposal option once collection of materials is complete.
- .5 Transport material designated for alternate disposal in accordance with applicable regulations.
- .6 Dispose of materials not designated for alternate disposal in accordance with applicable regulations.

**3.6 REPORTING**

- .1 Record off-site removal of debris and materials and provide following information regarding removed materials to Departmental Representative within 24 hours.
  - .1 Time and date of Removal
  - .2 Description of Material
  - .3 Weight and Quantity of Materials.
  - .4 Breakdown of reuse, recycling and landfill quantities.
  - .5 End Demolition of Materials.

**3.7 COORDINATION**

- .1 Coordinate alternative disposal activities with Departmental Representative's on site waste diversion representative.

**END OF SECTION**

**PART 1**      **GENERAL**

**1.1**            **RELATED SECTIONS**

- .1      Section 01 33 00 - Submittal Procedures.
- .2      Section 01 74 21 - Construction/Demolition Waste Management and Disposal.
- .3      Section 05 50 00 - Metal Fabrications.

**1.2**            **REFERENCES**

- .1      Canadian Standards Association (CSA)
  - .1      CAN/CSA G40.20/G40.21, General Requirements for Rolled or Welded Structural Quality Steel/Structural Quality Steel.
  - .2      CAN/CSA-S16, Limit States Design of Steel Structures.
  - .3      CAN/CSA-S136, Cold Formed Steel Structural Members.
  - .4      CSA-S136.1, Commentary on CSA Standard S136.
  - .5      CSA W47.1, Certification of Companies for Fusion Welding of Steel Structures.
  - .6      CSA W48, Filler Metals and Allied Materials for Metal Arc Welding of Structural Steel.
  - .7      CSA W55.3, Resistance Welding Qualification Code for Fabricators of Structural Members Used in Buildings.
  - .8      CSA W59, Welded Steel Construction (Metal Arc Welding) Metric.
- .2      Canadian General Standards Board (CGSB)
  - .1      CAN/CGSB-85.10, Protective Coatings for Metals.
- .3      American Society for Testing and Materials International (ASTM)
  - .1      ASTM A36/A36M, Specification for Structural Steel.
  - .2      ASTM A325M, Specification for High-Strength Bolts for Structural Steel Joints Metric.
- .4      Canadian Institute of Steel Construction (CISC)/Canadian Paint Manufacturer's Association (CPMA).
  - .1      CISC/CPMA 1, Quick-Drying, One Coat Paint for Use on Structural Steel.
  - .2      CISC/CPMA 2, Quick-Drying, Primer for use on Structural Steel.
- .5      The Society for Protective Coatings (SSPC)
  - .1      SSPC SP 1, Solvent Cleaning.
  - .2      SSPC SP 7, Brush-Off Blast Cleaning.

**1.3 SHOP DRAWINGS**

- .1 Submit shop drawings including fabrication and erection documents and materials list.
- .2 On erection drawings: indicate details and information necessary for assembly and erection purposes such as, description of methods, sequence of erection, type of equipment used in erection and temporary bracings. Show detail of all non-standard connections such as bracing connections, truss connections, moment connections and hanger assemblies and other non-standard connections as requested by the Departmental Representative.
- .3 Erection drawings to be stamped by a qualified professional Engineer licensed to practice in the Province of Newfoundland and Labrador. The erection drawings are to contain a clause stating that the professional Engineer who stamped the erection drawings is responsible for all fabricator designed assemblies, components and connections required for this project.
- .4 Drawings for all fabricator designed assemblies, components and connections are to be stamped and signed by the professional Engineer who stamped the erection drawings.

**1.4 SAMPLES**

- .1 Prepare sample of typical exposed structural connections in accordance with approval of Departmental Representative. Samples to be judged upon alignment of surfaces, uniform contact between surfaces, smoothness and uniformity of finished welds. When approved, sample units will serve as a standard for workmanship, appearance and material acceptable for entire project.

**1.5 DESIGN REQUIREMENTS**

- .1 Design details and connections in accordance with requirements of CAN/CSA-S16 and CAN/CSA-S136 with CSA-S136.1 to resist forces, moments, shears and allow for movements indicated.
- .2 Unless noted otherwise on the drawings or in the specifications connection design is the responsibility of the structural steel fabricator. Fully detailed connections shown on the contract drawings including bolt and welded sizes are deemed to have been designed by the Departmental Representative.
- .3 If connection for shear only (standard connection is required):
  - .1 Select framed beam shear connections from an industry accepted publication such as "Handbook of the Canadian Institute of Steel Construction".
  - .2 If shears are not indicated, select or design connections to support reaction from maximum uniformly distributed load that can be safely supported by beam in bending, provided no point loads act on beam.

- .4 For non-standard connections, submit sketches and design calculations stamped and signed by qualified professional Engineer licensed in the Province of Newfoundland and Labrador.

## **1.6 SOURCE QUALITY CONTROL**

- .1 If requested submit on certified copy of mill reports covering chemical and physical properties of steel used in this work.

## **1.7 QUALITY ASSURANCE**

- .1 At least 2 weeks prior to fabrication of structural steel submit to Departmental Representative a letter from the fabricators Welding engineer stating the Welding engineer is responsible for welding procedures and practices for this project as outlined in CSA S47.1
- .2 Provide certificate of Quality Compliance from steel fabricator upon completion of structural steel fabrication stating that the work has been designed and fabricated in accordance with the requirements of the contract documents.
- .3 If requested, submit to the Departmental Representative one copy of all approved welding procedures for this project.

## **PART 2 PRODUCTS**

### **2.1 MATERIALS**

- .1 Structural steel: to CAN/CSA-G40.20/G40.21 Grade as indicated, 350W and/or CAN/CSA-S136.
- .2 Cold formed structural members: to CAN/CSA S-136.
- .3 Anchor bolts: to CAN/CSA-G40.20/G40.21, Grade 300W.
- .4 Bolts, nuts and washers: to ASTM A325M
- .5 Welding materials: to CSA W59 and certified by Canadian Welding Bureau.
- .6 Shop paint primer:
  - .1 To CISC/CPMA 1 for interior steel.
  - .2 To CISC/CPMA 2 for exterior steel.

### **2.2 FABRICATION**

- .1 Fabricate structural steel in accordance with CAN/CSA-S16 and in accordance with approved reviewed shop drawings.



- .2 Install shear studs in accordance with CSA W59.
- .3 Continuously seal members by continuous welds where indicated.

**2.3 SHOP PAINTING**

- .1 Clean, prepare surfaces and shop prime structural steel in accordance with CAN/CSA-S16 except where members to be encased in concrete. Colour of shop primer to match the colour of the existing structural steel.
- .2 Shop primer to match the colour of the shop primer on the existing steel.
- .3 Clean members, remove loose mill scale, rust, oil, dirt and other foreign matter. Prepare surface by solvent cleaning to SSPC SP 1, followed by brush-off blast cleaning to SSPC SP 7.
- .4 Apply one coat of primer in shop to steel surfaces except:
  - .1 Surfaces and edges to be field welded.
- .5 Apply paint under cover, on dry surfaces when surface and air temperatures are above 5° C.
- .6 Maintain dry condition and 5°C minimum temperature until paint is thoroughly dry.
- .7 Strip paint from bolts, nuts, sharp edges and corners before prime coat is dry.

**PART 3 EXECUTION**

**3.1 GENERAL**

- .1 Structural steel work: in accordance with CAN/CSA-S16.
- .2 Welding: in accordance with CSA W59.
- .3 Companies to be certified under Division 1 or 2.1 of CSA W47.1 for fusion welding of steel structures and/or CSA W55.3 for resistance welding of structural components.

**3.2 CONNECTION TO EXISTING WORK**

- .1 Verify dimensions and condition of existing work, report discrepancies and potential problem areas to Departmental Representative for direction before commencing fabrication.

**3.3 MARKING**

- .1 Mark materials in accordance with CAN/CSA G40.20/G40.21. Do not use die stamping. If steel is to be left in unpainted condition, place marking at locations not visible from exterior after erection.
- .2 Match marking: shop mark bearing assemblies and splices for fit and match.

**3.4 ERECTION**

- .1 Erect structural steel, as indicated and in accordance with CAN/CSA-S16 and in accordance with approved reviewed erection drawings.
- .2 Field cutting or altering structural members: to approval of Departmental Representative.
- .3 Clean with mechanical brush and touch up shop primer to bolts, rivets, welds and burned or scratched surfaces at completion of erection.
- .4 Continuously seal members by continuous welds where indicated. Grind smooth.

**3.5 FIELD PRIMING**

- .1 Touch up damaged surfaces and surfaces without shop coat with primer to SSPC SP 7 except as specified otherwise. Apply in accordance with CAN/CGSB 85.10. Colour of primer to match colour of existing structural steel.

**3.6 FIELD QUALITY CONTROL**

- .1 The structural steel erection contractor will carry out an inspection of the work and make the inspection results available to the Departmental Representative. The inspection report will identify the areas of work inspected, deficiencies identified and measures taken to correct the deficiencies.
  - .1 Inspection to include: Vertical and horizontal alignment checks, torque testing and inspection of representative connection welds.
  - .2 Submit test reports to Departmental Representative within 2 weeks of completion of inspection.
  - .3 Copies of test reports and inspections to be included in Commissioning Manual.
- .2 The Owner may opt to designate a third party Inspection and Testing Company to complete additional inspection and testing of materials and workmanship.
  - .1 Provide safe access and working areas for testing on site, as required by testing agency and as authorized by Departmental Representative.

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 05 12 23 – Structural Steel for Buildings**

---

**Page 6 of 6**

.2 The Department will pay costs of initial inspection and testing by third party Inspection and Testing Company. Costs for any re-inspection and/or re-testing as a result of deficient work will be paid for by the contractor.

**END OF SECTION**

**PART 1      GENERAL**

**1.1            RELATED SECTIONS**

- .1      Section 01 33 00 - Submittal Procedures.
- .2      Section 01 61 00 – Common Product requirements.
- .3      Section 01 74 21 – Construction/Demolition Waste Management and Disposal.
- .4      Section 05 12 23 - Structural Steel for Buildings.

**1.2            REFERENCES**

- .1      American Society for Testing and Materials, (ASTM)
  - .1      ASTM A53/A53M, Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated Welded and Seamless.
  - .2      ASTM A269, Specification for Seamless and Welded Austenitic Stainless Steel Tubing for General Service.
  - .3      ASTM A307, Specification for Carbon Steel Bolts and Studs, 60,000 PSI Tensile Strength.
- .2      Canadian General Standards Board (CGSB)
  - .1      CAN/CGSB 1.153, High-Build, Gloss Epoxy Coating.
- .3      Canadian Standards Association (CSA)
  - .1      CAN/CSA-G40.20/G40.21, General Requirements for Rolled or Welded Structural Quality Steel.
  - .2      CAN/CSA-G164, Hot Dip Galvanizing of Irregularly Shaped Articles.
  - .3      CSA S16, Design of Steel Structures.
  - .4      CSA W48, Filler Metals and Allied Materials for Metal Arc Welding (Developed in co-operation with the Canadian Welding Bureau).
  - .5      CSA W59, Welded Steel Construction (Metal Arc Welding).
- .4      The Environmental Choice Program
  - .1      CCD-047, Architectural Surface Coatings.
  - .2      CCD-048, Surface Coatings - Recycled Water-borne.
- .5      Green Seal Environmental Standards (GS)
  - .1      GS-11, Paints and Coatings.
- .6      The Master Painters Institute (MPI)
  - .1      Architectural Painting Specification Manual.

**1.3 SUBMITTALS**

- .1 Product Data:
  - .1 Submit manufacturer's printed product literature, specifications and data sheet
  - .2 Submit two copies of WHMIS MSDS - Material Safety Data Sheets. Indicate VOC's:
    - .1 For finishes, coatings, primers and paints.
- .2 Shop Drawings
  - .1 Indicate materials, core thicknesses, finishes, connections, joints, method of anchorage, number of anchors, supports, reinforcement, details, and accessories.

**1.4 QUALITY ASSURANCE**

- .1 Test Reports: Submit Certified test reports showing compliance with specified performance characteristics and physical properties.
- .2 Certificates: Submit Product certificates signed by manufacturer certifying materials comply with specified performance characteristics and criteria and physical requirements.

**1.5 DELIVERY, STORAGE, AND HANDLING**

- .1 Deliver, store, handle and protect materials in accordance with Section 01 61 00 - Common Product Requirements.
- .2 Cover exposed stainless steel surfaces with pressure sensitive heavy protection paper or apply strippable plastic coating, before shipping to job site.
- .3 Leave protective covering in place until final cleaning of building. Provide instructions for removal of protective covering.

**PART 2 PRODUCTS**

**2.1 MATERIALS**

- .1 Steel sections and plates: to CAN/CSA-G40.20/G40.21, Grade 300W.
- .2 Welding materials: to CSA W59.
- .3 Welding electrodes: to CSA W48 Series.
- .4 Bolts and anchor bolts: to ASTM A307.

**2.2 FABRICATION**

- .1 Fabricate work square, true, straight and accurate to required size, with joints closely fitted and properly secured.
- .2 Use self-tapping shake-proof flat round oval headed screws on items requiring assembly by screws or as indicated.
- .3 Where possible, fit and shop assemble work, ready for erection.
- .4 Ensure exposed welds are continuous for length of each joint. File or grind exposed welds smooth and flush.

**2.3 FINISHES**

- .1 Shop coat primer: in accordance with chemical component limits and restrictions requirements and VOC limits of GS-11.
- .2 Zinc primer: zinc rich, ready mix: in accordance with chemical component limits and restrictions requirements and VOC limits of GS-11.

**2.4 SHOP PAINTING**

- .1 Apply one shop coat of primer to metal items, with exception of galvanized or concrete encased items. The colour of shop primer is to match the colour of the shop primer on the existing steel.
- .2 Use primer unadulterated, as prepared by manufacturer. Paint on dry surfaces, free from rust, scale, grease. Do not paint when temperature is lower than 7 degrees C.
- .3 Clean surfaces to be field welded; do not paint.

**PART 3 EXECUTION**

**3.1 ERECTION**

- .1 Do welding work in accordance with CSA W59 unless specified otherwise.
- .2 Erect metalwork square, plumb, straight, and true, accurately fitted, with tight joints and intersections.
- .3 Provide suitable means of anchorage acceptable to Owner's Representative such as dowels, anchor clips, bar anchors, expansion bolts and shields, and toggles.
- .4 Exposed fastening devices to match finish and be compatible with material through which they pass.

---

**Wabush Airport Monorail & Hoist Replacement**

**Wabush, NL**

**Project No. R.073048.001**

**Section 05 50 00 – Metal Fabrications**

---

**Page 4 of 4**

- .5 Provide components for building by other sections in accordance with shop drawings and schedule.
- .6 Make field connections with bolts to CAN/CSA-S16, or weld.
- .7 Touch-up rivets, field welds, bolts and burnt or scratched surfaces after completion of erection with primer.
- .8 Touch-up high build epoxy coated finishes.

**3.2 CLEANING**

- .1 Perform cleaning after installation to remove construction and accumulated environmental dirt.
- .2 Upon completion of installation, remove surplus materials, rubbish, tools and equipment barriers.

**3.3 PROTECTION**

- .1 Protect installed products and components from damage during construction.
- .2 Repair damage to adjacent materials caused by metal fabrications installation

**END OF SECTION**