




**LEGEND**

- DC1 DOOR / SECURITY HARDWARE – DOOR CONTROL CABINET
- DC2 DOOR / SECURITY HARDWARE – DOOR CONTROL MASTER STATION
- DC3 DOOR / SECURITY HARDWARE – DOOR CONTACT
- DC4 DOOR / SECURITY HARDWARE – ELECTRIC STRIKE
- DC5 DOOR / SECURITY HARDWARE – BARRIER FREE DOOR OPERATOR ACTUATOR PUSH BUTTON
- DC6 DOOR / SECURITY HARDWARE – KEY SWITCH FOR DOOR RELEASE
- DC7 DOOR / SECURITY HARDWARE – KILL SWITCH TO DESARM DOOR CONTROLS
- DC8 DOOR / SECURITY HARDWARE – FIXED POINT ALARM STATION OUTLET BOX

**ELECTRICAL NOTES:**

1. ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE LATEST EDITION OF THE CANADIAN ELECTRICAL CODE AND/OR LOCAL INSPECTION AUTHORITIES. THE ELECTRICAL CONTRACTOR SHALL OBTAIN ALL PERMITS AND INSPECTIONS REQUIRED BY LAWS, ORDINANCES, RULES AND REGULATIONS OF PUBLIC AUTHORITIES HAVING JURISDICTION OF THIS DISTRICT AND SHALL OBTAIN CERTIFICATES ON SUCH INSPECTIONS AND SUBMIT SAME AND PAY ALL CHARGES IN CONNECTION THEREWITH.
2. NO OMISSIONS IN THE DRAWINGS ARE INTENDED AND THE ELECTRICAL CONTRACTOR SHALL GIVE DUE CONSIDERATION TO THIS MATTER WHEN EXAMINING THE SITE.
3. CONDUITS AND WIRE IN FINISHED AREAS SHALL BE RUN CONCEALED. CONDUITS IN UNFINISHED AREAS SHALL BE RUN EXPOSED, PARALLEL TO BUILDING LINES IN A NEAT WORKMANLIKE MANNER. CONDUITS SHALL RUN THROUGH CEILING SPACES AND DOWN WALLS. EQUIPMENT AND MATERIALS SHALL BE NEW AND CSA CERTIFIED MANUFACTURED TO STANDARD QUOTED BUT INCORPORATING ADDITIONAL SPECIFIED REQUIREMENTS.
4. THE GENERAL CONTRACTOR SHALL PERFORM ALL CUTTING, PATCHING AND PAINTING NECESSARY FOR PROPER INSTALLATION OF WORK AND SHALL REPAIR ANY DAMAGE DONE EMPLOYING ONLY THE SERVICES OF SKILLED WORKMEN. THE ELECTRICAL CONTRACTOR SHALL, UPON REQUEST, PROVIDE ALL SUCH NECESSARY DETAIL AND INFORMATION TO ACCQUANT THE GENERAL CONTRACTOR WITH THE SCOPE OF PARTICULARS OF CUTTINGS, PAINTING AND PATCHING RELEVANT TO HIS WORK.
5. ON COMPLETION, ALL EQUIPMENT SHALL BE THOROUGHLY CLEANED. ALL WORK CHECKED OVER AND LEFT IN WORKING ORDER.  
ALL RUBBISH, UNUSED MATERIALS ETC., SHALL BE REMOVED AND THE PREMISES LEFT CLEAN.
6. DEVICES MOUNTED ON EXTERIOR WALLS SHALL BE INSTALLED C/W PLASTIC ENVELOPE TO MAINTAIN INTEGRITY OF VAPOUR BARRIER.
7. CONTRACTOR SHALL VISIT SITE PRIOR TO TENDER TO FAMILIARIZE HIMSELF WITH EXISTING CONDITIONS, OBSTRUCTIONS, ETC.
8. CONTRACTOR SHALL REFER TO BASE BUILDING DOCUMENTS FOR STANDARDS OF MATERIALS AND WORKMANSHIP REQUIRED.
9. ALL COMPUTER COMMUNICATION CABLE SHALL BE RUN IN EMT TO SECTION 80-310 C.E.C. 22.1.

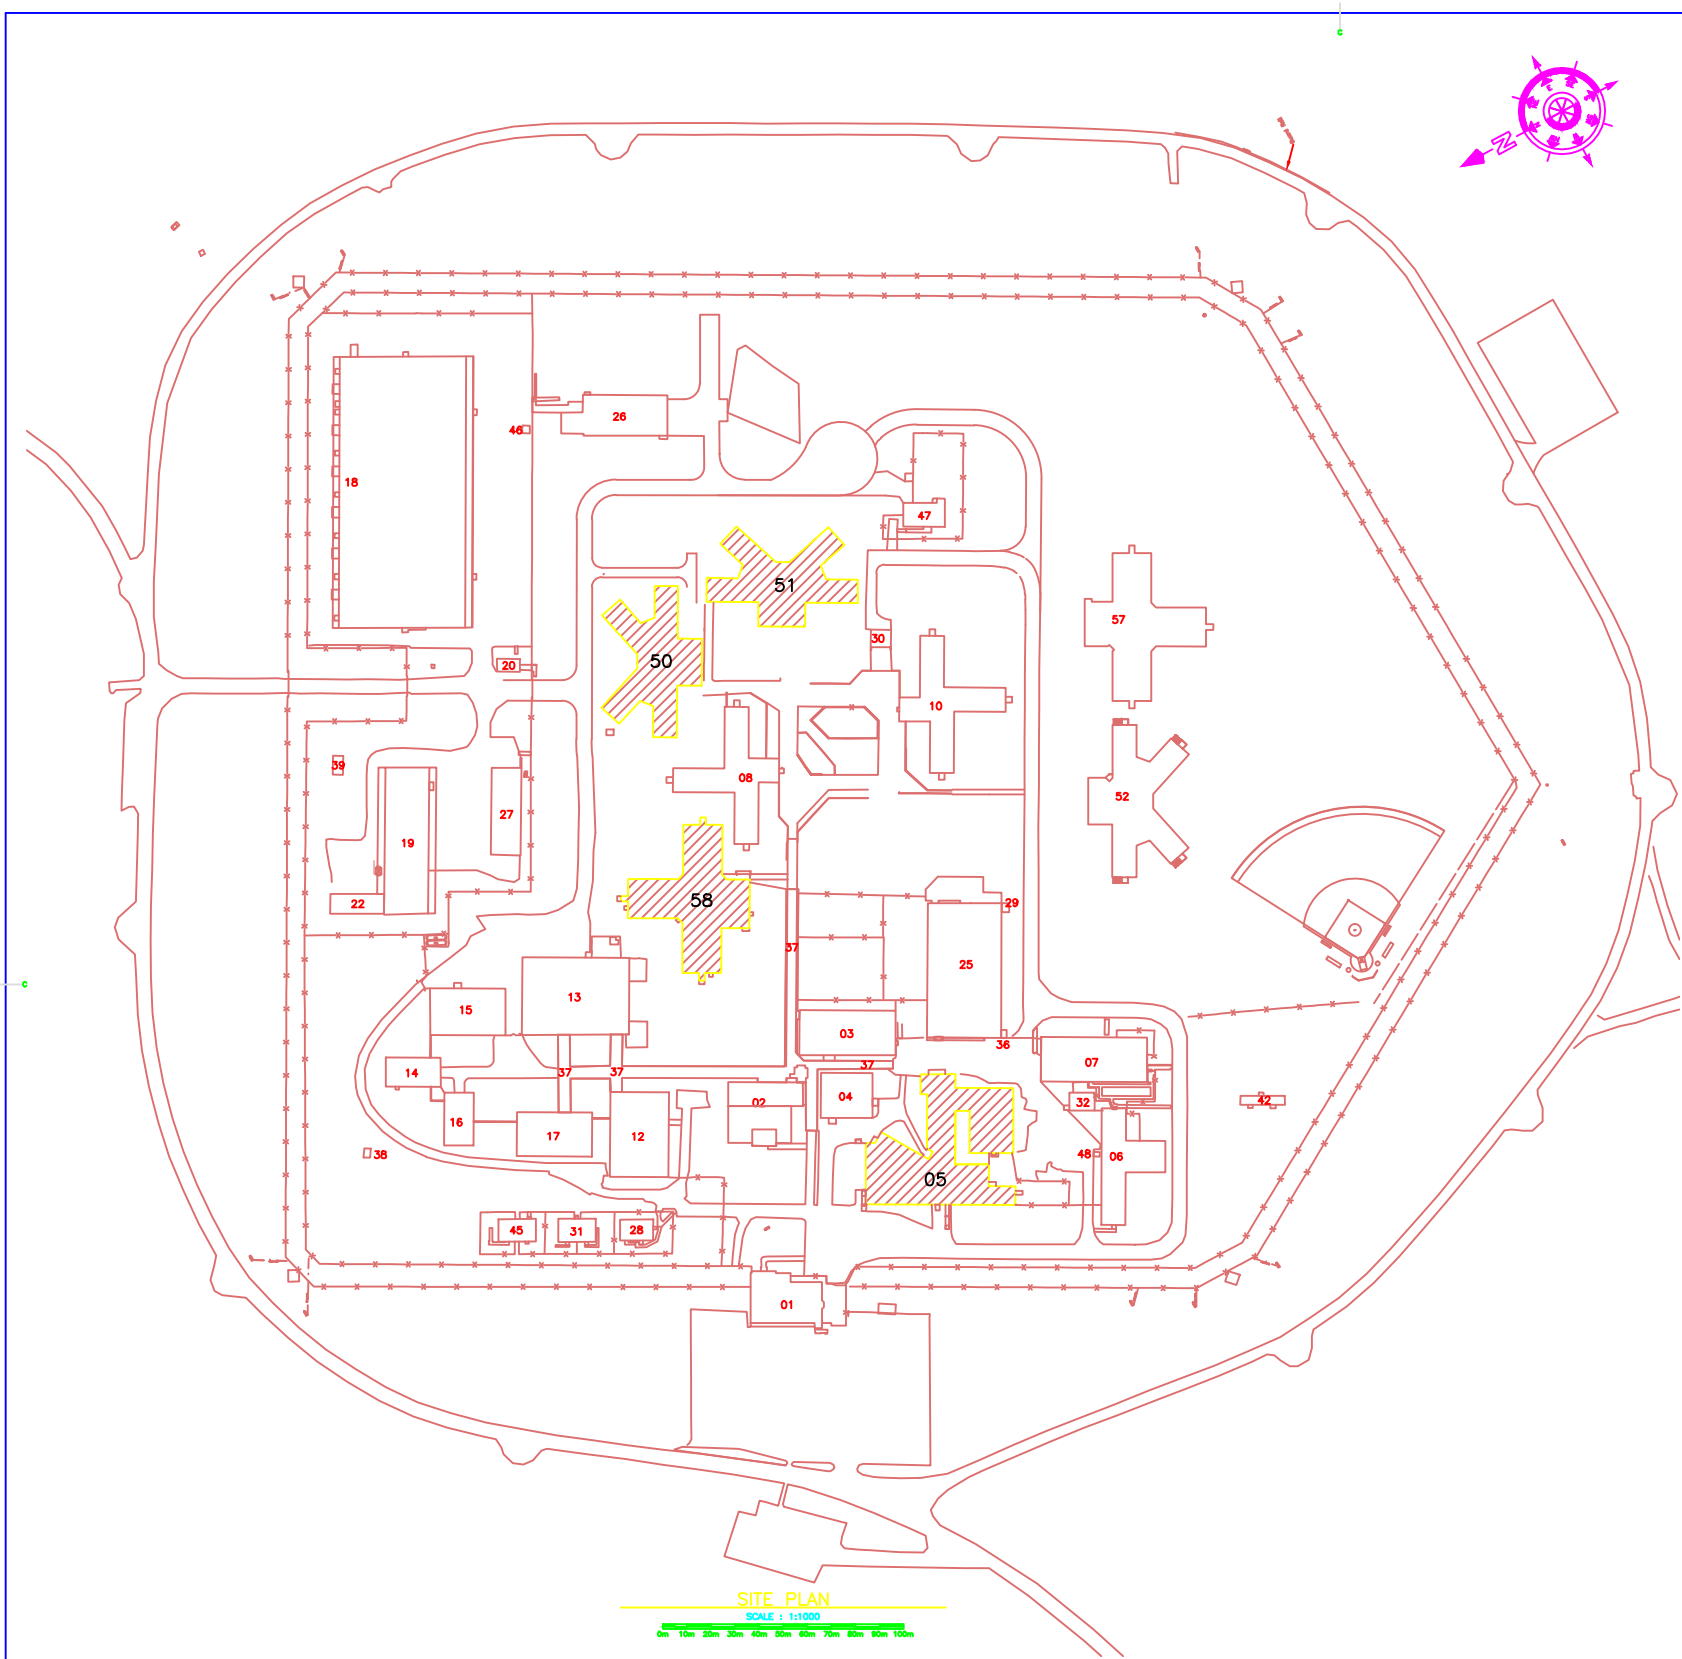

**SITE PLAN**  
SCALE: 1:10000  
0m 10m 20m 30m 40m 50m 60m 70m 80m 90m 100m

0	ISSUED FOR REVIEW	REV 01
revision		date
project		proj#
DOOR CONTROL SYSTEM UPGRADE BLDG's 05, 50, 58, 51 & 51 SPRINGHILL INSTITUTION SPRINGHILL, NOVA SCOTIA		
drawing		draw#
SITE PLAN, LEGEND AND NOTES		
designed by	V. MELÉNDEZ	draw#
date	MARCH 2014	
drawn by	K. WOLFE	draw#
date	MARCH 2014	
approved		approved
date		
checked		checked
date		
Project Manager	Administrateur de projets	Proj#
project number	R.061851.001	no. de projet
drawing no.	E1	no. de dessin