

PRELIMINARY
NOT FOR CONSTRUCTION

WATERMAIN DATA				
STATION	REF.	INVERT	DESCRIPTION	REMARKS
9+067.8	F11	1278.812	11.25' BEND	
9+063.5	V12	1278.812	150mm GATE VALVE FLANGED PVC HOPE	
9+066.4	PB1	1278.812	BEGIN PIPE BURSTING HOPE THROUGH CAST IRON	
24+437.7	DV4		LOCATE, CUT & CONNECT DRAIN VALVE IN CHAMBER	
24+485.2	V10	1280.709	150mm GATE VALVE	
24+486.3	H34	1280.698	HYDRANT #34, VALVE AND TEE	
24+618.5	H35	1278.935	HYDRANT #35, VALVE AND TEE	
24+619.9	V11	1278.921	150mm GATE VALVE	
24+671.3	F9	1278.235	45° BEND	
24+676.9	SP3		25mm STOP DRAIN & STAND PIPE TO IRRIGATION BOX	



Consultant's Name
Nom de l'expert-conseil
Amec Foster Wheeler
Environment & Infrastructure
469 - 40th Street South
Lethbridge, Alberta CANADA T1J 4M1
Tel. (403) 329-1467
Fax (403) 327-4938

Eng. Stamp
Sceau de l'ingénieur
PROFESSIONAL ENGINEER
Environment & Infrastructure
P. ENG.
DATE:

DO NOT SCALE DRAWINGS

Revision/	Description/Description	Date/Date
5		
4		
3		
2	100% DESIGN COMPLETION	07/13/18
1	75% DESIGN COMPLETION	07/01/18
0	50% DESIGN COMPLETION	06/17/18

Client/client
Parks Canada Agency
L'Agence Parcs Canada
Western and Northern Region
Ouest et Nord du Canada

Project title/Titre du projet
WATERTON TOWNSITE MUNICIPAL INFRASTRUCTURE UPGRADES PHASE A AND B
WATERTON NATIONAL PARK ALBERTA

Approved by/Approuvé par
B. ZACHER

Designed by/Concepté par
B. JOHNSON


PWGSC Project Manager/Administrateur de Projets TPSSC
M. BURKE

PWGSC, Architectural and Engineering Resources Manager/ Ressources Architectural et de Directeur d'Ingénierie, TPSSC
J. LAMBE


Client/client
J. LAMBE

Drawing title/Titre du dessin
NEW UTILITIES EVERGREEN AVENUE SOUTH PLAN PROFILE
Sta. 24+440 to Sta. 24+740

Project No./No. du projet R.075721.001	Sheet/Feuille C16 OF 41	Revision no./La Révision no. 2
--------------------------------------------------	--------------------------------------	------------------------------------------

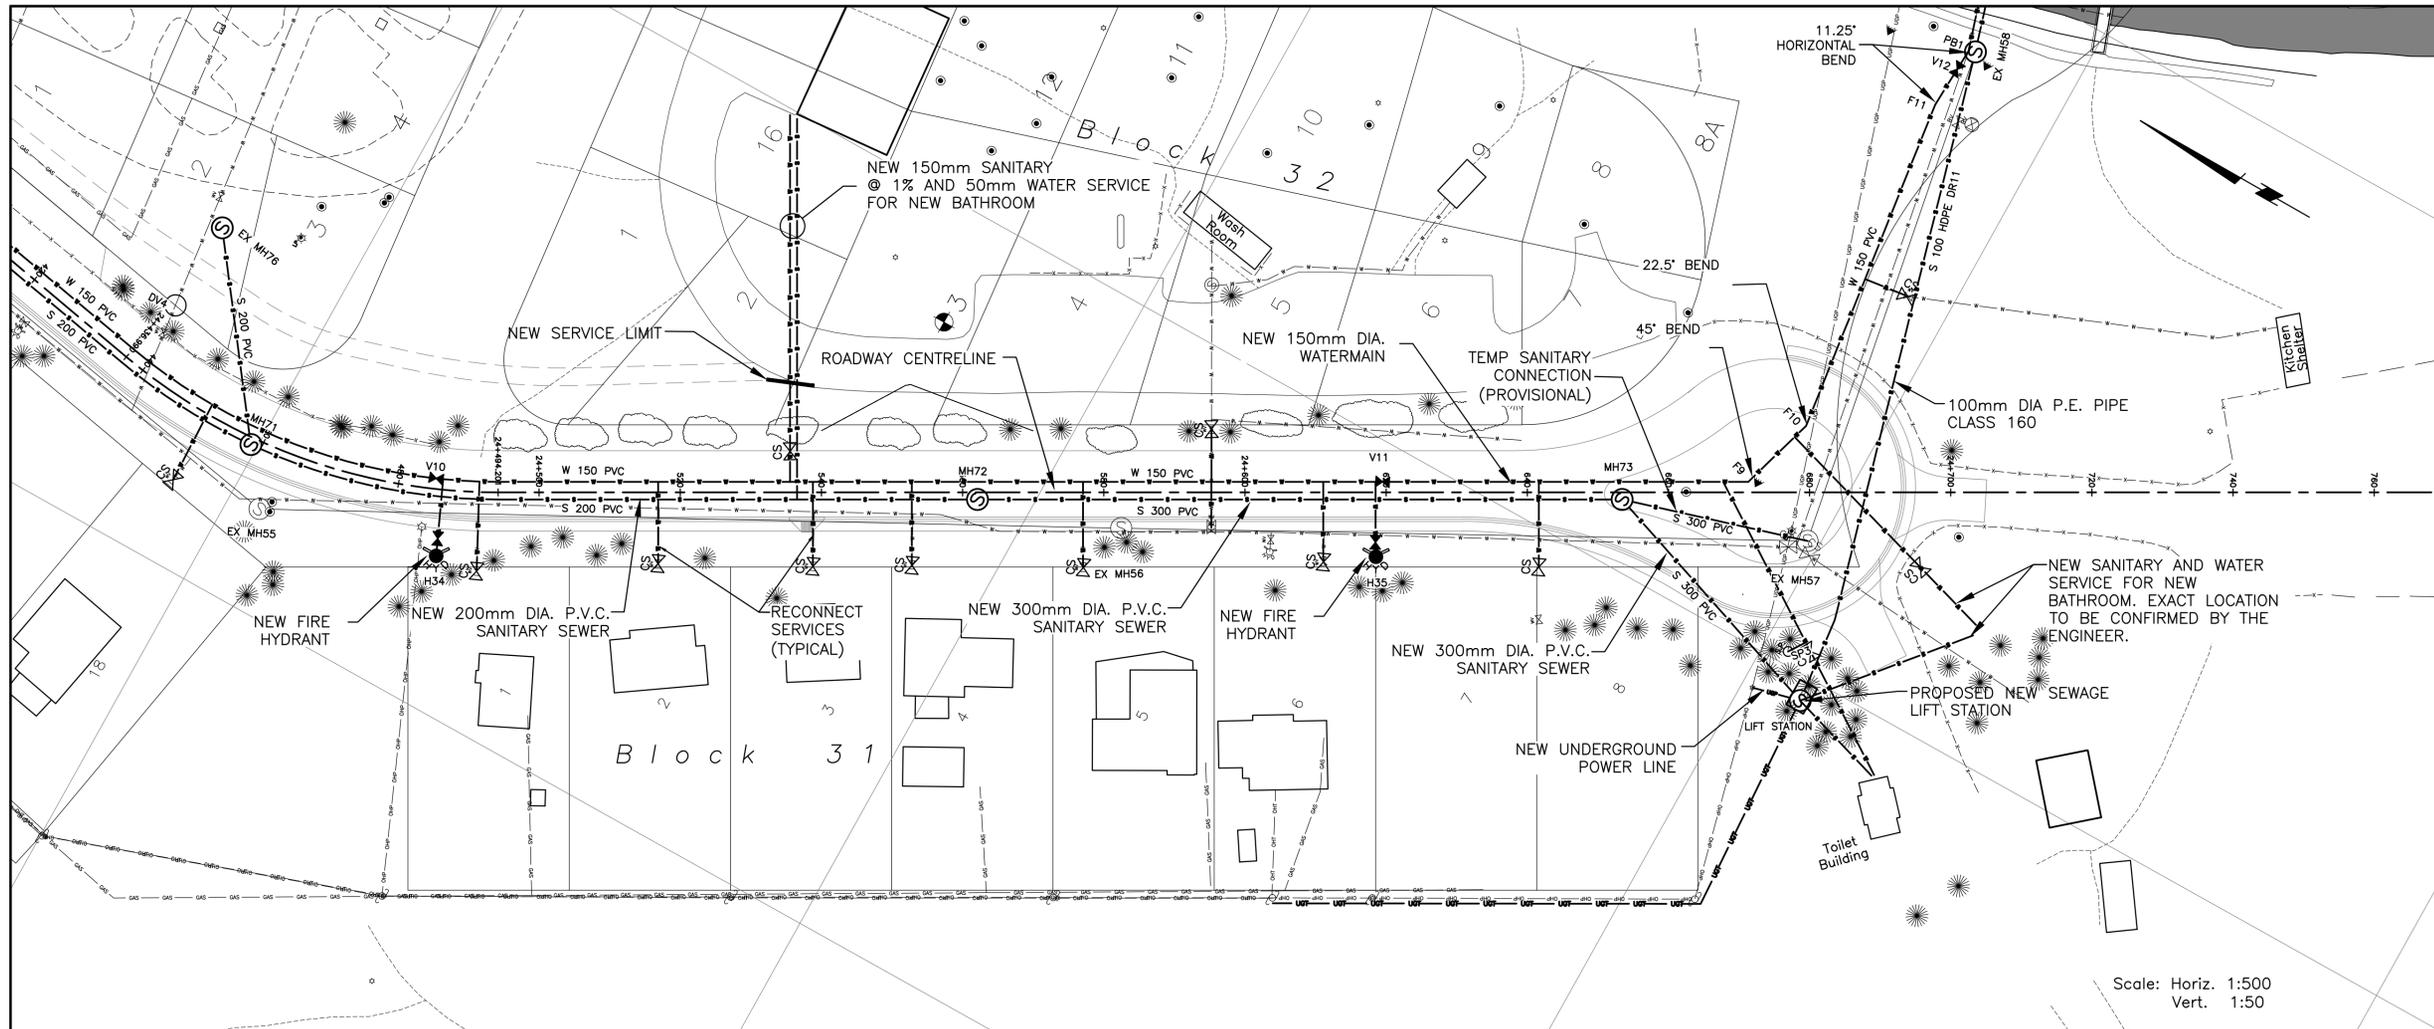

Scale: Horiz. 1:500
Vert. 1:50

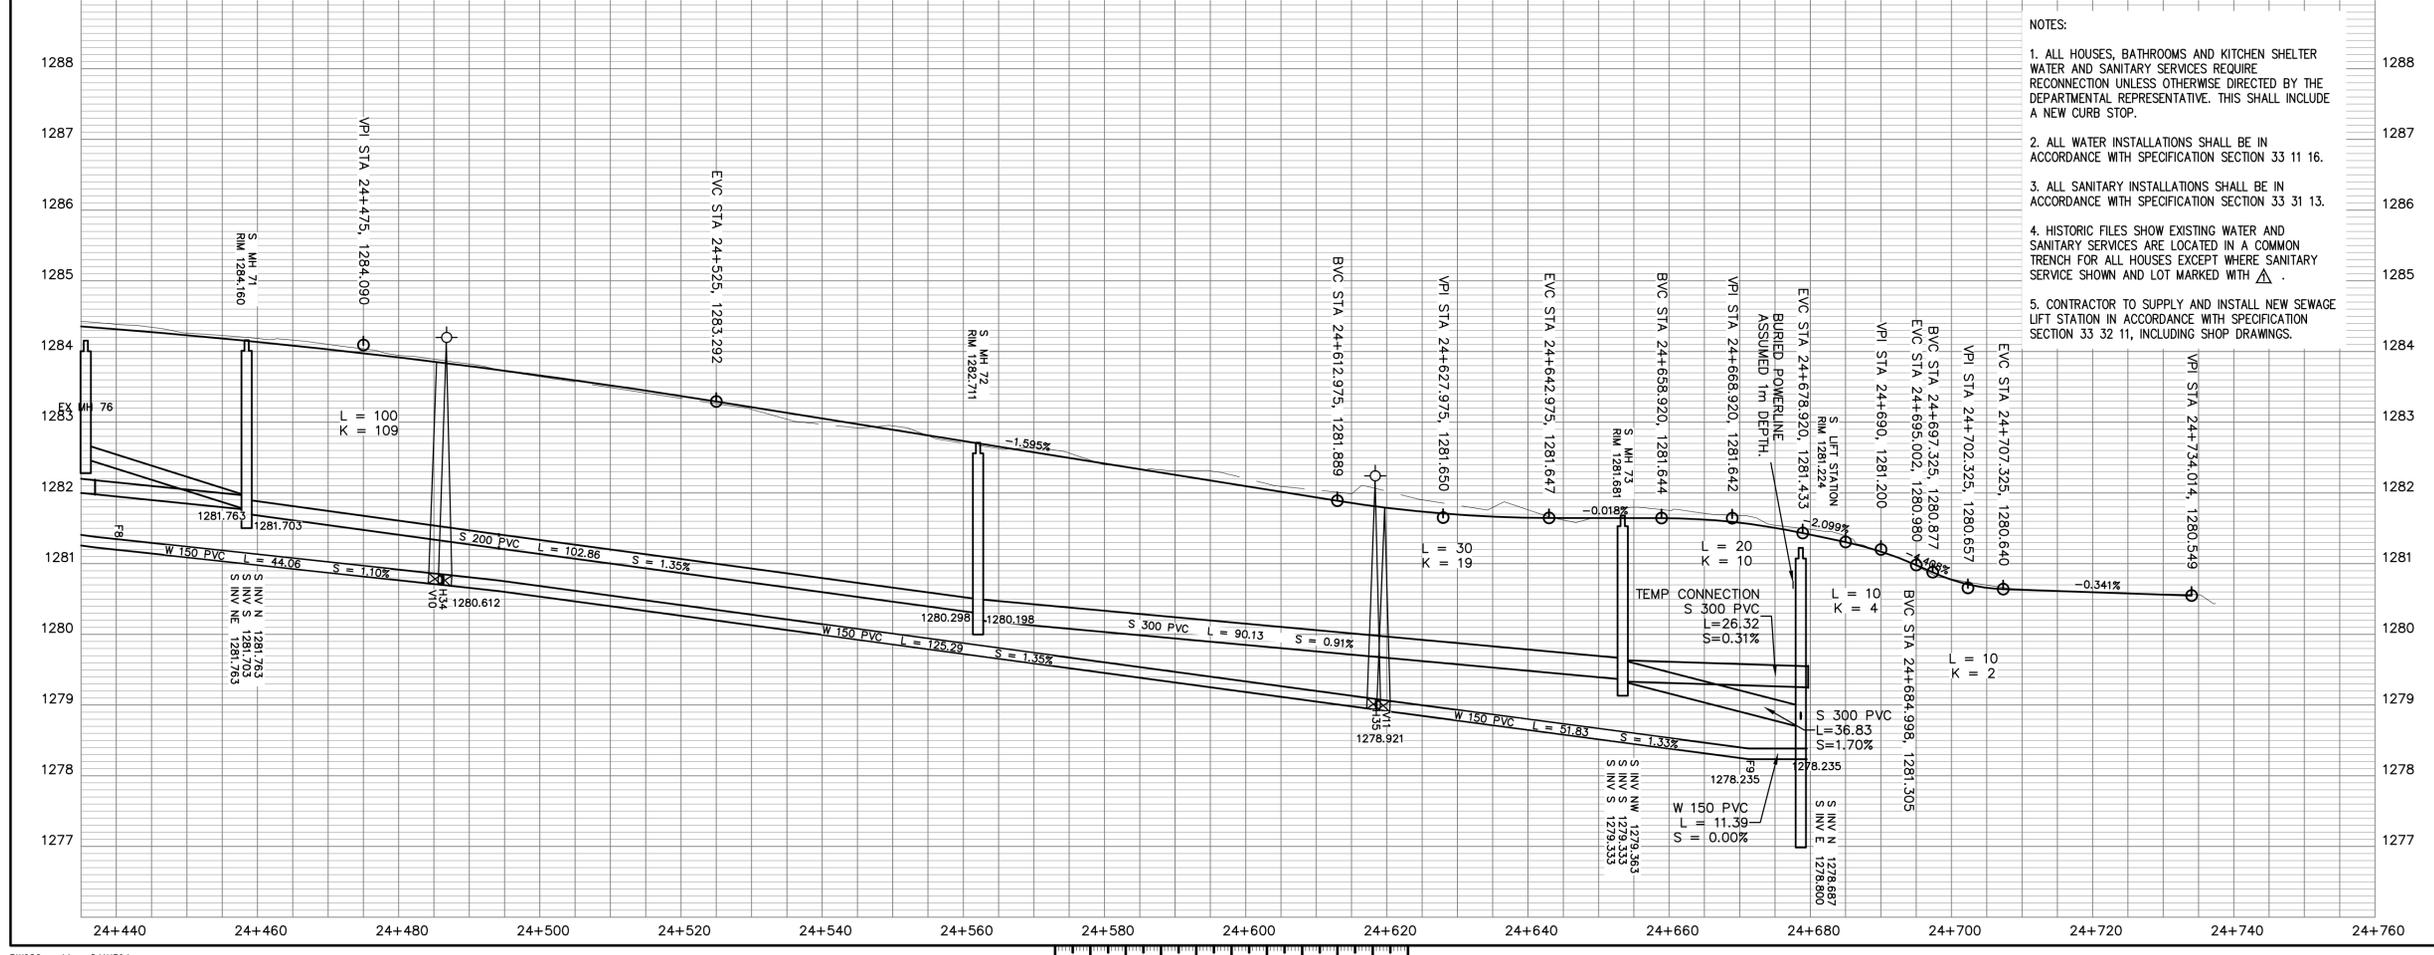

- NOTES:
1. ALL HOUSES, BATHROOMS AND KITCHEN SHELTER WATER AND SANITARY SERVICES REQUIRE RECONNECTION UNLESS OTHERWISE DIRECTED BY THE DEPARTMENTAL REPRESENTATIVE. THIS SHALL INCLUDE A NEW CURB STOP.
 2. ALL WATER INSTALLATIONS SHALL BE IN ACCORDANCE WITH SPECIFICATION SECTION 33 11 16.
 3. ALL SANITARY INSTALLATIONS SHALL BE IN ACCORDANCE WITH SPECIFICATION SECTION 33 31 13.
 4. HISTORIC FILES SHOW EXISTING WATER AND SANITARY SERVICES ARE LOCATED IN A COMMON TRENCH FOR ALL HOUSES EXCEPT WHERE SANITARY SERVICE SHOWN AND LOT MARKED WITH Δ.
 5. CONTRACTOR TO SUPPLY AND INSTALL NEW SEWAGE LIFT STATION IN ACCORDANCE WITH SPECIFICATION SECTION 33 32 11, INCLUDING SHOP DRAWINGS.