
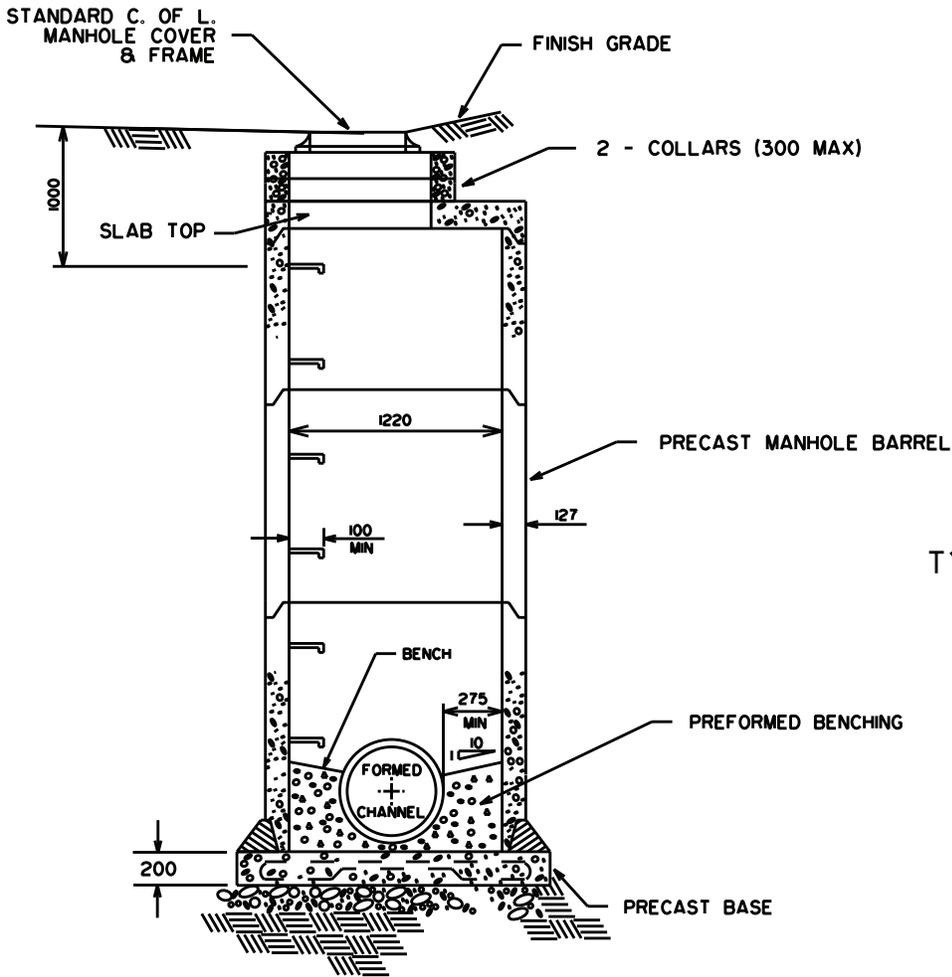


- NOTE: - PRECAST MANHOLE SECTIONS TO CONFORM TO A.S.T.M. DESIGNATION C478 (LATEST EDITION)
- ALL JOINTS TO BE SEALED WITH FLEXIBLE BUTYL RESIN SEALANT OR TYLOX SUPERSEAL GASKET
  - ALL DIMENSIONS IN mm
  - LADDER RUNGS SHALL BE CLEAR OF ALL LATERALS
  - MANHOLE STEPS AT 400 o/c
  - FOR BENCHING DETAIL SEE DRAWINGS S-07
  - CEMENT TO BE TYPE 50 (SULPHATE RESISTANT)

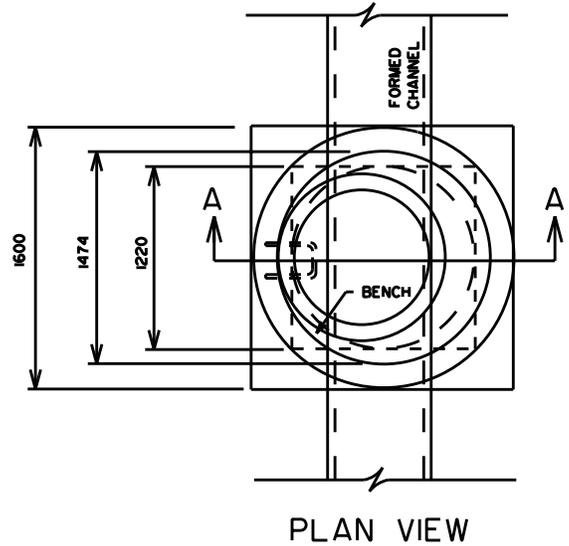

TYPICAL STEP DETAIL

SECTION A-A

NOTE: TO BE USED ONLY WHEN CONNECTING TO EXISTING MAINS 600 mm DIAMETER & SMALLER.

REVISED	 <p>CITY OF <i>Lethbridge</i> INFRASTRUCTURE SERVICES</p>	DRAWN	P.R.A.
NOV 15, 2004		CHECKED	
DEC 14, 2005		APPROVED	
FEB 3, 2010		SCALE	N.T.S.
		DATE	97/03/08
	STANDARD MANHOLE TYPE I	DWG NO	S-01