

PRELIMINARY
 NOT FOR CONSTRUCTION

WATERMAIN DATA				
STATION	REF.	INVERT	DESCRIPTION	REMARKS
24+057.7	F1	1288.665	LOCATE, CUT & CONNECT TO EXISTING 150mm LINE.	
24+060.8	F3	1288.581	90° BEND	
24+060.9	V2	1288.402	150mm GATE VALVE	
24+060.9	F2	1288.424	150 X 150 X 150 TEE	
24+061.9	V1	1288.400	150mm GATE VALVE	
24+153.1	H31	1288.229	HYDRANT #31, VALVE AND TEE	
24+264.7	V3	1283.573	150mm GATE VALVE	
24+265.6	F4	1283.554	150 X 150 X 150 TEE	
24+266.6	V5	1283.533	150mm GATE VALVE	
24+303.4	DV1		LOCATE, CUT & CONNECT DRAIN VALVE IN CHAMBER	
24+319.9	H33	1282.787	HYDRANT #33, VALVE AND TEE	
35+002.6	V4	1283.567	150mm GATE VALVE	
35+004.5	F19	1283.585	5" BEND	
60+011.8	F12	1288.199	11.25° BEND	
60+026.8	F13	1287.899	11.25° BEND	
60+056.8	SP1	1287.258	25mm STOP DRAIN & STAND PIPE TO IRRIGATION BOX	

Scale: Horiz. 1:500
 Vert. 1:50

amec foster wheeler

Consultant's Name
 Nom de l'expert-conseil
**Amec Foster Wheeler
 Environment & Infrastructure**

Eng. Stamp
 Scellement de l'ingénieur
**PROFESSIONAL ENGINEER
 (P. ENG.)**

489 - 40th Street South
 Lethbridge, Alberta CANADA T1J 4M1
 Tel. (403) 329-1467
 Fax (403) 327-4938

DO NOT SCALE DRAWINGS

Revision/Revision	Description/Description	Date/Date
5		
4		
3		
2	100% DESIGN COMPLETION	07/13/15
1	75% DESIGN COMPLETION	07/01/15
0	50% DESIGN COMPLETION	05/17/15

Client/client
 Parks Canada / L'Agence Parcs Canada
 Western and Northern Region / Ouest et Nord du Canada

Project title/Titre du projet
**WATERTON TOWNSITE
 MUNICIPAL INFRASTRUCTURE
 UPGRADES
 PHASE A AND B
 WATERTON NATIONAL PARK
 ALBERTA**

Approved by/Approuvé par
 B. ZACHER
 B. JOHNSON

Designed by/Concept par
 M. BURKE

PWGSC Project Manager/Administrateur de Projets TPSGC
 PWGSC, Architectural and Engineering Resources Manager/
 Ressources Architectural et de Directeur d'ingénierie, TPSGC



Client/client
 J. LAMBE

Drawing title/Titre du dessin
**NEW UTILITIES
 EVERGREEN AVENUE
 SOUTH
 PLAN PROFILE
 Sta. 24+000 to Sta. 24+280**

Project No./No. du projet
R.075721.001

Sheet/Feuille
C14
 OF 41

Revision no./La Révision no.
2

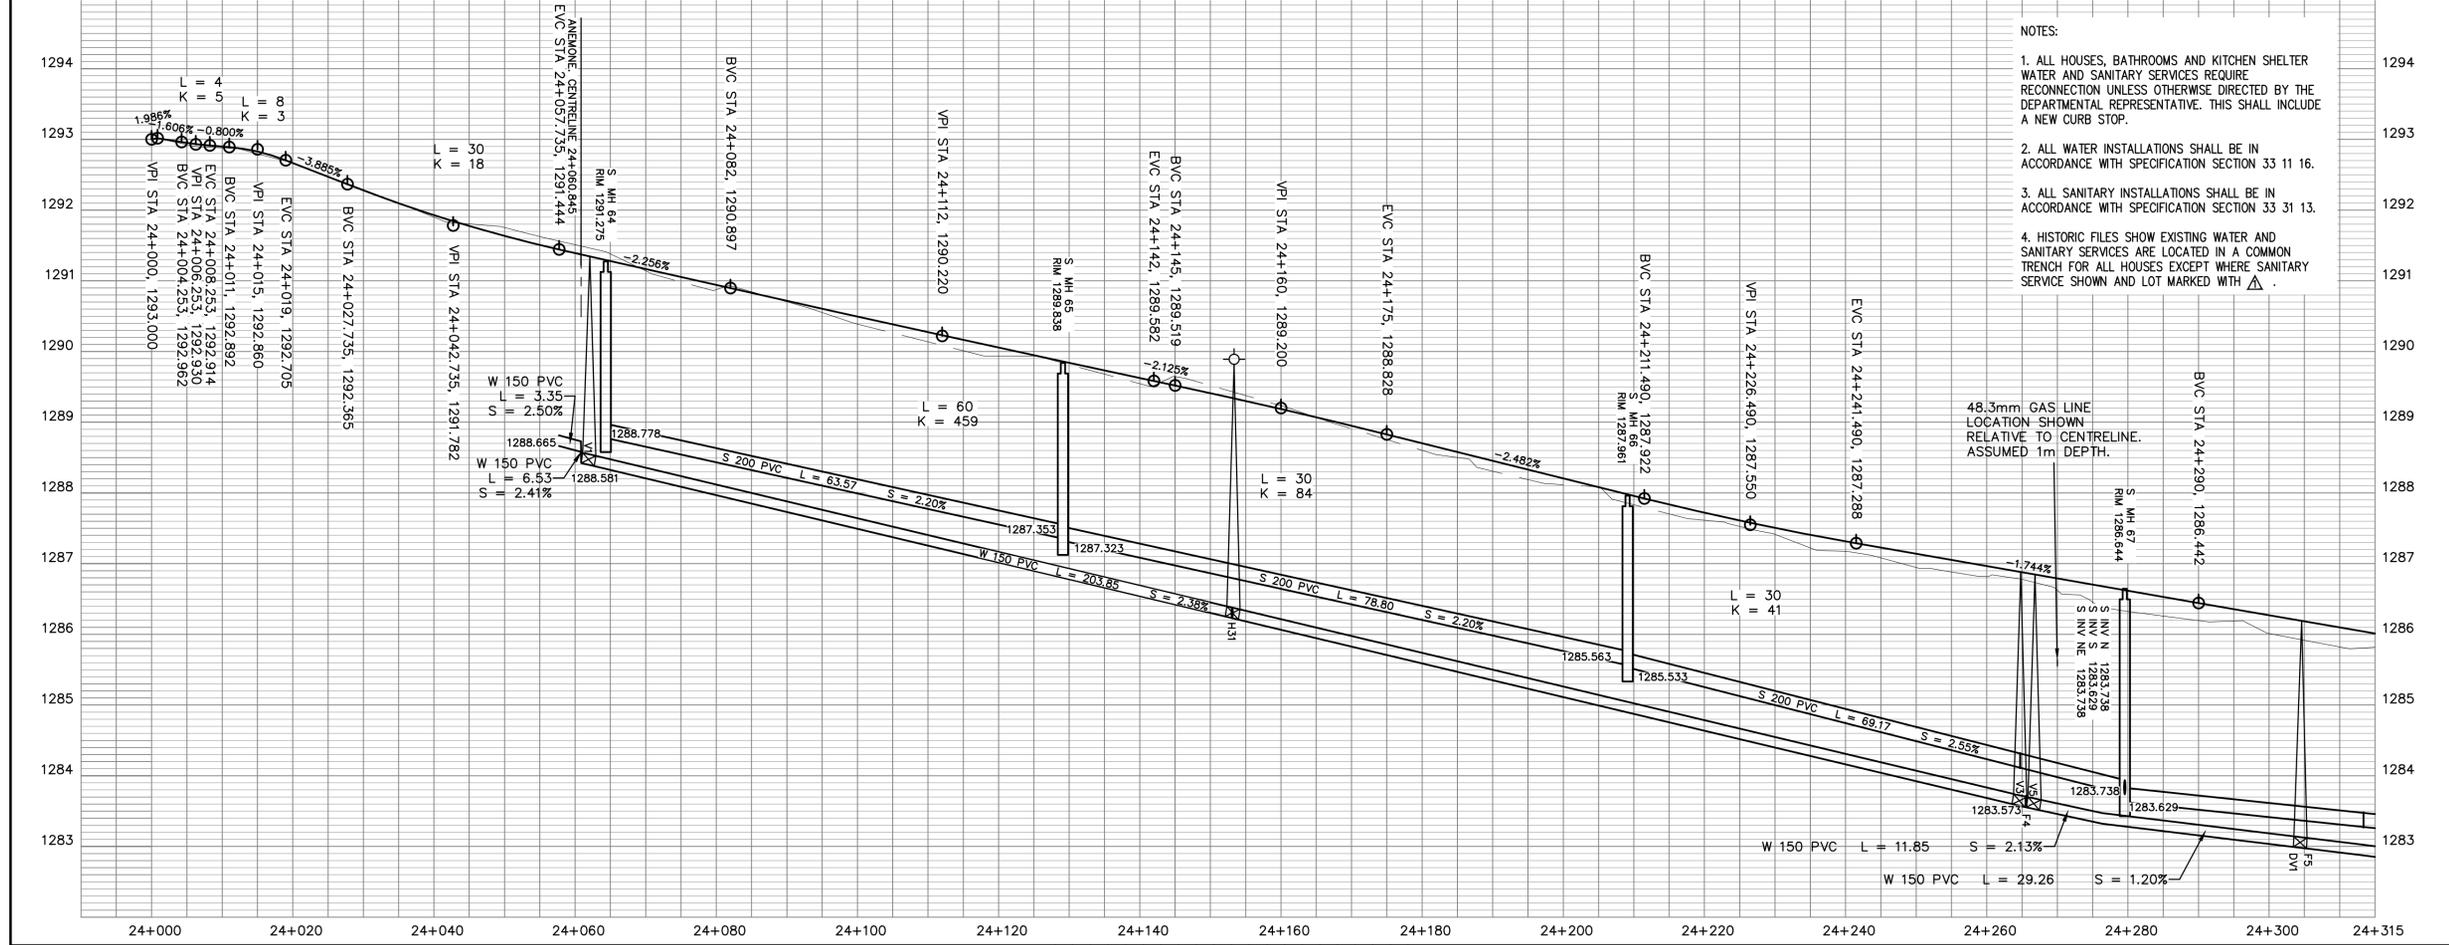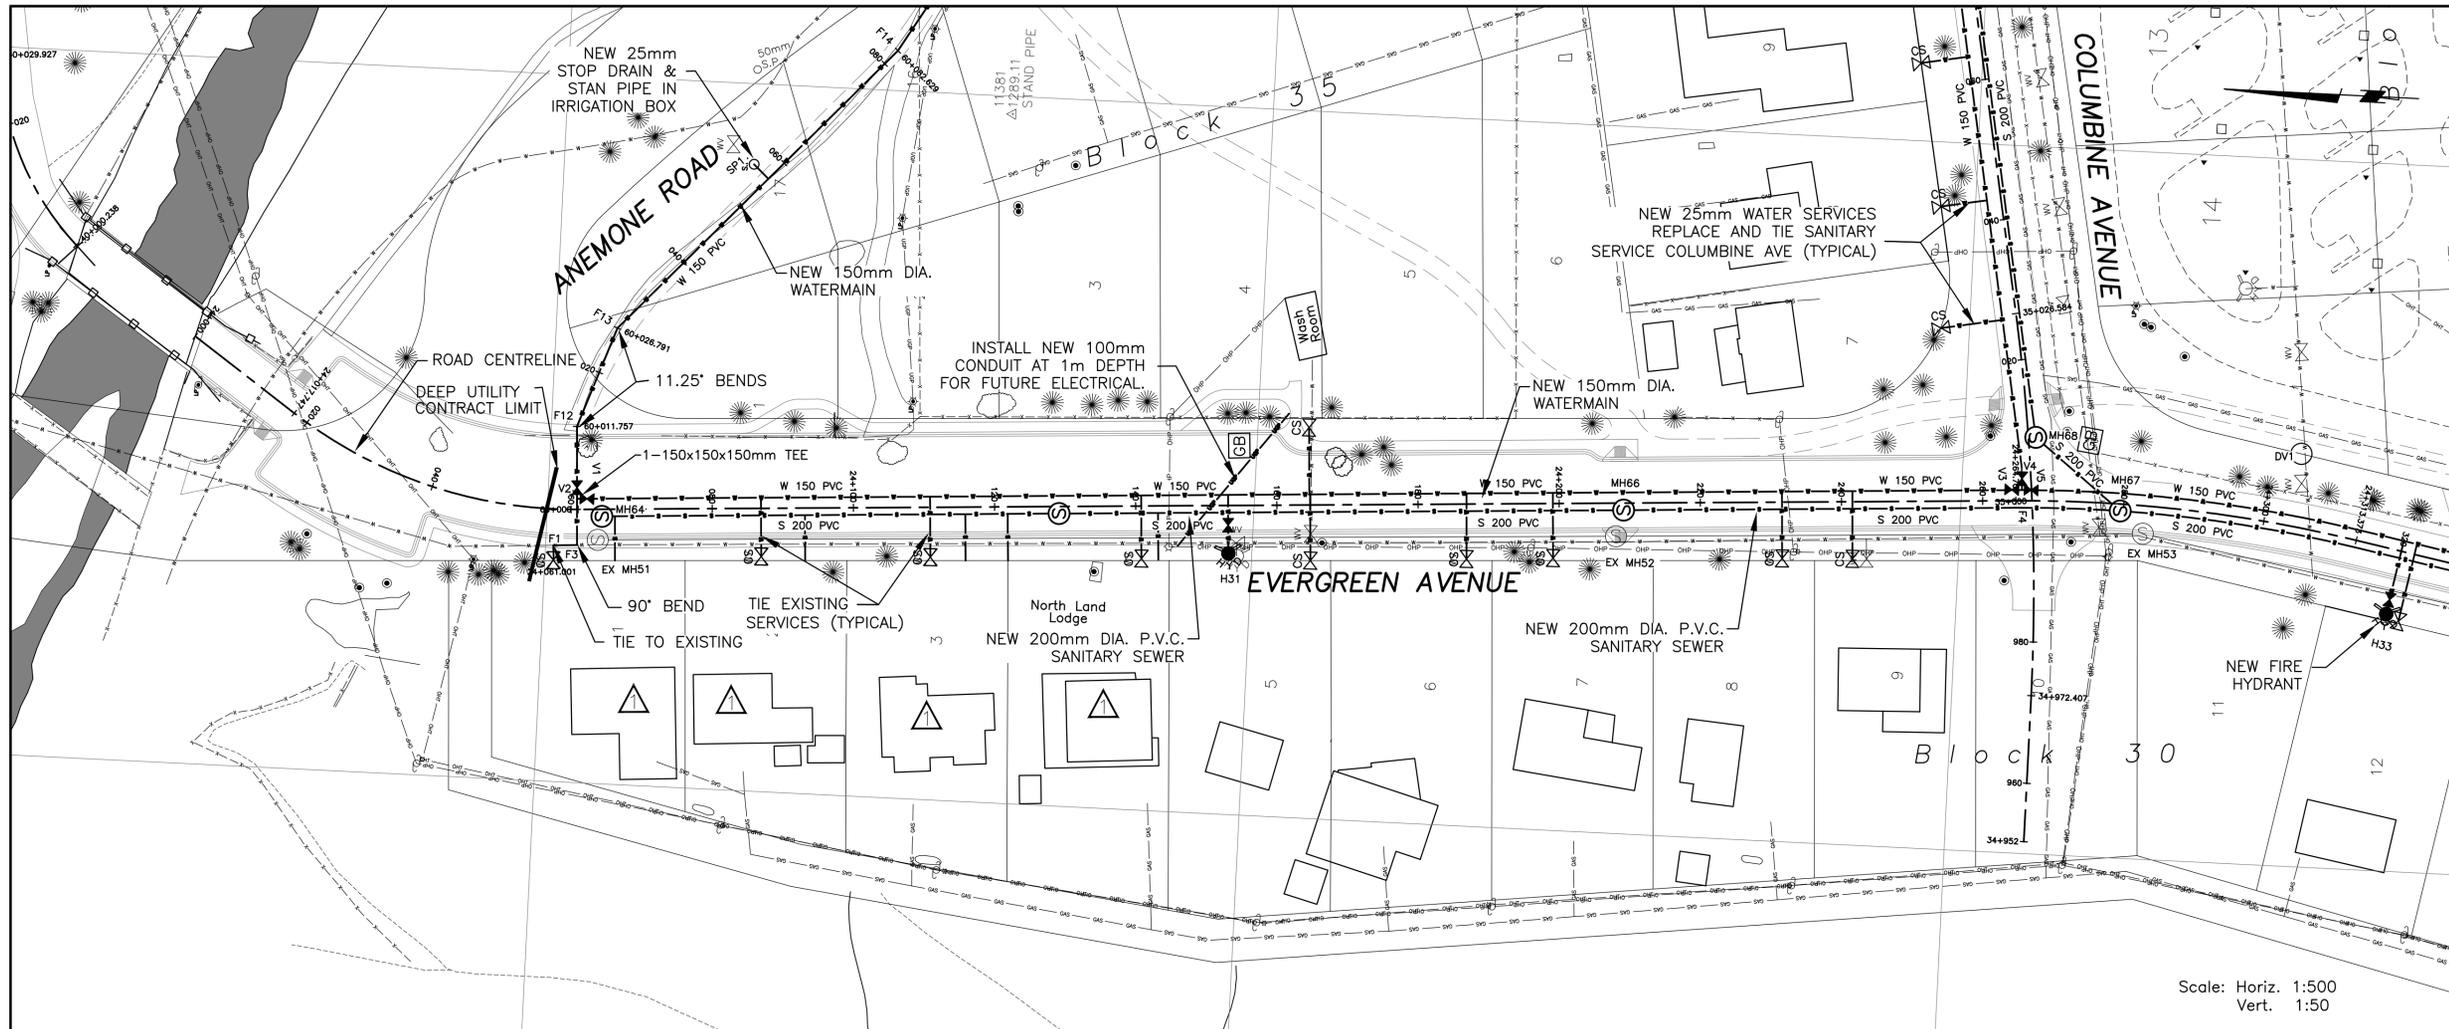

NOTES:

1. ALL HOUSES, BATHROOMS AND KITCHEN SHELTER WATER AND SANITARY SERVICES REQUIRE RECONNECTION UNLESS OTHERWISE DIRECTED BY THE DEPARTMENTAL REPRESENTATIVE. THIS SHALL INCLUDE A NEW CURB STOP.
2. ALL WATER INSTALLATIONS SHALL BE IN ACCORDANCE WITH SPECIFICATION SECTION 33 11 16.
3. ALL SANITARY INSTALLATIONS SHALL BE IN ACCORDANCE WITH SPECIFICATION SECTION 33 31 13.
4. HISTORIC FILES SHOW EXISTING WATER AND SANITARY SERVICES ARE LOCATED IN A COMMON TRENCH FOR ALL HOUSES EXCEPT WHERE SANITARY SERVICE SHOWN AND LOT MARKED WITH Δ .