

SYMBOL	DESCRIPTION
	ELECTRICAL CONNECTION POINT
	15A 120V DUPLEX RECEPTACLE
	15A 120V DUPLEX RECEPTACLE AT NON-STANDARD HEIGHT - TO BE CONFIRMED WITH ARCHITECTURAL ELEVATIONS
	15A 120V DUPLEX RECEPTACLE SURGE
	20A 120V DUPLEX RECEPTACLE (CSA 3-20RA)
	EXIT LIGHT - SHADING INDICATES ILLUMINATED FACE
	LED FIXTURE - REFER TO LUMINAIRE SCHEDULE
	FLUORESCENT FIXTURE - REFER TO LUMINAIRE SCHEDULE
	15A 120V SPST SWITCH
	CEILING MOUNTED VACANCY SENSOR
	WALL MOUNTED VACANCY SENSOR
	MOTOR AS NOTED
	PANEL AS NOTED
	DOUBLE HEAD REMOTE EMERGENCY LIGHT
	EMERGENCY LIGHTING UNIT WITH REMOTE HEADS
	NIGHT LIGHT
	VOICE DATA OUTLET (VDO DENOTES VOICE ZONE)
	TV OUTLET COMPLETE WITH COAXIAL CABLE IN 19mm EMT TO TV DISTRIBUTION ON SECOND FLOOR
	DATACOM SWITCH
	FLUSH FLOOR MOUNTED OUTLET BOX AND DEVICES AS SHOWN
	SYNCHRONOUS CLOCK
	FLOOR MOUNTED RACEWAY
	PHOTOCELL
	15A 120V SPST SWITCH 3 WAY SWITCH
	OUTLET BOX COMPLETE WITH BLANK FACEPLATE. INSTALL 25mm EMPTY CONDUIT BETWEEN THE WALL BOX AND OUTLET BOX IN SURFACE MOUNTED RACEWAY.

ABBREVIATIONS

D - DIMMER	P.L. - P.L.C. LIGHT
F - FLOOR	K - KEYED
GF - GROUND FAULT	R.P. - REAR PROOF
L - LOW VOLTAGE	E.P. - EXPLOSION PROOF

HATCHED LUMINAIRES INDICATE UNSWITCHED NIGHT LIGHTS.

LUMINAIRE SCHEDULE

AA - 30x120mm TWO LAMP RECESSED FLUORESCENT SUITABLE FOR T-BAR CEILING HINGED WHITE DOOR FRAME WITH METRIC CORNERS AND SPRING LOADED LATCHES. 3.2mm THICK K12 LENS. ELECTRONIC BALLAST (E 9 00) AND PAINT-FINISHED FRAME.  
LITHONIA A1023A12 120V DAWRITE #100225-1201  
COLUMBIA BPS14 225215A12 120V-SSL METALUX #9025-120V  
CFL #1425 225215A12 120V-SSL METALUX #9025-120V  
CFL #1425 225215A12 120V-SSL METALUX #9025-120V

BB - 1200mm TWO LAMP SURFACE MOUNTED FLUORESCENT STRIP CW SLOTTED REFLECTOR AND ELECTRONIC BALLAST (E 9 00).  
LITHONIA A1023A12 120V CFL #1425 225215A12 120V-SSL METALUX #9025-120V  
CFL #1425 225215A12 120V-SSL METALUX #9025-120V


CC - ONE LAMP 610mm WALL MOUNTED TO FLUORESCENT WHITE FINISH SATIN LENS.  
AXIS #8609

DD - 410mm x 1200mm TWO LAMP RECESSED FLUORESCENT SUITABLE FOR T-BAR CEILING HINGED WHITE DOOR FRAME WITH METRIC CORNERS AND SPRING LOADED LATCHES. 3.2mm THICK K12 LENS. ELECTRONIC BALLAST (E 9 00) AND PAINT-FINISHED FRAME.  
LITHONIA A1023A12 120V DAWRITE #100225-1201  
COLUMBIA BPS14 225215A12 120V-SSL METALUX #9025-120V  
CFL #1425 225215A12 120V-SSL METALUX #9025-120V



EE - LINEAR LED UNDERCABINET 3000K WHITE FINISH.  
COOPER #H4LDH1012 120V

1 - LED ALL EXTERIOR WALL MOUNT LUMINAIRE WITH EPOXY-COATED DIE-CAST ALUMINUM HOUSING AND BACKPLATE. TYPE 3 DISTRIBUTION. FULL CUT OFF. 40 LUMENS PER WATT. WHITE FINISH. 4000K COLOR TEMPERATURE.  
Rush The Edge # X-DE-63-M-C-140-7  
MAGNUM EXTERIOR RECESSED REBAR BALLAST OF WICKETITE BASH-3501-30-120-SAM  
LITHONIA FOSR42 LED 200 700 400 TIES 120 DN/ND 120V

XA - EXISTING 610x1200mm SURFACE MOUNTED FLUORESCENT.

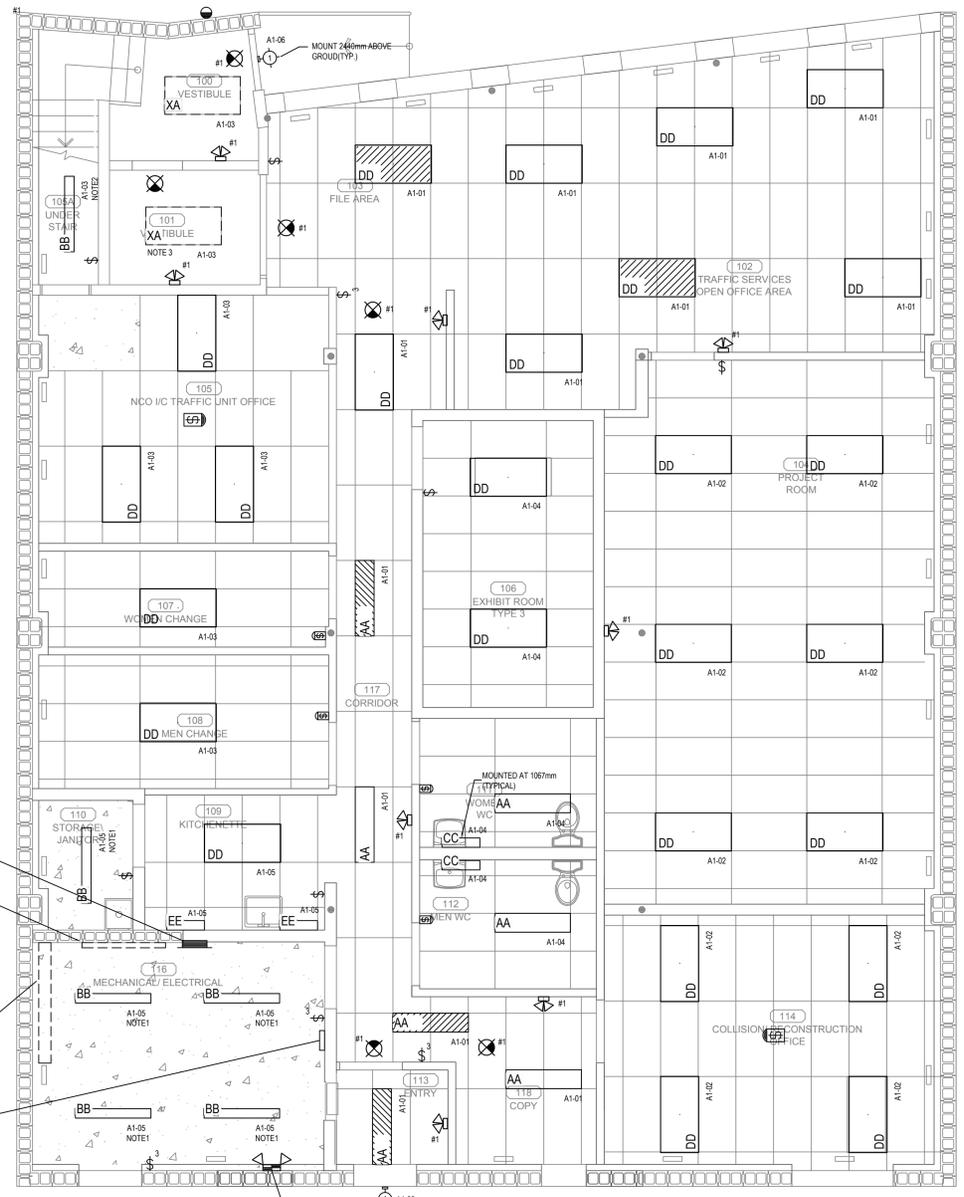

- NOTES
- COORDINATE MOUNTING HEIGHT OF LUMINAIRES WITH MECHANICAL ON SITE.
  - MOUNT LUMINAIRES TO USE OF GULFCON WIRE GUARD.
  - REINSTALL EXISTING LUMINAIRE IN NEW CEILING.

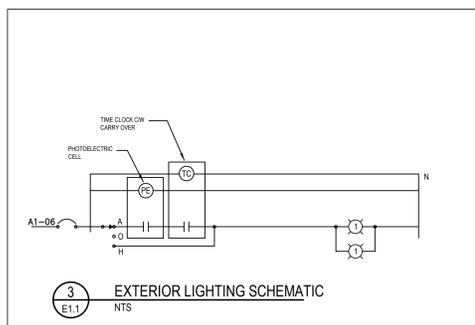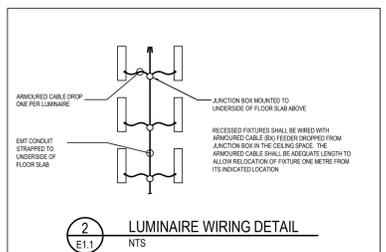

NEW PANEL 'A1'  
1200x40 V. 18. 3W. 25SA. 6ACCT.  
SURFACE MOUNTED

EXISTING TELEPHONE PLYWOOD

EXISTING MAIN DISTRIBUTION  
SEE DWG E2.3 FOR DETAIL

NEW TIME CLOCK FOR EXTERIOR LIGHTING.

1 E1.1 LIGHTING-MAIN FLOOR  
1/4"=1'-0"



REVISIONS	DESCRIPTION	DATE
D	ISSUED FOR TENDER	17/07/15
C	ISSUED FOR 100K	15/05/15
B	ISSUED FOR 99K REVIEW	04/06/15
A	ISSUED FOR 50K REVIEW	02/13/15

REVISIONS	DESCRIPTION	DATE
A	detail number of detail	
B	source drawing no. de dessin no.	
C	detail on drawing no. detail sur dessin no.	

project title / titre du projet: **RCMP ESTEVAN TENANT FIT-UP**

1320 4TH STREET  
ESTEVAN, SASKATCHEWAN

drawing title / titre du dessin: **MAIN FLOOR ELECTRICAL LIGHTING**

designed by / conçu par: HJ	drawn by / dessiné par: ZHW	approved by / approuvé par: BB
PWOSC Project Manager / Administrateur de Projets TPSOC		scale / échelle: AS SHOWN
project no. / projet no.: R.063116.001	sheet / feuille: E1.1	date / date: JULY 17TH, 2015