
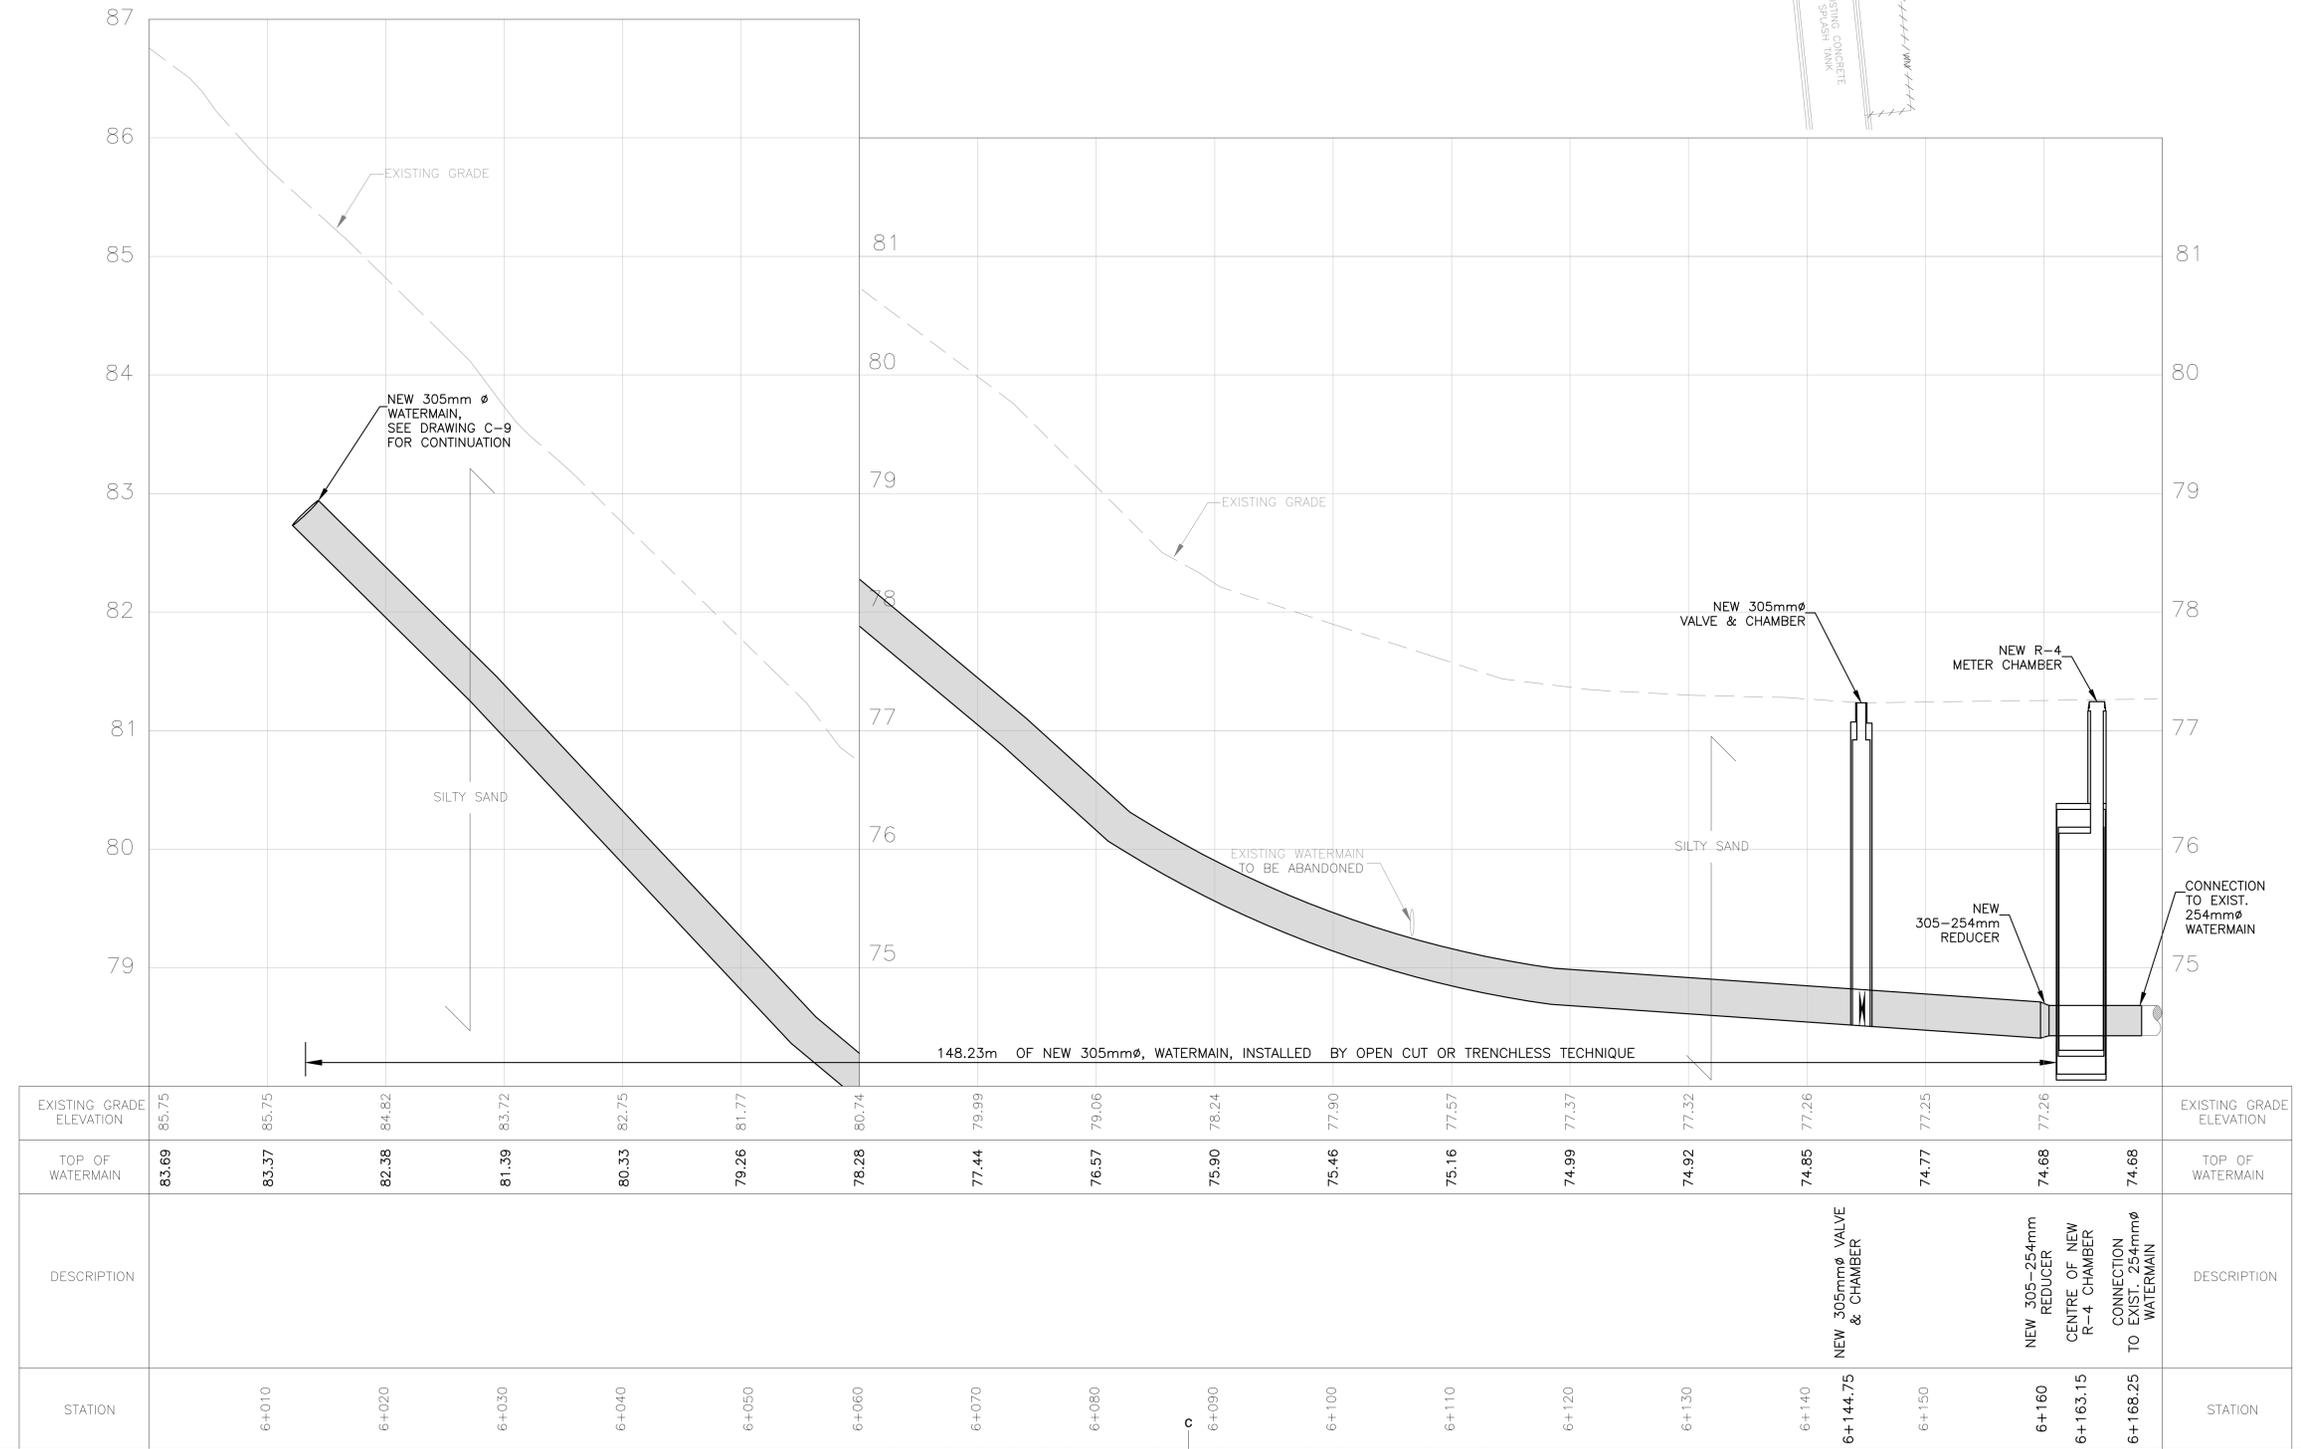


CONTINUED, SEE DRAWING C-9



NOTE: FOR TRENCHLESS INSTALLATIONS, VERTICAL AND HORIZONTAL BENDS MAY BE REPLACED WITH PIPE DEFLECTIONS PROVIDED RESULTANT PIPE DEFLECTIONS DO NOT EXCEED MANUFACTURERS' RECOMMENDATIONS.

3	100% ISSUED FOR TENDER	30/01/15
2	99% REVIEW	12/12/14
1	66% SUBMISSION	17/01/14
revisions	description	date

project

1426 ST-JOSEPH BLVD. WATERMAIN RECONSTRUCTION

OTTAWA, ONTARIO

drawing

PLAN AND PROFILE BASELINE 6 WATER MAIN STATION 6+000 TO 6+168.25

designed	J. MAYDA	conçu
date	2015/01/30	(yyyy/mm/dd)
drawn	G. FATTOUCHE	dessiné
date	2015/01/30	(yyyy/mm/dd)
reviewed	J. MAYDA	examiné
date	2015/01/30	(yyyy/mm/dd)
approved		approuvé
date		(yyyy/mm/dd)
Tender	D. MOIR	Soumission
Project Manager	2015/01/30	Administrateur de projets
project no.		no. du projet
	R.020045.006	
drawing no.		no. du dessin
	C-13	