




DRAWING NOTES:

- ① PROVIDE NEW ELECTRICAL FEED FOR NEW PUMP STATION. TIE INTO EXISTING CDP PANEL 'CDP-4' C/W NEW 400A, 3P BREAKER, IN ROOM 2100. REFER TO SLD ON DWG E2 FOR DETAILS.
- ② ONCE IN GARAGE RAISE CONDUIT UP TO CEILING JOISTS AND RUN IN OPEN AREAS.
- ③ RUN CONDUIT DOWN AROUND BAY GARAGE DOOR AND EXIT BUILDING INTO 1003MM X 914MM PULL BOX MOUNTED ON EXTERIOR OF BUILDING. FROM PULL BOX ENTER DUCT BANK AS PER CIVIL DRAWING DETAILS. REFER TO CIVIL DRAWINGS.
- ④ EXTERIOR DUCT BANK INSTALLED BY OTHERS. REFER TO CIVIL DRAWINGS FOR TRENCHING DETAIL.

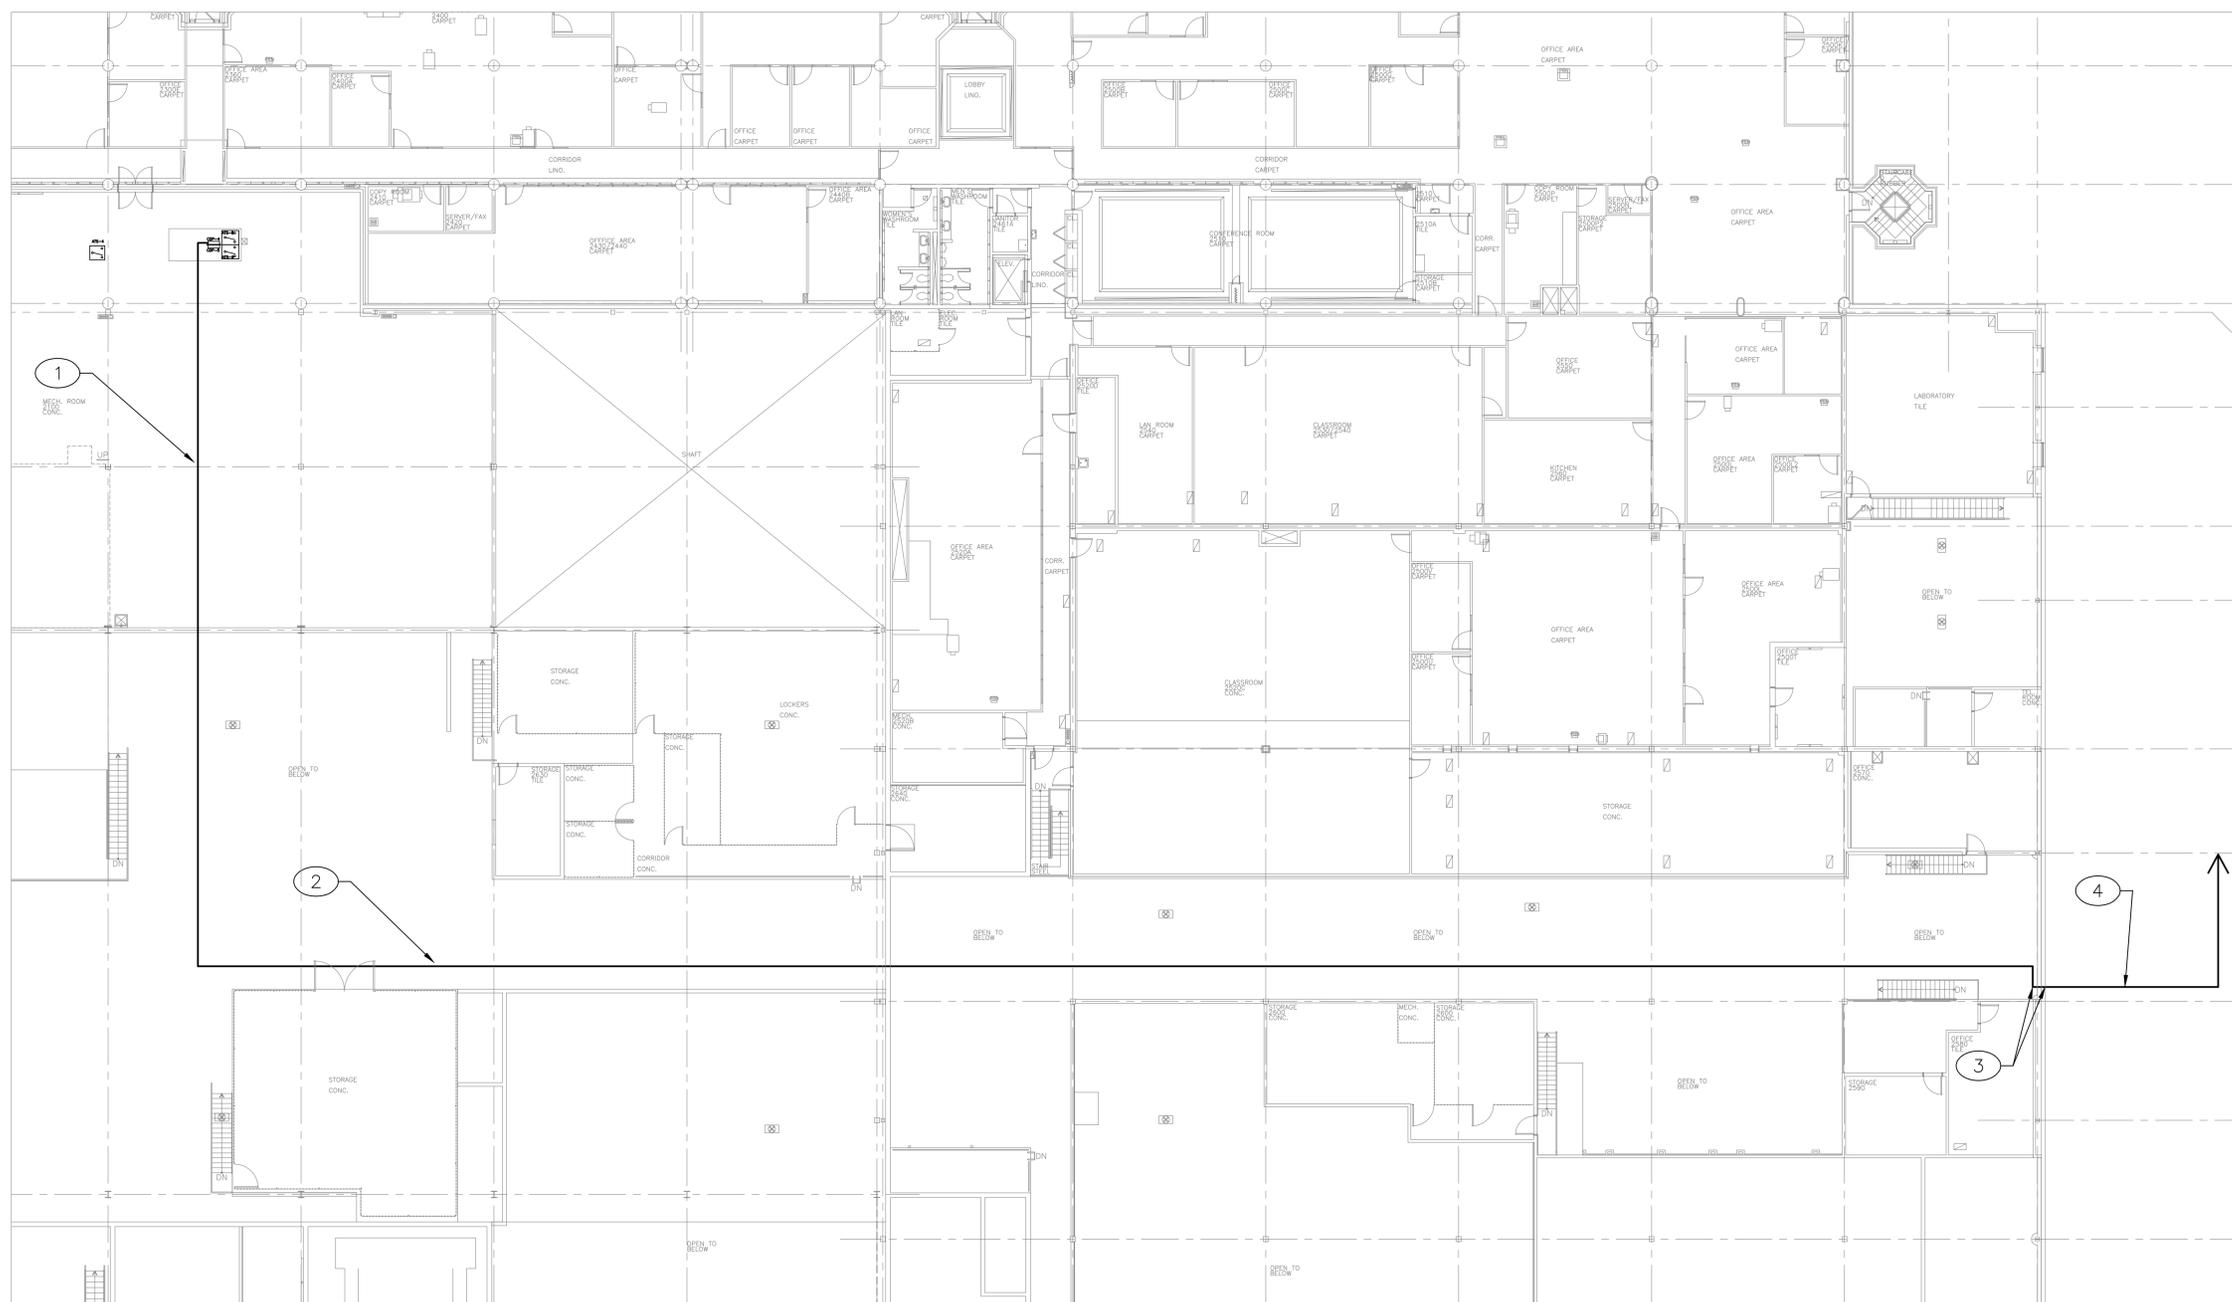

NEW PUMPING STATION ELECTRICAL FEED – CONDUIT PLAN

SCALE: 1:150

P.A.M.I

2215 - 8TH AVE
HUMBOLDT, SASKATCHEWAN S0K 2A0

CONSULTANT NAME AND ADDRESS:

JRP ENGINEERING
Professional Engineers

9 Holgate Court, Kanata, ON, K2K 1B4
Tel: 613-266-8226 Email: Admin@jrpeng.com

revisions	description	date
3	100% ISSUED FOR TENDER	30/01/15
2	99% REVIEW	12/12/14
1	66% SUBMISSION	17/01/14

A C	A detail no. no. du détail B location drawing no. sur dessin no. C drawing no. dessin no.	A B C
--------	--	-------------

project 1426 ST. JOSEPH BLVD.,
WATERMAIN
RECONSTRUCTION

OTTAWA, ONTARIO

drawing ELECTRICAL
CONDUIT RUN

designed	J.R.P.	conçu
date		(yyyy/mm/dd)
drawn	M.G.	dessiné
date		(yyyy/mm/dd)
reviewed	J.R.P.	examiné
date		(yyyy/mm/dd)
approved	J.R.P.	approuvé
date		(yyyy/mm/dd)
Tender	D.MOIR	Submission

Project Manager / Administrateur de projets
project no. / no. du projet

R.020045.006

drawing no. / no. du dessin

