


NOTE:
1. INSTALL CONDUIT TO FIELD MOUNTED JUNCTION BOX TO WITHIN 1-METRE OF DIRECTIONAL CONTROL VALVES

BILL OF MATERIALS		
ITEM#	DESCRIPTION	SPECIFICATION No.
5	CABLE - #14 - RW90 - RED	26 99 02 - 2.2
6	CABLE - #14 - RW90 - WHITE	26 99 02 - 2.3
10	DIRECTIONAL CONTROL VALVES	11 99 07 - 2.10
13	SOOW CABLE 14AWG	26 99 02 - 2.8
26	PROGRAMMABLE LOGIC CONTROLLER	26 99 01 - 2.12
39	MAIN CONTROL CABINET	26 99 01 - 2.1

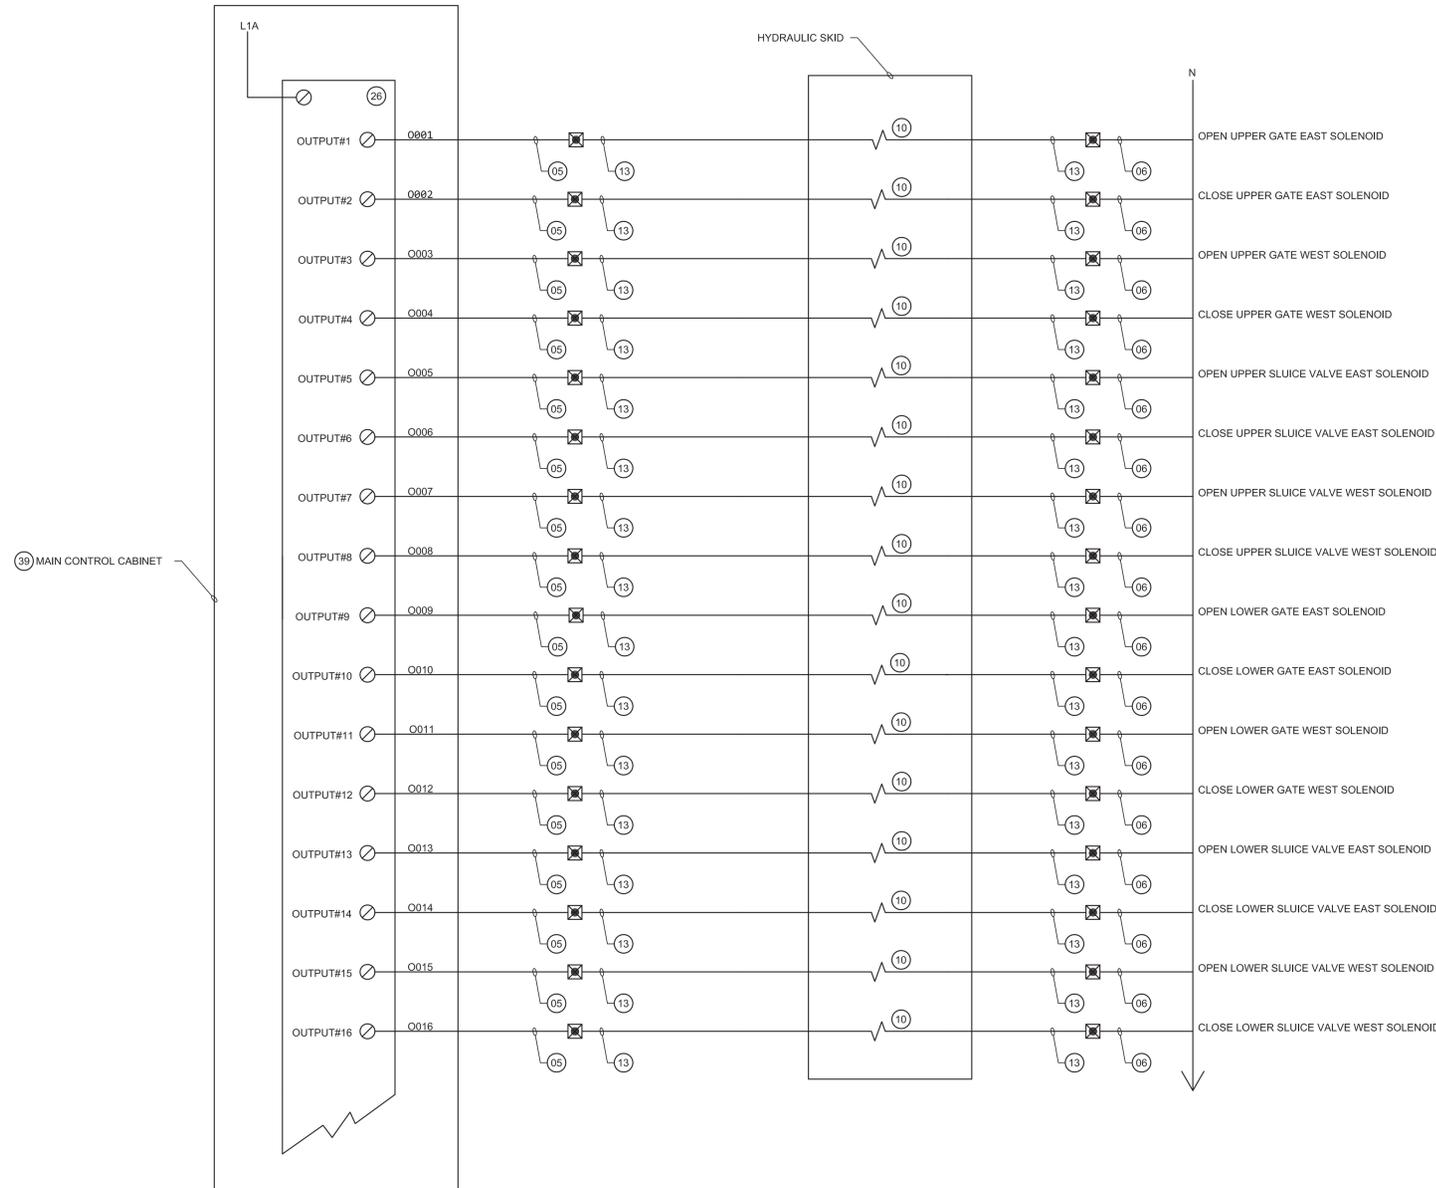

SEAL AND SIGNATURE MUST BE PRESENT TO USE DRAWING FOR OFFICIAL PURPOSES. TYPED INITIALS IN TITLE BLOCK AND REVISION BLOCK ARE FOR RECORD KEEPING PURPOSES ONLY.

No.	Description	Drawn By / Des.Par	Date
1	ISSUE FOR TENDER	DP	JULY 2015

Revision / Révision	
A	Detail number / No. du détail
B	Location dwg. no. / No. sur dessin

Project title / Titre du projet
**RIDEAU CANAL
BLACK RAPIDS LOCK 13
UPGRADES 2015**

Drawing title / Titre du dessin
**ELECTRICAL
PLC OUTPUT CARD**

Drawn by / Dessiné par ALEX BAILEY	Designed by / Conçu par HUGH CHANT
Approved by / Approuvé par HUGH CHANT	Drawing Date / Date du dessin JUNE 2015

Project No. / Numéro du projet R.078218.001	Drawing No. / Dessiné No. E104
Sheet / Feuille 1 of 1	