


DRAWING NOTES:

- CONNECT NEW SINK S-1 TO EXISTING DOMESTIC WATER, PLUMBING VENT AND SANITARY PIPING IN THIS AREA. PROVIDE ALL ADDITIONAL PIPING AND FITTINGS AS REQUIRED. CONFIRM EXACT LOCATION ON SITE.
- NEW 100mm \varnothing SPRINKLER MAIN UP FROM H17 LEVEL 1.
- NEW 100mm \varnothing SPRINKLER CONNECTION CAPPED FOR FUTURE C/W OS & Y GATE VALVE.
- NEW 100mm \varnothing SPRINKLER MAIN UP TO H17 LEVEL 2. PROVIDE FIRE STOPPING AT FLOOR PENETRATION AS REQUIRED.
- CONNECT NEW 100mm \varnothing SPRINKLER MAIN TO EXISTING 100mm \varnothing FIRE ENTRANCE HEADER AT THIS APPROXIMATE LOCATION C/W ALARM VALVE.
- EXISTING FIRE ENTRANCE BACKFLOW PREVENTER.
- NEW 100mm \varnothing FIRE PROTECTION HEADER. SEE DETAIL ON DRAWING M5.


- EXISTING DRINKING FOUNTAIN PIPING TO BE REMOVED AND CAPPED AT THIS APPROXIMATE LOCATION.
- NEW REVERSE OSMOSIS FILTRATION SYSTEM TO BE INSTALLED BELOW COUNTER IN MILLWORK. PURA MODEL QCR04V-75 OR APPROVED EQUAL. C/W CHROME POLISHED FAUCET, ADAPTORS, DRAIN CONNECTOR, TUBING, PRESSURE REGULATOR, 234mm \varnothing PLASTIC RESERVOIR TANK, FILTERS, SHUT OFF VALVES, AND MOUNTING BRACKETS. INSTALL RO SYSTEM AS PER MANUFACTURERS REQUIREMENTS. PROVIDE ALL ADDITIONAL PIPING AND FITTINGS AS REQUIRED FOR A COMPLETE WORKING SYSTEM. LOCATION TO BE CONSIDERED APPROXIMATE. COORDINATE WITH ARCHITECTURAL.

THE OUTLINED AREA IS TO BE PROTECTED WITH SPRINKLERS, INSTALLED AS PER NFPA 13. OCCUPANCY HAZARD SHALL BE AS REQUIRED BY NFPA 13. SPRINKLER DRAWINGS TO BE SEALED BY A PROFESSIONAL ENGINEER REGISTERED IN THE PROVINCE OF NEWFOUNDLAND AND LABRADOR. COORDINATE ALL NEW PIPING AND SPRINKLER HEAD LOCATIONS WITH ARCHITECTURAL, STRUCTURAL, MECHANICAL AND ELECTRICAL LAYOUTS. ALL SPRINKLER PIPING IS SHOWN FOR APPROXIMATE LOCATION PURPOSES ONLY. CONTRACTOR TO SUBMIT SHOP DRAWINGS OF SPRINKLER SYSTEM FOR REVIEW.

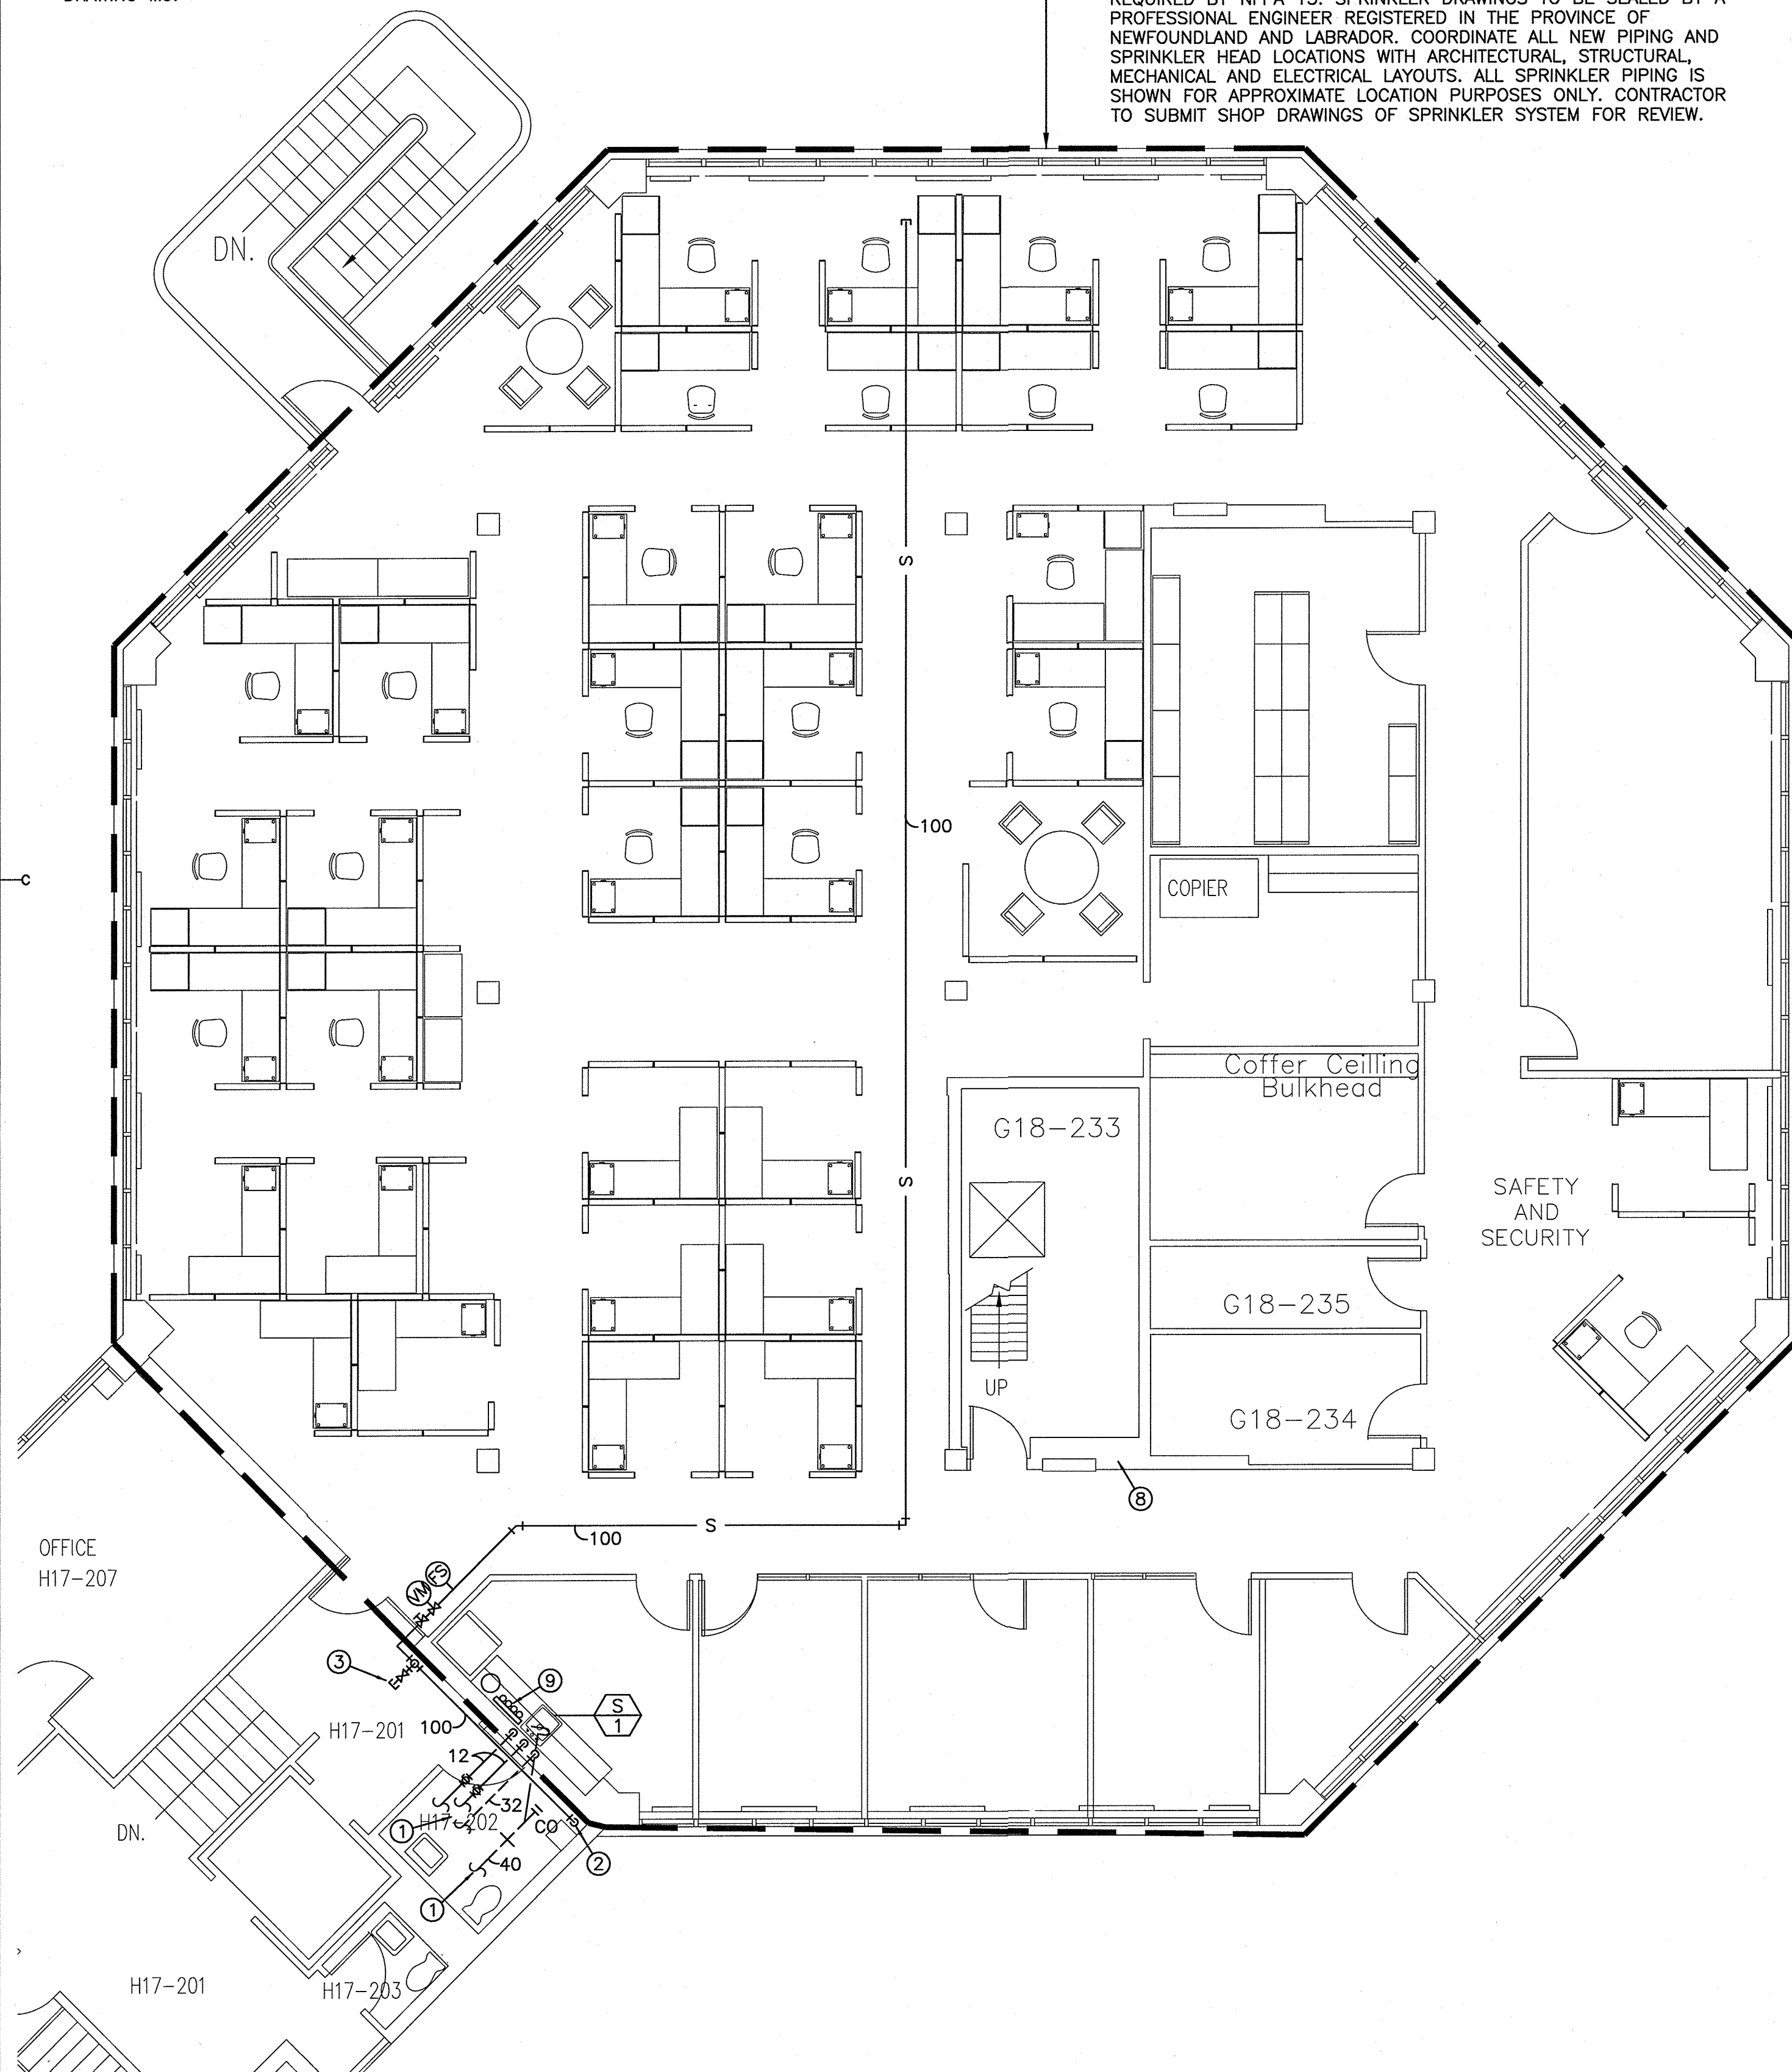


NEW PLUMBING AND SPRINKLER PLAN - LEVEL 2 (G18)

SCALE: 1 : 75

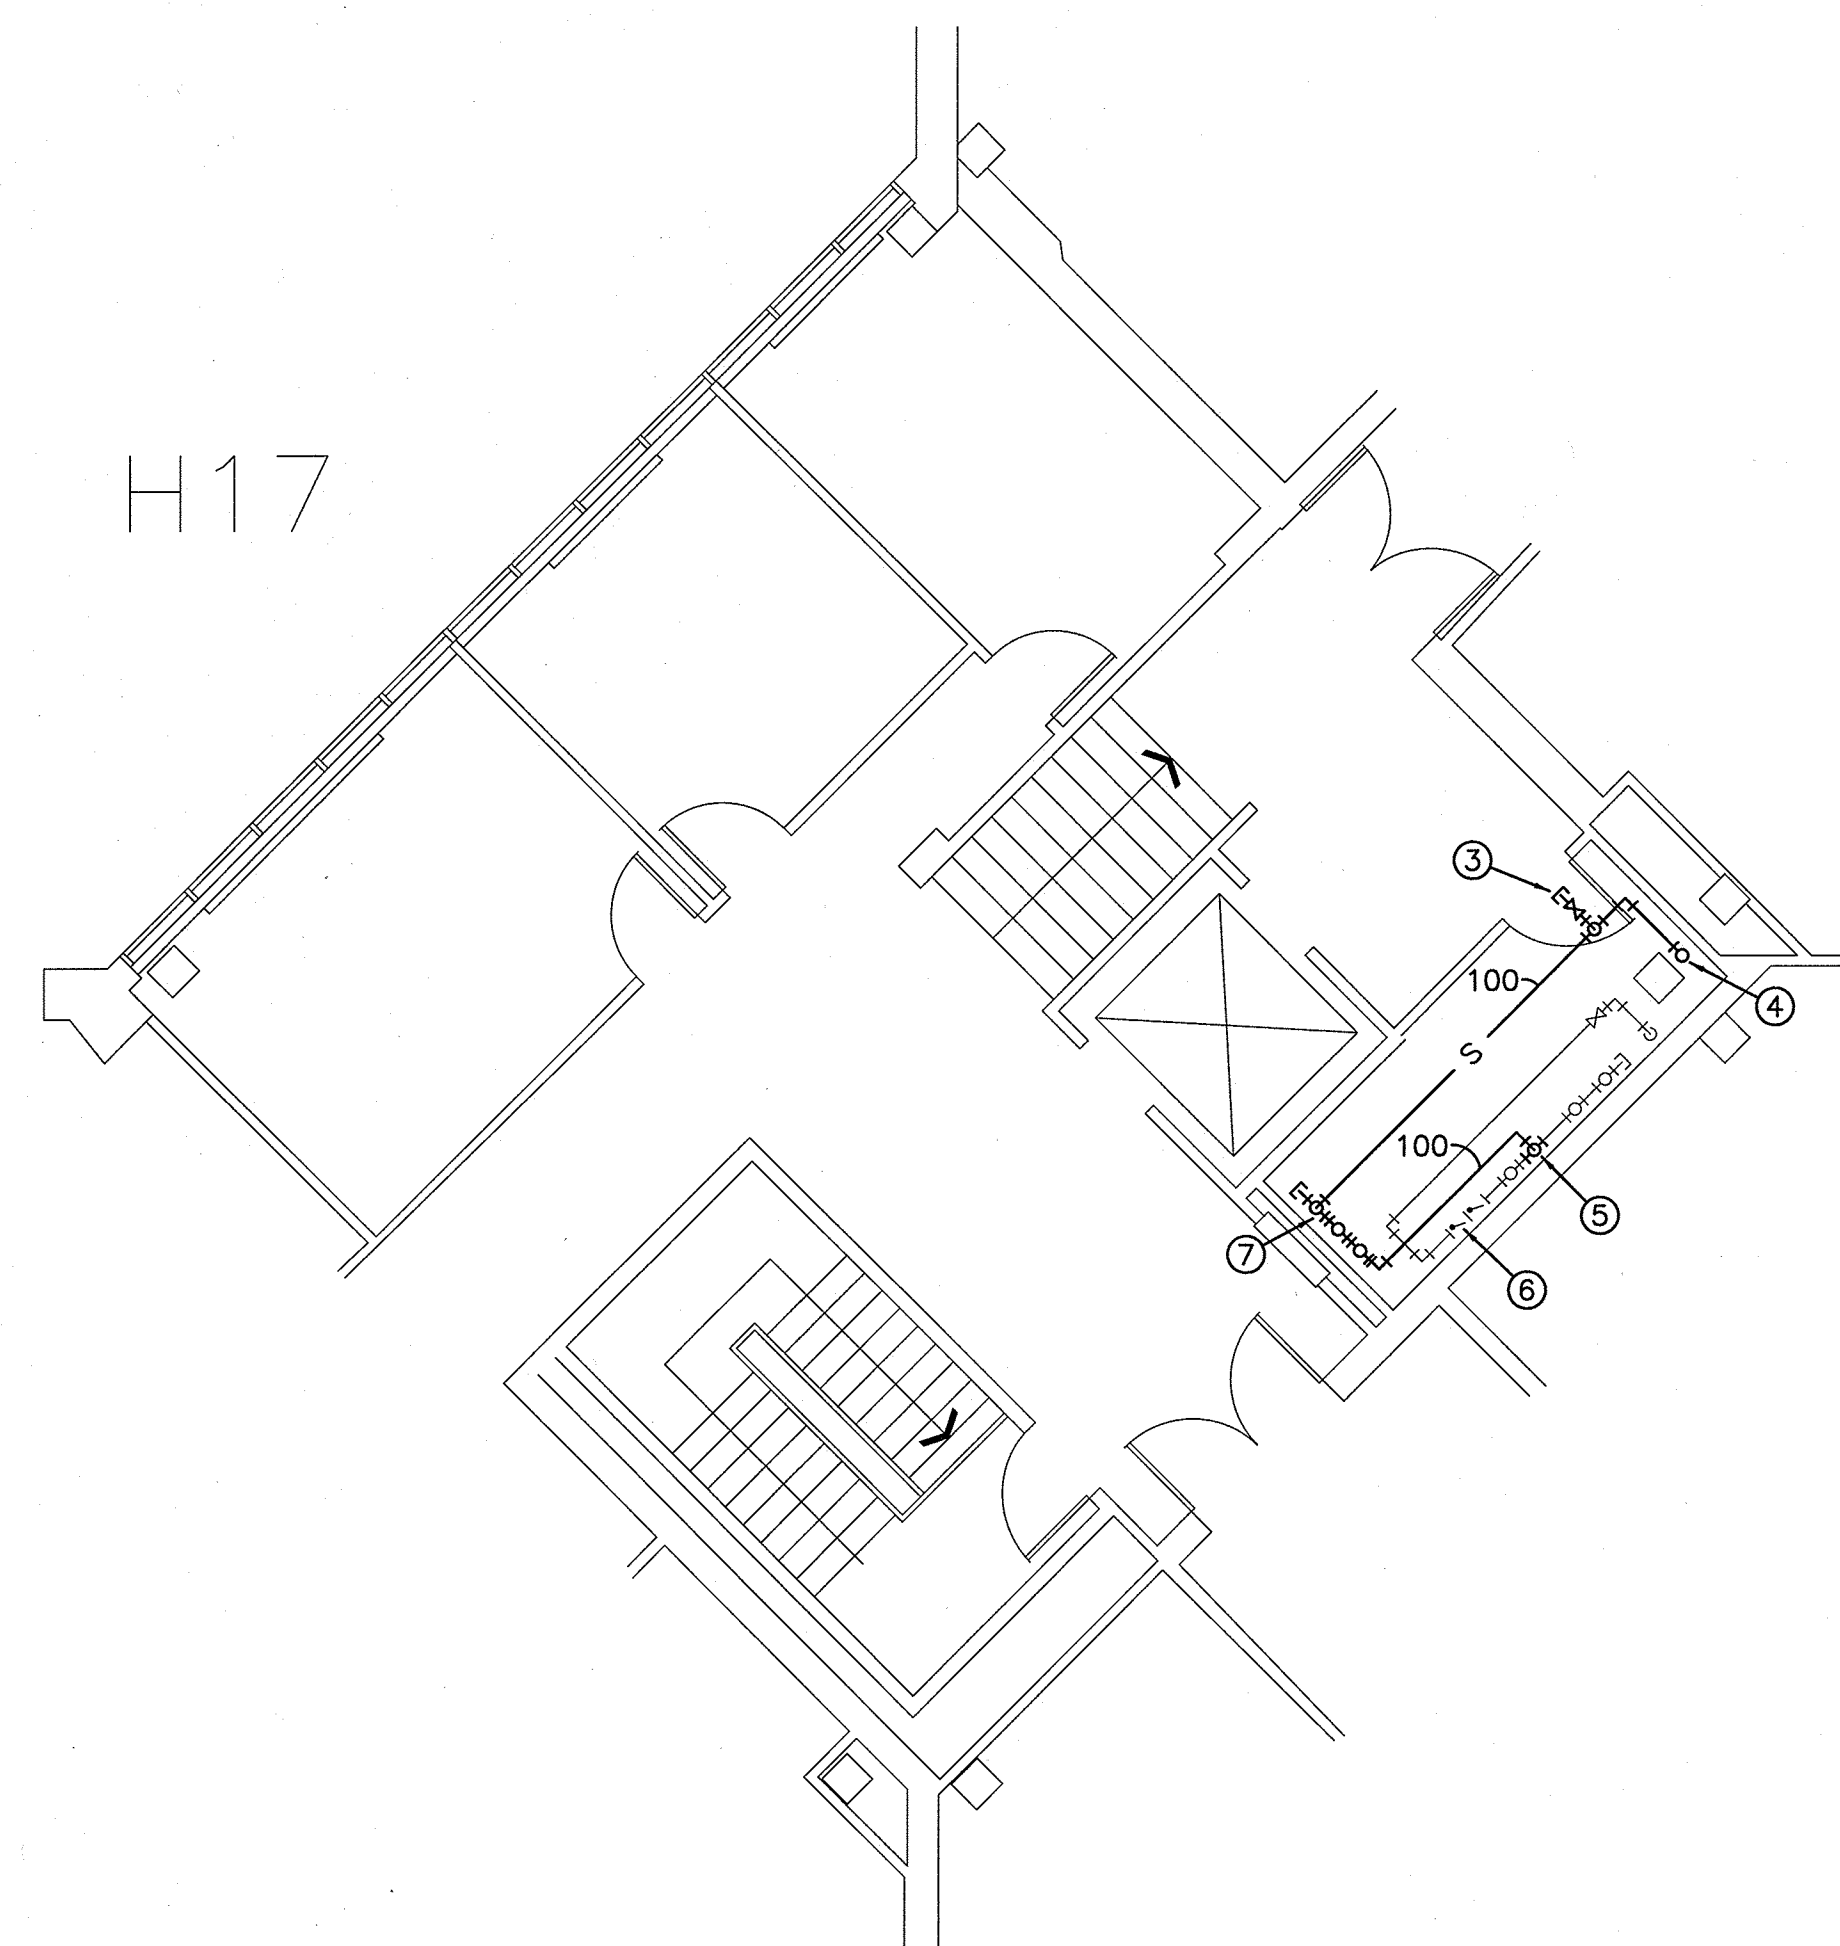

NEW SPRINKLER PLAN - LEVEL 1 (H17)

SCALE: 1 : 75



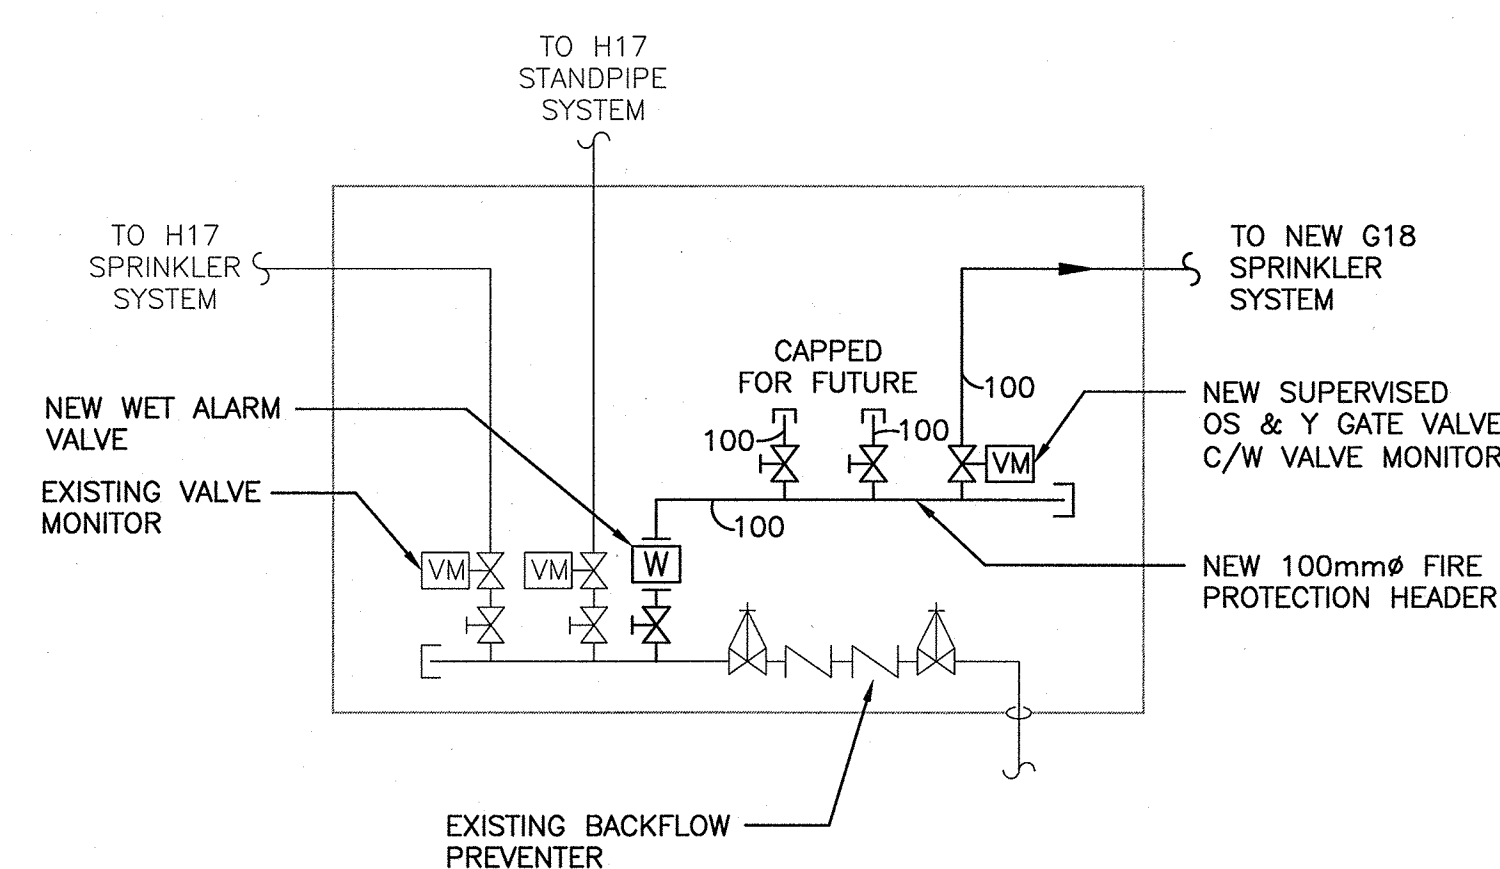


NEW FIRE PROTECTION HEADER DETAIL

N.T.S.

0 0.75m 1.5m 2.25m 3.0m 3.75m
SCALE 1 : 75

Public Works and Government Services Canada
Travaux Publics et Services gouvernementaux Canada

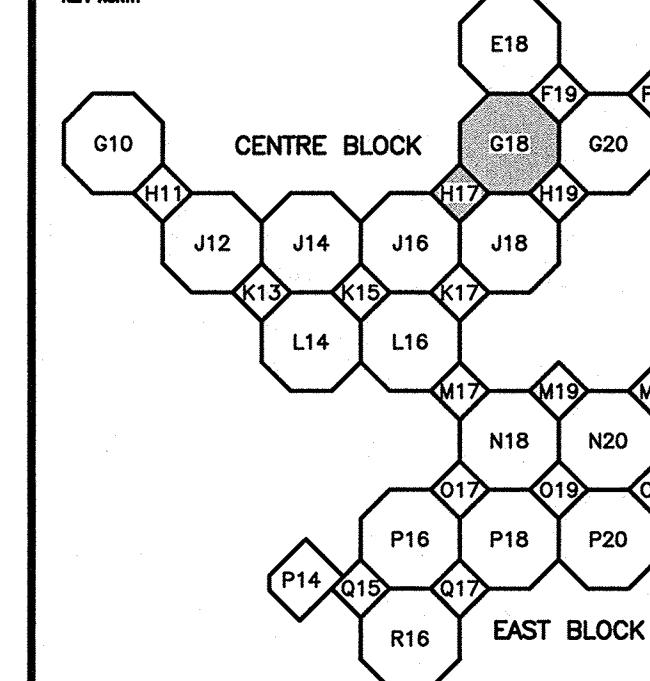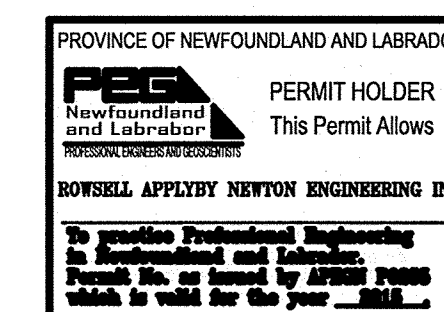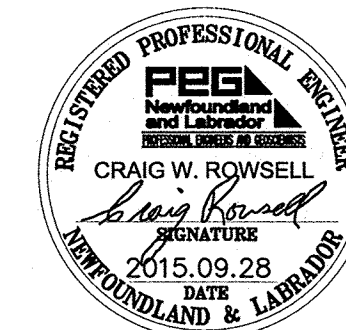

revisions	date
4	REVISED ISSUED FOR TENDER 09/28 2015
2	REVISED ISSUED FOR TENDER 04/07 2014
1	ISSUED FOR TENDER 03/24 2014
0	ISSUED FOR REVIEW 02/28 2014

G18 LEVEL 2
INTERIOR RENOVATIONS
NORTHWEST ATLANTIC
FISHERIES CENTRE
St. John's, NL

NEW PLUMBING &
SPRINKLER PLANS -
LEVELS 1 & 2

designed C.H. congu
date APRIL 2014
drawn C.H. dessiné
date APRIL 2014
approved C.R. approuvé
date APRIL 2014

Tender 14-02-28
PWSC Project Manager Administrateur de projets TPSC
project number no. du projet

R068178.001

drawing no. M3
no. du dessin