


M&R ENGINEERING LIMITED
5531 Cornwallis St, Halifax, NS, B3K 1B3
Tel: (902) 422-7393, Fax: (902) 423-4945
Website: www.mreng.ca

GENERAL NOTES :
DO NOT SCALE THIS DRAWING FOR CONSTRUCTION PURPOSES. USE FIGURED DIMENSIONS AS NOTED.
THESE DRAWINGS ARE TO BE READ IN CONJUNCTION WITH SPECIFICATIONS AND GENERAL CONTRACTUAL CONDITIONS.
ALL DIMENSIONS AND CONDITIONS ARE TO BE VERIFIED ON SITE. ALL DISCREPANCIES ARE TO BE REPORTED TO THE DEPARTMENTAL REPRESENTATIVE AND AGREED UPON WITH WORKS. INFORMATION ON THESE DRAWINGS IS TO BE USED FOR THIS PROJECT ONLY AND SHALL NOT BE USED FOR ANY OTHER PURPOSE.

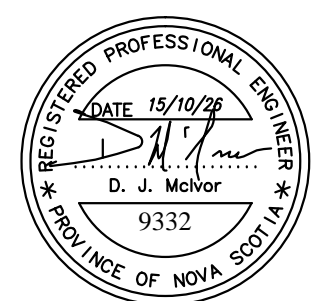


3	ISSUED FOR TENDER	OCT 26 2015
2	99% REVIEW	SEP 11 2015
1	66% REVIEW	JUN 30 2015
revisions		date

project: AAFK KENTVILLE RESEARCH CENTRE LABATORY BLOCK-C CONTROLS SYSTEM UPGRADE KENTVILLE, N.S.

drawing no.: **NEW FIRST FLOOR & MECHANICAL ROOM ELECTRICAL LAYOUT**

designed TML	concur
date JULY 2015	
drown JCN	dessiné
date JULY 2015	
approved	approuvé
date	
Tender	Submission
PWOSC Project Manager	Administrateur de projets TPSC
project number	no. du projet
R.074306.001	
drawing no.	no. du dessin
E302	

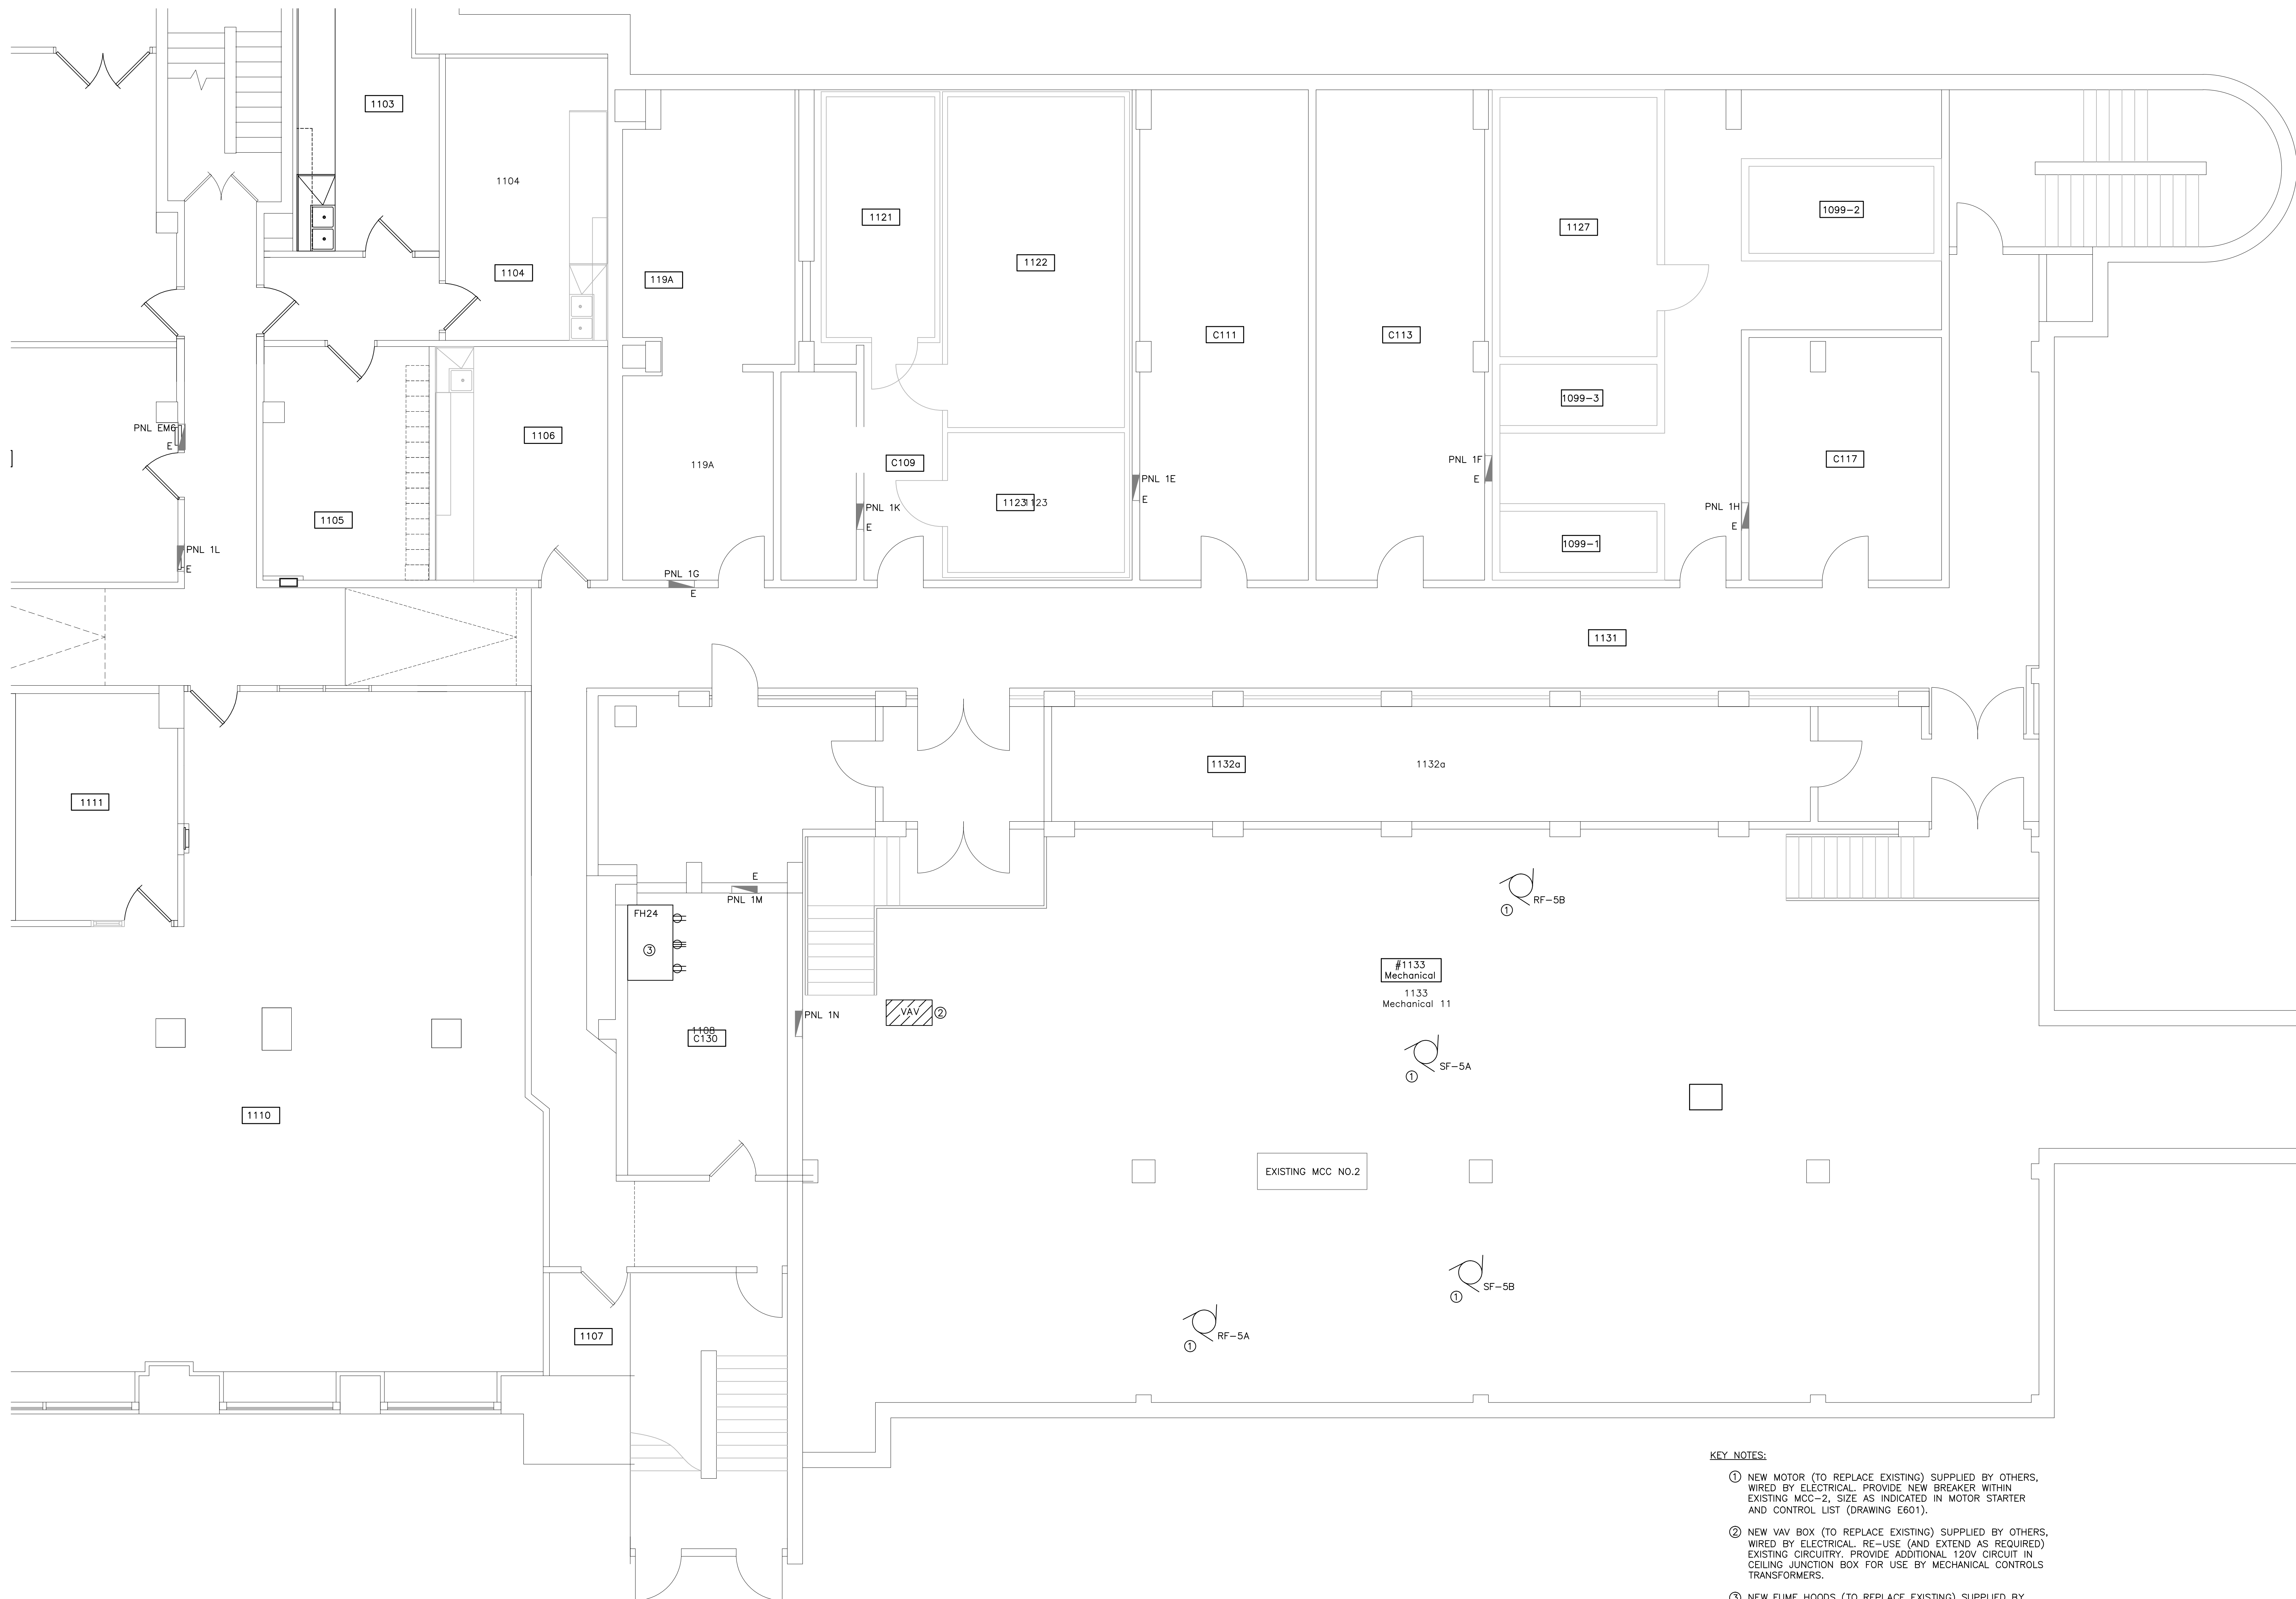

KEY NOTES:

- NEW MOTOR (TO REPLACE EXISTING) SUPPLIED BY OTHERS, WIRED BY ELECTRICAL. PROVIDE NEW BREAKER WITHIN EXISTING MCC-2, SIZE AS INDICATED IN MOTOR STARTER AND CONTROL LIST (DRAWING E601).
- NEW VAV BOX (TO REPLACE EXISTING) SUPPLIED BY OTHERS, WIRED BY ELECTRICAL. RE-USE (AND EXTEND AS REQUIRED) EXISTING CIRCUITRY. PROVIDE ADDITIONAL 120V CIRCUIT IN CEILING JUNCTION BOX FOR USE BY MECHANICAL CONTROLS TRANSFORMERS.
- NEW FUME HOODS (TO REPLACE EXISTING) SUPPLIED BY OTHERS, WIRED BY ELECTRICAL. RE-USE EXISTING CIRCUITRY. FUME HOOD RECEPTACLES SHALL ALSO BE REPLACED WITH NEW. NEW RECEPTACLES SHALL MATCH EXISTING IN A LIKE-FOR-LIKE FASHION.

GENERAL NOTES:

- ELECTRICAL CONTRACTOR SHALL PROVIDE NEW UPDATED PANEL DIRECTORIES FOR EXISTING PANELS THAT HAVE BEEN MODIFIED WITH THE SCORE OF WORK.

NEW FIRST FLOOR & MECHANICAL ROOM ELECTRICAL LAYOUT 1 E302

SCALE: 1:50
0m 1m 2m 3m 4m 5m