


NOTES:
INFORMATION ON EXISTING ROOF SYSTEM OBTAINED FROM REFERENCE
DWG. No. A-4, CSC PROJECT No. 658-657, DATED AUGUST 2, 1991.
CONTRACTOR TO VERIFY ROOF SYSTEM AT TIME OF CONSTRUCTION AND
MATCH ACTUAL CONSTRUCTION AND MATERIALS. ALL SUBSTITUTIONS TO
BE TO APPROVAL OF DEPARTMENTAL REPRESENTATIVE.

STONE BALLAST AT 1200 lbs./sq.ft.
POLYOLEFIN SCRIM
50mm EXTRUDED POLYSTYRENE
POLYETHYLENE SEPARATION SHEET
THERMASTIC B HOT RUBBERIZED MEMBRANE AT 7.5 kg/m²
TREMGLASS MEMBRANE
THERMASTIC B HOT RUBBERIZED MEMBRANE AT 7.5 kg/m²
ASPHALT GLAZE AT 1.5 kg/m²
TWO PLIES OF GLASS FELT IN TYPE II ASPHALT AT 1.25 kg/m²
25mm FIBERGLASS INSULATION ADHERED WITH TYPE II ASPHALT TREMPRIME-QUICK DRY
CONCRETE ROOF DECK

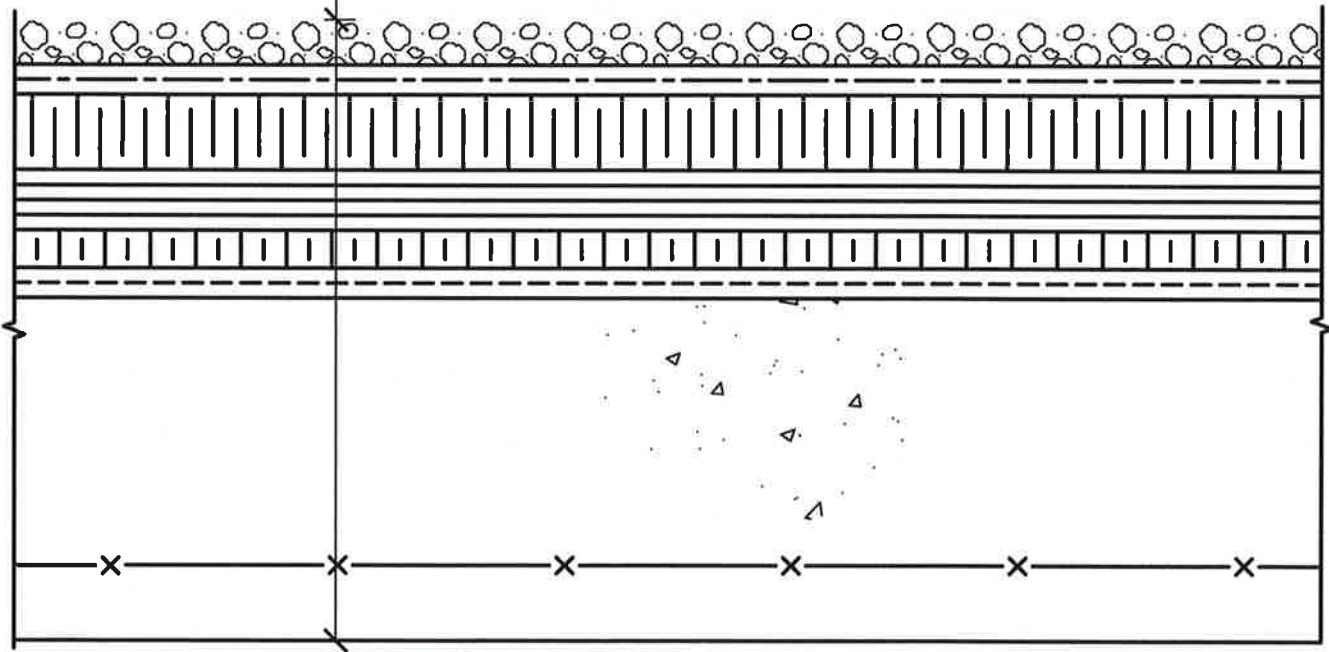

TYPICAL ROOF SYSTEM COMPOSITION – EXISTING

SCALE/ÉCHELLE: 1:5

0mm 100mm 200mm 300mm 400mm 500mm




Consultants Ingénieurs en structure 15226

VALRON
Structural Engineers

100 rue Cameron St., Suite 5000 Phone: 506.858.9601
Moncton, NB E1C 6Y8 Fax: 506.854.6820
http://www.valron.ca Email: valron@valron.ca

ALL DETAILS AND NOTES FOR STRUCTURAL REQUIREMENTS AS SHOWN ON THIS DRAWING ARE
PRODUCED SPECIFICALLY FOR THIS PROJECT AND ARE THE SOLE PROPERTY OF VALRON ENGINEERS
INC. THEY MAY NOT BE REPRODUCED, COPIED OR OTHERWISE USED WITHOUT EXPRESSED WRITTEN
PERMISSION FROM THE AFOREMENTIONED. COPYRIGHT 2015, VALRON ENGINEERS INC.

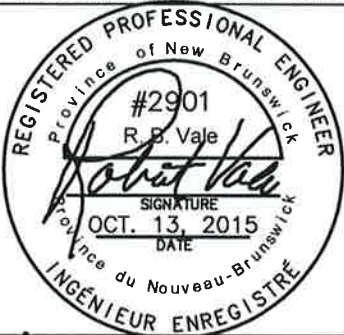

revisions project date

project projet

**BUNKER C TANK
DECOMMISSIONING**
DORCHESTER MEDUIM
DORCHESTER, NB

drawing dessin

**EXISTING ROOF
SYSTEM COMPOSITION**

designed RBV conçu

date SEPT. 2015

drawn RK dessiné

date SEPT. 2015

approved JMC approuvé

date OCT. 2015

Tender Soumission

PWGSC Project Manager Administrateur de projets TPSGC

project number no. du projet

R.61874.001

drawing no. no. du dessin

S4