


APPENDIX B

**DWG. No.: S7 - COMBINED TRENCH
(SEWERS & SEWER SERVICES)**

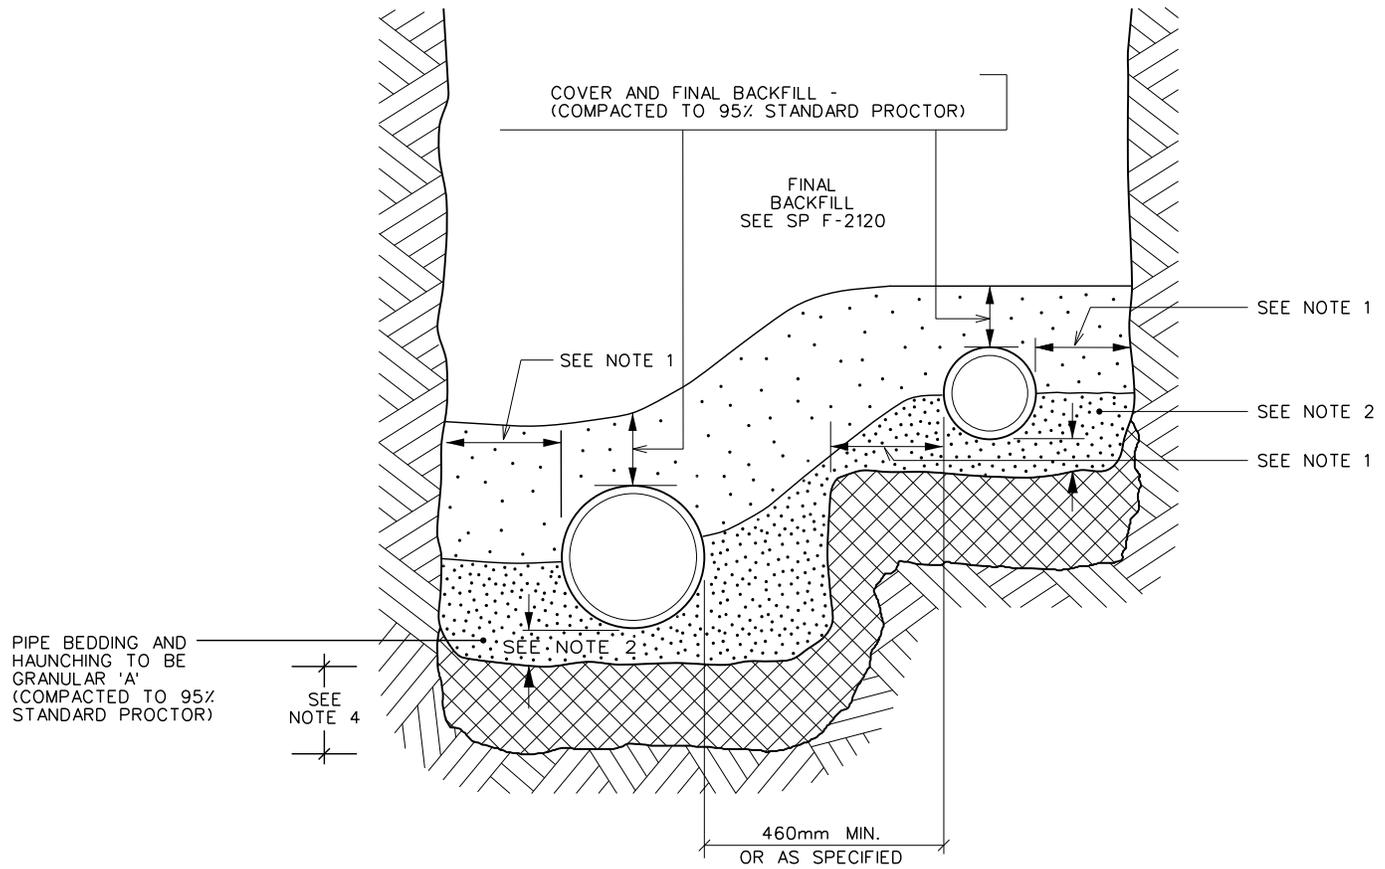

NOTES:

1.

PIPE INSIDE DIAMETER (mm)	CLEARANCE (mm)
150 TO 900	CONC 450 PVC 450
OVER 900	500

2.

CONDITION	SEWER	SERVICES
EARTH	150 Min.	150 Min.
ROCK	300 Min.	150 Min.

3. FINAL BACKFILL - APPROVED NATIVE MATERIAL OR SELECT SUBGRADE IN ACCORDANCE WITH F-2120.
4. WHEN APPROVED BY THE CONTRACT ADMINISTRATOR, POOR SOILS SHALL BE EXCAVATED TO CREATE A FOUNDATION THAT SHALL BE FILLED TO THE BOTTOM OF THE BEDDING WITH GRANULAR 'B'.
5. SEE S11.3 FOR TYPICAL SINGLE, SEMI-DETACHED AND TOWNHOUSE LOT SERVICING



COMBINED TRENCH
(SEWERS & SEWER SERVICES)

DATE: MAY 2001

REV. MARCH 2013

DWG. No.: S7