

DO NOT SCALE DRAWINGS

Revision/Revision	Description/Description	Date/Date
3	ISSUED FOR CONSTRUCTION	15/11/20
2	100% CD SUBMISSION	15/10/29
1	99% CD SUBMISSION	15/09/28
0	50% CD SUBMISSION	15/08/14

Client/client
CANADA SCHOOL OF PUBLIC SERVICE (CSPS)

Winnipeg
MANITOBA

Project title/Titre du projet
**STANLEY KNOWLES BUILDING
2ND FLOOR - 391 YORK AVENUE
WINNIPEG, MANITOBA**

CSPS WINNIPEG FIT-UP

Approved by/Approve par
KELLIE ORR

Designed by/Concepé par
JOSE SANTOS

Drawn by/Dessiné par
RHODA DE CASTRO
PWGSC Project Manager/Administrateur de Projets TPSCG
JOHN ALIBIN

PWGSC, Architectural and Engineering Resources Manager/
Ressources Architectural et de Directeur d'ingénierie, TPSCG


Client/client
PUBLIC WORKS AND GOVERNMENT SERVICES CANADA

Drawing title/Titre du dessin


**SECOND FLOOR SOUNDMASKING,
INTRUSION AND ACCESS CONTROL SYSTEM**

Project No./No. du projet R.060508.003	Sheet/Fauille T4 OF 5	Revision no./ La Révision no. 3
---	------------------------------------	--


- GENERAL NOTES:
- ALL P.A. CONDUITS TO BE 21mm UNLESS OTHERWISE NOTED.
 - USE 19mm FLEX CONDUIT FROM PULL BOX TO SPEAKER BACKBOX FOR ALL SPEAKERS THAT ARE LOCATED IN T-BAR CEILING.
 - COORDINATE LOCATION OF ALL SPEAKERS ON SITE WITH ELECTRICAL AND MECHANICAL CONTRACTORS.
 - ALL EXPOSED CABLES LOCATED IN THE CEILING SPACE SHALL BE FT6 RATED.

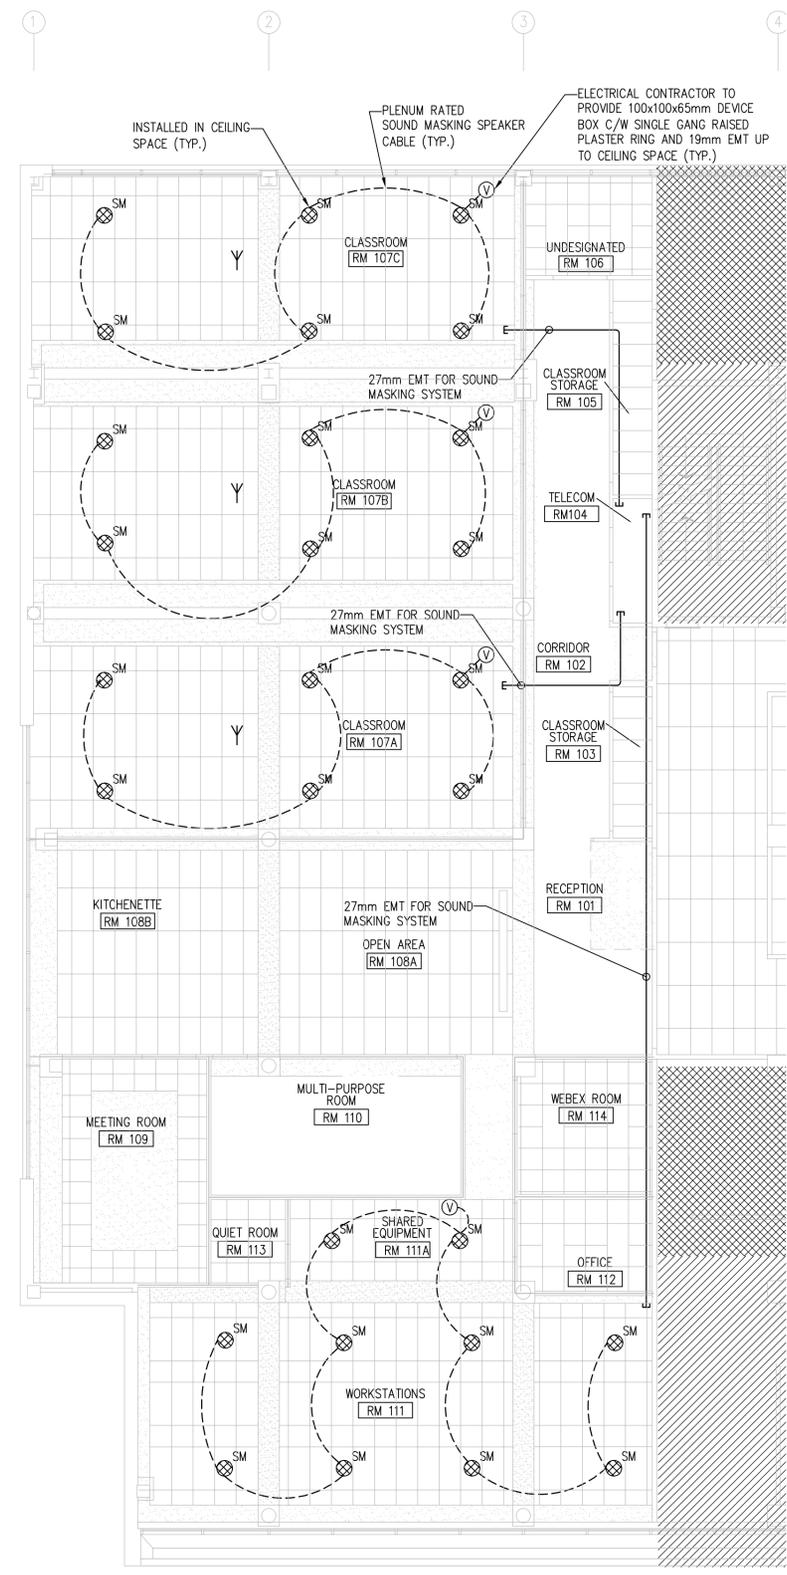

1 SECOND FLOOR SOUNDMASKING SYSTEM
T4 1:100

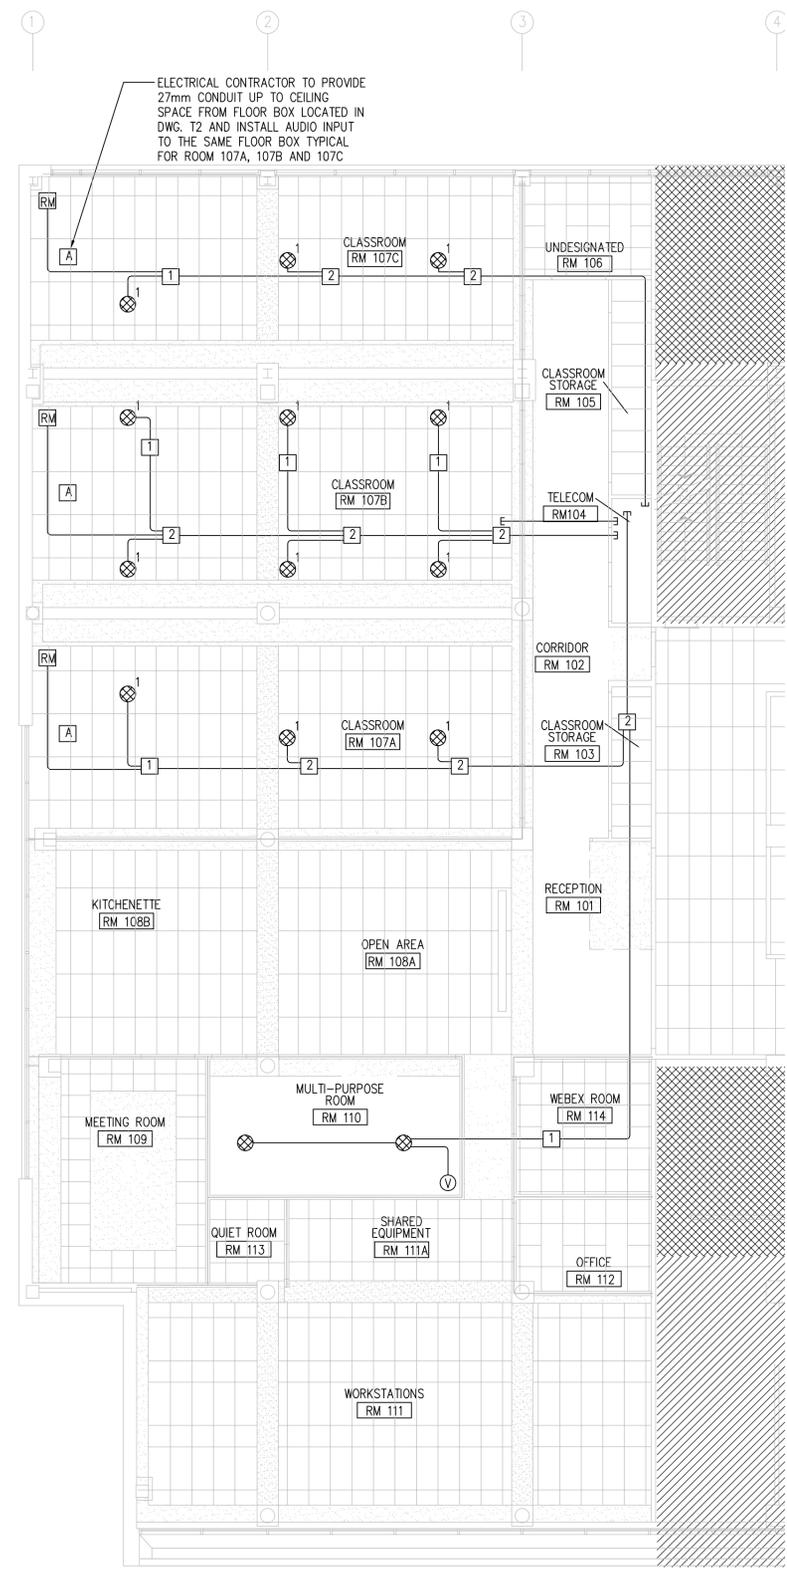

2 SECOND FLOOR AUDIO SYSTEM
T4 1:100

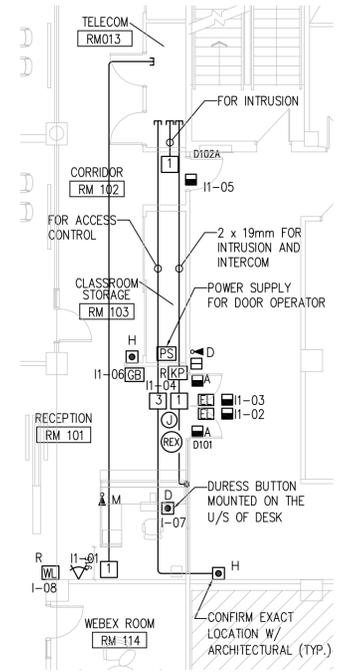

- NOTES:
- PULL BOX #1, #3 AND POWER SUPPLY TO BE MOUNTED IN CLASSROOM STORAGE ROOM 103.

3 SECOND FLOOR INTRUSION AND ACCESS CONTROL SYSTEM
T4 1:100

