



RETURN BIDS TO:
RETOURNER LES SOUMISSIONS À:
Bid Receiving Public Works and Government
Services Canada/Réception des
soumissions/Travaux publics et Services
gouvernementaux Canada
The Cambridge Building
3 Queen Street/3, rue Queen
Charlottetown
Prince Edward Island
C1A 4A2

SOLICITATION AMENDMENT MODIFICATION DE L'INVITATION

The referenced document is hereby revised; unless otherwise indicated, all other terms and conditions of the Solicitation remain the same.

Ce document est par la présente révisé; sauf indication contraire, les modalités de l'invitation demeurent les mêmes.

Comments - Commentaires

All enquiries are to be submitted in writing to the Contracting Officer, Janine Donovan: Email - janine.donovan@pwgsc.gc.ca or Fax No. (902) 566-7514.

Vendor/Firm Name and Address

Raison sociale et adresse du
fournisseur/de l'entrepreneur

Issuing Office - Bureau de distribution

Public Works and Government Services Canada
The Cambridge Building
3 Queen Street/3 rue, Queen
PO Box 1268/CP 1268
Charlottetown
Prince Ed
C1A 4A2

Title - Sujet Ctr.Pier Repair, Wood Isl. Ferry,PE	
Solicitation No. - N° de l'invitation ED001-162024/A	Amendment No. - N° modif. 004
Client Reference No. - N° de référence du client R.077637.001	Date 2016-01-13
GETS Reference No. - N° de référence de SEAG PW-\$PWC-021-3781	
File No. - N° de dossier PWC-5-38180 (021)	CCC No./N° CCC - FMS No./N° VME
Solicitation Closes - L'invitation prend fin at - à 02:00 PM on - le 2016-01-20	Time Zone Fuseau horaire Atlantic Standard Time AST
F.O.B. - F.A.B. Plant-Usine: <input type="checkbox"/> Destination: <input checked="" type="checkbox"/> Other-Autre: <input type="checkbox"/>	
Address Enquiries to: - Adresser toutes questions à: Donovan, Janine E.	Buyer Id - Id de l'acheteur pwc021
Telephone No. - N° de téléphone (506) 636-5347 ()	FAX No. - N° de FAX (506) 636-4376
Destination - of Goods, Services, and Construction: Destination - des biens, services et construction:	

Instructions: See Herein

Instructions: Voir aux présentes

Delivery Required - Livraison exigée	Delivery Offered - Livraison proposée
Vendor/Firm Name and Address Raison sociale et adresse du fournisseur/de l'entrepreneur	
Telephone No. - N° de téléphone Facsimile No. - N° de télécopieur	
Name and title of person authorized to sign on behalf of Vendor/Firm (type or print) Nom et titre de la personne autorisée à signer au nom du fournisseur/ de l'entrepreneur (taper ou écrire en caractères d'imprimerie)	
Signature	Date

Solicitation No. - N° de l'invitation	Amd. No. - N° de la modif.	Buyer ID - Id de l'acheteur
ED001-162024A	003	pwc021
Client Ref. No. - N° de réf. du client	File No. - N° du dossier	CCC No./N° CCC - FMS No./N° VME
R.077637.001	PWC-5-38180	

Cette modification à l'invitation numéro quatre (4) est soumise pour inclure l'addenda numéro 4 suivant.

La modification qui suie apportée aux documents de soumission entre en vigueur dès maintenant.
L'addenda fera partie des documents de contrat.

Toutes autres conditions ne changent pas.

Addenda 4.

1. **QUESTIONS ET RÉPONSES**

Question 1: Section 01 29 00: Project Particulars and Measurement pg 3 and 4

Under LS Item 4, Removals of Shore Power and Concrete Pads, it states that the work shall include removal of the concrete pad, stockpiling and protection of shore power equipment along with disposal of the existing concrete pad. It goes on to say that "Relocation, reinstallation and reconnection of the shore power assembly will be done in a separate contract by others."

If all the electrical involved in the removal of the ships shore power and transformer is by others outside of our contract, then what will be our involvement in stockpiling electrical equipment? By my interpretation, our work on this item is removal and reinstallation of the concrete pad under the existing transformer (transformer to be removed by others prior to our work). Please clarify if this is correct.

Answer 1: The documents are clear in that the contractor is to remove the ships power and remove then reinstate the transformer. It is correctly identified in section 01 29 00 items 3 and 4 and more clearly in Section 02 41 00 item 1.1.1. The work is further clarified on drawing S2.

Question 2: Section 01 29 00: Project Particulars and Measurement pg 3

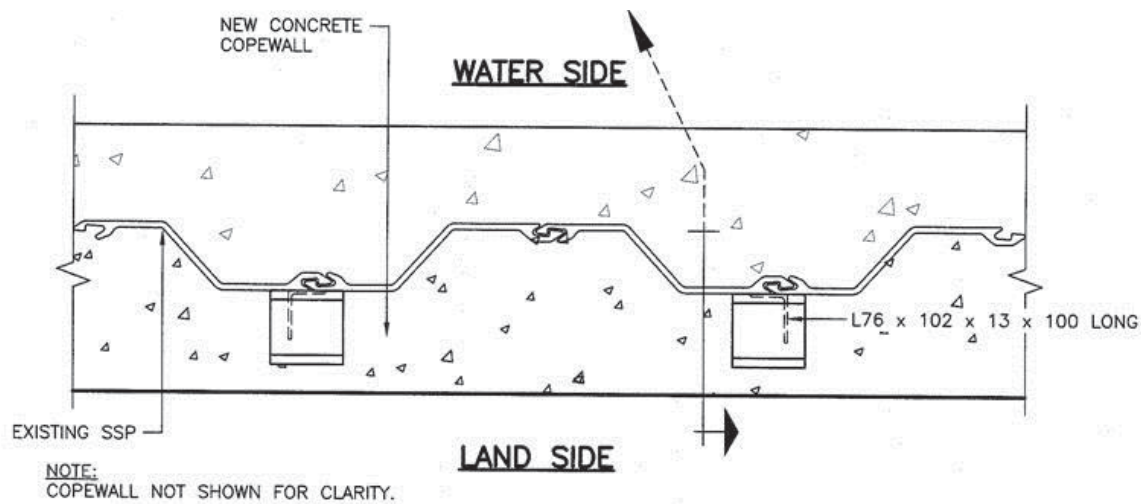

Under LS Item 2, Accommodate Existing Services (Electrical Power and Water Supply), please provide details on the requirements for temporary power under this contract.

Answer 2: Insert the following item to Section 02 41 00, Paragraph 1.1 'Work Included'.

Add - 1.1.2 "For the duration of the project, provide temporary power to the hydraulic building and the shore power for the East Birth(Holiday Island) which is located at the East Berth Transfer Ramp. Coordinate connection and disconnection of power with the Departmental Representative."

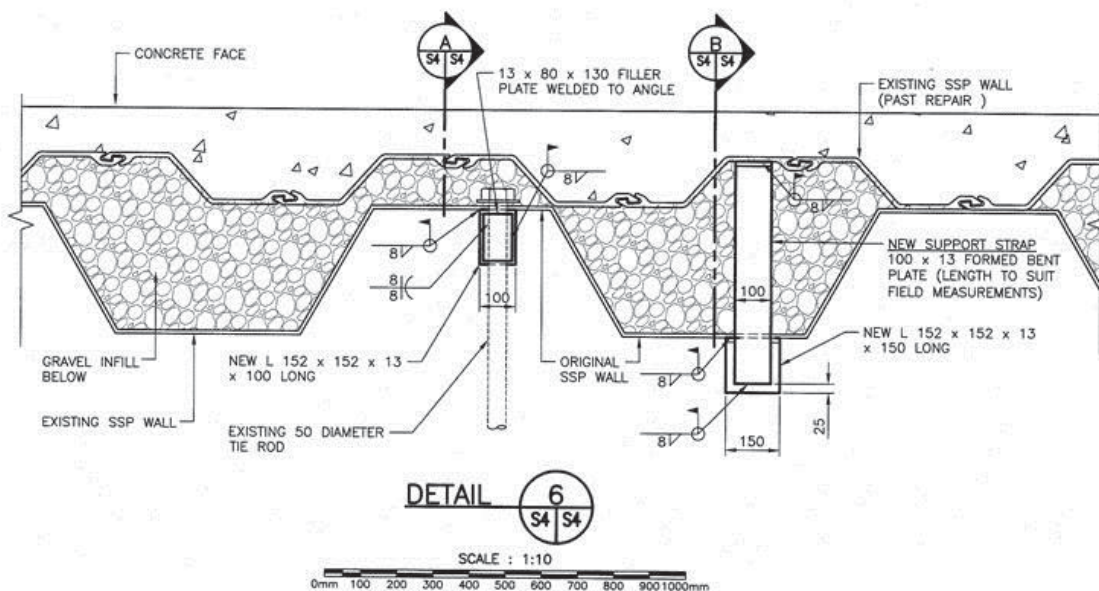
Question 3: Ref: Dwg S4 of 4- Detail 6, Section A and B, Detail 2

Please confirm the spacing of the lugs shown in Detail 2. Also please confirm if the support strap shown in detail 6 shall only be installed adjacent to the Existing 50mm tie rods (1905mm spacing), or if there is a different regular spacing.

**DETAIL LUG TO SSP CONNECTION**

SCALE : 1:10

0mm 100 200 300 400 500 600 700 800 900 1000mm



Solicitation No. - N° de l'invitation

ED001-162024A

Amd. No. - N° de la modif.

003

Buyer ID - Id de l'acheteur

pwc021

Client Ref. No. - N° de réf. du client

R.077637.001

File No. - N° du dossier

PWC-5-38180

CCC No./N° CCC - FMS No./N° VME

Answer 3: See responses below, referencing the above shown details:

1. Detail 2/S4, Add the following note. "INSTALL LUGS ON EACH SSP IN-PAN (APPROX. SPACING 950MM+/-)"
2. Detail 6/S4, Add the following note. "ONE NEW SUPPORT STRAP IS REQUIRED PER TIEROD"