

- KEYNOTES**
- NEW 50 DOMESTIC COLD WATER ENTRANCE. REFER TO DETAIL ON THIS DRAWING FOR PIPING ARRANGEMENT.
 - INSTALL REDUCED PRESSURE TYPE BACKFLOW PREVENTERS ON CW AND DHW LINES 1500 ABOVE FLOOR ON WALL. ROUTE TEST DRAINS TO ADJACENT JANITOR'S SINK. REFER TO DETAIL ON DRAWING 2200-3 FOR PIPING ARRANGEMENT.
 - ROUTE TRAP PRIMER PIPING BELOW FLOOR AND UP IN JANITOR'S ROOM TO WALL MOUNTED TRAP PRIMER STATION (TPS). REFER TO DETAIL ON DRAWING 2200-3 FOR TYPICAL PIPING ARRANGEMENT.
 - ROUTE 20 CW WITHIN SERVICE CHASE TO SERVE HOSE VALVE (HV).
 - ROUTE PIPING THRU CEILING SPACE. COORDINATE ROUTING ON SITE WITH DUCTWORK, LIGHTING, SPRINKLERS, ETC.
 - FIRE STOPPING REQUIRED AT FIRE WALL PENETRATION.
 - MOUNTING HEIGHT FOR EEW TO BE VERIFIED ON SITE WITH DEPARTMENTAL REPRESENTATIVE PRIOR TO INSTALLATION. NOT MORE THAN 829mm ABOVE FLOOR. THIS IS NOT TO BE MOUNTED FOR BARRIER-FREE ACCESS HEIGHT.
 - ROUTE 20 CW, 12 DHW AND 12 DHWR PIPING UP THRU MECHANICAL ROOM FLOOR TO SERVE FUTURE AS SHOWN. REFER TO DRAWING 2200-1 FOR PIPING CONTINUATION.




KEY PLAN

SCALE - NTS

GENERAL NOTES

- REFER TO DRAWING 2200-1 FOR LEGEND.

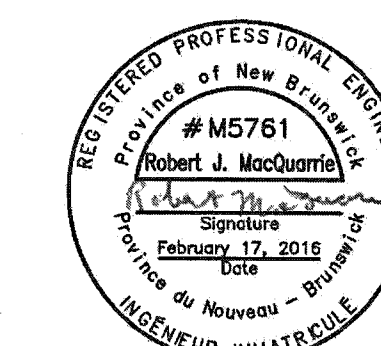

0	RELEASED FOR CONSTRUCTION	01/29/2016
revisions		date

project
**NEW
G.O.C.B.
SAINT-LÉONARD
NEW BRUNSWICK**
project

drawing
**MAIN FLOOR PLAN
CW AND DHW PIPING**
dessin

designed	RDD	conçu
date	JANUARY 29, 2016	
drawn	RDD	dessiné
date	JANUARY 29, 2016	
approved	DAG	approuvé
date	FEBRUARY 17, 2016	

Tender
Project Manager
Project Number
R.069499.001
no. du projet

drawing no.
2200-2
no. du dessin