


- ### GENERAL NOTES
- ALL PENETRATIONS THROUGH PENTHOUSE FLOOR AND INTERIOR FIRE RATED WALLS TO HAVE A FIRE DAMPER AT PENETRATION.
 - LOWER LEVEL DUCTWORK TO MAINTAIN A TWO (2) METER CLEARANCE FROM UNDERSIDE OF DUCT TO FLOOR WHERE POSSIBLE.
 - HRV-3 AND HUMIDIFIERS TO BE MOUNTED ON PENTHOUSE FLOOR OR HOUSEKEEPING PAD. ALL OTHER EQUIPMENT TO BE HUNG FROM STRUCTURAL STEEL.
 - COORDINATE EXACT LOCATION AND SIZE OF LOUVERS WITH ARCHITECTURAL DRAWINGS.


- ### KEYNOTES
- 250x250 EA DUCT TO RUN UNDER 250x250 OA DUCT.
 - REFER TO DRAWING 606-11 FOR LINEAR DIFFUSER LOCATIONS.
 - PROVIDE SECURITY BARS IN LOUVER.
 - PROVIDE SECURITY BAR/FIRE DAMPER AT FLOOR LEVEL FOR DUCT PENETRATION.
 - PROVIDE FIRE DAMPER AT FLOOR FOR DUCT PENETRATION.
 - EF-2 IS LOCATED IN VERTICAL (NOT SHOWN).

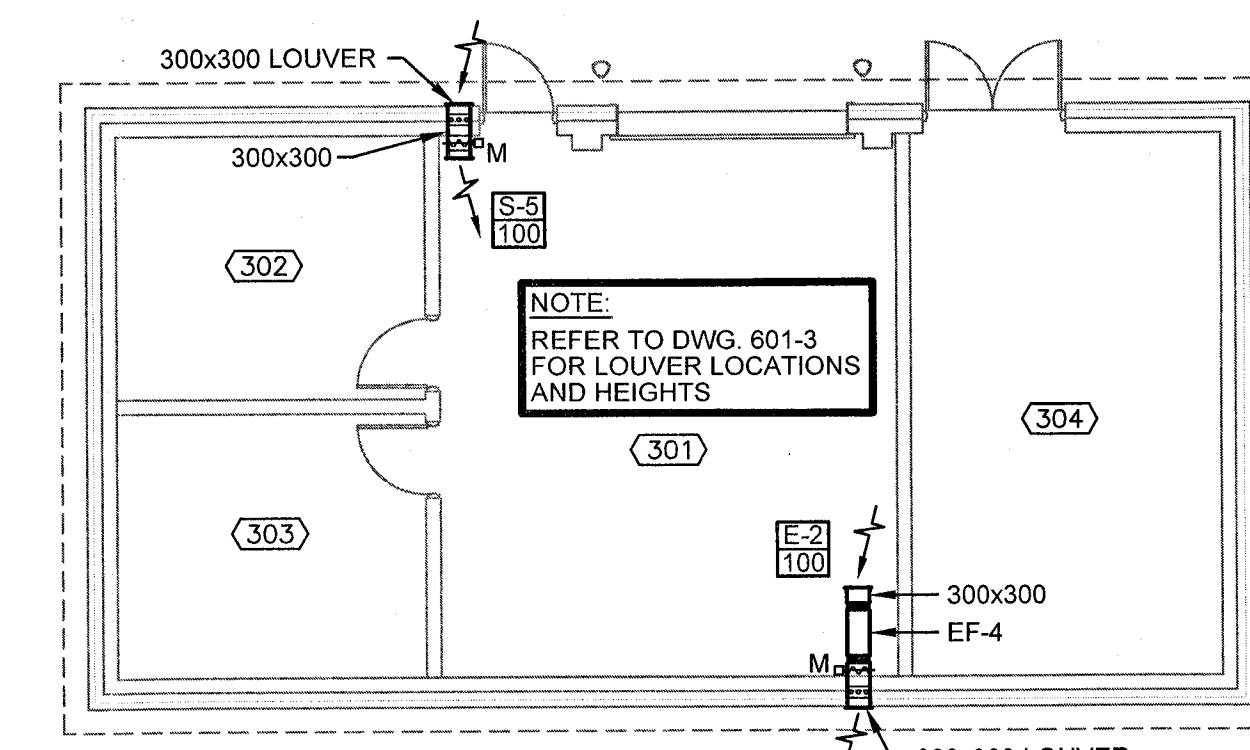

FLOOR PLAN - DRY STORAGE BUILDING

SCALE : 1:100


0m 1m 2m 3m 4m 5m 6m 7m 8m 9m 10m

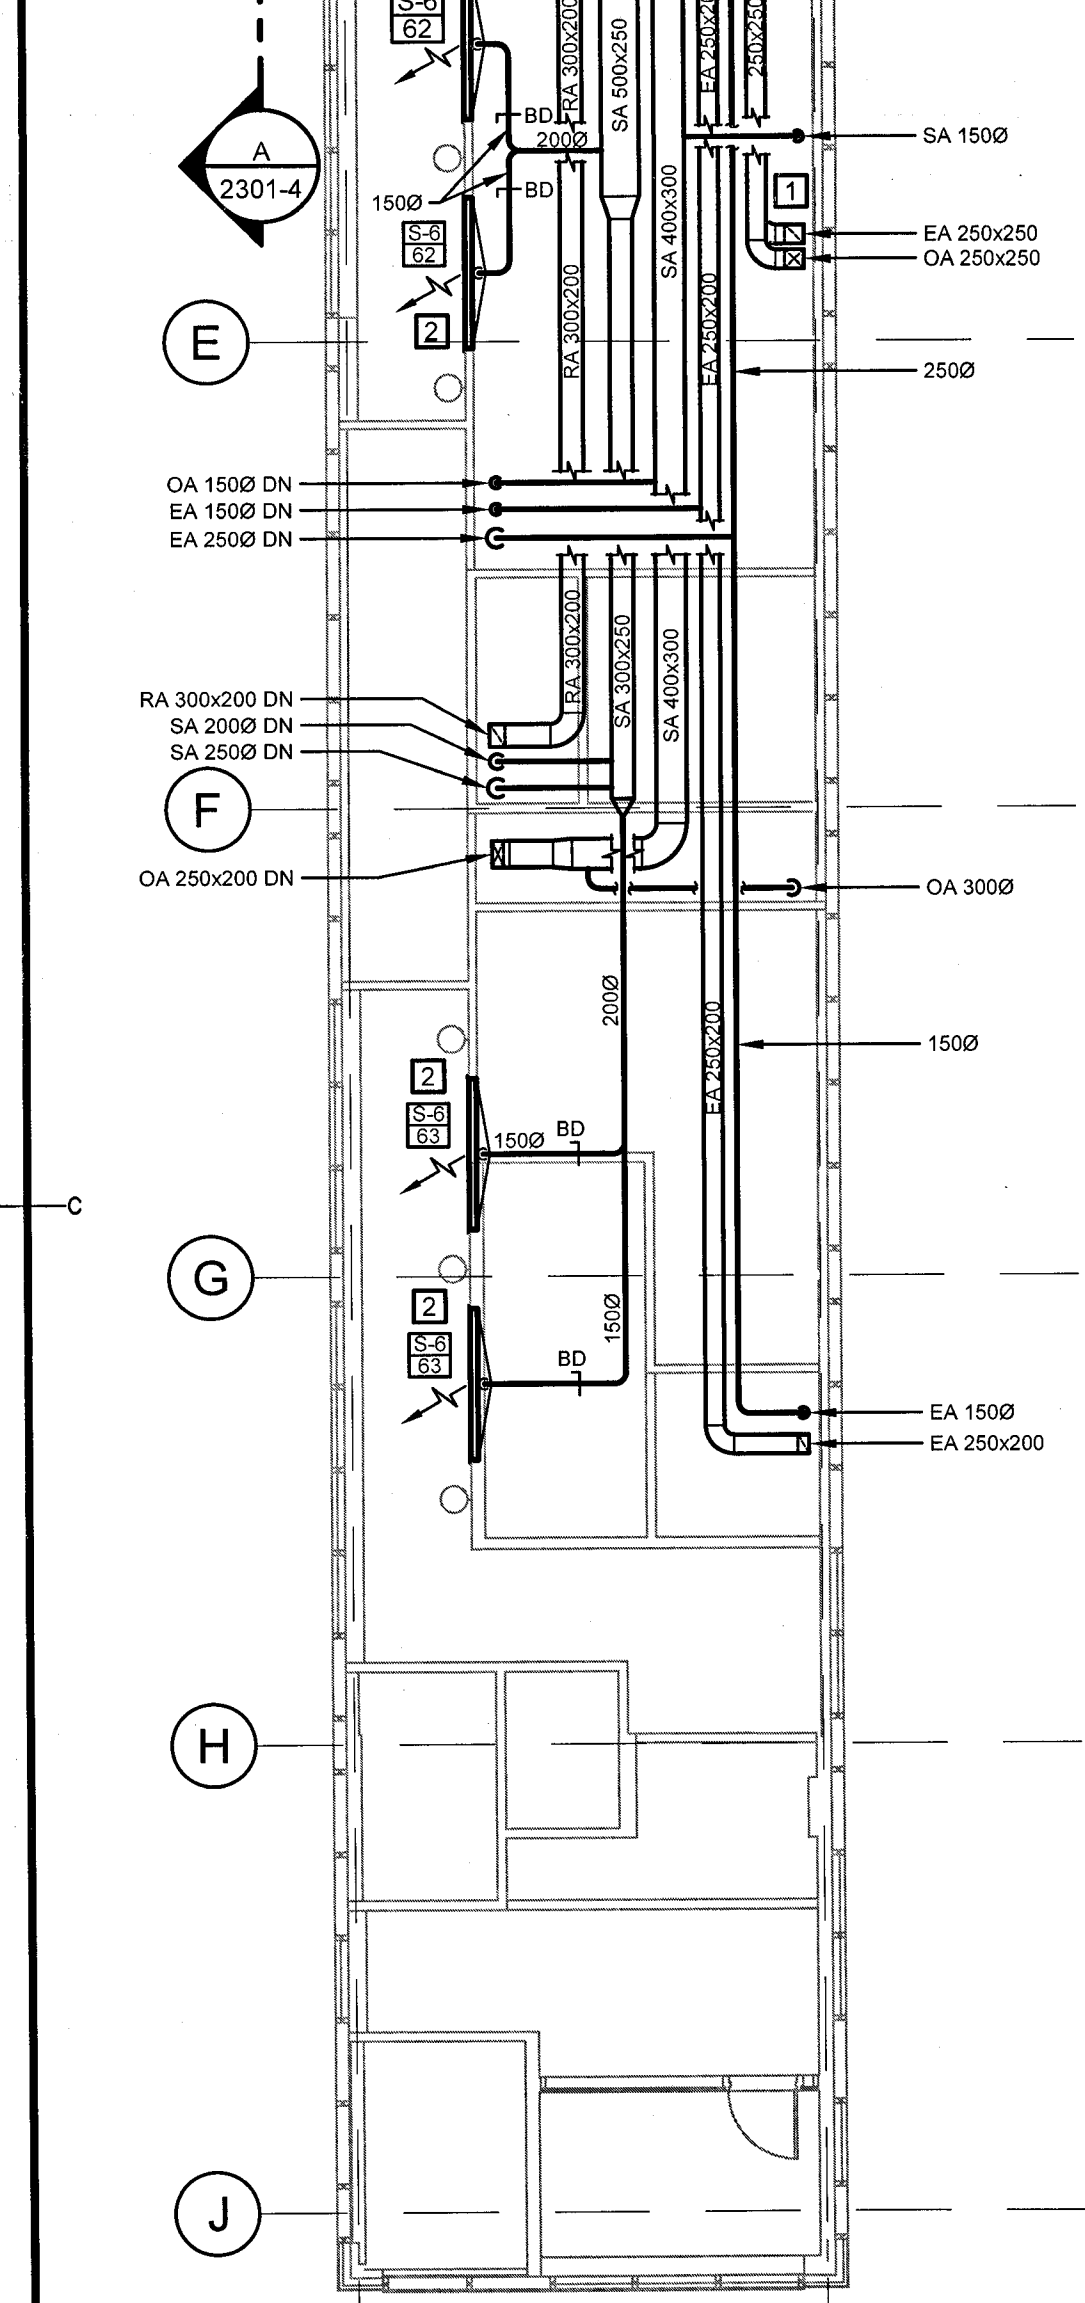

FLOOR PLAN - PENTHOUSE LEVEL

SCALE : 1:100


0m 1m 2m 3m 4m 5m 6m 7m 8m 9m 10m

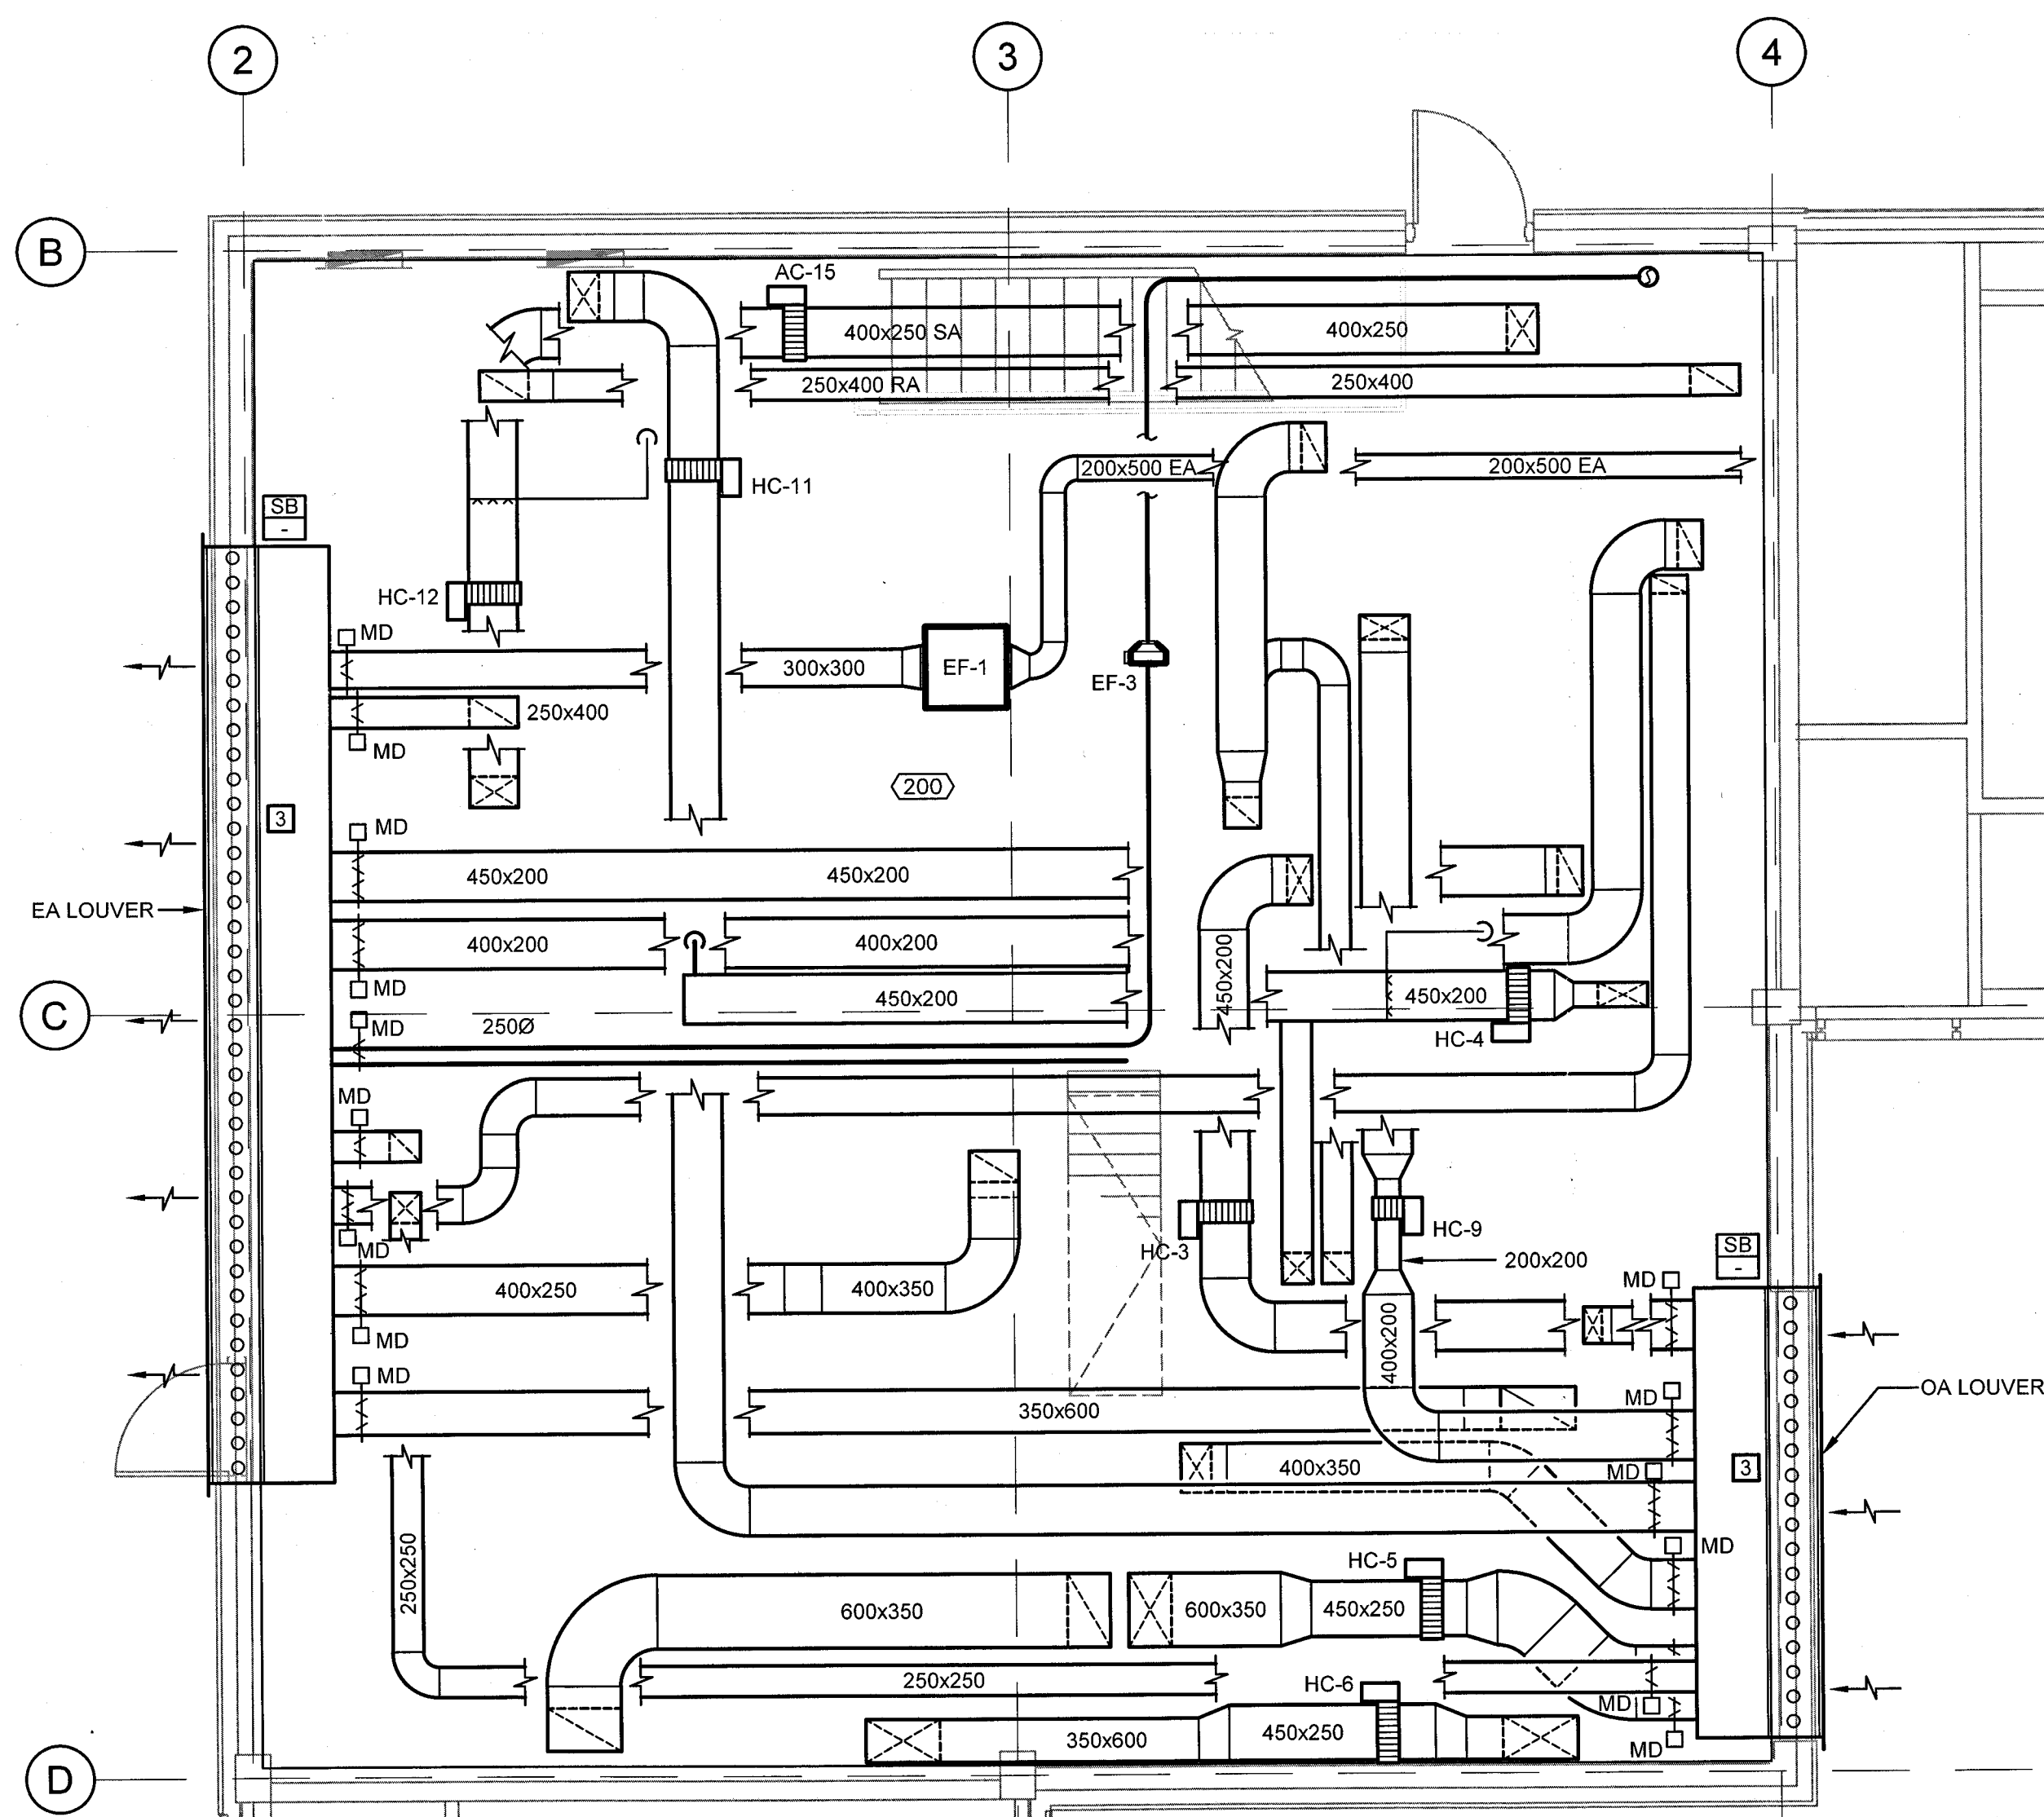

FLOOR PLAN - UPPER LEVEL VENTILATION

SCALE: 1:50


0m 1m 2m 3m 4m 5m

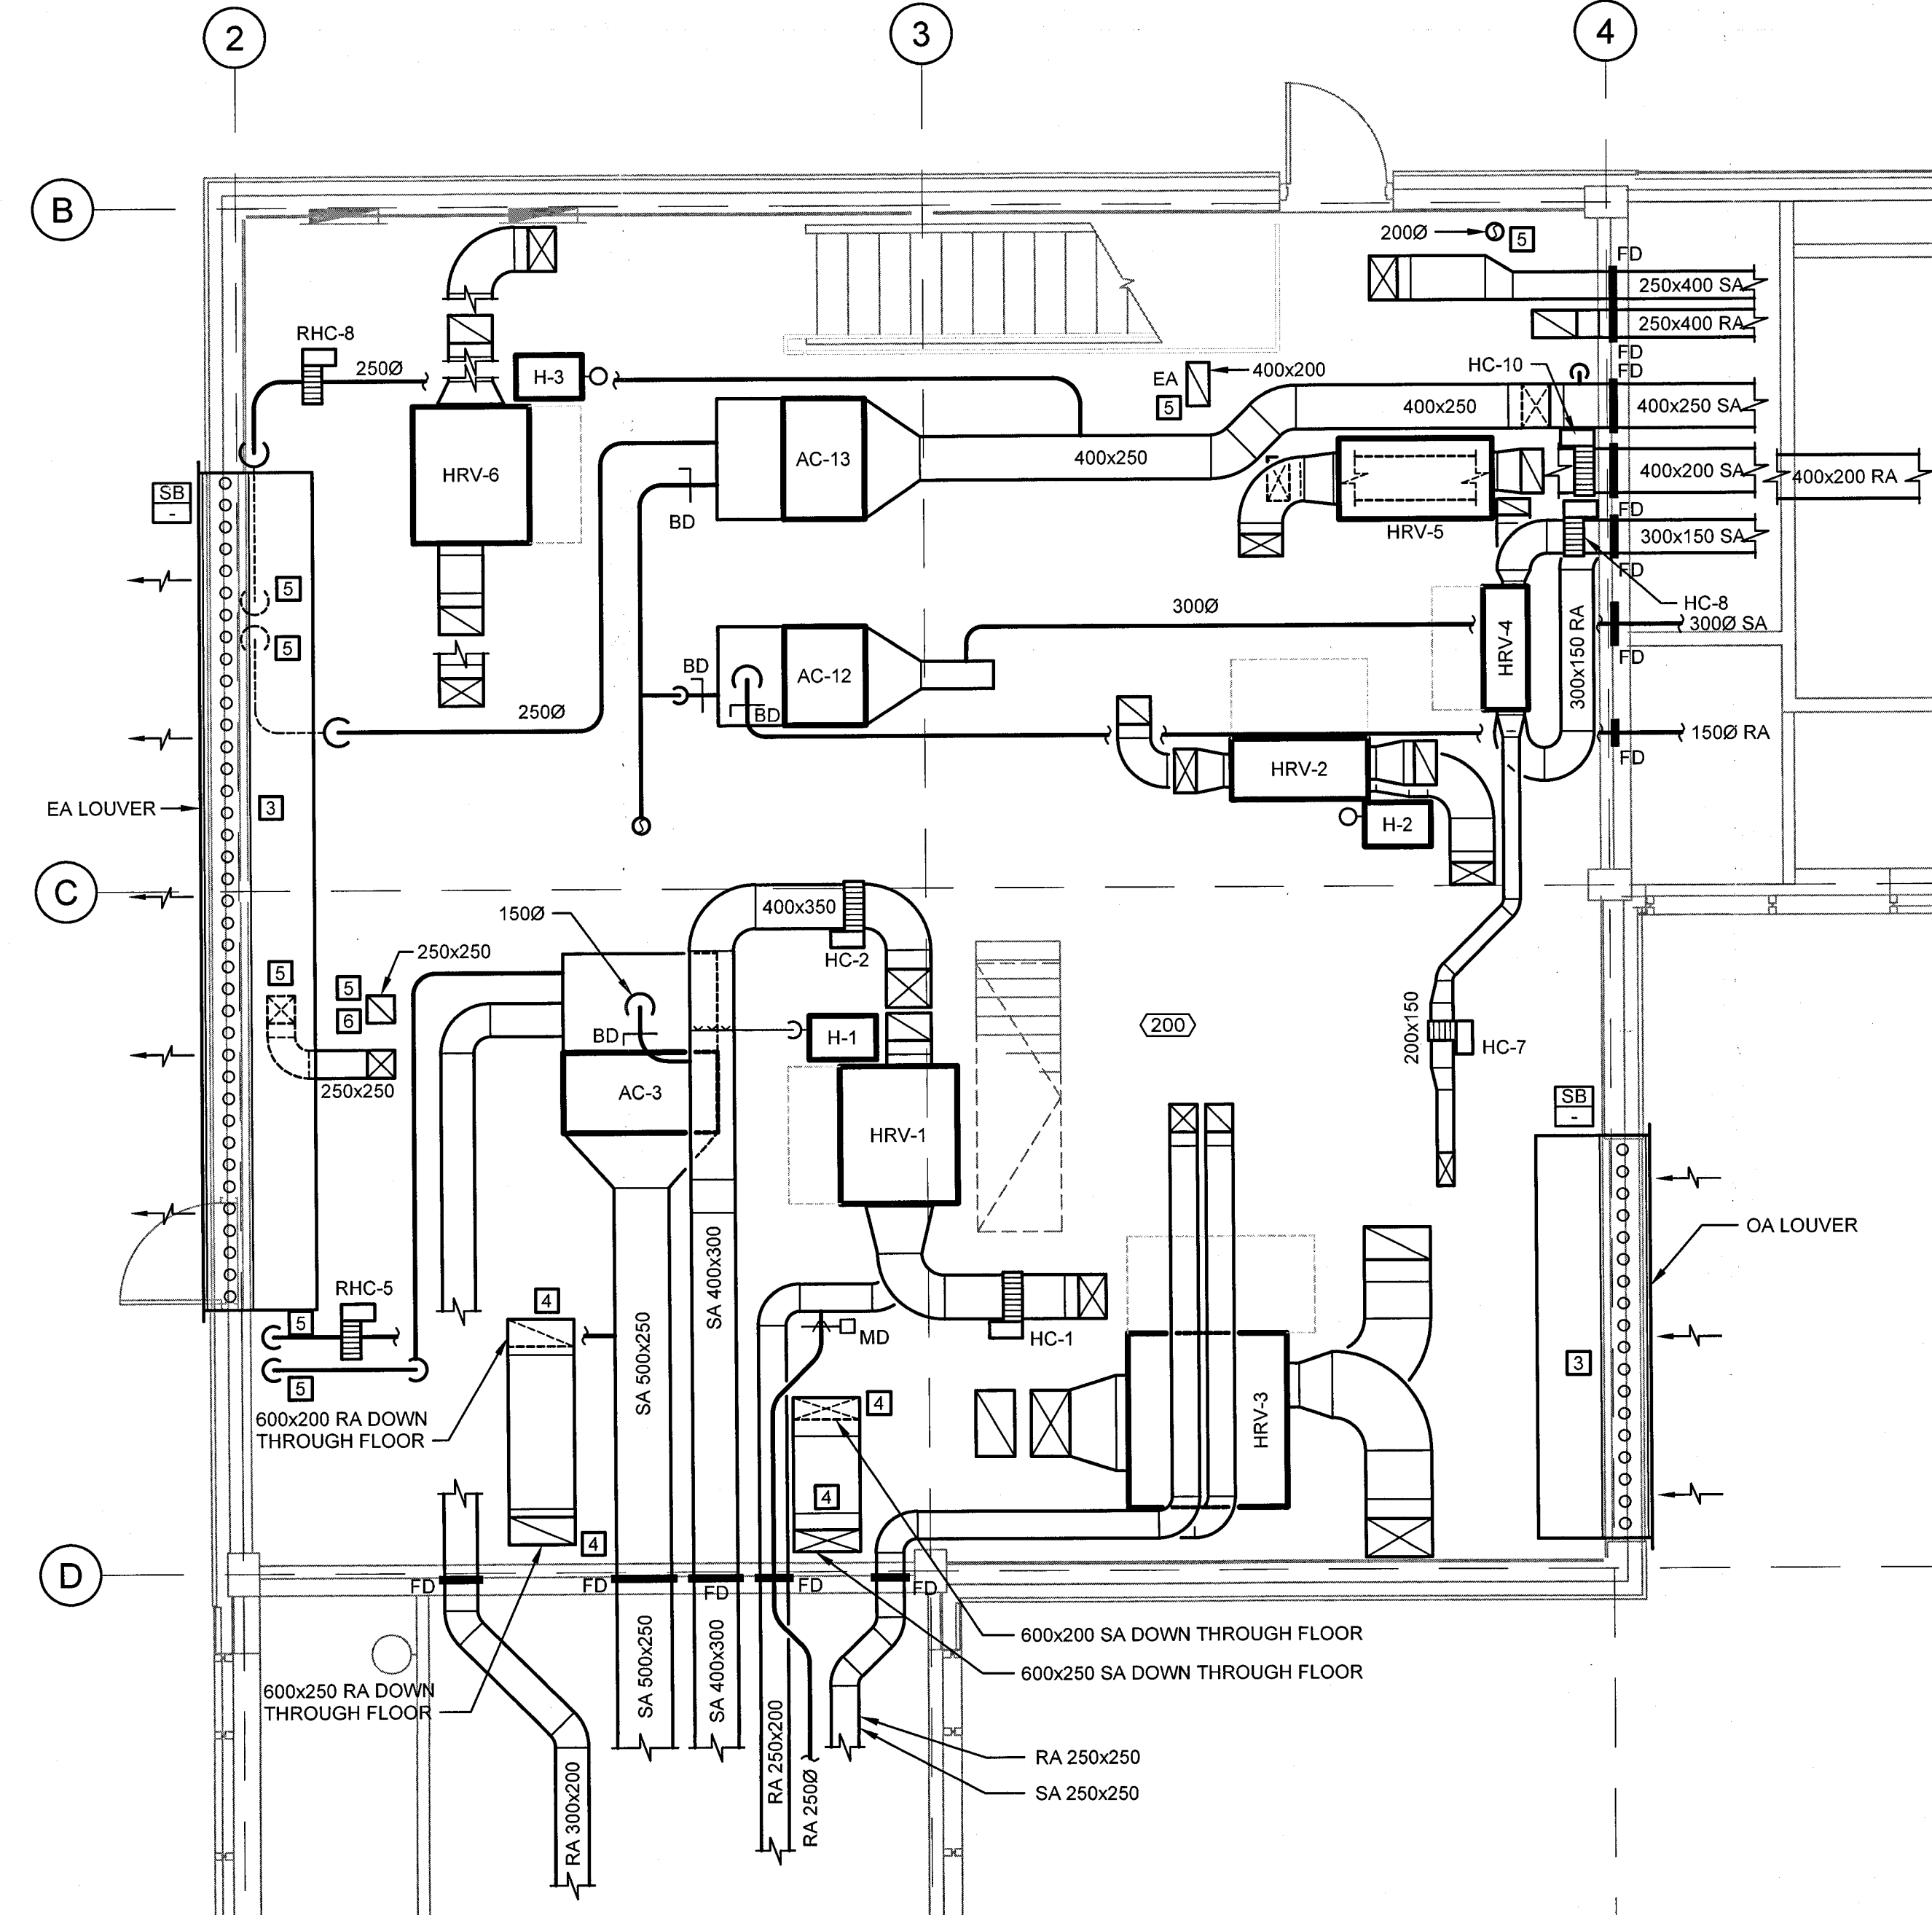

FLOOR PLAN - LOWER LEVEL VENTILATION


SCALE: 1:50

0m 1m 2m 3m 4m 5m

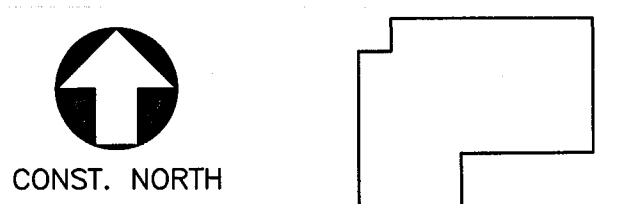

KEY PLAN

SCALE - NTS

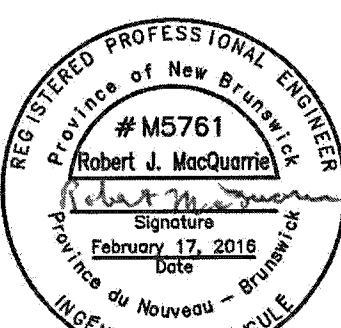

0 RELEASED FOR CONSTRUCTION 01/29/2016

revisions project date

NEW
G.O.C.B.
SAINT-LÉONARD
NEW BRUNSWICK

PENTHOUSE AND
PARTIAL PLANS
VENTILATION

designed RWM conçu

date JANUARY 29, 2016

drawn SET dessiné

date JANUARY 29, 2016

approved DAG approuvé

date FEBRUARY 17, 2016

Tender 2016/07/13

PWSC project manager Administrateur de projets TPSCC

project number no. du projet

R.069499.001

drawing no. no. du dessin

2301-2