


- ### KEYNOTES
- EXHAUST DUCT RUN IN ROOM 104 FROM 103 TO RUN IN STC 90 RATED PLENUM / BULKHEAD BY GENERAL CONTRACTOR.
  - 250x200 EXHAUST AIR UP FROM ROOM 104.
  - SEE TYPICAL 13mm LINEAR SLOT DIFFUSER SECTION DWG 2301-3.
  - 5mm THICK SLEEVE MUST EXTEND OUT TO DUCT BARRIER FROM WALL.
  - REHEAT COILS RHC-2 & RHC-3 NOT SHOWN FOR CLARITY.
  - REHEAT COILS RHC-4 & RHC-5 NOT SHOWN FOR CLARITY.

### LEGEND

OA	OUTSIDE AIR
SA	SUPPLY AIR
RA	RETURN AIR
EA	EXHAUST AIR
EF-1	EXHAUST FAN #1
CU-1a	CONDENSING UNIT #1a
HRV-1	HEAT RECOVERY VENTILATOR #1
AC-1	VARIABLE REFRIGERANT FLOW TERMINAL UNIT #1
PS-1	PLENUM SILENCER #1
BD	BALANCE DAMPER
ZV	AIR ZONE VALVE
MD	MOTORIZED DAMPER
HC-17	AIR FLOW DIRECTION
SB	HEATING COIL #17
S-1	SECURITY BARS
S-1	SUPPLY GRILLE TYPE 1
S-1	L/S FLOW RATE
OR	TRANSFER DUCTS

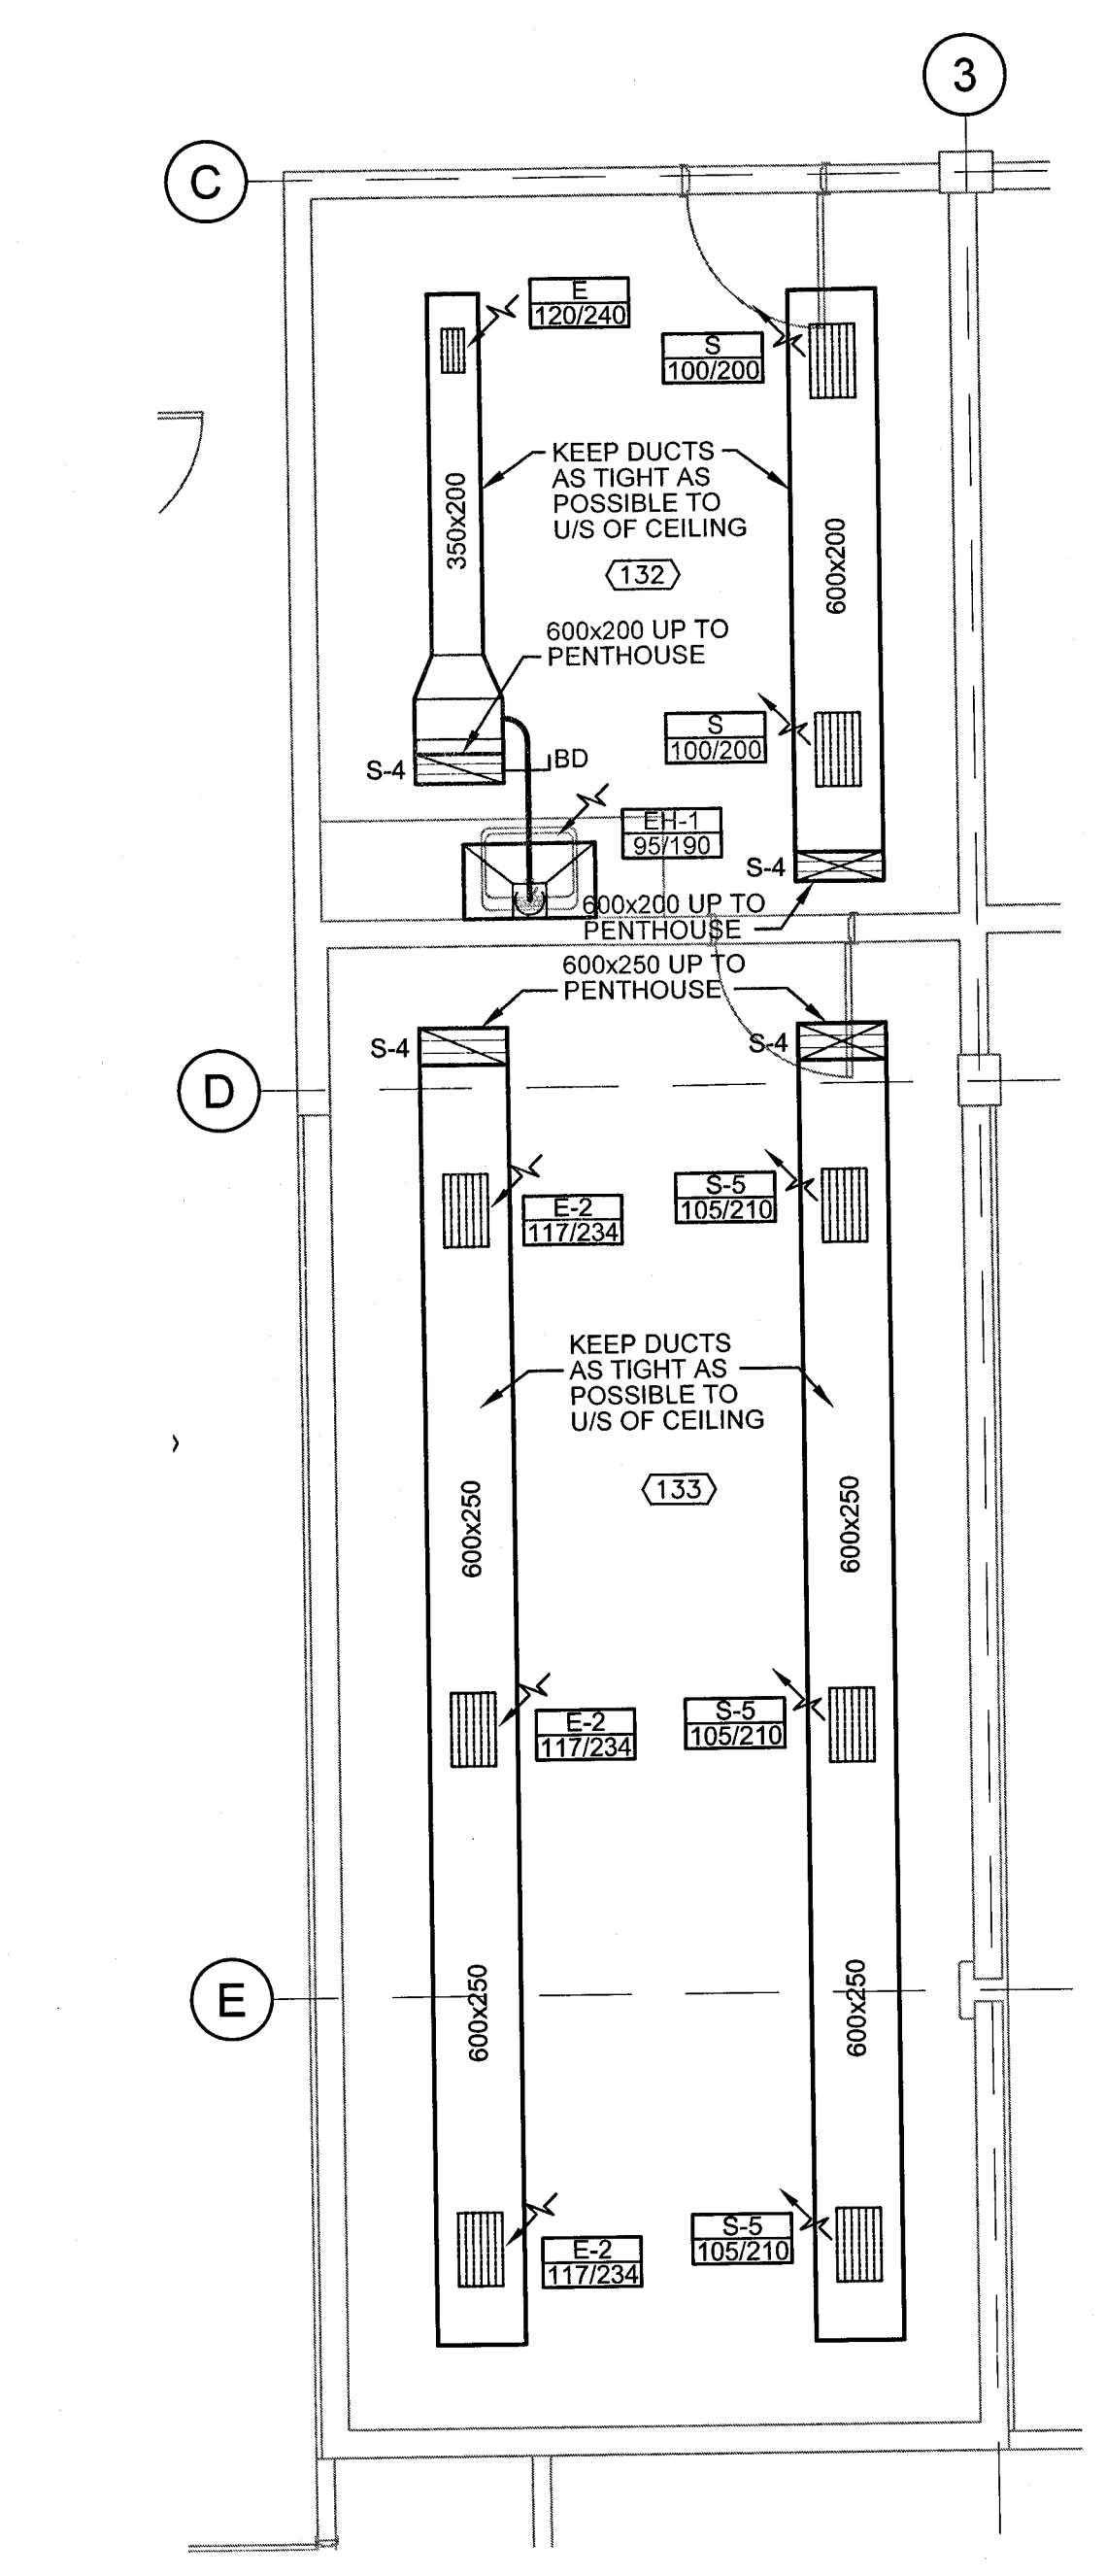

Public Works and Government Services Canada

exp Architects Inc.  
1133 Regent Street, Suite 300  
Fredericton, NB E3B 3Z2  
CANADA  
www.exp.com

exp Project No. FRE-00214763-A5

BUILDINGS - EARTH & ENVIRONMENT  
ENERGY - INDUSTRIAL  
INFRASTRUCTURE - SUSTAINABILITY

exp Services Inc.  
1133 Regent Street, Suite 300  
Fredericton, NB E3B 3Z2  
CANADA  
www.exp.com

CONST. NORTH

KEY PLAN  
SCALE - NTS

0	RELEASED FOR CONSTRUCTION	01/29/2016
revisions		date
project	NEW G.O.C.B SAINT-LÉONARD NEW BRUNSWICK	
drawing	desain	
<b>MAIN FLOOR PLAN VENTILATION</b>		
designed RWM	conçu	
date	JANUARY 29, 2016	
drawn	SET	dessiné
date	JANUARY 29, 2016	
approved DAG	approuvé	
date	FEBRUARY 17, 2016	
Tender	Soumission	
Project Manager	Administrateur de projet	
project number	no. du projet	
	R.069499.001	
drawing no.	no. du dessin	
	2301-1	