



FLOOR PLAN - MAIN LEVEL  
SCALE : 1:100





| KEYNOTES |   |
|----------|---|
| 1        | EXHAUST DUCT RUN IN ROOM 104 FROM 103 TO RUN IN STC 50 RATED PLENUM / BULKHEAD BY GENERAL CONTRACTOR. |
| 2        | 250x200 EXHAUST AIR UP FROM ROOM 104.   |
| 3        | SEE TYPICAL 13mm LINEAR SLOT DIFFUSER SECTION DWG 2301-3.   |
| 4        | 5mm THICK SLEEVE MUST EXTEND OUT TO DUCT BARRIER FROM WALL.   |
| 5        | REHEAT COILS RHC-2 & RHC-3 NOT SHOWN FOR CLARITY.   |
| 6        | REHEAT COILS RHC-4 & RHC-5 NOT SHOWN FOR CLARITY.   |



| LEGEND |  |
|--------|--|
| OA     | OUTSIDE AIR                                |
| SA     | SUPPLY AIR                                 |
| RA     | RETURN AIR                                 |
| EA     | EXHAUST AIR                                |
| EF-1   | EXHAUST FAN #1                             |
| CU-1a  | CONDENSING UNIT #1a                        |
| HRV-1  | HEAT RECOVERY VENTILATOR #1                |
| AC-1   | VARIABLE REFRIGERANT FLOW TERMINAL UNIT #1 |
| PS-1   | PLENUM SILENCER #1                         |
| BD     | BALANCE DAMPER                             |
| ZV     | AIR ZONE VALVE                             |
| MD     | MOTORIZED DAMPER                           |
| HC-17  | HEATING COIL #17                           |
| SB     | SECURITY BARS                              |
| S-1    | SUPPLY GRILLE TYPE 1                       |
| OR     | TRANSFER DUCTS                             |

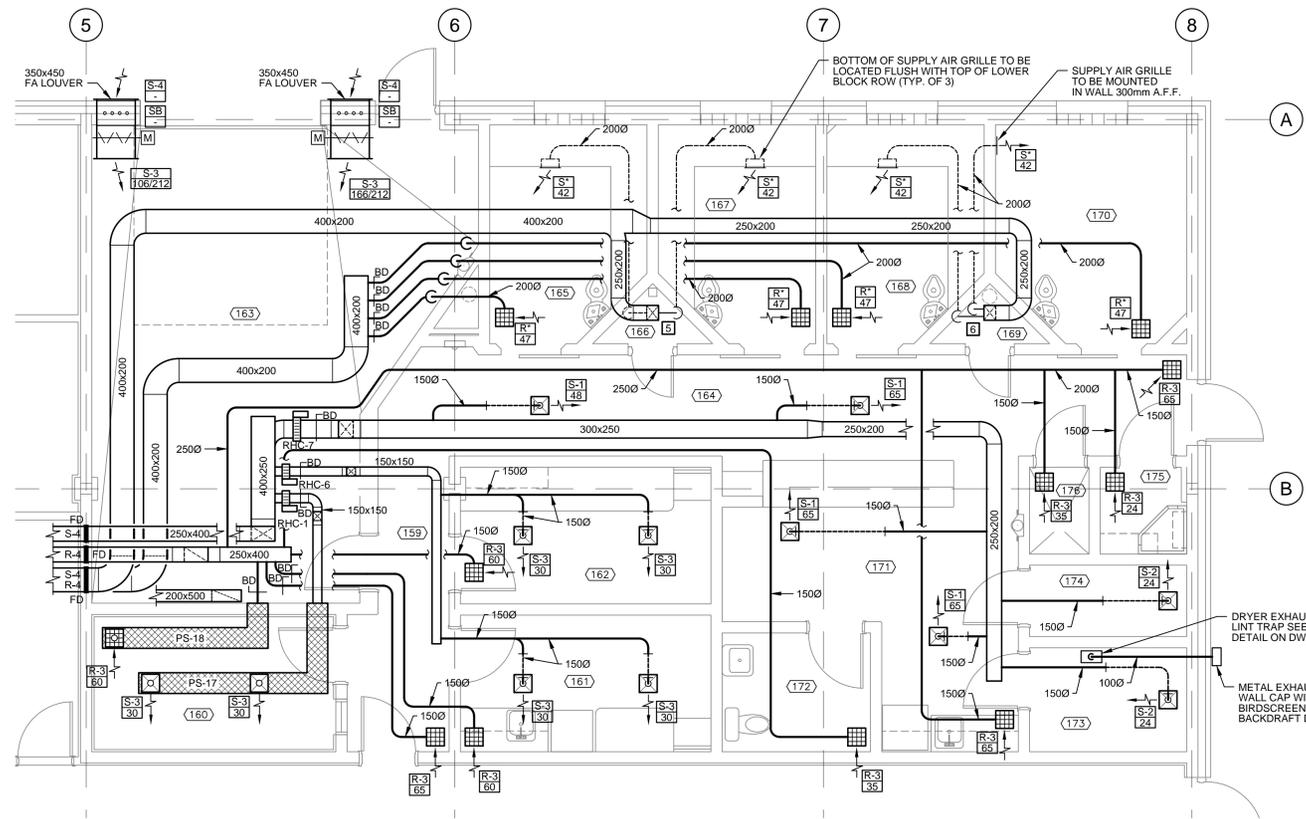

PARTIAL FLOOR PLAN - ROOMS 159 TO 176  
SCALE: 1:50

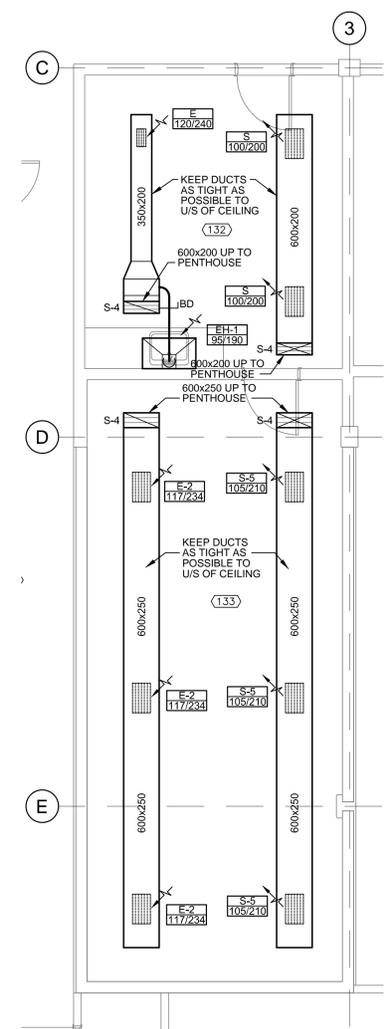

FLOOR PLAN - ROOMS 132 & 133  
SCALE: 1:50



|           |                           |            |
|-----------|---------------------------|------------|
| 0         | RELEASED FOR CONSTRUCTION | 01/29/2016 |
| revisions |                           | date       |

|         |   |         |
|---------|---|---------|
| project | NEW G.O.C.B SAINT-LEONARD NEW BRUNSWICK | project |
| drawing | design                                  |         |

MAIN FLOOR PLAN VENTILATION

|                      |                                  |               |
|----------------------|----------------------------------|---------------|
| designed             | RWM                              | conçu         |
| date                 | JANUARY 29, 2016                 |               |
| drawn                | SET                              | dessiné       |
| date                 | JANUARY 29, 2016                 |               |
| approved             | DAG                              | approuvé      |
| date                 | FEBRUARY 17, 2016                |               |
| Tender               | Soumission                       |               |
| PWGS Project Manager | Administrateur de projets TP/SGC |               |
| project number       | R.069499.001                     | no. du projet |
| drawing no.          | 2301-1                           | no. du dessin |