

EXTERIOR LIGHTS
- CCT A27
(BUILDING #32 & #34)
- CCT B27
(BUILDING #38)


EEMAC 1 ENCLOSURE, C/W HINGED COVER & LOCKING DOOR. PROVIDE LAMICOID NAMEPLATES READING "EXTERIOR LIGHTING CONTROL PANEL" AND LIST SEQUENCE OF OPERATION:
- HAND POSITION - LIGHTING ON
- OFF POSITION - LIGHTING OFF
- AUTO POSITION - LIGHTS ARE CONTROLLED BY TIME CLOCK AND PHOTOCELL.

MOUNT NAMEPLATES OVER SWITCHES. SURFACE MOUNT CONTROL PANEL 1.4m A.F.F. IN ELECTRICAL ROOM.

LEGEND

- PC** PHOTOCELL. "INTERMATIC CAT. NO. K1121 OR EQUAL 120 VOLT. WALL MOUNT 300mm. BELOW BLDG. EAVE.
- AR** AUXILIARY RELAY C/W 4 N.O. CONTACTS.
- C1** 2 POLE CONTACTOR. 120 VOLT, 20 AMP.
- H-O-A** HAND-OFF-AUTO SELECTOR SWITCH. MOUNT IN ENCLOSURE DOOR.

EXTERIOR LIGHTING CONTROL PANEL SCHEMATIC
N.T.S.

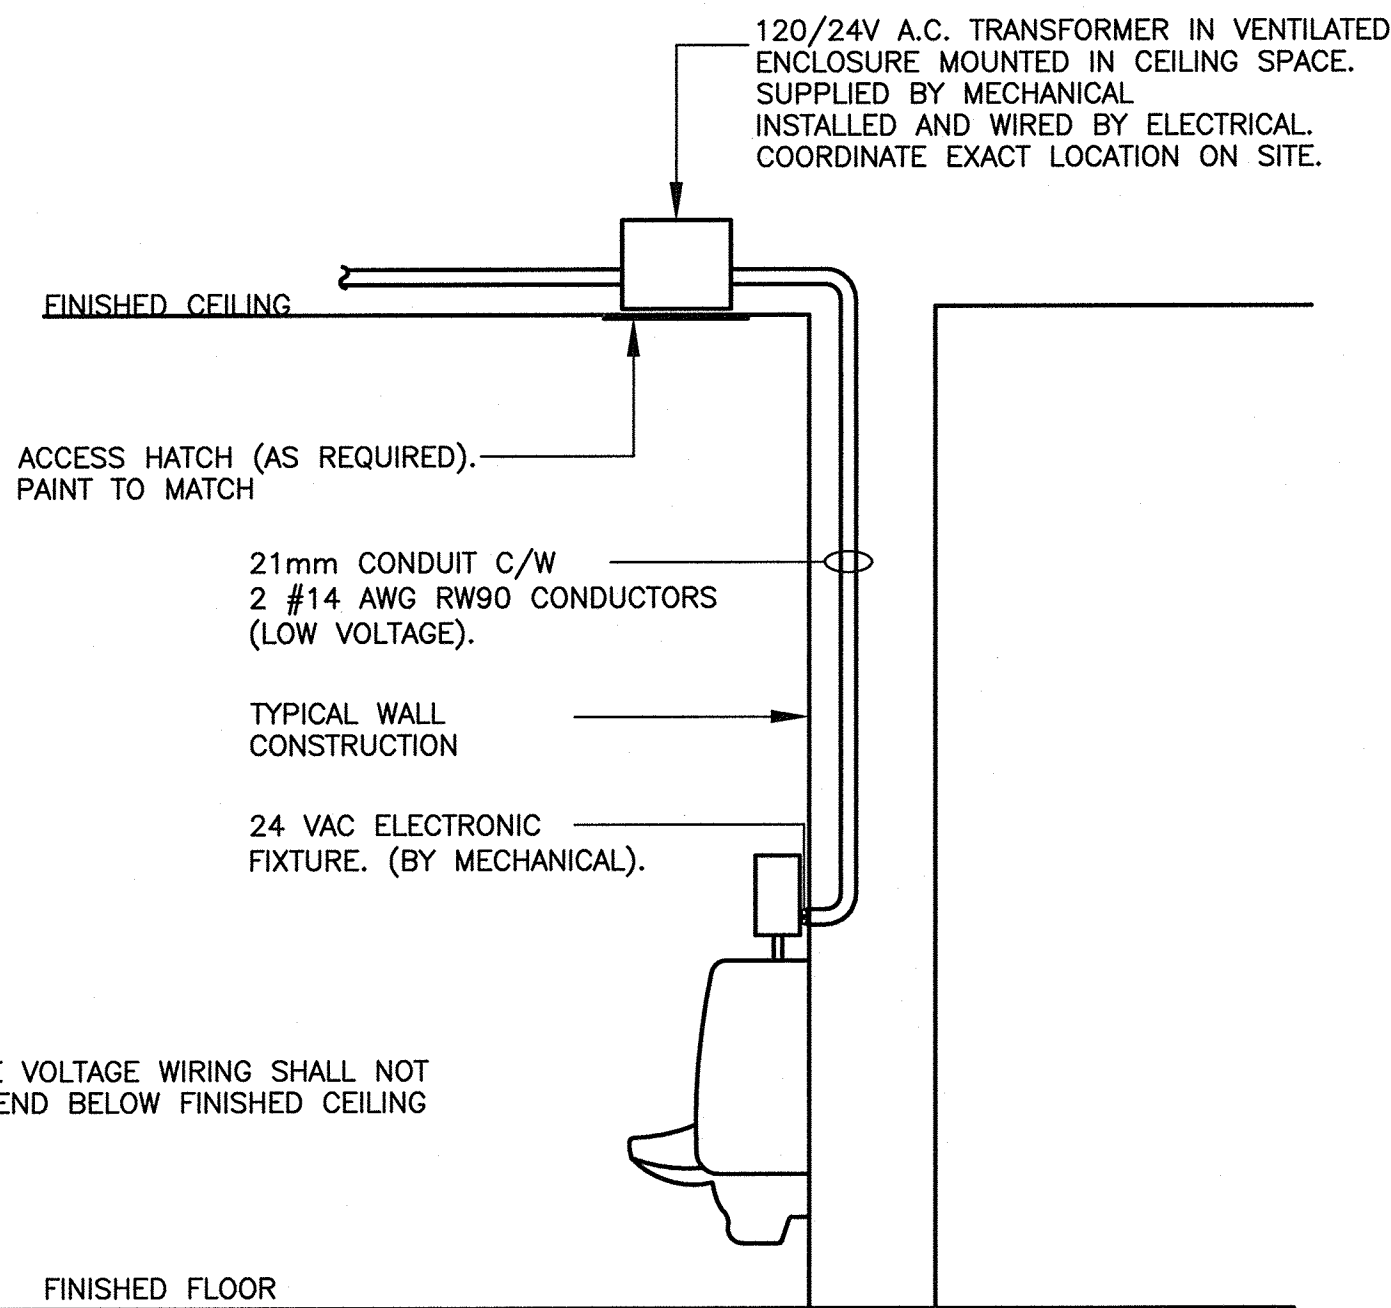


NOTES:


1. LINE VOLTAGE WIRING SHALL NOT EXTEND BELOW FINISHED CEILING

TYPICAL: ELECTRONIC FIXTURE WIRING DIAGRAM
N.T.S.

Stamp

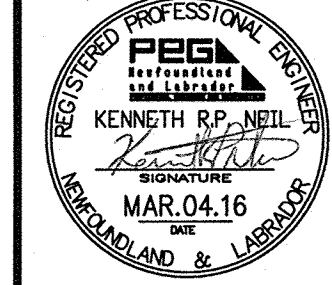

Permit

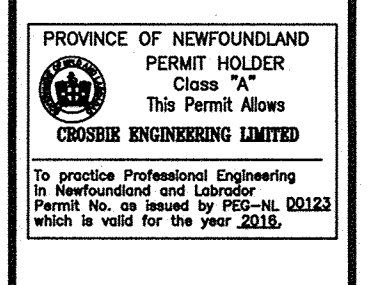

0	ISSUED FOR TENDER	2016/03/04
A	ISSUED FOR TENDER REVIEW	2015/09/11
revisions		date

project
WASHROOM BUILDING
RECAPITALIZATION
BUILDING 32, 34, & 38
NEWMAN SOUND CAMPGROUND
TERRA NOVA
NATIONAL PARK, NL

drawing
dessin

ELECTRICAL DETAILS

designed K.N.	conçu
date AUG. 2015	
drawn B.C.	dessiné
date AUG. 2015	
approved D.H.	approuvé
date AUG. 2015	
Tender <i>[Signature]</i> 22 April 2016	Submission
PWGSC Project Manager	Administrateur de projets TPSGC
project number	no. du projet
R-079272-001	
drawing no.	no. du dessin
E3	