


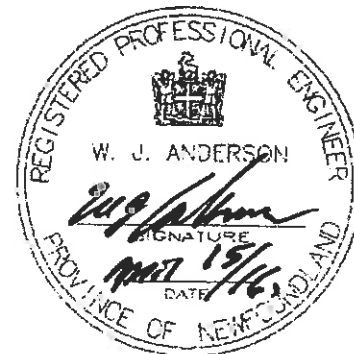
FISHERIES AND OCEANS CANADA
SMALL CRAFT HARBOURS NEWFOUNDLAND REGION
SPECIFICATION FOR
WHARF REPAIRS
FRENCHMAN'S COVE, NL

TENDER SPECIFICATION

Project No: 704122

Date: April, 2016

	PROVINCE OF NEWFOUNDLAND PERMIT HOLDER
	This Permit Allows
<u>ANDERSON ENGINEERING CONSULTANTS LTD.</u>	
To practice Professional Engineering in Newfoundland and Labrador.	
Permit No. as issued by APEGNL <u>R0092</u>	
which is valid for the year <u>2016</u> .	



<u>Section</u>	<u>Title</u>	<u>Pages</u>
<u>Division 01 - General Requirements</u>		
01 10 10	GENERAL INSTRUCTIONS	12
01 29 83	PAYMENT PROCEDURES: TESTING LABORATORY SERVICES	2
01 33 00	SUBMITTAL PROCEDURES	5
01 35 24	SPECIAL PROCEDURES ON FIRE SAFETY REQUIREMENTS	5
01 35 25	SPECIAL PROCEDURES ON LOCKOUT REQUIREMENTS	6
01 35 28	HEALTH AND SAFETY REQUIREMENTS	14
01 35 43	ENVIRONMENTAL PROCEDURES	4
01 45 00	TESTING AND QUALITY CONTROL	4
01 50 00	TEMPORARY FACILITIES	3
01 56 00	TEMPORARY BARRIERS AND ENCLOSURES	2
01 59 20	INSPECTOR'S CAMP AND BOARD	1
01 61 00	COMMON PRODUCT REQUIREMENTS	5
01 74 11	CLEANING	2
01 74 21	CONSTRUCTION/DEMOLITION WASTE MANAGEMENT AND DISPOSAL	5
01 78 00	CLOSEOUT SUBMITTALS	4
<u>Division 02 - Existing Conditions</u>		
02 41 16	SITework, DEMOLITION AND REMOVAL	3
<u>Division 03 - Concrete</u>		
03 10 00	CONCRETE FORMING AND ACCESSORIES	5
03 20 00	CONCRETE REINFORCING	4
03 30 00	CAST-IN-PLACE CONCRETE	11
<u>Division 05 - Metals</u>		
05 50 00	METAL FABRICATIONS	6
05 50 11	WELDING	2
<u>Division 06 - Wood Plastics, and Composites</u>		
06 05 73	WOOD TREATMENT	4
<u>Division 07 - Thermal and Moisture Protection</u>		
07 92 10	JOINT SEALING	6
<u>Division 31 - Earthwork</u>		
31 05 16	AGGREGATE MATERIALS	5
31 23 25	ROCK AND ROCK FILL	4
31 32 19.01	GEOTEXTILES	5
31 53 16	STRUCTURAL TIMBER	9
<u>Division 32 - Exterior Improvements</u>		
32 11 23	AGGREGATE BASE COURSE	5
32 12 10	MARSHALL IMMERSION TEST FOR BITUMEN	3
32 12 16	ASPHALT PAVING	17

Division 35 - Waterway and Marine Construction

35 31 23.13	RUBBLE MOUND BREAKWATER	6
35 59 29	MOORING DEVICES	3

List of Drawings

COVER

1 OF 7	PROJECT LOCATION MAP, SITE LOCATION PLAN, EXISTING SITE PLAN, DEMOLITION, AND STEEL PLAN
2 OF 7	EXISTING WHARF ELEVATIONS, SECTIONS, AND DEMOLITION
3 OF 7	WHARF LAYOUT PLAN
4 OF 7	WHARF PLAN
5 OF 7	WHARF ELEVATIONS AND SECTIONS
6 OF 7	WHARF SECTIONS AND DETAILS
7 OF 7	MISC. DETAILS

PART 1 - GENERAL

1.1 SCOPE

- .1 The scope for this project is the provision of construction activities to improve the safety, integrity and effectiveness of the facilities as is more specifically described in the Description of Work and the drawings and specifications. The work covered consists of the furnishing of all plant, labour, equipment and material for these improvements at Frenchman's Cove, Newfoundland and Labrador, in strict accordance with specifications and accompanying drawings and subject to all terms and conditions of the Contract. Bidders are advised that opportunities and requirements may arise that may warrant changes to the work that are in keeping with this general scope of work. Such changes will be made through the Change Order processes as outlined in the contract documents.

1.2 DESCRIPTION OF WORK

- .1 In general, work under this contract consist of but will not necessarily be limited to the following:
- .1 Partial demolition and removal of required components, as detailed on drawings.
 - .2 Replacement of existing steel cross bracing at steel pile wharf section.
 - .3 Replacement of existing wood cross bracing at wood pile wharf section.
 - .4 Replacement of horizontal wales and closed faced fenders as detailed on drawings.
 - .5 Replacement of concrete wharf deck sections as shown on drawings.
 - .6 Supply and installation of type B1 mooring cleats, mooring rings, wheelguard and ladders as indicated on drawings.
 - .7 Supply and placement of new rock rip rap stone.
- .2 All as indicated on accompanying drawings and

specifications hereto.

1.3 SITE OF WORK

- .1 Work will be carried out at Frenchman's Cove, Newfoundland and Labrador in the location as shown on the accompanying drawings.

1.4 DATUM

- .1 Datum used for this project is Lowest Normal Tides (LNT) and is assumed to be 3.258 metres below BM PWC 3-2006. Nail in concrete deck.
- .2 Bidders are advised to consult the Tide Tables issued by Fisheries and Oceans in order to make sure of the tidal conditions affecting work.

1.5 FAMILIARIZATION
WITH SITE

- .1 Before submitting a bid, it is recommended that bidders visit the site and its surroundings to review and verify the form, nature and extent of the work, materials needed for the completion of the work, the means of access to the site, severity, exposure and uncertainty of weather, soil conditions, any accommodations they may require, and in general shall obtain all necessary information as to risks, contingencies and other circumstances which may influence or affect their bid. No allowance shall be made subsequently in this connection on account of error or negligence to properly observe and determine the conditions that will apply.
- .2 Contractors, bidders or those they invite to site are to review specification Section 01 35 28 - Health and Safety Requirements before visiting site. Take all appropriate safety measures for any visit to site, either before or after acceptance of bid.

1.6 CODES AND
STANDARDS

- .1 Perform work in accordance with the latest edition of the National Building Code of Canada, FCC Standard 373 - Standard for Piers and Wharves
(<http://www1.servicecanada.gc.ca/eng/labour>)

/fi e_
protection/policies_standards/commissioner
373/page00.shtml), and any other code of
provincial or local application including all
amendments up to project bid closing date
provided that in any case of conflict or
discrepancy, the more stringent requirements
shall apply.

- .2 Materials and workmanship must meet or exceed requirements of specified standards, codes and referenced documents.

1.7 TERM ENGINEER

- .1 Unless specifically stated otherwise, the term Engineer where used in the Specifications and on the Drawings shall mean the Departmental Representative as defined in the General Conditions of the Contract.

1.8 SETTING OUT
WORK

- .1 Set grades and layout work in detail from control points and grades established by Departmental Representative.
- .2 Assume full responsibility for and execute complete layout of work to locations, lines and elevations indicated or as directed by Departmental Representative.
- .3 Provide devices needed to layout and construct work.
- .4 Supply such devices as straight edges and templates required to facilitate Departmental Representative's inspection of work.
- .5 Supply stakes and other survey markers required for laying out work.

1.9 COST BREAKDOWN

- .1 Before submitting first progress claim submit breakdown of Contract price in detail as directed by Departmental Representative and aggregating contract price. Departmental Representative will provide the required forms for application of progress payment.

- .2 Provide cost breakdown in same format as the numerical and subject title system used in this specification project manual and thereafter sub-divided into major work components as directed by Departmental Representative.
- .3 Upon approval by Departmental Representative, cost breakdown will be used as basis for progress payment.
- .4 All work items not designated in the unit price table as a measurement for payment, are to be included in the lump sum arrangement, as noted on the Bid and Acceptance Form.

1.10 WORK SCHEDULE

- .1 Submit within 7 work days of notification of acceptance of bid, a construction schedule showing commencement and completion of all work within the time stated on the Bid and Acceptance Form and the date stated in the bid acceptance letter.
- .2 Provide sufficient details in schedule to clearly illustrate entire implementation plan, depicting efficient coordination of tasks and resources, to achieve completion of work on time and permit effective monitoring of work progress in relation to established milestones.
- .3 As a minimum, work schedule to be prepared and submitted in the form of Bar (GANTT) Charts, indicating work activities, tasks and other project elements, their anticipated durations and planned dates for achieving key activities and major project milestones provided in sufficient details and supported by narratives to demonstrate a reasonable plan for completion of project within designated time, e.g., show target dates for the placement of each crib, if applicable. Generally Bar Charts derived from commercially available computerized project management system are preferred but not mandatory.
- .4 Submit schedule updates on a minimum monthly

basis and more often, when requested by Departmental Representative, due to frequent changing project conditions. Provide a narrative explanation of necessary changes and schedule revisions at each update.

- .5 The schedule, including all updates, shall be to Departmental Representative's approval. Take necessary measures to complete work within approved time. Do not change schedule without Departmental Representative's approval.
- .6 All work on the project will be completed within the time indicated on the Bid and Acceptance Form.

1.11 ABBREVIATIONS

- .1 Following abbreviations of standard specifications have been used in this specification and on the drawings:

CGSB - Canadian Government Specifications Board
CSA - Canadian Standards Association
NLGA - National Lumber Grades Authority
ASTM - American Society for Testing and Materials

- .2 Where these abbreviations and standards are used in this project, latest edition in effect on date of bid call will be considered applicable.

1.12 QUARRY AND
EXPLOSIVES

- .1 Make own arrangements with Provincial authorities and owners of private properties, for the quarrying and transportation of rock and all materials and machinery necessary for work over their property, roads or streets as case may be.

1.13 SITE
OPERATIONS

- .1 Arrange for sufficient space adjacent to project site for conduct of operations, storage of materials and so on. Exercise care so as not to obstruct or damage public or private property in area. Do not interfere

with normal day-to-day operations in progress at site. All arrangements for space and access will be made by Contractor.

- .2 Remove snow and ice as required to maintain safe access in a manner that does not damage existing structures or interfere with the operations of others.

1.14 PROJECT MEETINGS

- .1 Departmental Representative will arrange project meetings and assume responsibility for setting times and recording minutes.
- .2 Project meetings will take place on site of work unless so directed by the Departmental Representative.
- .3 Departmental Representative will assume responsibility for recording minutes of meetings and forwarding copies to all parties present at the meetings.
- .4 Have a responsible member of firm present at all project meetings.

1.15 PROTECTION

- .1 Store all materials and equipment to be incorporated into work to prevent damage by any means.
- .2 Repair or replace all materials or equipment damaged in transit or storage to the satisfaction of Departmental Representative and at no cost to Canada.

1.16 EXISTING SERVICES

- .1 Where work involves breaking into or connecting to existing services, carry out work at times directed by governing authorities, with minimum of disturbance to site operations, pedestrian, vehicular traffic, and tenant operations.
- .2 Before commencing work, establish location and extent of service lines in area of work and notify Departmental Representative of findings.

- .3 Submit schedule to and obtain approval from Departmental Representative for any shut-down or closure of active service or facility. This includes disconnection of electrical power and communication services to tenant's operational areas. Adhere to approved schedule and provide notice to affected parties.
- .4 Provide temporary services when directed by Departmental Representative to maintain critical facility systems.
- .5 Provide adequate bridging over trenches which cross walkways or roads to permit normal traffic.
- .6 Where unknown services are encountered, immediately advise Departmental Representative and confirm findings in writing.
- .7 Protect, relocate or maintain existing active services as required. When inactive services are encountered, cap off in manner approved by authorities having jurisdiction over service. Record locations of maintained, re-routed and abandoned service lines.

1.17 DOCUMENTS
REQUIRED

- .1 Maintain at job site, one copy each of the following:
 - .1 Contract Drawings
 - .2 Specifications
 - .3 Addenda
 - .4 Reviewed Shop Drawings
 - .5 List of outstanding shop drawings
 - .6 Change Orders
 - .7 Other modifications to Contract
 - .8 Field Test Reports
 - .9 Copy of Approved Work Schedule
 - .10 Site specific Health and Safety Plan and other safety related documents
 - .11 Other documents as stipulated elsewhere in the Contract Documents.

1.18 PERMITS

- .1 Obtain and pay for all permits, certificates

and licenses as required by Municipal, Provincial, Federal and other Authorities.

- .2 Provide appropriate notifications of project to municipal and provincial inspection authorities.
- .3 Obtain compliance certificates as prescribed by legislative and regulatory provisions of municipal, provincial and federal authorities as applicable to the performance of work.
- .4 Submit to Departmental Representative, copy of application submissions and approval documents received for above referenced authorities.
- .5 Submit to Departmental Representative, copy of quarry permit, if applicable, prior to start of quarry operations.
- .6 Comply with all requirements, recommendations and advise by all regulatory authorities unless otherwise agreed in writing by Departmental Representative. Make requests for such deviations to these requirements sufficiently in advance of related work.

1.19 CUTTING,
FITTING AND
PATCHING

- .1 Execute cutting, including excavation, fitting and patching required to make work fit properly.
- .2 Where new work connects with existing and where existing work is altered, cut, patch and make good to match existing work. This includes patching of openings in existing work resulting from removal of existing services.
- .3 Do not cut, bore, or sleeve load-bearing members.
- .4 Make cuts with clean, true, smooth edges. Make patches inconspicuous in final assembly.

1.20 EXISTING SUB-
SURFACE CONDITIONS

- .1 Information pertaining to the existing sub-surface conditions may be available by

contacting the Departmental Representative.

- .2 Contractors are cautioned that any previous investigations that may be available for review, were intended to provide general site information only. Any interpolation and/or assumptions made relative to any previous investigations is the Contractor's responsibility.

1.21 LOCATION OF
EQUIPMENT

- .1 Location of cleats, ladders, mooring rings, equipment, and fixtures, shown or specified shall be considered as approximate. Actual location shall be as required to suit conditions at time of installation and as is reasonable. Obtain approval of Departmental Representative.
- .2 Locate equipment, fixtures and distribution systems to provide minimum interference and maximum usable space and in accordance with manufacturer's recommendations for safety, access and maintenance.
- .3 Inform Departmental Representative when impending installation conflicts with other new or existing components. Follow directives for actual location.
- .4 Submit field drawings to indicate relative position of various services and equipment when required by Departmental Representative.

1.22 FISH HABITAT

- .1 This work is being conducted in an area where fish habitat may be affected. Perform work to conform with rules and regulations governing fish habitat and in accordance with authorization for work or undertakings affecting fish habitat.
- .2 Contact the Department of Fisheries and Oceans, Marine Development and Infrastructure Unit at (709) 772-2508 at least 48 hours in advance of starting any work on site.

1.23 NOTICE TO
SHIPPING/MARINERS

- .1 Notify the Marine Communications and Traffic Services' Centre, of Fisheries and Oceans Canada, at (709) 772-2083, ten (10) days prior to commencement and upon completion of the work, in order to allow for the issuance of Notices to Shipping/Mariners.
- .2 During construction any vessels or barges utilized must be marked in accordance with the provisions of the Canada Shipping Act Collision Regulations.

1.24 ACCEPTANCE

- .1 Prior to the issuance of the Certificate of Substantial Performance, in company with Departmental Representative, make a check of all work. Correct all discrepancies before final inspection and acceptance.

1.25 WORKS
COORDINATION

- .1 Responsible for coordinating the work of the various trades, where the work of such trades interfaces with each other.
- .2 Convene meetings between trades whose work interfaces and ensure that they are fully aware of the areas and the extent of where interfacing is required. Provide each trade with the plans and specifications of the interfacing trade, as required, to assist them in planning and carrying out their respective work.
- .3 Canada will not be responsible for or held accountable for any extra costs incurred as a result of the failure to carry out coordination work. Disputes between the various trades as a result of their not being informed of the areas and extent of interface work shall be the sole responsibility of the General Contractor and shall be resolved at no extra cost to Canada.

1.26 CONTRACTOR'S
USE OF SITE

- .1 Construction operations, including storage of materials for this contract, not to

interfere with the fishing activity and/or operations at this harbour facility.

- .2 Responsible for arranging the storage of materials on or off site, and any materials stored at the site which interfere with any of the day to day activities at or near the site will be moved promptly at the Contractor's expense, upon request by Departmental Representative.
- .3 Contractor will take adequate precautions to protect existing concrete decks and asphalt when operating tracked equipment.
- .4 Exercise care so as not to obstruct or damage public or private property in the area.
- .5 At completion of work, restore area to its original condition. Damage to ground and property will be repaired by Contractor. Remove all construction materials, residue, excess, etc., and leave site in a condition acceptable to Departmental Representative.

1.27 WORK
COMMENCEMENT

- .1 Mobilization to project site is to commence immediately after acceptance of bid and submission of Site Specific Safety Plan, unless otherwise agreed by Departmental Representative.
- .2 Project work on site is to commence as soon as possible, with a continuous reasonable work force, unless otherwise agreed by Departmental Representative.
- .3 Weather conditions, short construction season, delivery challenges and the location of the work site may require the use of longer working days and additional work force to complete the project within the specified completion time.
- .4 Make every effort to ensure that sufficient material and equipment is delivered to site at the earliest possible date after acceptance of bid and replenished as required.

1.28 FACILITY

SMOKING ENVIRONMENT

- .1 Comply with smoking restrictions.

1.29 INTERPRETATION
OF DOCUMENTS

- .1 Supplementary to the Order of Precedence article of the General Conditions of the Contract, the Division 01 sections take precedence over the technical specification sections in other Divisions of the Specification Manual.

1.30 ASBESTOS
DISCOVERY

- .1 Demolition of spray or trowel-applied asbestos can be hazardous to health. Should material resembling spray or trowel-applied asbestos be encountered in course of work, stop work and notify Departmental Representative immediately. Do not proceed with relevant work until written instructions have been received from Departmental Representative.

PART 1 - GENERAL

1.1 SECTION
INCLUDES

- .1 Inspecting and testing by inspecting firms or testing laboratories designated by Departmental Representative.

1.2 RELATED
REQUIREMENTS
SPECIFIED ELSEWHERE

- .1 Particular requirements for inspection and testing to be carried out by testing laboratory designated by Departmental Representative are specified under various sections.

1.3 APPOINTMENT AND
PAYMENT

- .1 Departmental Representative will appoint and pay for services of testing laboratory except for the following:
- .1 Inspection and testing required by laws, ordinances, rules, regulations or orders of public authorities.
 - .2 Inspection and testing performed exclusively for Contractor's convenience.
 - .3 Mill tests and certificates of compliance.
 - .4 Tests specified to be carried out by Contractor under the supervision of Departmental Representative.
 - .5 Tests requested by Departmental Representative to confirm material specifications when the applicable manufacturer's documentation or test results are unavailable.
 - .6 Additional tests specified in the following paragraph.
- .2 Where tests or inspections by designated testing laboratory reveal Work not in accordance with contract requirements, pay

costs for additional tests or inspections as required by Departmental Representative to verify acceptability of corrected work.

1.4 CONTRACTOR'S
RESPONSIBILITIES

- .1 Provide labour, equipment and facilities to:
testing.
 - .1 Provide access to Work to be inspected and tested.
 - .2 Facilitate inspections and tests.
 - .3 Make good Work disturbed by inspection and test.
 - .4 Provide storage on site for laboratory's exclusive use to store equipment and cure test samples.
- .2 Notify Departmental Representative sufficiently in advance of operations to allow for assignment of laboratory personnel and scheduling of test.
- .3 Where materials are specified to be tested, deliver representative samples in required quantity to testing laboratory.
- .4 Pay costs for uncovering and making good Work that is covered before required inspection or testing is completed and approved by Departmental Representative.

PART 2 - PRODUCTS

- 2.1 NOT USED .1 Not Used.

PART 3 - EXECUTION

- 3.1 NOT USED .1 Not Used.

PART 1 - GENERAL

1.1 SECTION
INCLUDES

- .1 Shop drawings and product data.
- .2 Samples.
- .3 Certificates.

1.2 SUBMITTAL
GENERAL REQUIREMENTS

- .1 Submit to Departmental Representative for review submittals listed, including shop drawings, samples, certificates and other data, as specified in other sections of the Specifications.
- .2 Submit with reasonable promptness and in orderly sequence so as to allow for Departmental Representative's review and not cause delay in Work. Failure to submit in ample time will not be considered sufficient reason for an extension of Contract Time and no claim for extension by reason of such default will be allowed.
- .3 Do not proceed with Work until relevant submissions are reviewed by Departmental Representative.
- .4 Present shop drawings, product data, samples and mock-ups in SI Metric units.
- .5 Where items or information is not produced in SI Metric units, provide soft converted values.
- .6 Review submittals prior to submission to Departmental Representative. Ensure during review that necessary requirements have been determined and verified, required field measurements or data have been taken, and that each submittal has been checked and co-ordinated with requirements of Work and Contract Documents.

- .1 Submittals not stamped, signed, dated and identified as to specific project will be returned unexamined by Departmental Representative and considered rejected.
- .7 Notify Departmental Representative, in writing at time of submission, identifying deviations from requirements of Contract Documents stating reasons for deviations.
- .8 Verify field measurements and affected adjacent Work are co-ordinated.
- .9 Contractor's responsibility for errors and omissions in submission is not relieved by Departmental Representative's review of submittals.
- .10 Contractor's responsibility for deviations in submission from requirements of Contract Documents is not relieved by Departmental Representative's review.
- .11 Submit format: paper originals, or alternatively clear and fully legible photocopies of originals. Facsimiles are not acceptable, except in special circumstances pre-approved by Departmental Representative. Poorly printed non-legible photocopies or facsimiles will not be accepted and be returned for resubmission.
- .12 Make changes or revision to submissions which Departmental Representative may require, consistent with Contract Documents and resubmit as directed by Departmental Representative. When resubmitting, notify Departmental Representative in writing of any revisions other than those requested.
- .13 Keep one reviewed copy of each submittal document on site for duration of Work.

1.3 SHOP DRAWINGS
AND PRODUCT DATA

- .1 The term "shop drawings" means drawings, diagrams, illustrations, schedules, performance charts, product data, brochures and other data which are to be provided by Contractor to illustrate details of a portion

of Work.

- .2 Number of Shop Drawings: submit sufficient copies of shop drawings which are required by the General Contractor and sub-contractors plus (2) copies which will be retained by Departmental Representative. Ensure sufficient numbers are submitted to enable one complete set to be included in each of the maintenance manuals specified, if applicable.
- .3 Shop Drawings Content and Format:
 - .1 Indicate materials, methods of construction and attachment or anchorage, erection diagrams, connections, explanatory notes and other information necessary for completion of Work. Where items or equipment attach or connect to other items or equipment, confirm that all interrelated work have been coordinated, regardless of section or trade from which the adjacent work is being supplied and installed.
 - .2 Shop Drawings Format:
 - .1 Opaque white prints or photocopies of original drawings or standard drawings modified to clearly illustrate work specific to project requirements. Maximum sheet size to be 1000 x 707 mm.
 - .2 Product Data from manufacturer's standard catalogue sheets, brochures, literature, performance charts and diagrams, used to illustrate standard manufactured products, to be original full colour brochures, clearly marked indicating applicable data and deleting information not applicable to project.
 - .3 Non or poorly legible drawings, photocopies or facsimiles will not be accepted and returned not reviewed.
 - .3 Supplement manufacturer's standard drawings and literature with additional information to provide details applicable to project.
 - .4 Delete information not applicable to project on all submittals.
- .4 Allow 14 calendar days for Departmental Representative's review of each submission.
- .5 Adjustments or corrections made on shop

drawings by Departmental Representative are not intended to change Contract Price. If adjustments affect value of Work, advise Departmental Representative in writing prior to proceeding with Work.

- .6 If upon review by Departmental Representative, no errors or omissions are discovered or if only minor corrections and comments are made, fabrication and installation may proceed upon receipt of shop drawings. If shop drawings are rejected and noted to be Resubmitted, do not proceed with that portion of work until resubmission and review of corrected shop drawings, through same submission procedures indicated above.
- .7 Accompany submissions with transmittal letter, containing:
 - .1 Date.
 - .2 Project title and number.
 - .3 Contractor's name and address.
 - .4 Identification and quantity of each shop drawing, product data and sample.
 - .5 Other pertinent data.
- .8 Submissions include:
 - .1 Date and revision dates.
 - .2 Project title and number.
 - .3 Name and address of:
 - .1 Subcontractor.
 - .2 Supplier.
 - .3 Manufacturer.
 - .4 Contractor's stamp, signed by Contractor's authorized representative certifying approval of submissions, verification of field measurements and compliance with Contract Documents.
 - .5 Cross references to particular details of contract drawings and specifications section number for which shop drawing submission addresses.
 - .6 Details of appropriate portions of Work as applicable:
 - .1 Fabrication.
 - .2 Layout, showing dimensions, including identified field dimensions, and clearances.
 - .3 Setting or erection details.
 - .4 Capacities.
 - .5 Performance characteristics.

- .6 Standards.
 - .7 Operating weight.
 - .8 Wiring diagrams.
 - .9 Single line and schematic diagrams.
 - .10 Relationship to adjacent work.
- .9 After Departmental Representative's review, distribute copies.
- .10 The review of shop drawings by the Departmental Representative or their delegated representative is for sole purpose of ascertaining conformance with general concept. This review shall not mean that Fisheries and Oceans Canada approves the detail design inherent in the shop drawings, responsibility for which shall remain with Contractor submitting same, and such review shall not relieve Contractor of responsibility for errors or omissions in shop drawings or of responsibility for meeting requirements of the construction and Contract Documents. Without restricting generality of foregoing, Contractor is responsible for dimensions to be confirmed and correlated at job site, for information that pertains solely to fabrication processes or to techniques of construction and installation and for co-ordination of Work of all sub-trades.

1.4 SCHEDULE,
PERMITS AND
CERTIFICATES

- .1 Upon acceptance of bid, submit to Departmental Representative copy of Work Schedule and various other schedules, permits, certification documents and project management plans as specified in other sections of the Specifications.
- .2 Submit copy of permits, notices, compliance Certificates received by Regulatory Agencies having jurisdiction and as applicable to the Work.
- .3 Submission of above documents to be in accordance with Submittal General Requirements procedures specified in this section

PART 1 - GENERAL

1.1 SECTION

INCLUDES

- .1 Fire Safety Requirements.
- .2 Hot Work Permit.

1.2 RELATED WORK

- .1 Section 01 35 25 - Special Procedures on Lockout Requirements.
- .2 Section 01 35 28 - Health and Safety Requirements.

1.3 REFERENCES

- .1 Fire Protection Standards issued by Fire Protection Services of Human Resources Development Canada as follows:
 - .1 FCC No. 301-June 1982 Standard for Construction Operations (<http://www.hrsdc.gc.ca/en/lp/lo/fp/standards/301.shtml>).
 - .2 FCC No. 302-June 1982 Standard for Welding and Cutting (<http://www.hrsdc.gc.ca/en/lp/lo/fp/standards/302.shtml>).
 - .3 FCC standards, may also be viewed at the Regional Fire Protection Services' office (previously known as the Fire Commissioner of Canada) located at 99 Wyse Road, 8th Floor, Dartmouth, NS, Tel: (902) 426-6053.

1.4 DEFINITIONS

- .1 Hot Work defined as:
 - .1 Welding work.
 - .2 Cutting of materials by use of torch or other open flame devices.
 - .3 Grinding with equipment which produces sparks.

1.5 SUBMITTALS

- .1 Submit copy of Hot Work Procedures and sample

of Hot Work permit to Departmental Representative for review, within 14 calendar days after notification of acceptance of bid.

- .2 Submit in accordance with the Submittal General Requirements specified in Section 01 33 00-Submittal Procedures.

1.6 FIRE SAFETY
REQUIREMENTS

- .1 Implement and follow fire safety measures during Work. Comply with following:
 - .1 National Fire Code, 2010.
 - .2 Fire Protection Standards FCC 301 and FCC 302.
 - .3 Federal and Provincial Occupational Health and Safety Acts and Regulations as specified in Section 01 35 28 - Health and Safety Requirements.
- .2 In event of conflict between any provisions of above authorities the most stringent provision will apply. Should a dispute arise in determining the most stringent requirement, Departmental Representative will advise on the course of action to be followed.

1.7 HOT WORK
AUTHORIZATION

- .1 Obtain Departmental Representative's written "Authorization to Proceed" before conducting any form of Hot work on site.
- .2 To obtain authorization submit to Departmental Representative:
 - .1 Contractor's typewritten Hot Work Procedures to be followed on site as specified below.
 - .2 Description of the type and frequency of Hot Work required.
 - .3 Sample Hot Work Permit to be used.
- .3 Upon review and confirmation that effective fire safety measures will be implemented during performance of hot work, Departmental Representative will provide authorization to proceed as follows:
 - .1 Issue one written "Authorization to Proceed" covering the entire project for

duration of work or;

.2 Separate work, or segregate certain parts of work, into individual entities. Each entity requiring a separately written "Authorization to Proceed" from Departmental Representative. Follow Departmental Representative's directives in this regard.

.4 Requirement for individual authorization based on:

.1 Nature or phasing of work;

.2 Risk to Facility operations;

.3 Quantity of various trades needing to perform hot work on project or;

.4 Other situation deemed necessary by Departmental Representative to ensure fire safety on premises.

.5 Do not perform any Hot Work until receipt of Departmental Representative's written "Authorization to Proceed" for that portion of work.

.6 In tenant occupied Facility, coordinate performance of Hot Work with Facility Manager through the Departmental Representative. When directed, perform Hot Work only during non-operative hours of Facility. Follow Departmental Representative's directives in this regard.

1.8 HOT WORK
PROCEDURES

.1 Develop and implement safety procedures and work practices to be followed during the performance of Hot Work.

.2 Procedures to include:

.1 Requirement to perform hazard assessment of site and immediate hot work area for each hot work event in accordance with Hazard Assessment and Safety Plan requirements of Section 01 35 28 -Health and Safety Requirements.

.2 Use of a Hot Work Permit system for each hot work event.

.3 The step by step process of how to prepare and issue permit.

.4 Permit shall be issued by Contractor's site Superintendent, or other authorized person designated by Contractor, granting

permission to worker or subcontractor to proceed with hot work.

.5 Provision of a designated person to carryout a Fire Safety Watch for a minimum of 60 minutes immediately upon completion of the hot work.

.6 Compliance with fire safety codes and standards specified herein and occupational health and safety regulations specified in Section 01 35 28 Health and Safety Requirements.

.3 Generic procedures, if used, must be edited and supplemented with pertinent information tailored to reflect specific project conditions. Clearly label as being the Hot Work Procedures applicable to this contract.

.4 Hot Work Procedures shall clearly establish worker instructions and allocate responsibilities of:

- .1 Worker(s),
- .2 Authorized person issuing the Hot Work Permit,
- .3 Fire Safety Watcher,
- .4 Subcontractors and Contractor.

.5 Brief all workers and subcontractors on Hot Work Procedures and Permit system established for project. Stringently enforce compliance.

.1 Failure to comply with the established procedures may result in the issuance of a Non-Compliance Notification at Departmental Representative's discretion with possible disciplinary measures imposed as specified in Section 01 35 28 - Health and Safety Requirements.

1.9 HOT WORK
PERMIT

.1 Hot Work Permit to include, as a minimum, the following data:

- .1 Project name and project number.
- .2 Building name, address and specific room or area where hot work will be performed.
- .3 Date when permit issued.
- .4 Description of hot work type to be performed.
- .5 Special precautions required, including type of fire extinguisher needed.
- .6 Name and signature of person authorized

to issue the permit.

.7 Name of worker (clearly printed) to which the permit is being issued.

.8 Time Duration that permit is valid (not to exceed 8 hours). Indicate start time and date, and completion time and date.

.9 Worker signature with date and time upon hot work termination.

.10 Specified time period requiring safety watch.

.11 Name and signature of designated Fire Safety Watcher, complete with time and date when safety watch terminated, certifying that surrounding area was under continual surveillance and inspection during the full watch time period specified in Permit and commenced immediately upon completion of Hot Work.

.2 Permit to be typewritten form. Industry Standard forms shall only be used if all data specified above is included on form.

.3 Each Hot Work Permit to be completed in full and signed as follows:

.1 Authorized person issuing Permit before hot work commences.

.2 Worker upon completion of Hot Work.

.3 Fire Safety Watcher upon termination of safety watch.

.4 Returned to Contractor's Site Superintendent for safe keeping.

1.10 DOCUMENTS ON
SITE

.1 Keep Hot Work Permits and Hazard assessment documentation on site for duration of Work.

.2 Upon request, make available to Departmental Representative or to authorized safety representative for inspection.

PART 1 - GENERAL

1.1 SECTION
INCLUDES

- .1 Procedures to isolate and lockout electrical facility or other equipment from energy source.

1.2 RELATED WORK

- .1 Section 01 35 24 - Special Procedures On Fire Safety Requirements.
- .2 Section 01 35 28 - Health and Safety Requirements.

1.3 REFERENCES

- .1 C22.1-06 - Canadian Electrical Code, Part 1, Safety Standard for Electrical Installations.
- .2 CAN/CSA C22.3 No. 1-06 - Overhead Systems.
- .3 CAN/CSA C22.3 No. 7-06 - Underground Systems.
- .4 COSH, Canada Occupational Health and Safety Regulations made under Part II of the Canada Labour Code.

1.4 DEFINITIONS

- .1 Electrical Facility: means any system, equipment, device, apparatus, wiring, conductor, assembly or part thereof that is used for the generation, transformation, transmission, distribution, storage, control, measurement or utilization of electrical energy, and that has an amperage and voltage that is dangerous to persons.
- .2 Guarantee of Isolation: means a guarantee by a competent person in control or in charge that a particular facility or equipment is isolated.
- .3 De-energize: in the electrical sense, that

a piece of equipment is isolated and grounded, e.g. if the equipment is not grounded, it cannot be considered de-energized (DEAD).

- .4 Guarded: means that an equipment or facility is covered, shielded, fenced, enclosed, inaccessible by location, or otherwise protected in a manner that, to the extent that is reasonably practicable, will prevent or reduce danger to any person who might touch or go near such item.
- .5 Isolate: means that an electrical facility, mechanical equipment or machinery is separated or disconnected from every source of electrical, mechanical, hydraulic, pneumatic or other kind of energy that is capable of making it dangerous.
- .6 Live/alive: means that an electrical facility produces, contains, stores or is electrically connected to a source of alternating or direct current of an amperage and voltage that is dangerous or contains any hydraulic, pneumatic or other kind of energy that is capable of making the facility dangerous to persons.

1.5 COMPLIANCE
REQUIREMENTS

- .1 Perform lockouts in compliance with:
 - .1 Canadian Electrical Code.
 - .2 Federal and Provincial Occupational Health and Safety Acts and Regulations as specified in Section 01 35 28 - Health and Safety Requirements.
 - .3 Regulations and code of practice as applicable to mechanical equipment or other machinery being de-energized.
 - .4 Procedures specified herein.
- .2 In event of conflict between any provisions of above authorities the most stringent provision will apply. Should a dispute arise in determining the most stringent requirement, Departmental Representative will advise on the course of action to be followed.

1.6 SUBMITTALS

- .1 Submit copy of proposed Lockout Procedures

and sample form of lockout permit or lockout tags for review.

- .2 Submit documentation within 7 calendar days of acceptance of bid. Do not proceed with work until submittal has been reviewed by Departmental Representative.
- .3 Submit above documents in accordance with the submittal requirements specified in Section 01 33 00- Submittal Procedures.
- .4 Resubmit Lockout Procedures with noted revisions as may result from Departmental Representative's review.

1.7 ISOLATION OF
EXISTING SERVICES

- .1 Obtain Departmental Representative's written authorization prior to conducting work on an existing active, energized service or facility required as part of the work and before proceeding with lockout of such services or facility.
- .2 To obtain authorization, submit to Departmental Representative the following documentation:
 - .1 Written Request for Isolation of the service or facility and;
 - .2 Copy of Contractor's Lockout Procedures.
- .3 Make a Request for Isolation for each event, unless directed otherwise by Departmental Representative, and as follows:
 - .1 Fill-out standard forms in current use at the Facility when so directed by Departmental Representative or;
 - .2 Where no form exist at Facility, make request in writing identifying:
 - .1 Identification of system or equipment to be isolated, including it's location;
 - .2 Time duration, indicating Start time and date, and Completion time and date when isolation will be in effect;
 - .3 Voltage of service feed to system or equipment being isolated;
 - .4 Name of person making the request.
- .3 Document to be in typewritten format.

- .4 Do not proceed until receipt of written notification from Departmental Representative granting the Isolation Request and authorizing to proceed with the isolation of designated equipment or facility. Departmental Representative may designate other individual at the Facility as the person authorized to grant the Isolation Request.
- .5 Conduct safe, orderly shut down of equipment or facilities, de-energize and isolate power and other sources of energy and lockout items in accordance with requirement of clause 1.8 below.
- .6 Plan and schedule shut down of existing services in consultation with the Departmental Representative and the Facility Manager. Minimize impact and downtime of facility operations.
- .7 Determine in advance, as much as possible, in cooperation with the Departmental Representative, the type and frequency of situations which will require a Request for Isolation. Follow Departmental Representative's directives in this regard.
- .8 Conduct hazard assessment as part of the planning process of isolating existing equipment and facilities. Hazard Assessments to conform with requirements of Health and Safety Section 01 35 28- Health and Safety Requirements.

1.8 LOCKOUTS

- .1 Isolate and lockout electrical facilities, mechanical equipment and machinery from all potential energy sources prior to starting work on such items.
- .2 Develop and implement lockout procedures to be followed on site as an integral part of the Work.
- .3 Use energy isolation lockout devices specifically designed and appropriate for type of facility or equipment being locked

out.

- .4 Use industry standard lockout tags.
- .5 Provide appropriate safety grounding and guards as required.
- .6 Prepare Lockout Procedures in writing. Describe safe work practices, work functions and sequence of activities to be followed on site to safely isolate all potential energy sources and lockout/tagout facilities and equipment.
- .7 Include within procedures a system of worker request and issuance of individual lockout permit by a person, employed by Contractor, designated to be "in-charge" and being responsible for:
 - .1 Controlling issuance of permits or tags to workers.
 - .2 Determining permit duration.
 - .3 Maintaining record of permits and tags issued.
 - .4 Submitting a Request for Isolation to Departmental Representative when required in accordance with Clause 1.7 above.
 - .5 Designating a Safety Watcher, when one is required based on type of work.
 - .6 Ensuring equipment or facility has been properly isolated, providing a Guarantee of Isolation to worker(s) prior to proceeding with work.
 - .7 Collecting and safekeeping lockout tags, returned by workers, as a record of the event.
- .8 Clearly establish, describe and allocate, within procedures, the responsibilities of:
 - .1 Workers.
 - .2 Designated person controlling issuance of lockout tags/permits.
 - .3 Safety Watcher.
 - .4 Subcontractors and General Contractor.
- .9 Procedures shall meet the requirements of Codes and Regulations specified in clause 1.5 above.
- .10 Generic procedures, if used, must be edited, supplemented with pertinent information and

tailored to reflect specific project conditions. Clearly label as being the procedures applicable to this contract.

.1 Incorporate site specific rules and procedures established by Facility Manager and in force at site. Obtain such procedures through Departmental Representative.

.11 Procedures to be in typewritten format.

.12 Submit copy of Lockout Procedures to Departmental Representative, in accordance with submittal requirements of clause 1.6 herein, prior to commencement of work.

1.9 CONFORMANCE

.1 Ensure that lockout procedures, as established for project on site, are stringently followed. Enforce use and compliance by all workers.

.2 Brief all persons working on electrical facilities, mechanical and other equipment fed by an energy source on requirements of this section.

.3 Failure to perform lockouts in accordance with regulatory requirements or follow procedures specified herein may result in the issuance of a Non-Compliance Notification at Departmental Representative's discretion with possible disciplinary measures imposed as specified in Section 01 35 28 - Health and Safety Requirements.

1.10 DOCUMENTS ON SITE

.1 Post Lockout Procedures on site in common location for viewing by workers.

.2 Keep copies of Request for Isolation submitted to Departmental Representative and lockout permits or tags issued to workers during the course of work for full project duration.

.3 Upon request, make such data available to Departmental Representative or to authorized safety representative for inspection.

PART 1 - GENERAL

1.1 RELATED WORK

- .1 Section 01 35 24 - Special Procedures on Fire Safety Requirements.
- .2 Section 01 35 25 - Special Procedures on Lockout Requirements.

1.2 SUBMITTALS

- .1 Submit to Departmental Representative copies of the following documents, including updates:
 - .1 Site Specific Health and Safety Plan.
 - .2 Building Permit, compliance certificates and other permits obtained.
 - .3 Reports or directions issued by Federal and Provincial Inspectors and other Authorities having jurisdiction.
 - .4 Accident or Incident Reports.
 - .5 MSDS data sheets.
 - .6 Name of Contractor's representative designated to perform full time health and safety supervision on site.
 - .7 Letter of Good Standing/Certificate of Clearance form the provincial Workers Compensation Board.
- .2 Upon request by Departmental Representative, submit reports and other documentation as stipulated to be produced and maintained by Federal and Provincial Occupational Health and Safety Regulations and as specified herein.
- .3 Submit above documents in accordance with the submittal procedures specified in Section 01 33 00- Submittal Procedures.

1.3 COMPLIANCE
REQUIREMENTS

- .1 Comply with the Occupational Health and Safety Act for the Province of Newfoundland and Labrador, and the Occupational Health and Safety Regulations made pursuant to the Act.

- .2 Comply with Canada Labour Code Part II, and the Canada Occupational Safety and Health Regulations made under Part II of the Canada Labour Code.
- .3 Observe and enforce construction safety measures required by:
 - .1 2014 National Building Code of Canada, Part 8.
 - .2 Provincial Worker's Compensation Board.
 - .3 Municipal statutes and ordinances.
- .4 In event of conflict between any provisions of above authorities the most stringent provision will apply. Should a dispute arise in determining the most stringent requirement, Departmental Representative will advise on the course of action to be followed.
- .5 A copy of the Canada Labour Code Part II may be obtained by contacting: Canadian Government Publishing Public Works and Government Services Canada Ottawa, Ontario, K1A 0S9 Tel: (819) 956-4800 (1-800-635-7943) Publication No. L31-85/2000 E or F).
- .6 Maintain Workers Compensation Coverage for duration of Contract. Submit Letter of Good Standing to Departmental Representative at time of submitting the Project Health and Safety Plan and with each Request for Progress Payment.

1.4 RESPONSIBILITY

- .1 Be responsible for health and safety of persons on site, of property and for protection of persons and public circulating adjacent to work operations to extent that they may be affected by conduct of the Work.
- .2 Enforce compliance by all workers, sub-contractors and other persons granted access to work site with safety requirements of Contract Documents, applicable Federal, Provincial, and local statutes, regulations, and ordinances, and with site specific Health and Safety Plan.

1.5 SITE CONTROL
AND ACCESS

- .1 Control work site and entry points to construction areas.
 - .1 Delineate and isolate construction areas from other areas of Facility by use of appropriate means.
 - .2 Post notices and signage at entry points and at other strategic locations identifying entrance onto site to be restricted to authorized persons only.
 - .3 Signage must be professionally made, bilingual in both official languages or display internationally understood graphic symbols.
- .2 Approve and grant access to site only to workers and authorized persons.
 - .1 Immediately stop non-authorized persons from circulating in construction areas and remove from site.
 - .2 Provide site safety orientation to all persons before granting access. Advise of site conditions, hazards and mandatory safety rules to be observed on site.
- .3 Secure site at night time to extent required to protect against unauthorized entry. Provide security guard where protection cannot be achieved by other means.
- .4 Ensure persons granted access to site wear appropriate personal protective equipment (PPE) suitable to work and site conditions.
 - .1 Provide such PPE to authorized persons who require access to perform inspections or other approved purposes.

1.6 PROTECTION

- .1 Carry out work placing emphasis on health and safety of the Public, Facility personnel, construction workers and protection of the environment.
- .2 Erect safety barricades, lights and signage on site to effectively delineate work areas, protect pedestrian and vehicular traffic around and adjacent to work, and to create a safe working environment.
 - .1 Erect fences, hoarding, protective

barriers and temporary lighting as required. See Section 01 56 00- Temporary Barriers and Enclosures for minimum acceptable barricades.

- .3 Should unforeseen or peculiar safety related hazard or condition become evident during performance of work, immediately take measures to rectify the situation and prevent damage or harm. Advise Departmental Representative verbally and in writing.

1.7 PERMITS

- .1 Obtain building permit, licenses, compliance certificates and other permits as specified in Section 01 10 10 - General Instructions before and during progress of work. Post on site.
- .2 Where particular permit or compliance certificate cannot be obtained at the required stage of work, notify Departmental Representative in writing and obtain Departmental Representative's approval to proceed prior to carrying out that portion of work.

1.8 HAZARD
ASSESSMENTS

- .1 Conduct site specific health and safety hazard assessment before commencing project and during course of work identifying risks and hazards resulting from site conditions, weather conditions and work operations.
 - .1 Perform on-going assessments addressing new risks and hazards as work progresses including when new subtrade or sub-contractor arrives on site.
 - .2 Also, conduct assessment when the scope of work has been changed by Change Order and when potential hazard or weakness in current health and safety practices are identified by Departmental Representative or by an authorized safety representative.
- .2 Record results in writing and address in Health and Safety Plan.
- .3 Keep copy of all assessments on site.

1.9 PROJECT/SITE
CONDITIONS

- .1 The following are known or potential project related health, environmental and safety hazards at site which must be properly managed if encountered during course of work:
 - .1 The following are known or potential project related safety hazards at site:
 - .1 Working in close proximity of water.
 - .2 Use of water crafts and floating platforms.
 - .3 Wet and slippery conditions.
 - .4 Inclement weather.
 - .5 Potential structural weakness of existing structures.
 - .6 Heavy equipment activity in the area.
 - .7 Heavy lifting.
 - .8 Working at heights.
 - .9 Cutting tools and other construction power tools.
 - .10 Overhead power/utility lines.
 - .11 Risk of electric shock.
 - .12 Vehicular and pedestrian traffic.
 - .13 Confined spaces.
- .2 Above list shall not be construed as being complete and inclusive of potential health, and safety hazards encountered during work. Include above items into hazard assessment process.
- .3 Obtain from Departmental Representative, copy of MSDS Data sheets for existing hazardous products stored on site or used by Facility personnel.

1.10 HEALTH AND
SAFETY MEETINGS

- .1 Attend pre-construction health and safety meeting conducted by Departmental Representative. Have following persons in attendance:
 - .1 Site Superintendent.
 - .2 Contractor's designated Health and Safety Site Supervisor.
 - .3 Departmental Representative will advise of date, time and location.

- .2 Conduct health and safety meetings and tool box briefings on site. Hold on a regular and pre-scheduled basis during entire work in accordance with requirements and frequency as stipulated in provincial Occupational Health and Safety Regulations.
 - .1 Keep workers informed of potential hazards and provide safe work practices and procedures to be followed.
 - .2 Take written minutes and post on site.

1.11 HEALTH AND
SAFETY PLAN

- .1 Develop written site specific Project Health and Safety Plan, based on hazard assessments, prior to commencement of work.
 - .1 Submit copy to Departmental Representative within 14 calendar days of acceptance of bid.
 - .2 Submit updates as work progresses.
- .2 Health and Safety Plan shall contain three (3) parts with the following information:
 - .1 Part 1 - Hazards: List of individual health risks and safety hazards identified by hazard assessment process.
 - .2 Part 2 - Safety Measures: Engineering controls, personal protective equipment and safe work practices used to mitigate hazards and risks listed in Part 1 of Plan.
 - .3 Part 3a: Emergency Response: standard operating procedures, evacuation measures and emergency response in the occurrence of an accident, incident or emergency.
 - .1 Include response to all hazards listed in Part 1 of Plan.
 - .2 Evacuation measures to complement the Facility's existing Emergency Response and Evacuation Plan. Obtain pertinent information from Departmental Representative.
 - .3 List names and telephone numbers of officials to contact including:
 - .1 General Contractor and all Subcontractors.
 - .2 Federal and Provincial Departments as stipulated by laws and regulations of authorities having jurisdiction and local emergency resource organizations,

as needed base on nature of emergency.

.3 Officials from PWGSC and site Facility Management.

Departmental Representative will provide list.

.4 Part 3b - Site Communications:

.1 Procedures used on site to share work related safety issues between workers, subcontractors, and General Contractor.

.2 List of critical tasks and work activities, to be communicated with the Facility Manager, which has risk of affecting tenant operations, or endangering health and safety of Facility personnel and the general public. Develop list in consultation with the Departmental Representative.

.3 Prepare Health and Safety Plan in a three column format, addressing the three parts specified above, as follows:

Part 1 Identified Hazards	Part 1 Safety Measures	Part 3a/3b Emergency Response & Site Communications
---------------------------------	------------------------------	---

.4 Develop Plan in collaboration with subcontractors. Address work activities of all trades. Revise and update Plan as subcontractors arrive on site.

.5 Implement and enforce compliance with requirements of Plan for full duration of work to final completion and demobilization from site.

.6 As work progresses, review and update Plan. Address additional health risks and safety hazards identified by on-going hazard assessments.

.7 Post copy of Plan and updates, on site.

.8 Submission of the Health and Safety Plan and updates, to the Departmental Representative, is for review and information purposes only. Departmental Representative's receipt, review and any comments made of the Plan shall

not be construed to imply approval in part, or in hold, of such Plan by Departmental Representative, and shall not be interpreted as a warranty of being complete and accurate, or as a confirmation that all health and safety requirements of the Work, have been addressed, and that it is legislative compliant. Furthermore, Departmental Representative's review of the Plan shall not relieve the Contractor of any of his legal obligations for Occupational Health and Safety provisions specified as part of the Work and those required by provincial legislation or those which would otherwise be applicable to the site of the work.

1.12 SAFETY
SUPERVISION AND
INSPECTIONS

- .1 Designate one person to be present on site at all times, responsible for supervising health and safety of the Work.
 - .1 Person to be competent in Occupational Health and Construction Safety as defined in the Provincial Occupational Health and Safety Act.
- .2 Assign responsibility, obligation and authority to such designated person to stop work as deemed necessary for reasons of health and safety.
- .3 Conduct regularly scheduled informal safety inspections of work site on a minimum bi-weekly basis.
 - .1 Note deficiencies and remedial action taken in a log book or diary.
- .4 Conduct Formal Inspections on a minimum monthly basis.
 - .1 Use standardized safety checklist forms.
 - .2 Prepare written report of each inspection. Document deficiencies, remedial action needed and assign responsibility for rectification to appropriate subcontractor or worker.
 - .3 Distribute monthly reports to subcontractors for their pursuance.
 - .4 Follow-up and ensure appropriate action and corrective measures are taken.

- .5 Cooperate with Facility's Health and Safety Site Coordinator responsible for the entire site, should one be designated by Departmental Representative.
- .6 Keep inspection reports on site.

1.13 TRAINING

- .1 Ensure that all workers and other persons granted access to site are competently trained and knowledgeable on:
 - .1 Safe use of tools and equipment.
 - .2 How to wear and use personal protective equipment (PPE).
 - .3 Safe work practices and procedures to be followed in carrying out work.
 - .4 Site conditions and minimum safety rules to be observed on site, as given at site orientation session.
- .2 Maintain evidence and records of worker training.

1.14 MINIMUM SITE
SAFETY RULES

- .1 Notwithstanding the requirement to abide by federal and provincial health and safety regulations, the following safety rules shall be considered minimum requirements to be obeyed by all persons granted site access:
 - .1 Wear personnel protective equipment (PPE) appropriate to function and task on site; the minimum requirements being hard hat, safety footwear and eye protection.
 - .2 Immediately report unsafe activity or condition at site, near-miss accident, injury and damage.
 - .3 Maintain site in tidy condition.
 - .4 Obey warning signs and safety tags.
- .2 Brief workers on site safety rules and on disciplinary measures to be taken by Departmental Representative for violation or non-compliance of such rules. Post rules on site.
- .3 The following actions or conduct by Contractor, workers and sub-contractors will be considered as non conformance with the

health and safety requirements of the contract for which a Non-compliance Notification will be issued to the General Contractor by the Departmental Representative:

- .1 Failure to follow the minimum site safety rules specified above.
 - .2 Negligence resulting in serious injury or major property damage.
 - .3 Deliberate non-compliance with Federal and Provincial Acts and Regulations.
 - .4 Falsification of information in Workers Compensation Reports, safety reports and other health and safety related documents submitted to Departmental Representative or to Authority having jurisdiction.
 - .5 Possession of firearms on site.
 - .6 Possession of non-prescriptive illegal drugs or alcohol.
 - .7 Action, or lack thereof, resulting in the issuance of Warnings, Fines or Stop Work Orders from a Provincial Authority having jurisdiction.
 - .8 Violation of other specified health and safety rules and requirements as determined by Departmental Representative.
- .4 See elsewhere in this section for details on Non-Compliance Notifications and resulting disciplinary measures.

1.15 ACCIDENT
REPORTING

- .1 Investigate and report the following incidents and accidents:
- .1 Those as required by Provincial Occupational Safety and Health Act and Regulations.
 - .2 Injury requiring medical aid as defined in the Canadian Dictionary of Safety Terms-1987, published by the Canadian Society of Safety Engineers (C.S.S.E) as follows:
 - .1 Medical Aid Injury: any minor injury for which medical treatment was provided and the cost of which is covered by Workers' Compensation Board of the province in which the injury was incurred.
 - .3 Property damage in excess of \$5000.00.
 - .4 Interruption to Facility operations with potential loss to a Federal Department in excess of \$5000.00.

.5 Those which require notification to Workers Compensation Board or other regulatory agencies as stipulated by applicable law or regulations.

.2 Send written report to Departmental Representative for all above cases.

1.16 TOOLS AND
EQUIPMENT SAFETY

.1 Routinely check and maintain tools, equipment and machinery for safe operation.

.2 Conduct checks as part of site safety inspections. When requested, submit proof that checks and maintenance have been carried out.

.3 Tag and immediately remove from site items found faulty or defective.

1.17 HAZARDOUS
PRODUCTS

.1 Comply with requirements of Workplace Hazardous Materials Information System (WHMIS).

.2 Keep MSDS data sheets for all products delivered to site. Post on site. Submit copy to Departmental Representative upon receipt.

.3 On building renovation projects where work is within or immediately adjacent to occupied areas, also post copy of data sheets in a public location accessible to Facility personnel.

1.18 BLASTING

.1 Do blasting operations in accordance with local and provincial codes.

1.19 POWDER
ACTUATED DEVICES

.1 Use powder actuated fastening devices only after receipt of written permission from Departmental Representative.

1.20 CONFINED
SPACES

.1 Carry out work in confined spaces in compliance with:

.1 Provincial Occupational Safety and

Health Regulations; and
.2 Canada Occupational Safety and Health
Regulations (COSH) made under the Canada
Labour Code - Part II.

- .2 Conduct hazard assessment and address in
Safety Plan before entering confined space.
- .3 Provide and maintain equipment and PPE as
required for the safety and emergency
evacuation of persons entering confined
spaces.
- .4 Provide training to persons who will be
entering and to those persons who will be
assisting in the confined space entry process.
Training to be specialized instructions
beyond (basic confined space entry
information) as required to suit type and
conditions of confined space.

1.21 POSTING OF
DOCUMENTS

- .1 Post on site safety documentation as
stipulated by Authorities having jurisdiction
and as specified herein. Place in a common
visible location.

1.22 SITE RECORDS

- .1 Maintain on site a copy of all health and
safety documentation and reports specified
to be produced as part of the work and received
from authorities having jurisdiction.
- .2 Upon request, make available to Departmental
Representative, or authorized safety
representative, for review. Provide copy when
directed by Departmental Representative.

1.23 NON-COMPLIANCE
AND DISCIPLINARY
MEASURES

- .1 Immediately address and correct health and
safety violations and non-compliance issues.
- .2 Negligence or failure to follow occupational
health and safety provisions specified in the
Contract Documents and of those of applicable
laws and regulations could result in
disciplinary measures taken by the
Departmental Representative against the

General Contractor.

- .3 DFO uses a system of Non-Compliance Notifications and Disciplinary Measures on projects as follows:
 - .1 A non-compliance notification is issued to the General Contractor, by the Departmental Representative, whenever there is a violation or non-compliance of the project's health and safety requirements and of those of Provincial and Federal regulations by any worker, subcontractor or other person to whom the Contractor has granted access to the work site.
 - .2 Non-compliance notifications are progressive in nature resulting in disciplinary measures imposed depending on the frequency, nature and severity of the infraction.
 - .3 Disciplinary measures could include:
 - .1 Removal of the offending person or party from site;
 - .2 Financial penalties in the form of progress payment reduction or holdback assessments made against the Contract and;
 - .3 Taking the Work Out of Contractor's Hands in accordance with the General Conditions.
- .4 Departmental Representative will make final decision as to what constitutes a violation and when to issue a Non-compliance Notification.
- .5 Non-compliance Notifications issued by Departmental Representative shall not be construed as to overrule or disregard warnings, orders and fines levied against Contractor by a regulatory agency having jurisdiction.
- .6 Details of the Non-compliance Notification and Disciplinary Measures system will be provided by Departmental Representative upon acceptance of bid and prior to commencement of work.
- .7 Be responsible to fully brief workers and subcontractors on the operation and importance of this system.

1.24 DIVING
OPERATIONS

- .1 All diving work to comply fully with the requirements of CSA Z275.2-04, "Occupational Safety Code for Diving Operations", CSA Z275.4-02, "Competency Standards for Diving Operations" and CSA Z180.1-00, "Compressed Breathing Air and Systems."
- .2 Dive personnel must meet the minimum competency requirements of the CSA Z275.4-02 (R2008) and all divers must possess a valid Category 1 Diving Certificate or an Unrestricted Surface-supplied Certificate.
- .3 Diving in free-swim mode is not permitted at the work site.
- .4 Divers must have a current (less than one year) validated medical examination certificate(s) from a licensed Diving Physician in Newfoundland and Labrador who is knowledgeable and competent in diving and hyperbaric medicine, for all dives.

PART 1 - GENERAL

1.1 RELATED
SECTIONS

- .1 Section 01 74 21 - Construction/Demolition
Waste Management and Disposal.

1.2 DEFINITIONS

- .1 Hazardous Material: Product, substance, or
organism that is used for its original
purpose; and that is either dangerous goods
or a material that may cause adverse impact
to the environment or adversely affect health
of persons, animals, or plant life when
released into the environment.

1.3 FIRES

- .1 Fires and burning of rubbish on site are not
permitted.

1.4 DISPOSAL OF
WASTES AND
HAZARDOUS MATERIALS

- .1 Do not bury rubbish and waste materials on
site. Dispose at approved landfill sites as
specified in Section 01 74 21 -
Construction/Demolition Waste Management and
Disposal.
- .2 Do not dispose of hazardous waste or volatile
materials, such as mineral spirits, paints,
thinners, oil or fuel into waterways, storm
or sanitary sewers or waste landfill sites.
- .3 Store, handle and dispose of hazardous
materials and hazardous waste in accordance
with applicable federal and provincial laws,
regulations, codes and guidelines.
- .4 Dispose of construction waste materials and
demolition debris, resulting from work, at
approved landfill sites only. Carryout such

disposal in strict accordance with provincial and municipal rules and regulations.

Separate out and prevent improper disposal of items banned from landfills.

- .5 Establish methods and undertake construction practices which will minimize waste and optimize use of construction materials. Separate at source all construction waste materials, demolition debris and product packaging and delivery containers into various waste categories in order to maximize recycling abilities of various materials and avoid disposal of debris at landfill site(s) in a "mixed state". Where recycling firms, specializing in recycling of specific materials exist, transport such materials to the recycling facility and avoid disposal at landfill sites.
- .6 Communicate with landfill operator prior to commencement of work, to determine what specific construction, demolition and renovation waste materials have been banned from disposal at the landfill and at transfer stations.

1.5 DRAINAGE

- .1 Provide temporary drainage and pumping as necessary to keep excavations and site free from water.
- .2 Do not pump water containing suspended materials into waterways, sewer or drainage systems.
- .3 Control disposal or runoff of water containing suspended materials or other harmful substances in accordance with governing regulations and requirements.
- .4 Pumped water must meet applicable federal, provincial, and municipal standards before it can be discharged to a surface water body. If regulatory guidelines exceedences are noted, the Departmental Representative has the right to issue stop pumping instructions to the Contractor. Contractor will not be compensated for any delays associated with retrofitting equipment to meet guidelines.

- .5 Provide control devices such as filter fabrics, sediment traps and settling ponds to control drainage and prevent erosion of adjacent land. Maintain in good order for duration of work.

1.6 PERMIT

- .1 All guidelines and instructions stated on permits must be strictly adhered to.

1.7 WORK ADJACENT
TO WATERWAYS

- .1 Do not operate construction equipment in waterways.
- .2 Do not use waterway beds for borrow material.
- .3 Do not dump excavated fill, waste material or debris in waterways.
- .4 At borrow sites, design and construct temporary crossings to minimize erosion to waterways in strict conformance with provincial and federal environmental regulations.
- .5 Do not skid logs or construction materials across waterways.
- .6 Avoid indicated spawning beds when constructing temporary crossings of waterways.
- .7 Do not blast under water or within 100 m of spawning beds.
- .8 Do not refuel any type of equipment within 100 m of a water body. Maintain equipment in good working condition with no fluid leaks, loose hoses or fittings.

1.8 POLLUTION
CONTROL

- .1 Maintain temporary erosion and pollution control features installed under this contract.
- .2 Control emissions from equipment and plant to local authorities' emission requirements.

- .3 Prevent sandblasting and other extraneous materials from contaminating air beyond application area, by providing temporary enclosures.
- .4 Cover or wet down dry materials and rubbish to prevent blowing dust and debris. Provide dust control for temporary roads and around entire construction site.
- .5 Maintain inventory of hazardous materials and hazardous waste stored on site. List items by product name, quantity and date when storage began.
- .6 Have emergency spill response equipment and rapid clean-up kit, appropriate to work, at site. Locate adjacent to work and where hazardous materials are stored. Provide personal protective equipment as required for clean-up.
- .7 Report, to Federal and Provincial Department of the Environment, spills of petroleum and other hazardous materials as well as accidents having potential of polluting the environment. Also notify Departmental Representative and submit a written spill report to Departmental Representative within 24 hours of occurrence.
- .8 Provide a floating debris containment boom whenever any of the Contractors methods of work allow for the potential of floating debris.

1.9 WILDLIFE
PROTECTION

- .1 Should nests of migratory birds in wetlands be encountered during work, immediately notify Departmental Representative for directives to be followed.
 - .1 Do not disturb nest site and neighbouring vegetation until nesting is completed.
 - .2 Minimize work immediately adjacent to such areas until nesting is completed.
 - .3 Protect these areas by following recommendations of Canadian Wildlife Service.

PART 1 - GENERAL

1.1 SECTION
INCLUDES

- .1 Inspection and testing, administrative and enforcement requirements.
- .2 Tests and mix designs.
- .3 Mock-ups.
- .4 Mill tests.
- .5 Equipment and system adjust and balance.

1.2 RELATED
SECTIONS

- .1 Section 01 33 00 - Submittal Procedures.
- .2 Section 01 78 00 - Closeout Submittals.

1.3 INSPECTION

- .1 Facilitate Departmental Representative's access to Work. If part of Work is being fabricated at locations other than construction site, make preparations to allow access to such Work whenever it is in progress.
- .2 Give timely notice requesting inspection of Work designated for special tests, inspections or approvals by Departmental Representative or by inspection authorities having jurisdiction.
- .3 If Contractor covers or permits to be covered Work designated for special tests, inspections or approvals before such is made, uncover Work until particular inspections or tests have been fully and satisfactorily completed and until such time as Departmental Representative gives permission to proceed. Pay costs to uncover and make good such Work.

- .4 In accordance with the General Conditions, Departmental Representative may order part of Work to be examined if Work is suspected to be not in accordance with Contract Documents.

1.4 INDEPENDENT
INSPECTION AGENCIES

- .1 Departmental Representative will engage and pay for service of Independent Inspection and Testing Agencies for purpose of inspecting and testing portions of Work except for the following which remain part of Contractor's responsibilities:
 - .1 Inspection and testing required by laws, ordinances, rules, regulations, or orders of public authorities.
 - .2 Inspection and testing performed exclusively for Contractor's convenience.
 - .3 Testing, adjustment and balancing of conveying systems, mechanical and electrical equipment and systems.
 - .4 Mill tests and certificates of compliance.
 - .5 Tests as specified within various sections designated to be carried out by Contractor under the supervision of Departmental Representative.
 - .6 Additional tests specified in Clause 1.4.2.
- .2 Where tests or inspections by designated Testing Agency reveal work not in accordance with contract requirements, Contractor shall pay costs for additional tests or inspections as Departmental Representative may require to verify acceptability of corrected work.
- .3 Employment of inspection and testing agencies by Departmental Representative does not relax responsibility to perform Work in accordance with Contract Documents.

1.5 ACCESS TO WORK

- .1 Furnish labour and facility to provide access to the work being inspected and tested.
- .2 Co-operate to facilitate such inspections and tests.

- .3 Make good work disturbed by inspections and tests.

1.6 PROCEDURES

- .1 Notify Departmental Representative sufficiently in advance of when work is ready for tests, in order for Departmental Representative to make attendance arrangements with Testing Agency. When directed by Departmental Representative, notify such Agency directly.
- .2 Submit representative samples of materials specified to be tested. Deliver in required quantities to Testing Agency. Submit with reasonable promptness and in an orderly sequence so as not to cause delay in Work.
- .3 Provide labour and facilities to obtain and handle samples on site. Provide sufficient space on site for Testing Agency's exclusive use to store equipment and cure test samples.

1.7 REJECTED WORK

- .1 Remove and replace defective Work, whether result of poor workmanship, use of defective or damaged products and whether incorporated in Work or not, which has been identified by Departmental Representative as failing to conform to Contract Documents.
- .2 Make good damages to existing or new work, including work of other Contracts, resulting from removal or replacement of defective work.

1.8 TESTING BY CONTRACTOR

- .1 Provide all necessary instruments, equipment and qualified personnel to perform tests designated as Contractor's responsibilities herein or elsewhere in the Contract Documents.
- .2 At completion of test, turn over 2 copies of fully documented test reports to Departmental Representative. Additionally, obtain other copies in sufficient quantities to enable one

complete set of test reports to be placed in each of the maintenance manuals specified in Section 01 78 00 - Closeout Submittals.

- .3 Submit mill test certificates and other certificates as specified in various sections.
- .4 Furnish test results and mix designs as specified in various sections.

1.9 MOCK-UPS

- .1 Prepare mock-ups for Work specifically requested in various trade sections. Include in each mock-up all related work components representative of final assembly.
- .2 Construct in locations acceptable to Departmental Representative.
- .3 Prepare mock-ups for Departmental Representative's review with reasonable promptness and in orderly sequence, so as not to cause any delay in Work.
- .4 Failure to prepare mock-ups in ample time is not considered sufficient reason for extension of Contract Time and no claim for extension by reason of such default will be allowed.
- .5 If requested, Departmental Representative will assist in preparing schedule fixing dates for preparation.
- .6 Remove mock-up at conclusion of Work or when acceptable to Departmental Representative unless approval is given to remain as part of Work.

PART 1 - GENERAL

1.1 ACCESS

- .1 Provide and maintain adequate access to project site.
- .2 Maintain access roads for duration of contract and make good damage resulting from Contractors' use of roads.

1.2 CONTRACTOR'S
SITE OFFICE

- .1 Be responsible for and provide own site office, if required, including electricity, heat, lights and telephone. Locate site office as directed by Departmental Representative.

1.3 DEPARTMENTAL
REPRESENTATIVE'S
SITE OFFICE

- .1 Provide or construct a separate site office for the use of the Departmental Representative and the Site Representative. The building must be in place prior to commencement of work.
- .2 Provide heating system to maintain 22°C inside temperature at -20°C outside temperature.
- .3 The building will be approximately 2400 mm x 3600 mm. It will have a suitable frame covered with a weatherproof siding and lined with plywood or other approved material. The floor will be of 19 mm thick material. It will be provided with suitable window with at least 1 m² of glass and arranged to provide at least 0.5 m² of screened opening. The door will be fitted with a lockset and 2 keys.
- .4 The office will be equipped with a drafting chair and a 900 mm x 1500 mm table having a hinged, smooth wooden top suitable for drafting.
- .5 Install electrical lighting system to provide minimum 750 lux using surface mounted, shielded commercial fixtures with 10% upward light component.

- .6 Maintain office in clean condition.
- .7 Arrange and pay for telephone and facsimile machine in the Departmental Representative's Office for Site Representative's exclusive use. Long distance calls or faxes placed on this phone by the Departmental Representative or the Site Representative will be paid by the Contractor.
- .8 Contractor may, on approval of Departmental Representative, provide cellular or mobile phone. If approval to use cellular or mobile phone is granted, be responsible for all services, airtime, license and network access fees, and all other fees or charges required to utilize the phone as intended by the manufacturer.

1.4 SANITARY
FACILITIES

- .1 Provide sanitary facilities for work force in accordance with governing regulations and ordinances.
- .2 Post notices and take such precautions as required by local health authorities. Keep area and premises in sanitary condition.

1.5 POWER

- .1 Arrange, pay for and maintain temporary electrical power supply in accordance with governing regulations and ordinances.
- .2 Supply and install all temporary facilities for power such as pole lines and underground cables to approval of local power supply authority.

1.6 WATER SUPPLY

- .1 Arrange, pay for and maintain temporary water supply in accordance with governing regulations and ordinances.

1.7 SCAFFOLDING

- .1 Design, construct and maintain scaffolding in rigid, secure and safe manner in accordance

with CAN/CSA-S269.2-M87 (R2003).

- .2 Erect scaffolding independent of walls.
Remove when no longer required.

1.8 CONSTRUCTION
SIGN AND NOTICES

- .1 Contractor or subcontractor advertisement signboards are not permitted on site.
- .2 Only notices of safety or instructions are permitted on site.
- .3 Safety and Instruction Signs and Notices:
 - .1 Signs and notices for safety and instruction shall be in both official languages. Graphic symbols shall conform to CAN/CSA-Z321-96 (R2001).
- .4 Maintenance and Disposal of Site Signs:
 - .1 Maintain approved signs and notices in good condition for duration of project and dispose of off site on completion of project or earlier if directed by Departmental Representative.

1.9 REMOVAL OF
TEMPORARY
FACILITIES

- .1 Remove temporary facilities from site when directed by Departmental Representative.

PART 1 - GENERAL

1.1 SECTION
INCLUDES

- .1 Barriers.
- .2 Traffic Controls.

1.2 INSTALLATION
AND REMOVAL

- .1 Provide temporary controls in order to execute Work expeditiously.
- .2 Remove from site all such work after use.

1.3 HOARDING

- .1 Erect temporary site enclosures using 1.8 m high x 2.4 m long welded wire galvanized mesh panel with end post of 32 mm dia. galvanized tubes. Each panel shall have a "hook" end or clamp system to engage the top of the adjoining panel post. Panel support base plate of 12 ga. galvanized steel plate with double "stems" to engage and support tube frame ends.
- .2 Provide (2) swing frame gates using galvanized steel tube 50 mm and vertical and horizontal bars rigid frame wire mesh to match fence panels. Provide hinge to structurally support all gates without deformation during opening and closing. Latch to be clamp on gravity system that is self-latching. Provide one drop bar to secure in closed position and padlock for night security. Keys to be supplied to Departmental Representative.
- .3 Secure fencing at established boundary lines inside property lines and/or determined by Departmental Representative. Secure base plates to ground with 15 mm x 250 mm long (2 pen plate) lag screws placed into existing asphalt. After removal, fill holes with cold patch.

1.4 GUARD RAILS AND
BARRICADES

- .1 Provide secure, rigid guard rails and barricades around open excavations.
- .2 Provide barricades along wharf structure when wheelguard is not in place.
- .3 Provide as required by governing authorities.

1.5 ACCESS TO SITE

- .1 Provide and maintain access to adjacent harbour facilities.

1.6 PUBLIC TRAFFIC
FLOW

- .1 Provide and maintain competent signal flag operators, traffic signals, barricades and flares, lights, or lanterns as required to perform Work and protect the public.

1.7 FIRE ROUTES

- .1 Maintain access to property including overhead clearances for use by emergency response vehicles.

1.8 PROTECTION FOR
OFF-SITE AND PUBLIC
PROPERTY

- .1 Protect surrounding private and public property from damage during performance of Work.
- .2 Be responsible for damage incurred.

PART 1 - GENERAL

1.1 DESCRIPTION

- .1 This section specifies requirements for board, lodgings and related services to be provided by the Contractor for the Inspector.
- .2 Due to the location of this site, it is a requirement of this contract that the Contractor provide and pay for all board and lodgings for the Inspector's sole use for the duration of the project. Provide for and maintain acceptable living accommodations for the Inspector's sole use. The minimum requirement would be a self-contained unit with private sleeping accommodation and shower or bath or other arrangement approved by the Inspector.

1.2 BOARD AND
LODGINGS

- .1 For the purpose of this contract board and lodgings shall include but not necessarily be limited to: sleeping accommodation, meals and dining facilities, washroom facilities, laundry facilities, electrical and heating service, linens and bedding, etc. and any reasonable service as directed by the Inspector.
- .2 Board and lodgings must be approved by the Inspector and Contractor will cooperate in providing all services required to maintain an acceptable standard of living during construction period.
- .3 The Contractor shall include all calendar days, including weekends and statutory holidays in determining the cost.

1.3 REQUIREMENTS OF
REGULATORY AGENCIES

- .1 Comply with any or all applicable Agencies regulation of the Province of Newfoundland and Labrador, relating to the set up, servicing and maintenance of accommodations for the Inspector.
- .2 Obtain and pay for any permits which may be required and comply to regulations of same.

PART 1 - GENERAL

1.1 GENERAL

- .1 Use new material and equipment unless otherwise specified.
- .2 Within 7 days of written request by Departmental Representative, submit following information for any materials and products proposed for supply:
 - .1 name and address of manufacturer;
 - .2 trade name, model and catalogue number;
 - .3 performance, descriptive and test data;
 - .4 manufacturer's installation or application instructions;
 - .5 evidence of arrangements to procure;
 - .6 evidence of manufacturer delivery problems or unforeseen delays.
- .3 Provide material and equipment of specified design and quality, performing to published ratings and for which replacement parts are readily available.
- .4 Use products of one manufacturer for equipment or material of same type or classifications unless otherwise specified.
- .5 Permanent labels, trademarks and nameplates on products are not acceptable in prominent locations, except where required for operating instructions, or when located in mechanical or electrical rooms.

1.2 PRODUCT QUALITY
AND REFERENCED
STANDARDS

- .1 Contractor shall be solely responsible for submitting relevant technical data and independent test reports to confirm whether a product or system proposed for use meets contract requirements and specified standards.
- .2 Final decision as to whether a product or

system meets contract requirements rest solely with the Departmental Representative in accordance with the General Conditions.

1.3 ACCEPTABLE
MATERIALS AND
ALTERNATIVES

- .1 Acceptable Materials: When materials specified include trade names or trademarks or manufacturer's or supplier's name as part of the material description, select and only use one of the names listed for incorporation into the Work.
- .2 Alternative Materials: Submission of alternative materials to trade names or manufacturer's names specified must be done during the bidding period following procedures indicated in the Instructions to Bidders.
- .3 Substitutions: After acceptance of bid, substitution of a specified material will be dealt with as a change to the Work in accordance with the General Conditions of the Contract.

1.4 MANUFACTURERS
INSTRUCTIONS

- .1 Unless otherwise specified, comply with manufacturer's latest printed instructions for materials and installation methods to be used. Do not rely on labels or enclosure provided with products. Obtain written instructions directly from manufacturers.
- .2 Notify Departmental Representative in writing of any conflict between these specifications and manufacturer's instructions, so that Departmental Representative will designate which document is to be followed.

1.5 AVAILABILITY

- .1 Immediately notify Departmental Representative in writing of unforeseen or unanticipated material delivery problems by manufacturer. Provide support documentation as per Clause 1.1.2 above.

1.6 WORKMANSHIP

- .1 Ensure quality of work is of highest standard, executed by workers experienced and skilled in respective duties for which they are employed.
- .2 Remove unsuitable or incompetent workers from site as stipulated in General Conditions.
- .3 Ensure cooperation of workers in laying out work. Maintain efficient and continuous supervision on site at all times.
- .4 Coordinate work between trades and subcontractors.
- .5 Coordinate placement of openings, sleeves and accessories.

1.7 FASTENINGS -
GENERAL

- .1 Provide metal fastenings and accessories in same texture, colour and finish as base metal in which they occur. Prevent electrolytic action between dissimilar metals. Use non-corrosive fasteners, anchors and spacers for securing exterior work and in humid areas.
- .2 Space anchors within limits of load bearing or shear capacity and ensure that they provide positive permanent anchorage. Wood or organic material plugs not acceptable.
- .3 Keep exposed fastenings to minimum, space evenly and lay out neatly.
- .4 Fastenings which cause spalling or cracking of material to which anchorage is made, are not acceptable.
- .5 Do not use explosive actuated fastening devices unless approved by Departmental Representative. See Section 01 35 28 - Health and Safety Requirements in this regard.

1.8 FASTENINGS -
EQUIPMENT

- .1 Use fastenings of standard commercial sizes and patterns with material and finish suitable

for service.

- .2 Use heavy hexagon heads, semi-finished unless otherwise specified.
- .3 Bolts may not project more than one diameter beyond nuts.
- .4 Use plain type washers on equipment, sheet metal and soft gasket lock type washers where vibrations occur. Use resilient washers with stainless steel.

1.9 STORAGE,
HANDLING AND
PROTECTION

- .1 Deliver, handle and store materials in manner to prevent deterioration and soiling and in accordance with manufacturer's instructions when applicable.
- .2 Store packaged or bundled materials in original and undamaged condition with manufacturer's seal and labels intact. Do not remove from packaging or bundling until required in Work. Provide additional cover where manufacturer's packaging is insufficient to provide adequate protection.
- .3 Store products subject to damage from weather in weatherproof enclosures.
- .4 Store cementitious products clear of earth or concrete floors, and away from walls.
- .5 Keep sand, when used for grout or mortar materials, clean and dry. Store sand on wooden platforms and cover with waterproof tarpaulins during inclement weather.
- .6 Store sheet materials and lumber on flat, solid supports and keep clear of ground. Slope to shed moisture.
- .7 Store and mix paints in heated and ventilated room. Remove oily rags and other combustible debris from site daily. Take every precaution necessary to prevent spontaneous combustion.
- .8 Immediately remove damaged or rejected materials from site.

- .9 Touch-up damaged factory finished surfaces to Departmental Representative's satisfaction. Use touch-up materials to match original. Do not paint over name plates.

PART 1 - GENERAL

1.1 GENERAL

- .1 Conduct cleaning and disposal operations to comply with local ordinances and anti-pollution laws.
- .2 Store volatile waste in covered metal containers, and remove from premises at end of each working day.
- .3 Prevent accumulation of wastes which create hazardous conditions.
- .4 Provide adequate ventilation during use of volatile or noxious substances.

1.2 MATERIALS

- .1 Use only cleaning materials recommended by manufacturer of surface to be cleaned, and as recommended by cleaning material manufacturer.

1.3 CLEANING DURING CONSTRUCTION

- .1 Maintain project grounds and public properties in condition, free from accumulations of waste material and debris. Clean areas on a daily basis.
- .2 Provide on-site garbage containers for collection of waste materials and debris.
- .3 Remove waste materials and debris from site on a daily basis.

1.4 FINAL CLEANING

- .1 In preparation for acceptance of the Work

perform final cleaning.

- .2 Inspect finishes, fitments and equipment.
Ensure specified workmanship and operation.
- .3 Broom clean exterior paved and concrete
surfaces; rake clean other surfaces of
grounds.

PART 1 - GENERAL

1.1 RELATED
SECTIONS

- .1 Section 01 35 43 - Environmental Procedures.
- .2 Section 02 41 16 - Sitework, Demolition and Removal.

1.2 WASTE
MANAGEMENT PLAN

- .1 Prior to commencement of work, prepare waste Management Workplan.
- .2 Workplan to include:
 - .1 Waste audit.
 - .2 Waste reduction practices.
 - .3 Material source separation process.
 - .4 Procedures for sending recyclables to recycling facilities.
 - .5 Procedures for sending non-salvageable items and waste to approved waste processing facility or landfill site.
 - .6 Training and supervising workforce on waste management at site.
- .3 Workplan to incorporate waste management requirements specified herein and in other sections of the Specifications.
- .4 Develop Workplan in collaboration with all subcontractors to ensure all waste management issues and opportunities are addressed.

1.3 WASTE AUDIT

- .1 At project start-up, conduct waste audit of:
 - .1 Site conditions identifying salvageable and non-salvageable items and waste resulting from demolition and removal work.
 - .2 Projected waste resulting from product packaging and from material leftover after installation work.
- .2 Develop written list. Record type,

composition and quantity of various salvageable items and waste anticipated, reasons for waste generation and operational factors which contribute to waste.

1.4 WASTE REDUCTION

- .1 Based on waste audit, develop waste reduction program.
- .2 Structure program to prioritize actions, with waste reduction as first priority, followed by salvage and recycling effort, then disposal as solid waste.
- .3 Identify materials and equipment to be:
 - .1 Protected and turned over to Departmental Representative when indicated.
 - .2 Salvaged for resale by Contractor.
 - .3 Sent to recycling facility.
 - .4 Sent to waste processing/landfill site for their recycling effort.
 - .5 Disposed of in approved landfill site.
- .4 Reduce construction waste during installation work. Undertake practices which will minimize waste and optimize full use of new materials on site, such as:
 - .1 Use of a central cutting area to allow for easy access to off-cuts;
 - .2 Use of off-cuts for blocking and bridging elsewhere.
 - .3 Use of effective and strategically placed facilities on site for storage and staging of left-over or partially cut materials to allow for easy incorporation into work whenever possible avoiding unnecessary waste.
- .5 Develop other strategies and innovative procedures to reduce waste such as minimizing the extent of packaging used for delivery of materials to site, etc.

1.5 MATERIALS
SOURCE SEPARATION
PROCESS

- .1 Develop and implement material source separation process at commencement of work as part of mobilization and waste management

at site.

- .2 Provide on-site facilities to collect, handle, and store anticipated quantities of reusable, salvageable and recyclable materials.
 - .1 Use suitable containers for individual collection of items based on intended purpose.
 - .2 Locate to facilitate deposit but without hindering daily operations of existing building tenants.
 - .3 Clearly mark containers and stockpiles as to purpose and use.
- .3 Perform demolition and removal of existing components and equipment following a systematic deconstruction process.
 - .1 Separate materials and equipment at source, carefully dismantling, labelling and stockpiling alike items for the following purposes:
 - .1 Reinstallation into the work where indicated.
 - .2 Salvaging reusable items not needed in project which Contractor may sell to other parties. Sale of such items not permitted on site.
 - .3 Sending as many items as possible to locally available recycling facility.
 - .4 Segregating remaining waste and debris into various individual waste categories for disposal in a "non-mixed state" as recommended by waste processing/landfill sites.
- .4 Isolate product packaging and delivery containers from general waste stream. Send to recycling facility or return to supplier/manufacturer.
- .5 Send leftover material resulting from installation work for recycling whenever possible.
- .6 Establish methods whereby hazardous and toxic waste materials, and their containers, encountered or used in the course work are properly isolated, stored on site and disposed in accordance with applicable laws and

regulations from authorities having jurisdiction.

- .7 Isolate and store existing materials and equipment identified for re-incorporation into the Work. Protect against damage.

1.6 WORKER
TRAINING AND
SUPERVISION

- .1 Provide adequate training to workforce, through meetings and demonstrations, to emphasize purpose and worker responsibilities in carrying out the Waste Management Plan.
- .2 Waste Management Coordinator: designate full-time person on site, experienced in waste management and having knowledge of the purpose and content of Waste Management Plan to:
 - .1 Oversee and supervise waste management during work.
 - .2 Provide instructions and directions to all workers and subcontractors on waste reduction, source separation and disposal practices.
- .3 Post a copy of Plan in a prominent location on site for review by workers.

1.7 CERTIFICATION
OF MATERIAL
DIVERSION

- .1 Submit to Departmental Representative, copies of certified weigh bills from authorized waste processing sites and sale receipts from recycling/reuse facilities confirming receipt of building materials and quantity of waste diverted from landfill.
- .2 Submit data at pre-determined project milestones as determined by Departmental Representative.
- .3 Compare actual quantities diverted from landfill with projections made during waste audit.

1.8 DISPOSAL
REQUIREMENTS

- .1 Burying or burning of rubbish and waste materials is prohibited.
- .2 Disposal of waste, volatile materials, mineral spirits, oil, paint, paint thinner or unused preservative material into waterways, storm, or sanitary sewers is prohibited.
- .3 Do not dispose of preservative treated wood through incineration.
- .4 Do not dispose of preservative treated wood with other materials destined for recycling or reuse.
- .5 Dispose of treated wood, end pieces, wood scraps and sawdust at a sanitary landfill.
- .6 Dispose of waste only at approved waste processing facility or landfill sites approved by authority having jurisdiction.
- .7 Contact the authority having jurisdiction prior to commencement of work, to determine what, if any, demolition and construction waste materials have been banned from disposal in landfills and at transfer stations. Take appropriate action to isolate such banned materials at site of work and dispose in strict accordance with provincial and municipal regulations.
- .8 Transport waste intended for landfill in separated condition, following rules and recommendations of Landfill Operator in support of their effort to divert, recycle and reduce amount of solid waste placed in landfill.
- .9 Collect, bundle and transport salvaged materials to be recycled in separated categories and condition as directed by recycling facility. Ship materials only to approved recycling facilities.
- .10 Sale of salvaged items by Contractor to other parties not permitted on site.

PART 1 - GENERAL

1.1 SECTION
INCLUDES

- .1 Project Record Documents as follows:
 - .1 As-built drawings;
 - .2 As-built specifications;
 - .3 Reviewed shop drawings.

1.2 PROJECT RECORD
DOCUMENTS

- .1 Departmental Representative will provide two white print sets of contract drawings and two copies of Specifications Manual specifically for "as-built" purposes.
- .2 Maintain at site one set of the contract drawings and specifications to record actual as-built site conditions.
- .3 Maintain up-to-date, real time as-built drawings and specifications in good condition and make available for inspection by the Departmental Representative at any time during construction.
- .4 As-Built Drawings:
 - .1 Record changes in red ink on the prints. Mark only on one set of prints and at completion of project and prior to final inspection, neatly transfer notations to second set (also by use of red ink). Submit both sets to Departmental Representative. All drawings of both sets shall be stamped "As-Built Drawings" and be signed and dated by Contractor.
 - .2 Show all modifications, substitutions and deviations from what is shown on the contract drawings or in specifications.
 - .3 Record following information:
 - .1 Horizontal and vertical location of various elements in relation to CHS Chart Datum.
 - .2 Field changes of dimension and

- detail.
- .3 All design elevations, sections, and details dimensioned and marked-up to consistently report finished installation conditions.
 - .4 Any details produced in the course of the contract by the Departmental Representative to supplement or to change existing design drawings must also be marked-up and dimensioned to reflect final as-built conditions and appended to the as-built drawing document.
 - .5 All change orders issued over the course of the contract must be documented on the finished as-built documents, accurately and consistently depicting the changed condition as it applies to all affected drawing details.
- .5 As-built Specifications: legibly mark in red each item to record actual construction, including:
- .1 Manufacturer, trade name, and catalogue number of each product actually installed, particularly items substituted from that specified.
 - .2 Changes made by Addenda and Change Orders.
 - .3 Mark up both copies of specifications; stamp "as-built", sign and date similarly to drawings as per above clause.
- .6 Maintain As-built documents current as the contract progresses. Departmental Representative will conduct reviews and inspections of the documents on a regular basis. Frequency of reviews will be subject to Departmental Representative's discretion. Failure to maintain as-builts current and complete to satisfaction of the Departmental Representative shall be subject to financial penalties in the form of progress payment reductions and holdback assessments.
- .7 Record information concurrently with construction progress.
- .1 Do not conceal Work until required information is recorded.
- .8 Provide digital photos, if requested, for site

records.

1.3 WARRANTIES AND BONDS

- .1 Develop warranty management plan to contain information relevant to Warranties.
- .2 Warranty management plan to include required actions and documents to assure that Departmental Representative receives warranties to which it is entitled.
- .3 Submit Warranty information made available during construction phase to Departmental Representative for approval prior to each monthly pay estimate.
- .4 Assemble approved information in binder, submit upon acceptance of work and organize binder as follows:
 - .1 Separate each warranty or bond with index tab sheets keyed to Table of Contents listing.
 - .2 List subcontractor, supplier and manufacturer with name, address, and telephone number of responsible principal.
 - .3 Obtain warranties and bonds, executed in duplicate by subcontractors, suppliers, and manufacturers, within ten days after completion of applicable item of work.
 - .4 Retain warranties and bonds until time specified for submittal.
- .5 Except for items put into use with Owner's permission, leave date of beginning of time of warranty until Date of Substantial Performance is determined.
- .6 Respond in a timely manner to oral or written notification of required construction warranty repair work.

1.4 REVIEWED SHOP DRAWINGS

- .1 Compile 2 full sets of all reviewed shop drawings and deliver to Departmental Representative after completion of work.

Small Craft Harbours
Frenchman's Cove, NL
704122

CLOSEOUT SUBMITTALS

Section 01.78 00
Page 4
April 2016

PART 2 - PRODUCTS .2
NOT APPLICABLE

PART 3 - EXECUTION .3
NOT APPLICABLE

PART 1 - GENERAL

1.1 DESCRIPTION

- .1 This section specifies requirements for demolishing and removing wholly or in part various items designated to be removed or partially removed.

1.2 GENERAL
REQUIREMENTS

- .1 A Notice to Shipping is to be issued prior to commencement and upon completion of work.
- .2 During construction, any vessels or barges utilized must be marked in accordance with the provisions of the Canada Shipping Act Collision Regulations.
- .3 Upon completion of the project, a written Notice to Mariners must be issued.

1.3 PROTECTION

- .1 Protect existing objects designated to remain. In event of damage, immediately replace or make repairs to approval of and at no additional cost to Canada.
- .2 Place a floating boom around entire demolition site to prevent loss of any materials.
- .3 Remove all floating debris from water on a routine and timely basis.

1.4 MEASUREMENT FOR
PAYMENT

- .1 All cost for items in this section is to be measured in fixed price items including all plant, labour, material required to complete this work as indicated on drawings and specifications.

PART 2 - PRODUCTS
NOT APPLICABLE

PART 3 - EXECUTION

3.1 EXECUTION

- .1 Inspect site and verify with Departmental Representative objects designated for removal.
- .2 Locate and protect utility lines. Preserve in operating condition active utilities traversing site.

3.2 REMOVAL

- .1 Demolition and removal of existing reinforced concrete deck, wheel guards, mooring cleats, mooring rings, coping, timber beams and wood decking and sheeting as indicated on drawings.
- .2 Removal of existing tires and connection attachments as indicated on drawings.
- .3 Demolition and removal of existing horizontal wood timber wales, vertical closed facing fenders and ladders along north face of wharf.
- .4 Demolition and removal of existing wood timber cross bracing including connection bolts.
- .5 Demolition and removal of existing steel angle cross bracing including bolts and existing brackets as indicated on the drawings.
- .6 Contractor to remove any and all existing wood timber or debris from the harbour bottom in the vicinity of the wharf work area.

- .7 Remove in their entirety all material and objects specified for removal.
- .8 Do not disturb adjacent work designated to remain in place.

3.3 DISPOSAL OF
MATERIAL

- .1 All demolished materials, except materials designated to be reused or turned over to owner, will become property of contractor and will be removed from site and disposed of to satisfaction of Departmental Representative and in accordance with environmental guidelines. It is the sole responsibility of the contractor to dispose of all demolished materials at an approved disposal site. Ensure that disposal site is approved and willing to accommodate any materials disposed of from work site.
- .2 Contractor shall obtain and pay for all necessary permits and disposal fees for use of an approved waste disposal site.

3.4 RESTORATION

- .1 Upon completion of work, remove debris, trim surfaces and leave work site in clean condition.
- .2 Reinstate areas and existing works outside areas of demolition to conditions that existed prior to commencement of work.

PART 1 - GENERAL

1.1 RELATED
SECTIONS

- .1 Section 03 20 00 - Concrete Reinforcing.
- .2 Section 03 30 00 - Cast-in-Place Concrete.
- .3 Section 07 92 10 - Joint Sealing.

1.2 REFERENCES

- .1 Canadian Standards Association (CSA)
 - .1 CAN/CSA-A23.1-04, Concrete Materials and Methods of Concrete Construction.
 - .2 CAN/CSA-086-01 (R2006), Engineering Design in Wood (Limit States Design).
 - .3 CSA O121-M1978 (R2003), Douglas Fir Plywood.
 - .4 CSA O151-04, Canadian Softwood Plywood.
 - .5 CSA O153-M1980 (R2003), Poplar Plywood.
 - .6 CAN3-0188.0-M78, Standard Test Methods for Mat-Formed Wood Particleboards and Waferboard.
 - .7 CSA O437 Series-93 (R2001), Standards for OSB and Waferboard.
 - .8 CSA S269.1-1975 (R2003), Falsework for Construction Purposes.
 - .9 CAN/CSA-S269.3-M92 (R2003), Concrete Formwork.

1.3 SHOP DRAWINGS

- .1 Submit shop drawings for formwork and falsework in accordance with Section 01 33 00 - Submittal Procedures.
- .2 Indicate method and schedule of construction, shoring, stripping and re-shoring procedures, materials, arrangement of joints, special architectural exposed finishes, ties, liners, and locations of temporary embedded parts. Comply with CSA S269.1, for falsework drawings

Comply with CAN/CSA-S269.3 for formwork drawings.

- .3 Indicate formwork design data, such as permissible rate of concrete placement, and temperature of concrete, in forms.
- .4 Indicate sequence of erection and removal of formwork/falsework as directed by Departmental Representative.
- .5 Each shop drawing submission shall bear stamp and signature of qualified Professional Engineer registered or licensed in Province of Newfoundland and Labrador, Canada.

1.4 WASTE
MANAGEMENT AND
DISPOSAL

- .1 Separate and recycle waste materials in accordance with Section 01 74 21 - Construction/Demolition Waste Management and Disposal and the Waste Reduction Workplan.
- .2 Place materials defined as hazardous or toxic waste in designated containers.
- .3 Ensure emptied containers are sealed and stored safely for disposal away from children.
- .4 Use sealers, form release and stripping agents that are non-toxic, biodegradable and have zero or low VOC's.

PART 2 - PRODUCTS

2.1 MATERIALS

- .1 Formwork materials:
 - .1 Use formwork materials to CAN/CSA-A23.1.
- .2 Form ties:
 - .1 Removable or snap-off metal ties, fixed or adjustable length, free of devices leaving holes larger than 25 mm diameter in concrete surface.

- .3 Form release agent: non-toxic, chemically active release agents containing compounds that react with free lime present in concrete to provide water insoluble soaps, preventing set of film of concrete in contact with form.
- .4 Falsework materials: to CSA-S269.1.
 - .1 Materials required to bear grade marks, or be accompanied with certificates, test reports or other proof of conformity.
- .5 Premoulded joint fillers:
 - .1 Bituminous impregnated fiberboard to ASTM D1751.
- .6 Bond Breaker:
 - .1 Impermeable tube formed of polyvinylchloride, rubber or similar material to the approval of the Departmental Representative. Internal diameter equal to dowels.
- .7 Sealant: to Section 07 92 10 - Joint Sealing.

PART 3 - EXECUTION

3.1 FABRICATION AND ERECTION

- .1 Verify lines, levels and centres before proceeding with formwork/falsework and ensure dimensions agree with drawings.
- .2 Obtain Departmental Representative's approval for use of earth forms framing openings not indicated on drawings.
- .3 Hand trim sides and bottoms and remove loose earth from earth forms before placing concrete.
- .4 Fabricate and erect falsework in accordance with CSA S269.1.
- .5 Fabricate and erect formwork in accordance with CAN/CSA-S269.3 to produce finished concrete conforming to shape, dimensions,

locations and levels indicated within tolerances required by CAN/CSA-A23.1.

- .6 Align form joints and make watertight. Keep form joints to minimum.
- .7 Use 25 mm chamfer strips on external corners and/or 25 mm fillets at interior corners, joints, unless specified otherwise.
- .8 Form chases, slots, openings, drips, recesses, expansion and control joints as indicated.
- .9 Build in anchors, sleeves, and other inserts required to accommodate Work specified in other sections. Assure that all anchors and inserts will not protrude beyond surfaces designated to receive applied finishes, including painting.
- .10 Clean formwork in accordance with CAN/CSA-A23.1, before placing concrete.

3.2 REMOVAL AND RESHORING

- .1 Leave formwork in place for following minimum periods of time after placing concrete.
 - .1 5 days for beam soffits, slabs, decks and other structural members, or 3 days when replaced immediately with adequate shoring to standard specified for falsework.
- .2 Remove formwork when concrete has reached 75% of its design strength or minimum period noted above, whichever comes later, and replace immediately with adequate reshoring.
- .3 Provide all necessary reshoring of members where early removal of forms may be required or where members may be subjected to additional loads during construction as required.
- .4 Space reshoring in each principal direction at not more than 3000 mm apart.
- .5 Re-use formwork and falsework subject to requirements of CAN/CSA-A23.1.

3.3 JOINT FILLERS

- .1 Locate and form expansion joints as indicated. Intall joint filler in all joints.
- .2 Use 13 mm thick joint filler to separate slab-on-grade and extend joint filler from bottom of slab to within 25 mm of finished slab surface unless indicated otherwise.

3.4 JOINT SEALANT

- .1 Fill expansion and control joints with sealer as per manufacturer instructions.

PART 1 - GENERAL

1.1 RELATED
SECTIONS

- .1 Section 03 10 00 - Concrete Forming and Accessories.
- .2 Section 03 30 00 - Cast-in-Place Concrete.
- .3 Section 35 59 29 - Mooring Devices.

1.2 REFERENCES

- .1 American Concrete Institute (ACI)
 - .1 ACI 315R-80, Manual of Engineering and Placing Drawings for Reinforced Concrete Structure.
- .2 American National Standards Institute/American Concrete Institute (ANSI/ACI)
 - .1 ANSI/ACI 315-80, Details and Detailing of Concrete Reinforcement.
- .3 Canadian Standards Association (CSA)
 - .1 CAN/CSA-A23.1-04, Concrete Materials and Methods of Concrete Construction.
 - .2 CSA-A23.3-04, Design of Concrete Structures for Buildings.
 - .3 CSA G30.3-M1983(R1998), Cold Drawn Steel Wire for Concrete Reinforcement.
 - .4 CSA G30.14-M1983(R1998), Welded Steel Wire Fabric for Concrete Reinforcement.
 - .5 CSA G30.14-M1983(41998), Deformed Steel Wire for Concrete Reinforcement.
 - .6 CSA G30.15-M1983(R1991), Welded Deformed Steel Wire Fabric for Concrete Reinforcement.
 - .7 CAN/CSA-G30.18-M92(R2007), Billet-Steel Bars for Concrete Reinforcement.
 - .8 CAN/CSA-G40.21-04, Structural Quality Steels.
 - .9 CAN/CSA-G164-M92(R2003), Hot Dip Galvanizing of Irregularly Shaped Articles.

.10 CSA W186-M1990(R2007), Welding of Reinforcing Bars in Reinforced Concrete Construction.

1.3 SHOP DRAWINGS

- .1 Submit shop drawings including placing of reinforcement in accordance with Section 01 33 00 - Submittal Procedures.
- .2 Indicate on shop drawings, bar bending details, lists, quantities of reinforcement, sizes, spacings, locations of reinforcement and mechanical splices if approved by Departmental Representative, with identifying code marks to permit correct placement without reference to structural drawings. Indicate sizes, spacings and locations of chairs, spacers and hangers. Prepare reinforcement drawings in accordance with Reinforcing Steel Manual of Standard Practice - by Reinforcing Steel Institute of Canada. ANSI/ACI 315 and ACI 315R, Manual of Engineering and Placing Drawings for Reinforced Concrete Structure.

1.4 WASTE
MANAGEMENT AND
DISPOSAL

- .1 Separate and recycle waste materials in accordance with Section 01 74 21 - Construction/Demolition Waste Management and Disposal and the Waste Reduction Workplan.

PART 2 - PRODUCTS

2.1 MATERIALS

- .1 Substitute different size bars only if permitted in writing by Departmental Representative.
- .2 Reinforcing steel: billet steel, grade 400, deformed bars to CAN/CSA-G30.18, unless indicated otherwise.
- .3 Reinforcing steel: weldable low alloy steel

deformed bars to CAN/CSA-G30.18.

- .4 Cold-drawn annealed steel wire ties: to CSA G30.3.
- .5 Welded steel wire fabric: to CSA G30.5. Provide in flat sheets only.
- .6 Chairs, bolsters, bar supports, spacers: to CAN/CSA-A23.1.
- .7 Mechanical splices: subject to approval of Departmental Representative.

2.2 FABRICATION

- .1 Fabricate reinforcing steel in accordance with CAN/CSA-A23.1, ANSI/ACI 315, and Reinforcing Steel Manual of Standard Practice by the Reinforcing Steel Institute of Canada. ACI 315R, Manual of Engineering and Placing Drawings for Reinforced Concrete Structures unless indicated otherwise.
- .2 Obtain Departmental Representative's approval for locations of reinforcement splices other than those shown on placing drawings.
- .3 Upon approval of Departmental Representative, weld reinforcement in accordance with CSA W186.
- .4 Ship bundles of bar reinforcement, clearly identified in accordance with bar bending details and lists.

2.3 SOURCE QUALITY CONTROL

- .1 Provide Departmental Representative with certified copy of mill test report of reinforcing steel, showing physical and chemical analysis, minimum 2 weeks prior to commencing reinforcing work.
- .2 Upon request inform Departmental Representative of proposed source of material to be supplied.

PART 3 - EXECUTION

3.1 FIELD BENDING

- .1 Do not field bend or field weld reinforcement except where indicated or authorized by Departmental Representative.
- .2 When field bending is authorized, bend without heat, applying slow and steady pressure.
- .3 Replace bars, which develop cracks or splits.

3.2 PLACING
REINFORCEMENT

- .1 Place reinforcing steel as indicated on reviewed placing drawings and in accordance with CAN/CSA-A23.1.
- .2 Use approved type chairs to locate the reinforcing steel at the proper grade.
- .3 Tie reinforcement where spacing in each direction is:
 - .1 Less than 300 mm: tie at alternate intersections.
 - .2 300 mm or more: tie at each intersection.
- .4 Prior to placing concrete, obtain Departmental Representative's approval of reinforcing material and placement.
- .5 Ensure cover to reinforcement is maintained during concrete pour.

3.3 CLEANING

- .1 Clean reinforcing before placing concrete to CAN/CSA-A23.1.

PART 1 - GENERAL

1.1 DESCRIPTION

- .1 This section specifies requirements for supply, placing, finishing, protecting and curing cast-in-place concrete for mooring cleat blocks and wharf deck.

1.2 RELATED SECTIONS

- .1 Section 03 10 00 - Concrete Forming and Accessories.
- .2 Section 03 20 00 - Concrete Reinforcing.
- .3 Section 35 59 29 - Mooring Devices.

1.3 REFERENCES

- .1 American Society for Testing and Materials (ASTM)
 - .1 ASTM C109/C109M-05, Test Method for Compressive Strength of Hydraulic Cement Mortars (Using 2 in. or 50 mm Cube Specimens).
 - .2 ASTM C260-06, Specification for Air-Entraining Admixtures for Concrete.
 - .3 ASTM C494/C494M-05a, Specification for Chemical Admixtures for Concrete.
- .2 Canadian General Standards Board (CGSB)
 - .1 CAN/CGSB-51.34-M86, Vapour Barrier, Polyethylene Sheet for Use in Building Construction.
- .3 Canadian Standards Association (CSA International)
 - .1 CAN/CSA-A23.1-04, Concrete Materials and Methods of Concrete Construction.
 - .2 CAN/CSA-A28.2-04, Methods of Test for Concrete.
 - .3 CSA A283-06, Qualification Code for Concrete Testing Laboratories.
 - .4 CAN/CSA-A3000-03, Cementitious

Materials Compendium (Consists of A3001, A3002, A3003, A3004 and A3005).

.1 CSA-A3001-03, Cementitious Materials for Use in Concrete.

1.4 CERTIFICATES

- .1 Submit certificates in accordance with Section 01 33 00 Submittal Procedures.
- .2 Minimum 2 weeks prior to starting concrete work submit to Departmental Representative manufacturer's test data and certification by qualified independent inspection and testing laboratory that following materials will meet specified requirements:
 - .1 Portland cement.
 - .2 Blended hydraulic cement.
 - .3 Supplementary cementing materials.
 - .4 Grout.
 - .5 Admixtures.
 - .6 Aggregates.
 - .7 Water.
 - .8 Joint filler.
 - .9 Joint Sealant.
- .3 Provide certification that mix proportions selected will produce concrete of quality, yield and strength as specified in concrete mixes, and will comply with CAN/CSA-A23.1.
- .4 Provide certification that plant, equipment, and materials to be used in concrete comply with requirements of CAN/CSA-A23.1.

1.5 STORAGE OF MATERIALS

- .1 Store materials to prevent contamination or deterioration.
- .2 Provide adequate storage facilities for materials to ensure a continuous supply of these materials during batching operations.
- .3 Store cement in weathertight facility.

1.6 QUALITY
ASSURANCE

- .1 Minimum 2 weeks prior to starting concrete work, submit proposed quality control procedures to Departmental Representative for the following items:
 - .1 Cold weather concrete.
 - .2 Curing.
 - .3 Finishes.
 - .4 Formwork removal.
 - .5 Joints.

1.7 WASTE
MANAGEMENT AND
DISPOSAL

- .1 Use trigger operated spray nozzles for water hoses.
- .2 Designate a cleaning area for tools to limit water use and runoff.
- .3 Carefully coordinate the specified concrete work with weather conditions.
- .4 Ensure emptied containers are sealed and stored safely for disposal away from children.
- .5 Prevent plasticizers, water-reducing agents and air-entraining agents from entering drinking water supplies or streams. Using appropriate safety precautions, collect liquid or solidify liquid with an inert, noncombustible material and remove for disposal. Dispose of all waste in accordance with applicable local, provincial and national regulations.
- .6 Choose least harmful, appropriate cleaning method which will perform adequately.

1.8 MEASUREMENT FOR
PAYMENT

- .1 Reinforced Concrete Deck: Supply and installation of reinforced concrete deck to be measured in square metres (m²) calculated from actual field measurements, excluding area occupied by mooring cleat pedestals and coping. Contractor to provide all plant, equipment, material, and labour including concrete, reinforcing steel, expansion and control joints.

- .2 Cleat Pedestals: No measurement for payment to be made under this section. Include costs incidental to unit price for Type "B1" mooring cleats.
- .3 No separate payment will be made for any other ingredient or feature of concrete work, and all factors, including cold weather placement, dowels, expansion and reinforcing steel, anchor bolts, joint filler for control joints, cement, plant and labour will be considered as being included in the unit price for item.

PART 2 - PRODUCTS

2.1 MATERIALS

- .1 Cement: to CAN/CSA-A3001, Type GU.
- .2 Supplementary cementing materials: to CAN/CSA-A3001.
- .3 Cementitious hydraulic slag: to CAN/CSA-A3001.
- .4 Water: to CAN/CSA-A23.1.
- .5 Aggregates: to CAN/CSA-A23.1. Coarse aggregate to be normal density.
- .6 Air entraining admixture: to ASTM C260.
- .7 Chemical admixtures: to ASTM C494/C494M. Departmental Representative to approve accelerating or set retarding admixtures during cold and hot weather placing.
- .8 Concrete retarders: to ASTM C494/C494M. Do not allow moisture of any kind to come in contact with the retarder film.
- .9 Curing compound: curing compounds are not to be used.
- .10 Premoulded joint fillers:
 - .1 Sponge rubber: to ASTM D1752, Type I,

flexible grade.

2.2 MIXES

- .1 Proportion concrete in accordance with CAN/CSA-A23.1, Clause 4.3.
- .2 Proportion concrete to comply with Alternate 1, Table 2 in CAN/CSA-A23.1 and following requirements:
 - .1 Cement:
 - .1 Type GU Portland Cement.
 - .2 Minimum compressive strength: 35 MPa at 28 days.
 - .3 Class of exposure: C2.
 - .4 Minimum cement content: 385 kg/m³ of concrete.
 - .5 20 mm nominal size coarse aggregate.
 - .6 Air content 5% to 8%.
 - .7 Density of air-dry concrete in range of 2240 kg/m³ to 2400 kg/m³.
 - .8 Slump at time and point of discharge 50 mm to 100 mm.
- .3 When the Contractor wishes to purchase concrete from a ready mix concrete supplier, submit a letter from the supplier certifying the following:
 - .1 That plant and equipment is certified and all materials to be used in the concrete comply with the requirements of CAN/CSA-A23.1.
 - .2 That the mix proportions selected will produce concrete of the specified quality and yield. Indicate mix proportions and sources of all materials.
 - .3 That the strengths will comply with the strengths specified herein.
- .4 When the Contractor wishes to mix concrete on site, identify the source of aggregates and submit samples of fine and coarse aggregates to a testing laboratory for testing and trial mixes in order to determine a suitable mix design. The testing laboratory, at Contractor's cost, will test the trial mix for slump, air content, density and strength. The results of these tests will be submitted to the Departmental Representative to be reviewed for compliance with the

specification. This review must be completed before permission to place concrete is given.

- .1 The sand, gravel, water and air entraining agent should be mixed prior to the addition of cement and water reducer.
- .5 Weigh aggregates, cement, water and admixture when batching. No alternative methods of measuring will be permitted.
- .6 Do not use calcium chloride.

PART 3 - EXECUTION

3.1 PREPARATION

- .1 Obtain Departmental Representative's approval before placing concrete. Provide 24 hours notice prior to placing of concrete.
- .2 Pumping of concrete is permitted only after approval of equipment and mix.
- .3 Ensure reinforcement and inserts are not disturbed during concrete placement.
- .4 Prior to placing of concrete obtain Departmental Representative's approval of proposed method for protection of concrete during placing and curing in adverse weather.
- .5 Maintain accurate records of poured concrete items to indicate date, location of pour, quality, air temperature and test samples taken.
- .6 Do not place load upon new concrete until authorized by Departmental Representative.

3.2 CONSTRUCTION

- .1 Comply with additional requirements of CAN/CSA-A23.1, Clause 4.1.1.5, for concrete exposed to seawater environments.
- .2 Minimum concrete cover over reinforcing steel bars to be 75 mm.

- .3 Place concrete in hot weather to CAN/CSA-A23.1.
 - .4 Place concrete in cold weather to CAN/CSA-A23.1.
 - .5 Keep concrete surfaces moist continually during protection stage.
 - .6 Place, consolidate, finish, cure and protect concrete to CAN/CSA-A23.1.
 - .7 Do not commence placing concrete until Departmental Representative has inspected and approved forms, foundations, reinforcing steel, joints, conveying, spreading, consolidation and finishing equipment and curing and protective methods.
- 3.3 FORMWORK
- .1 Install and strip formwork to CAN/CSA-A23.1 and Section 03 10 00 - Concrete Forming and Accessories.
- 3.4 INSERTS
- .1 Position and secure anchor bolts in formwork to maintain line and grades.
 - .2 Confirm exact size and location of anchor bolts for electrical pedestal based on existing base configuration.
- 3.5 CONTROL JOINTS
- .1 Construct control joints in locations shown on drawings or directed by Departmental Representative.
 - .2 All joints will be centred over a support. Joints will be made in a perfectly straight line.
 - .3 Cut control joint when concrete has hardened.
 - .4 Fill saw cut with joint sealer as specified.

3.6 PLACING
CONCRETE

- .1 Place and consolidate concrete to CAN/CSA-A23.1.
- .2 Do not place concrete on or against frozen material.
- .3 Place concrete continuously from joint to joint.
- .4 Place concrete in a uniform heading, normal to the centreline. Limit rate of placing to that which can be finished before beginning of initial set.

3.7 STRIKE OFF AND
CONSOLIDATION

- .1 High speed internal poker vibrators shall be used to consolidate the concrete during placing. Final compaction of the surfaces shall be done by beam-type vibratory air screed as approved by Departmental Representative. A surcharge of approximately 65 mm of concrete will be maintained at the screed face during consolidation.
- .2 Strikeoff and consolidation must be completed before excess water bleeds to the surface.
- .3 Ensure that the concrete deck conforms to the elevations and slopes as shown on the drawings so that satisfactory drainage will result.

3.8 FINISHING

- .1 Only ACI certified or other pre-approved concrete finishers are to be utilized in finishing all concrete works. All work is to be finished to CAN/CSA-A23.1, and as specified below.
- .2 The surface will be brought to the specified level by means of darbying or bull floating which will be carried out immediately following screeding and must be completed before any bleed water is present on the surface. Surface tolerance to be 8 mm under a 3 metre straight edge.
- .3 Provide slope as shown on the drawings to permit proper drainage of the concrete deck.

- .4 Finish slabs to elevations indicated on drawings.
- .5 Strike off the surface with a straight edge.
- .6 Hand tamp low slump concrete with jitterbug.
- .7 Darby or bull float the surface to smooth and level the concrete.
- .8 Allow bleed water or sheen to disappear.
- .9 Float the surface by means of power and/or hand float where the concrete has hardened enough for a man to leave only slight footprints on the surface.
- .10 Do not bring water and fines to the surface by over floating. Where extra floating is required the floating operation shall be repeated after the time interval necessary for any sheen to disappear and for concrete to set further.
- .11 Steel trowel the concrete surfaces by means of power and/or hand trowel. Do not leave any hard, smooth, polished or burnished surface area.
- .12 Do not bring water and fines to the surface by over trowelling.
- .13 After slight interval necessary for concrete to further harden, repeat the trowelling operation.
- .14 Lightly broom surface with a soft bristle broom obtaining a fine and even textured finish with a non-slip finish. All brush strokes to be parallel across paving.
- .15 The surface shall be true and accurate to a maximum tolerance of 1 mm in 500 mm.

3.9 PROTECTION AND
CURING

- .1 Cure to CAN/CSA-A23.1.
- .2 Cure concrete by protecting it against loss of moisture, rapid temperature change and

mechanical injury for at least 7 days after placement. After finishing operations have been completed, the entire surface of the newly placed concrete shall be covered by whatever curing medium is applicable to local conditions and approved by the Departmental Representative. The edges of concrete slabs exposed by removal of forms shall be protected with continuous curing treatment equal to the method selected for curing the slab and curb surfaces. Cure to CAN/CSA-A23.1. Have the equipment needed for adequate curing at hand and ready to install before actual concrete placement begins.

- .3 When air temperature is at or below 5°C or when there is a probability of its falling to that limit within 24 hours of placing (as forecast by the nearest official meteorological office) cold weather protection as per CAN/CSA-A23.1 will be provided and the following:
 - .1 Housing - Protect concrete by a windproof shelter of canvas or other material to allow free circulation of inside air around fresh touch formwork and provide sufficient space for removal of formwork for finishing. Supply approved heating equipment capable of keeping inside air at a constant temperature sufficiently high to maintain concrete at following curing temperatures.
 - .1 For initial 3 days at a temperature of not less than 15°C nor more than 27°C at surface.
 - .2 Maintain concrete at 10°C for an extra 4 days plus the initial 3 days.
 - .3 In addition to the protective housing, the concrete must be cured as outlined in Clause 3.9.2 above.

3.10 TESTING

- .1 Departmental Representative will appoint a concrete testing company to test all work under this section of specification as per CAN/CSA-A23.1.
- .2 Cost of compressive strength tests shall be paid for by the Departmental Representative.

- .3 Testing company shall issue reports to Departmental Representative on quality of test cylinders.
- .4 Notify Departmental Representative at least 7 days prior to start of placing concrete. Provide for testing purposes an adequate quantity of approved test cylinders.
- .5 At least 1 set of 3 cylinders each shall be taken from 25 m³ or fraction thereof of each day's pour, whichever is less. 1 cylinder shall be tested at 7 days and other 2 tested at 28 days.
- .6 Crate cylinders and deliver to the testing laboratory within 48 hours after casting in accordance with CAN/CSA-A23.1. Contractor will pay for crating and delivery of cylinders to the laboratory.
- .7 If strength tests of test cylinder for any portion of the work falls below the specified compressive strength at 28 days, the Departmental Representative reserves the right to determine the acceptability of the concrete by performing additional field testing as outlined in CAN/CSA-A23.1.
- .8 If concrete does not conform to drawings or specifications, take measures as directed to correct the deficiency. All costs of correctional measures will be at the expense of the Contractor.

PART 1 - GENERAL

1.1 RELATED
SECTIONS

- .1 Section 01 33 00 - Submittal Procedures.
- .2 Section 01 74 21 - Construction/Demolition Waste Management and Disposal.
- .3 Section 03 30 00 - Cast-in-Place Concrete.

1.2 REFERENCES

- .1 American Society for Testing and Materials International, (ASTM)
 - .1 ASTM A 53/A53M-latest edition, Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated Welded and Seamless.
 - .2 ASTM A 269-latest edition, Specification for Seamless and Welded Austenitic Stainless Steel Tubing for General Service.
 - .3 ASTM A 307-latest edition, Specification for Carbon Steel Bolts and Studs, 60,000 PSI Tensile Strength.
- .2 Canadian General Standards Board (CGSB)
 - .1 CAN/CGSB-1.40-latest edition, Anti-corrosive Structural Steel Alkyd Primer.
 - .2 CAN/CGSB-1.181-latest edition, Ready-Mixed, Organic Zinc-Rich Coating.
- .3 Canadian Standards Association (CSA International)
 - .1 CAN/CSA-G40.20/G40.21-latest edition, General Requirements for Rolled or Welded Structural Quality Steel.
 - .2 CAN/CSA-G164-latest edition, Hot Dip Galvanizing of Irregularly Shaped Articles.
 - .3 CAN/CSA-S16.1-latest edition, Limit States Design of Steel Structures.
 - .4 CSA W48-latest edition, Filler Metals and Allied Materials for Metal Arc Welding (Developed in co-operation with the Canadian

Welding Bureau).

.5 CSA W59-latest edition, Welded Steel
Construction (Metal Arc Welding).

1.3 SUBMITTALS

- .1 Product Data:
 - .1 Submit manufacturer's printed product literature, specifications and data sheet in accordance with Section 01 33 00 - Submittal Procedures.
 - .2 Submit two copies of WHMIS MSDS - Material Safety Data Sheets in accordance with Section 01 33 00 - Submittal Procedures.
Indicate VOC's:
 - .1 For finishes, coatings, primers and paints.
- .2 Shop Drawings
 - .1 Submit shop drawings in accordance with Section 01 33 00 - Submittal Procedures.
 - .2 Indicate materials, core thicknesses, finishes, connections, joints, method of anchorage, number of anchors, supports, reinforcement, details, and accessories.

1.4 QUALITY
ASSURANCE

- .1 Test Reports: Certified test reports showing compliance with specified performance characteristics and physical properties.
- .2 Certificates: Product certificates signed by manufacturer certifying materials comply with specified performance characteristics and criteria and physical requirements.

1.5 DELIVERY,
STORAGE, AND
HANDLING

- .1 Packing, Shipping, Handling and Unloading:
 - .1 Deliver, store, handle and protect materials in accordance with Section 01 61 00 - Common Product Requirements.
- .2 Storage and Protection:
 - .1 Cover exposed stainless steel surfaces

with pressure sensitive heavy protection paper or apply strippable plastic coating, before shipping to job site.

.2 Leave protective covering in place until final cleaning of building. Provide instructions for removal of protective covering.

1.6 WASTE
MANAGEMENT AND
DISPOSAL

- .1 Separate and recycle waste materials in accordance with Section 01 74 21 - Construction/Demolition Waste Management and Disposal.
- .2 Remove from site and dispose of packaging materials at appropriate recycling facilities.
- .3 Collect and separate for disposal paper plastic polystyrene corrugated cardboard with Waste Management Plan.
- .4 Divert unused metal materials from landfill to metal recycling facility approved by Departmental Representative.

1.7 MEASUREMENT FOR
PAYMENT

- .1 Steel support brackets. The supply and installation of steel support brackets will be measured by the unit secured in place. Contractor to provide all plant, equipment, material, and labour including steel, nuts, bolts, welding, fabrication, priming and painting. Include incidental to the unit price all costs for demolition and removal of existing steel support plates.
- .2 Steel angle cross bracing: The supply and installation of steel angle cross bracing (9.5 x 150 x 150) will be measured by the linear metre (LM) secured in place. Contractor to provide all plant, equipment, material, and labour including steel angle, nuts, bolts, welding, fabrication, priming, and painting. Include incidental to the cost by the linear metre all grinding, priming, and painting of existing steel support brackets prior to installation of new steel angle cross bracing.

PART 2 - PRODUCTS

2.1 MATERIALS

- .1 Steel sections and plates: to CAN/CSA-G40.20/G40.21, Grade 300W or better, galvanized finish.
- .2 Welding materials: to CSA W59.
- .3 Welding electrodes: to CSA W48 Series.
- .4 Bolts and anchor bolts: to ASTM A 307.
- .5 Grout: non-shrink, non-metallic, flowable, 15 MPa at 24 hours.

2.2 FABRICATION

- .1 Fabricate work square, true, straight and accurate to required size, with joints closely fitted and properly secured.
- .2 Use self-tapping shake-proof flat headed screws on items requiring assembly by screws or as indicated.
- .3 Where possible, fit and shop assemble work, ready for erection.
- .4 Ensure exposed welds are continuous for length of each joint. File or grind exposed welds smooth and flush.

2.3 FINISHES

- .1 Galvanizing: hot dipped galvanizing with zinc coating 600 g/m² to CAN/CSA-G164.
- .2 Shop coat primer: to CAN/CGSB-1.40 as recommended by paint supplier.
- .3 Zinc primer: zinc rich, ready mix to CAN/CGSB-1.181.
- .4 Marine industrial enamel paint: 2.0-4.0 mils

dry film. Conforms to AWWA D102 OCS#1. Gloss finish, green.

2.4 SHOP PAINTING

- .1 Apply one shop coat of primer to metal items, with exception of galvanized or concrete encased items.
- .2 Use primer unadulterated, as prepared by manufacturer. Paint on dry surfaces, free from rust, scale, grease. Do not paint when temperature is lower than 7 degrees C.
- .3 Clean surfaces to be field welded; do not paint.

2.5 STEEL SUPPORT
BRACKET

- .1 Steel Angles, stiffeners, beams, plates and HSS sections, sizes as indicated on detailed drawings. Three (3) required.
- .2 Steel bolts and washers as indicated.
- .3 Finish: Shop finish, one coat primer, one coat industrial enamel (green).

2.6 ANGLE CROSS
BRACING

- .1 Steel Angles: 150 x 150 x 9.5 prime and painted.
- .2 Bolt or weld as indicated on drawings.
- .3 Finish: shop finish, one coat primer, one coat marine enamel (green).

PART 3 - EXECUTION

3.1 ERECTION

- .1 Do welding work in accordance with CSA W59 unless specified otherwise.

- .2 Erect metalwork square, plumb, straight, and true, accurately fitted, with tight joints and intersections.
- .3 Exposed fastening devices to match finish and be compatible with material through which they pass.
- .4 Make field connections with bolts to CAN/CSA-S16.1, or weld.
- .5 Hand items over for casting into concrete or building into masonry to appropriate trades together with setting templates.
- .6 Touch-up rivets, field welds, bolts and burnt or scratched surfaces after completion of erection with primer.
- .7 Touch-up galvanized surfaces with zinc rich primer where burned by field welding.

3.2 CLEANING

- .1 Perform cleaning after installation to remove construction and accumulated environmental dirt.
- .2 Upon completion of installation, remove surplus materials, rubbish, tools and equipment barriers.

PART 1 - GENERAL

- 1.1 RELATED WORK .1 Section 05 50 00 - Metal Fabrications
- 1.2 REFERENCE STANDARDS .1 Welding to be in accordance with CSA- 989 for all applications to steel support brackets and steel angle cross bracing.
- 1.3 CERTIFICATION .1 Welding shall only be undertaken by welders certified by the Canadian Welding Bureau to the requirements of CSA W27.1 1992, Division 1 or Division 2.1 for all applications to steel support brackets and steel angle cross bracing.
- 1.4 WELDING PROCEDURES .1 Welding procedure specifications, welding procedure data sheets and welding procedure qualification report shall be submitted for applications to steel support brackets and steel angle cross bracing for the Departmental Representative's review.
- .2 All welds will be subject to visual inspection requirements of CSA W59-1989.
- .3 Welds which fail the visual inspection will be subject to further non-destructive testing. This testing may be radiographic inspection, magnetic particle investigation or ultrasonic testing or other appropriate testing. The full length of the weld will be examined.
- .4 The contractor shall be responsible for all

costs for non- destructive testing resulting from visual inspection failure.

- .5 The Departmental Representative will not approve any weld until all required inspection is completed, found acceptable and marked as such.

PART 2 - PRODUCTS

2.1 WELDING MATERIALS

- .1 Welding materials shall be in accordance with CSA W59 M1989.

PART 3 - EXECUTION

3.1 WELDING

- .1 Welding to be in accordance with CSA W59 M1989.
- .2 Do not deviate the size, length and location of welds from the design drawings or from details shown on shop drawings that have been reviewed by the Engineer.

PART 1 - GENERAL

1.1 REFERENCES

- .1 American Wood-Preservers' Association (AWPA)
 - .1 AWPA M2-01, Standard Inspection of Treated Wood Products.
 - .2 AWPA M4-06, Standard for the Care of Preservative-Treated Wood Products.
- .2 Canadian Standards Association (CSA)
 - .1 CSA O80 Series-97(R2007) - Wood Preservation.
 - .2 CSA O80.201-97, Standard for Hydrocarbon Solvents for Preservatives. This Standard covers hydrocarbon solvents for preparing solutions of preservatives. This is not stand alone specification.
 - .3 CSA O322-02, Procedure for Certification of Pressure-Treated Wood Materials for Use in Preserved Wood Foundations.

1.2 QUALITY
ASSURANCE

- .1 Testing of products treated with preservative by pressure impregnation will be carried out by the manufacturer's testing laboratory to AWPA M2, and revisions specified in CSA O80 Series, Supplementary Requirements to AWPA M2.
- .2 Inspection and testing of timber materials will be carried out by the manufacturer.

1.3 CERTIFICATES
AND ASSAY
RETENTION RESULTS

- .1 Submit certificates and assay retention results in accordance with Section 01 33 00 - Submittal Procedures.
- .2 For products treated with preservative by

pressure impregnation submit following information certified by authorized signing officer of treatment plant:

- .1 Information listed in AWPA M2 and revisions specified in CSA 080 Series, Supplementary Requirement to AWPA M2 applicable to specified treatment.
- .2 Moisture content after drying following treatment with water-borne preservative.
- .3 Assay retentions results representing each treated batch of supplied timber.
- .4 Acceptable types of paint, stain, and clear finishes that may be used over treated materials to be finished after treatment.

1.4 WASTE
MANAGEMENT AND
DISPOSAL

- .1 Do not dispose of preservative treated wood through incineration.
- .2 Do not dispose of preservative treated wood with other materials destined for recycling or reuse.
- .3 Dispose of treated wood, end pieces, wood scraps and sawdust at sanitary landfill approved by Departmental Representative.
- .4 Dispose of unused wood preservative material at official hazardous material collections site approved by Departmental Representative.
- .5 Do not dispose of unused preservative material into sewer system, into streams, lakes, onto ground or in other location where they will pose health or environmental hazard.

PART 2 - PRODUCTS

2.1 MATERIALS

- .1 Preservative: to CSA-080 Series.
- .2 Solvent: to CSA-080.201.

2.2 PRESERVATIVE
TREATMENTS

- .1 Treat to CSA 080, commodity standard 080.18, Table 1 and its referenced standards, with the following minimum assay retentions:

Species Dimension Timber	CCA kg/m ³	ACA kg/m ³
-Coast Douglas Fir	24	24
-Western/Eastern Hemlock	24	24
-Hemlock, Douglas Fir (Wheelguard, Wheelguard Blocking)	10	10
-Birch or Maple	Treat to Rufusal	

Note: Birch or maple must be air dried for six (6) months in weather protected environment or kiln dried.

PART 3 - EXECUTION

3.1 FIELD TREATMENT

- .1 Handle pressure treated material in a manner that will avoid damage which may expose untreated material. Rejection of any damaged material may result and replacement will be at the Contractor's expense.
- .2 Fill all bored bolt holes with preservative immediately after boring. Use a pressurized container with hose to apply preservative, or some alternate method acceptable to the Departmental Representative.
- .3 Fill all unused bored holes and spike holes with tight fitting treated wooden plugs.

3.2 CUTTING

- .1 Field cuts, if authorized, are to receive three (3) liberal coats of the applicable preservative applied to dry wood on each application.

3.3 FIELD QUALITY

- .1 Timber which contain rot, splits exposing untreated wood, excessive wane, or timbers which cannot be fastened in the work so as to be structurally sound are unacceptable.
- .2 The Departmental Representative reserves the right to carry out field testing of treated timber for penetration and retention of preservative. Timber not meeting the requirements of the specification may be rejected for use under the contract.

PART 1 - GENERAL

1.1 SECTION
INCLUDES

- .1 Materials, preparation and application for caulking and sealants.

1.2 RELATED
SECTIONS

- .1 Section 01 33 00 - Submittal Procedures.
- .2 Section 01 45 00 - Testing and Quality Control.
- .3 Section 01 61 00 - Common Product Requirements.
- .4 Section 01 74 21 - Construction/Demolition Waste Management and Disposal.
- .5 Section 03 10 00 - Concrete Forming and Accessories.
- .6 Section 03 30 00 - Cast-in-Place Concrete.

1.3 REFERENCES

- .1 Canadian General Standards Board (CGSB)
- .2 CAN/CGSB-19.24-M90, Multi-component, Chemical Curing Sealing Compound.
- .3 Department of Justice Canada (Jus)
 - .1 Canadian Environmental Protection Act, 1999 (CEPA).
- .4 Health Canada/Workplace Hazardous Materials Information System (WHMIS)
 - .1 Material Safety Data Sheets (MSDS).
- .5 Transport Canada (TC)
 - .1 Transportation of Dangerous Goods Act, 1992 (TDGA).

1.4 SUBMITTALS

- .1 Submit product data in accordance with Section 01 33 00 - Submittal Procedures.
- .2 Manufacturer's product to describe.
 - .1 Caulking compound.
 - .2 Primers.
 - .3 Sealing compound, each type, including compatibility when different sealants are in contact with each other.
- .3 Submit manufacturer's instructions in accordance with Section 01 33 00 - Submittal Procedures.
 - .1 Instructions to include installation instructions for each product used.

1.5 DELIVERY,
STORAGE, AND
HANDLING

- .1 Deliver, handle, store and protect materials in accordance with Section 01 61 00 - Common Product Requirements.
- .2 Deliver and store materials in original wrappings and containers with manufacturer's seals and labels, intact. Protect from freezing, moisture, water and contact with ground or floor.

1.6 WASTE
MANAGEMENT AND
DISPOSAL

- .1 Separate waste materials for reuse and recycling in accordance with Section 01 74 21 - Construction/Demolition Waste Management and Disposal.
- .2 Remove from site and dispose of packaging materials at appropriate recycling facilities.
- .3 Collect and separate for disposal paper, plastic, polystyrene, corrugated cardboard, packaging material, in appropriate on-site bins, for recycling in accordance with Waste Management Plan.
- .4 Place materials defined as hazardous or toxic in designated containers.
- .5 Handle and dispose of hazardous materials in accordance with the CEPA, TDGA, Regional and

Municipal regulations.

- .6 Unused sealant material must not be disposed of into sewer system, into streams, lakes, onto ground or in other location where it will pose health or environmental hazard.
- .7 Divert unused joint sealing material from landfill to official hazardous material collections site approved by Departmental Representative.
- .8 Empty plastic joint sealer containers are not recyclable. Do not dispose of empty containers with plastic materials destined for recycling.
- .9 Fold up metal banding, flatten, and place in designated area for recycling.

1.7 PROJECT
CONDITIONS

- .1 Environmental Limitations:
 - .1 Do not proceed with installation of joint sealants under following conditions:
 - .1 When ambient and substrate temperature conditions are outside limits permitted by joint sealant manufacturer or are below 4.4 degrees C.
 - .2 When joint substrates are wet.
- .2 Joint-Width Conditions:
 - .1 Do not proceed with installation of joint sealants where joint widths are less than those allowed by joint sealant manufacturer for applications indicated.
- .3 Joint-Substrate Conditions:
 - .1 Do not proceed with installation of joint sealants until contaminants capable of interfering with adhesion are removed from joint substrates.

1.8 ENVIRONMENTAL
REQUIREMENTS

- .1 Comply with requirements of Workplace Hazardous Materials Information System (WHMIS) regarding use, handling, storage, and disposal of hazardous materials; and regarding labelling and provision of Material Safety Data Sheets (MSDS) acceptable to Labour

Canada.

- .2 Conform to manufacturer's recommended temperatures, relative humidity, and substrate moisture content for application and curing of sealants including special conditions governing use.

1.9 MEASUREMENT FOR
PAYMENT

- .1 No measurement for payment to be made under this section. Include costs in unit prices for items in which joint sealing is required.

PART 2 - PRODUCTS

2.1 SEALANT
MATERIALS

- .1 Where sealants are qualified with primers use only these primers.

2.2 SEALANT
MATERIAL
DESIGNATIONS

- .1 Polysulfide Two Part.
 - .1 Self-Leveling to CAN/CGSB-19.24, Type 1, Class B, colour to match concrete.
- .2 Polysulfide Two Part.
 - .1 Non-Sag to CAN/CGSB-19.24, Type 2, Class B, colour to match concrete.
- .3 Preformed Compressible and Non-Compressible back-up materials.
 - .1 Polyethylene, Urethane, Neoprene or Vinyl Foam.
 - .1 Extruded closed cell foam backer rod.
 - .2 Size: oversize 30 to 50%.
 - .2 Neoprene or Butyl Rubber.
 - .1 Round solid rod, Shore A hardness 70.
 - .3 High Density Foam.
 - .1 Extruded closed cell polyvinyl chloride (PVC), extruded polyethylene, closed cell, Shore A hardness 20, tensile strength 140 to 200 kPa, extruded polyolefin foam, 32 kg/m³ density, or neoprene foam backer, size

as recommended by manufacturer.

- .4 Bond Breaker Tape.
 - .1 Polyethylene bond breaker tape which will not bond to sealant.

2.3 JOINT CLEANER

- .1 Non-corrosive and non-staining type, compatible with joint forming materials and sealant recommended by sealant manufacturer.
- .2 Primer: as recommended by manufacturer.

PART 3 - EXECUTION

3.1 PROTECTION

- .1 Protect installed Work of other trades from staining or contamination.

3.2 SURFACE PREPARATION

- .1 Examine joint sizes and conditions to establish correct depth to width relationship for installation of backup materials and sealants.
- .2 Clean bonding joint surfaces of harmful matter substances including dust, rust, oil grease, and other matter which may impair Work.
- .3 Do not apply sealants to joint surfaces treated with sealer, curing compound, water repellent, or other coatings unless tests have been performed to ensure compatibility of materials. Remove coatings as required.
- .4 Ensure joint surfaces are dry and frost free.
- .5 Prepare surfaces in accordance with manufacturer's directions.

3.3 PRIMING

- .1 Where necessary to prevent staining, mask adjacent surfaces prior to priming and caulking.
- .2 Prime sides of joints in accordance with

sealant manufacturer's instructions
immediately prior to caulking.

3.4 BACKUP MATERIAL

- .1 Apply bond breaker tape where required to manufacturer's instructions.
- .2 Install joint filler to achieve correct joint depth and shape, with approximately 30% compression.

3.5 MIXING

- .1 Mix materials in strict accordance with sealant manufacturer's instructions.

3.6 APPLICATION

- .1 Sealant.
 - .1 Apply sealant in accordance with manufacturer's written instructions.
 - .2 Mask edges of joint where irregular surface or sensitive joint border exists to provide neat joint.
 - .3 Apply sealant in continuous beads.
 - .4 Apply sealant using gun with proper size nozzle.
 - .5 Use sufficient pressure to fill voids and joints solid.
 - .6 Form surface of sealant with full bead, smooth, free from ridges, wrinkles, sags, air pockets, embedded impurities.
 - .7 Tool exposed surfaces before skinning begins to give slightly concave shape.
 - .8 Remove excess compound promptly as work progresses and upon completion.
- .2 Curing.
 - .1 Cure sealants in accordance with sealant manufacturer's instructions.
 - .2 Do not cover up sealants until proper curing has taken place.
- .3 Cleanup.
 - .1 Clean adjacent surfaces immediately and leave Work neat and clean.
 - .2 Remove excess and droppings, using recommended cleaners as work progresses.
 - .3 Remove masking tape after initial set of sealant.

PART 1 - GENERAL

1.1 RELATED
SECTIONS

- .1 Section 01 29 83 - Payment Procedures for Testing Laboratory Services.
- .2 Section 01 33 00 - Submittal Procedures.
- .3 Section 01 74 21 - Construction/Demolition Waste Management and Disposal.
- .4 Section 32 12 16 - Asphalt Paving.

1.2 REFERENCES

- .1 American Society for Testing and Materials (ASTM)
 - .1 ASTM D 4791-05, Standard Test Method for Flat Particles, Elongated Particles, or Flat and Elongated Particles in Coarse Aggregate.

1.3 SAMPLES

- .1 Submit samples in accordance with Section 01 33 00 - Submittal Procedures.
- .2 Allow continual sampling by Departmental Representative during production.
- .3 Provide Departmental Representative with access to source and processed material for sampling.
- .4 Install sampling facilities at discharge end of production conveyor, to allow Departmental Representative to obtain representative samples of items being produced. Stop conveyor belt when requested by Departmental Representative to permit full cross section sampling.
- .5 Pay cost of sampling and testing of aggregates which fail to meet specified requirements.

1.4 WASTE
MANAGEMENT AND
DISPOSAL

- .1 Divert unused granular materials from landfill to local quarry facility as approved by Departmental Representative.

PART 2 - PRODUCTS

2.1 MATERIALS

- .1 Aggregate quality: sound, hard, durable material free from soft, thin, elongated or laminated particles, organic material, clay lumps or minerals, or other substances that would act in deleterious manner for use intended.
- .2 Flat and elongated particles of coarse aggregate: to ASTM D 4791.
 - .1 Greatest dimension to exceed five times least dimension.
- .3 Fine aggregates satisfying requirements of applicable section to be one, or blend of following:
 - .1 Natural sand.
 - .2 Manufactured sand.
 - .3 Screenings produced in crushing of quarried rock, boulders, gravel or slag.
- .4 Coarse aggregates satisfying requirements of applicable section to be one of or blend of following:
 - .1 Crushed rock.
 - .2 Gravel and crushed gravel composed of naturally formed particles of stone.
 - .3 Light weight aggregate, including slag and expanded shale.

2.2 SOURCE QUALITY
CONTROL

- .1 Inform Departmental Representative of proposed source of aggregates and provide access for sampling at least 2 weeks prior

to commencing production.

- .2 If, in opinion of Departmental Representative, materials from proposed source do not meet, or cannot reasonably be processed to meet, specified requirements, locate an alternative source or demonstrate that material from source in question can be processed to meet specified requirements.
- .3 Advise Departmental Representative 2 weeks in advance of proposed change of material source.
- .4 Acceptance of material at source does not preclude future rejection if it fails to conform to requirements specified, lacks uniformity, or if its field performance is found to be unsatisfactory.

PART 3 - EXECUTION

3.1 PREPARATION

- .1 Aggregate source preparation
 - .1 Prior to excavating materials for aggregate production, clear and grub area to be worked, and strip unsuitable surface materials. Dispose of cleared, grubbed and unsuitable materials as directed by Departmental Representative.
 - .2 Where clearing is required, leave screen of trees between cleared area and roadways as directed.
 - .3 Clear, grub and strip area ahead of quarrying or excavating operation sufficient to prevent contamination of aggregate by deleterious materials.
 - .4 When excavation is completed dress sides of excavation to nominal 1.5:1 slope, and provide drains or ditches as required to prevent surface standing water.
 - .5 Trim off and dress slopes of waste material piles and leave site in neat condition.
- .2 Processing
 - .1 Process aggregate uniformly using

methods that prevent contamination, segregation and degradation.

.2 Blend aggregates, if required, to obtain gradation requirements, percentage of crushed particles, or particle shapes, as specified. Use methods and equipment approved by Departmental Representative.

.3 Wash aggregates, if required to meet specifications. Use only equipment approved by Departmental Representative.

.4 When operating in stratified deposits use excavation equipment and methods that produce uniform, homogeneous aggregate.

.3 Handling

.1 Handle and transport aggregates to avoid segregation, contamination and degradation.

.4 Stockpiling

.1 Stockpile aggregates on site in locations as indicated unless directed otherwise by Departmental Representative. Do not stockpile on completed pavement surfaces.

.2 Stockpile aggregates in sufficient quantities to meet Project schedules.

.3 Stockpiling sites to be level, well drained, and of adequate bearing capacity and stability to support stockpiled materials and handling equipment.

.4 Except where stockpiled on acceptably stabilized areas, provide compacted sand base not less than 300 mm in depth to prevent contamination of aggregate. Stockpile aggregates on ground but do not incorporate bottom 300 mm of pile into Work.

.5 Separate different aggregates by strong, full depth bulkheads, or stockpile far enough apart to prevent intermixing.

.6 Do not use intermixed or contaminated materials. Remove and dispose of rejected materials as directed by Departmental Representative within 48 hours of rejection.

.7 Stockpile materials in uniform layers of thickness as follows:

.1 Max 1.5 m for coarse aggregate and base course materials.

.2 Max 1.5 m for fine aggregate and sub-base materials.

.3 Max 1.5 m for other materials.

.8 Uniformly spot-dump aggregates delivered to stockpile in trucks and build

up stockpile as specified.

.9 Do not cone piles or spill material over edges of piles.

.10 Do not use conveying stackers.

.11 During winter operations, prevent ice and snow from becoming mixed into stockpile or in material being removed from stockpile.

3.2 CLEANING

- .1 Leave aggregate stockpile site in tidy, well drained condition, free of standing surface water.
- .2 Leave any unused aggregates in neat compact stockpiles as directed by Departmental Representative.
- .3 For temporary or permanent abandonment of aggregate source, restore source to condition meeting requirements of authority having jurisdiction.

PART 1 - GENERAL

- 1.1 DESCRIPTION .1 This section specifies supply, placement and compaction of rock and gravel fill as required or as directed by Departmental Representative.
- 1.2 RELATED SECTIONS .1 Section 31 23 33.01 - Excavating, Trenching, and Backfilling.
- 1.3 MEASUREMENT FOR PAYMENT .1 Rock Fill (100 mm minus): Supply, placement, and compaction of rock fill will be measured by the cubic metre (m³). The volume of material will be determine in place from measurements taken prior to and at completion of the work. Include the cost of all plant, labour, equipment, and materials required to complete the work as specified.
- .2 Gravel Fill: Supply, placement, and compaction of gravel fill is to be considered as incidental to timber crib construction as per Section 31 53 13 - Timber Cribwork.
- 1.4 REFERENCES .1 ASTM International
- .1 ASTM C 117-13, Standard Test Method for Material Finer than 0.075 mm (No. 200) Sieve in Mineral Aggregates by Washing.
- .2 ASTM C 127-12, Standard Test Method for Density, Relative Density (Specific Gravity), and Absorption of Coarse Aggregate.
- .3 ASTM C 136-13, Standard Test Method for Sieve Analysis of Fine and Coarse Aggregates.

1.5 DELIVERY,
STORAGE AND
HANDLING

- .1 Deliver, store and handle materials in accordance with Section 01 61 00 - Common Product Requirements.

PART 2 - PRODUCTS

2.1 MATERIALS

- .1 Rock fill material to following requirements:
- .1 Crushed quarry stone consisting of hard durable particles free from clay lumps, frozen material and other deleterious materials, and free from splits, seams or defects likely to impair its soundness during handling or under action of water.
 - .2 Relative density: to ASTM C 127, not less than 2.65.
 - .3 (100 mm minus) Rock size to be 85% - 90% 38 mm - 100 mm and with rock no greater than 150 mm dia.
 - .4 (100 mm to 300 mm minus) Rock size to be 80% - 90% 100 mm - 300 mm and with no rock greater than 300 mm dia.
- .2 Gravel fill will consist of hard, durable, particles of stone mixed with suitable binding material. It shall be free from flat, elongated particles and shall be well graded. When tested by means of laboratory sieves it shall fulfill requirements as follows:

Sieve size	% by Weight Passing
56 mm	100
16 mm	45-80
4.75 mm	25-55
1.25 mm	10-35
0.300 mm	5-15
0.075 mm	3-8

- .3 Use of shale rock or slate will not be permitted.

PART 3 - EXECUTION

3.1 PREPARATION

- .1 Excavate in accordance with Section 31 23 33.01 - Excavation, Trenching and Backfilling area where rock fill is to be placed to elevation as indicated.
- .2 Visually inspect substrate in presence of Departmental Representative.
- .3 Inform Departmental Representative of unacceptable conditions immediately upon discovery.
- .4 Proceed with installation only after unacceptable conditions have been remedied and after receipt of written approval to proceed from Departmental Representative.

3.2 PLACEMENT

- .1 Ensure that no frozen material is used in placing.
- .2 Do not place rock fill material until bottom area has been reviewed by Departmental Representative.
- .3 Place rock fill materials to dimensions as indicated.
- .4 Prevent segregation in placing of material sizes.
- .5 Do not place material during weather judged unsuitable by Departmental Representative.
- .6 Level top surface of rockfill to specified grade.
 - .1 Use excavation bucket as screed to level surface of each layer.
 - .2 Other methods of levelling may be employed subject to review of Departmental Representative.

3.3 PLACING GRAVEL FILL.1

Top 300 mm of fill will consist of gravel fill as specified in Clause 2.2.1 of this section.

.2

Place gravel fill in two (2) equal lifts to minimum 95% standard proctor density.

3.4 TOLERANCES

.1

Surface of rockfill to be parallel with elevation as indicated with mean elevation of surface within 50 mm of elevations as indicated.

PART 1 - GENERAL

1.1 SECTION
INCLUDES

- .1 Materials and installation of polymeric geotextiles used in retaining wall structures, filtration, and drainage structures, purpose of which is to:
 - .1 Separate and prevent mixing of granular materials of different grading.
 - .2 Act as hydraulic filters permitting passage of water while retaining soil strength of granular structure.

1.2 RELATED WORK

- .1 Section 01 33 00 - Submittal Procedures.
- .2 Section 01 74 21 - Construction/Demolition Waste Management and Disposal.

1.3 REFERENCES

- .1 ASTM Society for Testing and Materials (ASTM)
 - .1 ASTM D4491-99a(2004)e1, Standard Test Methods for Water Permeability of Geotextiles by Permittivity.
 - .2 ASTM D 4595-05, Standard Test Method for Tensile Properties of Geotextiles by the Wide-Width Strip Method.
 - .3 ASTM D 4716-04, Standard Test Method for Determining the (In-Plane) Flow Rate Per Unit Width and Hydraulic Transmissivity of a Geosynthetic Using a Constant Head.
 - .4 ASTM D 4751-04, Standard Test Method for Determining Apparent Opening Size of a Geotextile.
- .2 Canadian General Standards Board (CGSB)
 - .1 CAN/CGSB-4.2-M88, Textile Test Methods.
 - .2 CAN/CGSB-148.1, Methods of Testing Geotextiles and Geomembranes.
 - .1 No.2-M85, Mass per Unit Area.
 - .2 No.3-M85, Thickness of Geotextiles.
 - .3 No.7.3-92, Grab Tensile Test for

Geotextiles.

.4 No. 6.1-93, Bursting Strength of Geotextiles Under No Compressive Load.

- .3 Canadian Standards Association (CSA)
.1 CAN/CSA-G40.20-04/G40.21-04, General Requirements for Rolled or Welded Structural Quality Steel.
.2 CAN/CSA-G164-M92(R2003), Hot Dip Galvanizing of Irregularly Shaped Articles.

1.4 SAMPLES

- .1 Submit samples in accordance with Section 01 33 00 - Submittal Procedures.
.2 Submit to Departmental Representative the following samples at least 2 weeks prior to commencing work.
.1 Minimum length of 1 m of roll width of geotextile.

1.5 MILL
CERTIFICATES

- .1 Submit to Departmental Representative a copy of mill test data and certificate at least 2 weeks prior to start of work.

1.6 DELIVERY AND
STORAGE

- .1 During delivery and storage, protect geotextiles from direct sunlight, ultraviolet rays, excessive heat, mud, dirt, dust, debris and rodents.

1.7 WASTE
MANAGEMENT AND
DISPOSAL

- .1 Separate waste materials for reuse and recycling in accordance with Section 01 74 21 - Construction/Demolition Waste Management and Disposal.
.2 Remove from site and dispose of all packaging materials at appropriate recycling facilities.
.3 Collect and separate for disposal paper, plastic, polystyrene, corrugated cardboard,

and packaging material, in appropriate on-site bins, for recycling in accordance with Waste Management Plan.

- .4 Fold up metal banding, flatten and place in designated area for recycling.

1.8 MEASUREMENT FOR PAYMENT

- .1 Geotextiles: Measurement for payment to be made under this section will be measured by the square metre (m²). Include cost in unit price of all plant, labour, equipment required to complete the work as specified.

PART 2 - PRODUCTS

2.1 MATERIAL

- .1 Non-woven, mechanically bounded, needle punched polyester membrane, suitable for use in seawater environment, with the following material properties:
 - .1 4.7 mm thickness (CAN-148.1, No. 3)
 - .2 1180 N tensile strength (ASTM D4595)
 - .3 530 N Tear propagation (CAN-12.2)
 - .4 3850 Kpa Burst (Mullen) (CAN-4.2 method 11.1)
- .2 Physical properties:
 - .1 Thickness: to CAN/CGSB-148.1, No.3, minimum 2.5 mm.
 - .2 Mass per unit area: to CAN/CGSB-148.1, No.2, minimum 400 g/m².
 - .3 Tensile strength and elongation (in any principal direction): to ASTM D4595.
 - .1 Tensile strength: minimum 1180 N, wet condition.
 - .2 Elongation at break: 50 to 100 percent.
 - .3 Seam strength: equal to or greater than tensile strength of fabric.
 - .4 Mullen burst strength: to CAN/CGSB-4.2, method 11.1, minimum 3100 kPa.
- .3 Hydraulic properties:

- .1 Apparent opening size (AOS): to ASTM D4751, 50 to 150 micrometres.
- .2 Permittivity: to ASTM D4491, 0.25 cm per second.
- .4 Securing pins and washers: to CAN/CSA-G40.21, Grade 300W, hot-dipped galvanized with minimum zinc coating of 600 g/m² to CAN/CSA G164.

PART 3 - EXECUTION

3.1 INSTALLATION

- .1 Place one (1) layer of geotextile material as indicated on drawings.
- .2 Place geotextile material by unrolling onto graded surface in orientation, manner and locations indicated and retain in position with securing pins and washers.
- .3 Place geotextile material on sloping surfaces in one continuous length from toe of slope to upper extent of geotextile.
- .4 Place geotextile material smooth and free of tension stress, folds, wrinkles and creases.
- .5 Overlap each successive strip of geotextile 600 mm over previously laid strip.
- .6 Join successive strips of geotextile by sewing.
- .7 Pin successive strips of geotextile with securing pins at 300 mm interval at mid point of lap as indicated.
- .8 Protect installed geotextile material from displacement, damage or deterioration before, during and after placement of material layers.
- .9 After installation, cover with overlying layer within 4 hours of placement.
- .10 Replace damaged or deteriorated geotextile to approval of Departmental Representative.

3.2 CLEANING

.1

Remove construction debris from Project site and dispose of debris in an environmentally responsible and legal manner.

PART 1 - GENERAL

1.1 DESCRIPTION

- .1 This section specifies requirements for supply and installation of structural timber as follows:
 - .1 Supply and installation of treated dimension timber wheelguard, wheelguard blocking, coping, horizontal timber beams, wales, wale splice blocking, cross bracing, sleepers, pile cap blocking and associated painting.
 - .2 Supply and installation untreated dimension hardwood timber fenders, and associated painting.
 - .3 Supply and installation treated decking plywood.
 - .4 Supply and installation of untreated timber hardwood ladders, hardware, and associated painting.

1.2 RELATED WORK

- .1 Section 02 41 16 - Sitework, Demolition and Removal.
- .2 Section 03 30 00 - Cast-in-Place Concrete.
- .3 Section 06 05 73 - Wood Treatment.

1.3 REFERENCES

- .1 American Society for Testing and Materials (ASTM International)
 - .1 ASTM A307-10, Specification for Carbon Steel Bolts and Studs, 60,000 PSI Tensile.
 - .2 ASTM-A123/A123M-09, Standard Specification for Zinc (Hot Dip Galvanized) Coatings on Iron and Steel Products.
- .2 American Wood-Preserver's Association (AWPA)
 - .1 AWPA M4-08, Standard for the Care of Preservation - Treated Wood Products.
- .3 Canadian Standards Association (CSA International)
 - .1 CSA B111-1974(R2003), Wire Nails,

Spikes and Staples.

.2 CAN/CSA-G40.21-04 (R2009), General Requirements for Rolled or Welded Structural Quality Steel/Structural Steel.

.3 CAN/CSA G164-M92 (R2003), Hot Dip Galvanizing of Irregularly Shaped Articles.

.4 CAN/CSA-080 Series-08, Wood Preservation.

.4 Canadian Wood Council

.1 Wood Design Manual.

.5 National Lumber Grades Authority (NLGA)

.1 Standard Grading Rules for Canadian Lumber 2003 edition.

1.4 DIMENSIONS

.1 Check existing site dimensions and report discrepancies to Departmental Representative before commencing work.

1.5 PROTECTION

.1 Avoid dropping, bruising or breaking of wood fibres.

.2 Avoid breaking surfaces of treated timber.

.3 Do not damage surfaces of treated timber by boring holes or driving nails or spikes into them to support temporary material or staging.

.4 Treat cuts, breaks or abrasions on surfaces of treated timber with 3 brush coats of preservative to CSA 080.

.5 Treat bolt holes, cutoffs and field cuts in accordance with CSA 080.

1.6 DELIVERY AND STORAGE

.1 Store timber horizontally, evenly supported and open piled permit circulation when stored for prolonged period.

.2 When handling long timber, provide support at sufficient number of points, properly located to prevent damage due to excessive bending.

- .3 Handle treated timber with hemp, manila or sisal rope slings or other approved means of support that will not damage surface.
- .4 Do not use sharp pointed tools to handle treated timber. Any timber so handled will be rejected and be replaced at Contractor's expense.

1.7 MEASUREMENT FOR
PAYMENT

- .1 Structural Timber (Supply and Install):
 - .1 Treated Dimension Timber: The supply and installation of treated dimension timber for wheelguard, wheelguard blocking, coping, horizontal beams, wales, wale splice blocking, sleepers, pile cap blocking, and cross bracing, and plywood will be measured by the cubic metre (m³) of timber secured in place, including all timber, fastenings, plant, material, equipment, labour, fasteners, levelling, sealant, painting of wheelguard and wheelguard blocking, and installation of new mooring rings.
 - .2 Untreated Dimension Hardwood Timber: The supply and installation of untreated dimension hardwood timber for hardwood fenders, as specified will be measured by the cubic metre (m³) of timber secured in place including all timber, fastenings, plant, material, equipment, and labour.
 - .3 Ladders - (Untreated): The supply and installation of untreated ladders as a unit will be measured by the unit secured in place. Contractor will provide all timber, fastenings, plant, material, equipment, and labour, including untreated timber hardwood ladder uprights, ladder rungs, ladder handgrips, and painting of ladder uprights.

PART 2 - PRODUCTS

2.1 TIMBER
MATERIALS

- .1 Timber: Use timber graded and stamped in accordance with applicable grading rules and standards of associations or agencies approved to grade lumber by Canadian Lumber Standards Administration Board of CSA.

- .2 Species
 - .1 Wheelguard, wheelguard blocks, coping, horizontal beams, wales, wale splice blocks, sleepers, pile cap blocking, cross bracing: Hemlock or Douglas Fir (CCA or ACA treated).
 - .2 Hardwood fenders, and ladder uprights: Birch or Maple untreated.
- .3 Grade: No. 1 Structural Grade
- .4 Grading Authority: NLGA
- .5 Preservative Treatment: Treat to CSA 080, for coastal waters and Section 06 05 73 - Wood Treatment. Timbers will be treated in the lengths required. Unnecessary field cutting will not be permitted.
- .6 Primer: Alkyd undercoat, exterior oil wood primer, similar to Pittsburgh 6-9.
- .7 Paint: Alkyd/Oil Resin paint similar to Pittsburgh Paints "Safety Yellow" Product ID 7-808. Paint to conform to CAN/CGSB-1.61-2004.

2.2 MISCELLANEOUS
STEEL AND
FASTENINGS

- .1 Miscellaneous Steel: All steel and fastenings to be CSA G40.21, Grade 300 W, galvanized.
- .2 Nails and Spikes: to CSA B111.
- .3 Machine Bolts and Nuts: to ASTM A307. All machine bolts and nuts to be galvanized.
- .4 Drift Bolts: to G40.21 from round stock button head and diamond or wedge point. All drift bolts to be galvanized.
- .5 Washers:
 - .1 Round Plate Washers: for 16 mm machine bolts will be 76 mm diameter by 6.4 mm thick, for 19 mm machine bolts will be 79 mm diameter by 7.9 mm thick and have a hole diameter of 18 mm and 21 mm diameter respectively. Washers to conform to G40.21. All washers to be galvanized.
 - .2 Plain Washers: to CSA B19.1, Class 2. All washers to be galvanized.

- .3 Square washers are not permitted.
- .6 Galvanizing: will conform to ASTM-A123/A123M-09, Standard Specification for Zinc (Hot Dip Galvanized) Coatings on Iron and Steel Products.
- .7 Ladder Rungs and Hand Grips: to CSA G40.21, galvanized.
- .8 Welding in accordance with CSA Standards. The welders will be qualified to the appropriate classification as stated in CSA W47.1-09 "Certification of Companies for Fusion Welding of Steel Structures." Conform welding to all appropriate requirements and recommendations of CSA Standard W59-03 (R2008) "Welded Steel Construction" (metal arc welding).

2.3 ANCHOR BOLTING SYSTEM

- .1 Anchor bolts, where required, for anchoring coping and/or wheelguard to existing concrete deck will be 19 mm diameter resin cartridge anchors.
- .2 Submit shop drawings and manufacturer's specification for anchor bolts for approval.
- .3 Anchor bolts to be installed with strict adherence to manufacture specifications.

PART 3 - EXECUTION

3.1 PREPARATION

- .1 Install structural timbers to details shown on drawings or as specified.

3.2 WHEELGUARD AND WHEELGUARD BLOCKING

- .1 Wheelguard timbers to be 200 mm x 200 mm, and will be in minimum lengths of 6100 mm or as specially required with butt joints made over wheelguard blocking. Wheelguard timbers to be chamfered on top, 25 mm on each horizontal and vertical surface.

- .2 Wheelguard blocks will be installed at 1500 mm on centre as support for wheelguard.
- .3 Wheelguard will be secured through wheelguard, wheelguard blocking, coping and exterior beam below with two (2) 25 mm diameter machine bolts per blocking location as shown on detail drawings.
- .4 The installation of wheelguard and wheelguard blocking as per detail.

3.3 COPING

- .1 Install 200 mm x 150 mm treated timber coping in minimum length of 7620 mm as shown on drawings.
- .2 Secure coping to wood beam with 16 mm diameter drift bolts spaced at 900 mm on centre and to concrete deck with 19 mm diameter by 600 mm long machine bolts spaced at 1500 mm on centre. The machine bolts will be countersunk on the exterior face; the nut installed on the outside and each bolt equipped with 2 washers.

3.4 BEAMS

- .1 Exterior beam splice block to be 200 x 200 x 1200 mm. Secure beam to pilecap with 19 mm dia. galvanized bolts c/w washers and nuts as indicated on drawings.
- .2 Exterior beam to be 200 mm x 300 mm. Install timber beams as shown on the drawings or as indicated.
- .3 Exterior beams will be of minimum length of 6100 mm, except where especially required.
- .4 Exterior beams will be bolted as per drawing.

3.5 WALES, WALE SPLICE BLOCKING

- .1 Wales to be 200 x 200 mm and in minimum lengths of 6100 mm except where especially required. Wales to be butt joined between pile bents. Wale splice blocks to be installed as shown

on drawings. Wales to be attached to timber piles with 19 mm diameter machine bolts. Contractor to provide necessary treated levelling shims to ensure straight wharf face. All machine bolts to be countersunk. All countersinking to be drilled.

3.6 CROSS BRACING

- .1 Cross bracing will be 100 mm x 200 mm and supplied in lengths required/specified. Cross bracing will be installed diagonal or horizontal on both sides of timber piles and span across at least three (3) piles. Cross bracing to be attached to timber pile with 25 mm diameter machine bolt as indicated on drawings. Length as required.

3.7 FENDERS

- .1 Horizontal Fender:
- .1 Install hardwood timber fenders in minimum length of 4880 mm along top perimeter of wharf. Stagger joints in coping from joints in horizontal fender.
 - .2 Top horizontal fender to be chamfered 25 mm on top seaward face.
 - .3 Secure horizontal fender to coping with 16 mm diameter lag screws, minimum of four (4) each lag screws per fender, spaced at 1500 mm on centre. All lag screws to be countersunk on the exterior face.
- .2 Vertical Fenders:
- .1 Install hardwood timber fenders closed faced along face of wharf including exterior corners as directed.
 - .2 Secure each fender with four (4) each 16 mm diameter lag screws at horizontal timber all member locations. Lag screws to be countersunk.
 - .3 All fenders to extend from underside of horizontal fender to 300 mm below LNT.
 - .4 Do not notch or cut fenders to provide straight wharf face. Continuous blocking will be installed behind fenders and chocks to provide straight face.
 - .5 Fenders to be supplied in dimensions required to match existing and will range in size from 100 mm x 150 mm to 150 mm x 150 mm or as directed on drawings.

3.8 LADDERS

- .1 Install ladders on face of wharf in locations shown on drawings or designated by Departmental Representative.
- .2 Ladder uprights to be 150 mm x 150 mm and installed from 900 mm below LNT to wheelguard elevation. Uprights to be bevelled at 45° on top and painted as specified.
- .3 Construction details and steel handgrips as per detail.
- .4 Secure each upright with four (4) each evenly spaced 19 mm diameter galvanized lag screws. All lag screws to be countersunk.

3.9 SLEEPER

- .1 Supply and install pressure treated 150 mm x 50 mm sleepers as shown on drawings.
- .2 Secure to existing 125 mm x 250 mm beams with 100 mm hot dipped galvanized nails, spaced at 300 mm c/c staggered pattern or as directed by engineer.

3.10 PLYWOOD

- .1 Supply and install pressure treated 19 mm exterior grade plywood sheathing as shown on drawings.
- .2 Secure plywood to sleepers with 50 mm decking screws at 300 mm c/c.

3.11 PAINTING

- .1 Paint four (4) sides and exposed ends of wheelguard, exposed sides of wheelguard blocking, and complete ladder uprights as directed by the Departmental Representative.
- .2 Use one (1) coat of exterior oil wood primer and two (2) coats of alkyd/oil resin paint as specified. Paint materials for each coat to be product of a single manufacturer as specified. Ensure previous coat of primer or

paint is dry before second coat is applied.

- .3 If, for any reason, one coat of primer and two coats of paint does not satisfy the Departmental Representative, the Departmental Representative will request additional coats of paint be applied.

3.12 BOLT SIZING

- .1 Drift Bolts: Drift bolts used in the work will have a length equal to thickness of timbers being fastened less 50 mm unless otherwise specified. Holes for drift bolts will be bored 2 mm smaller diameter than size of steel used and for full length of bolts.
- .2 Machine Bolts: Machine bolts used in work will have a length equal to thickness of timbers being fastened plus thickness of washers plus 40 mm. Where bolts are countersunk, the length will be as above less depth of countersinking. Machine bolts will be threaded for 64 mm. Holes will be drilled same diameter as bolt.
- .3 Lag Screws: All lag screws used in the work will have a length equal to thickness of timbers being fastened less 50 mm and depth of countersinking. Holes for lag screws to be drilled same diameter as shank portion of screw and to inside thread diameter for threaded portion of screw and for full length. All lag screws will be countersunk, screwed, not driven in place, and will have one (1) standard washer under the head.
- .4 Countersink drift bolts and/or lag screws in hardwood fenders, chocks, ladders, and slipway runners to the extent that the minimum distance from face of timber to head of bolt is 12 mm.
- .5 Bolting of timbers without properly drilled bolt holes will not be accepted.

PART 1 - GENERAL

1.1 RELATED
SECTIONS

- .1 Section 01 45 00 - Quality Control.
- .2 Section 01 74 21 - Construction/Demolition Waste Management and Disposal.
- .3 Section 31 05 17 - Aggregate Materials.
- .4 Section 32 12 16 - Asphalt Paving.

1.2 MEASUREMENT
PROCEDURES

- .1 Type 1 Granular Base: will be measured in cubic metres (m³). Supply, placement and compaction of Type 1 granular base including the cost of all plant, labour, equipment and materials required to complete the work as specified.
- .2 Type 2 Granular Sub Base: will be measured in cubic meters (m³). Supply, placement and compaction of Type 2 granular sub base including the cost of all plant, labour, equipment and materials required to complete the work as specified.

1.3 REFERENCES

- .1 American Society for Testing and Materials (ASTM)
 - .1 ASTM C117-13, Standard Test Method for Material Finer Than 0.075 mm Sieve in Mineral Aggregates by Washing.
 - .2 ASTM C131-06, Standard Test Method for Resistance to Degradation of Small-Size Coarse Aggregate by Abrasion and Impact in the Los Angeles Machine.
 - .3 ASTM C117-06, Standard Test Method for Sieve Analysis of Fine and Coarse Aggregate.
 - .4 ASTM D698, Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Standard Effort (12,400ft-lbf/ft³)

(600kN-m/m³).

.5 ASTM D1557, Test Method for Laboratory Compaction Characteristics of Soil Using Modified Effort (56,000ft-lbf/ft³) (2,700kN-m/m³).

.6 ASTM D1883, Standard Test Method for CBR (California Bearing Ratio) of Laboratory Compacted Soil.

.7 ASTM D4318, Standard Test Methods for Liquid Limit, Plastic Limit and Plasticity Index of Soils.

.2 Canadian General Standards Board (CGSB)

.1 CAN/CGSB-8.1-88, Sieves, Testing, Woven Wire, Inch Series.

.2 CAN/CGSB-8.2-M88, Sieves, Testing, Woven Wire, Metric.

1.4 DELIVERY,
STORAGE AND
HANDLING

.1 Deliver and stockpile aggregates in accordance with Section 31 05 17 - Aggregate Materials. Stockpile minimum 50% of total aggregate required prior to beginning operation.

.2 Divert unused granular material from landfill to local facility as approved by Departmental Representative.

PART 2 - PRODUCTS

2.1 MATERIALS

.1 Type 1 Granular Base: Material to the following requirements:

.1 Granulations to be within following limits when tested to ASTM C136-84a and ASTM C117-87. The gradings shall not show marked fluctuations from opposite extremes of the limiting sizes, and giving a smooth curve without sharp breaks when plotted on a semi-log grading chart to ASTM.

<u>ASTM Sieve Designation</u>	<u>% Passing</u>
19.0 mm	100
12.5 mm	70-100
9.5 mm	-
4.75 mm	40-70

2.00 mm	23-50
0.425 mm	7-25
0.180 mm	-
0.075 mm	3-8

.2 Type 2 Granular Sub-Base Material to the following requirements:

.1 Gradation to be within following limits when tested to ASTM C136-82 and ASTM C117-80. The gradings shall not show marked fluctuations from opposite extremes of the limiting sizes, having a smooth curve without sharp breaks when plotted on a semi-log grading chart to ASTM E11-87.

<u>ASTM Sieve Designation</u>	<u>%Passing</u>
15.9 mm	45-80
4.76 mm	25-55
1.20 mm	12-35
0.300 mm	7-20
0.075 mm	3-6 (Pit Source) 3-8 (Rock Source)

.2 Other properties as follows:

.1 Liquid Limit ASTM D423-66 (1972) Maximum 25.

.2 Plasticity Index ASTM D424-59 (1971) Maximum 0.

.3 Los Angeles Abrasion ASTM C131-81 Maximum % Loss by Weight: 35.

.4 Crushed fragments: 50%. The percent of crushed particles will be determined by examining the fraction retained on the 4.76 mm sieve and dividing the weight of the crushed particles by the total weight retained on the 4.76 mm sieve.

.5 CBR: AASHTO T180-74 Method D.

.3 Other properties as follows:

.1 Liquid Limit: to ASTM D4318 (1972) maximum 25.

.2 Plasticity Index: to ASTM D4318-59 (1971) maximum 0.

.3 Los Angeles Abrasion: to ASTM C131-06. Maximum % loss by weight: 35.

.4 Crushed Fragments: 50%. The percent of crushed particles will be determined by examining the fraction retained on the 4.76 mm sieve and dividing the weight of the crushed particles by the total weight retained on the 4.76 mm sieve.

.5 CBR: AASSHTO T 193-10 (2010) Min 100 when compacted to 100% of AASSHTO T 180-10 Method D.

PART 3 - EXECUTION

3.1 SEQUENCE OF
OPERATIONS

- .1 Place granular base after common backfill is inspected and approved by Departmental Representative.
- .2 Placing
 - .1 Construct granular base to depth and grade in areas indicated.
 - .2 Ensure no frozen material is placed.
 - .3 Place material only on clean unfrozen surface, free from snow and ice.
 - .4 Place material to full width in uniform layers not exceeding 150mm compacted thickness. Department Representative may authorize thicker lifts (layers) if specified compaction can be achieved.
 - .5 Shape to smooth contour and compact to specified density before succeeding layer is placed.
 - .6 Remove and replace that portion of layer in which material becomes segregated during spreading.
- .3 Compaction Equipment
 - .1 Compaction equipment to be capable of obtaining required material densities.
- .4 Compacting
 - .1 Compact to density not less than 100% corrected maximum dry density ASTM D698.
 - .2 Shape and roll alternately to obtain smooth, even and uniformly compacted base.
 - .3 Apply water as necessary during compacting to obtain specified density.
 - .4 In areas not accessible to rolling equipment, compact to specified density with mechanical tampers approved by Department Representative.

3.2 SITE TOLERANCES

- .1 Finished base surface to be within plus or minus 10 mm of established grade and cross section but

not uniformly high or low.

3.3 PROTECTION

- 1.1 Maintain finished base in condition conforming to this Section until succeeding material is applied or until acceptance by Departmental Representative.

- .3 Flat transfer plates of glass or metal. Keep one plate under each specimen during immersion period and during subsequent handling, except when weighing and testing, to prevent breakage or distortion of specimens.
- .4 Apparatus required to conduct Marshall test.

PART 3 - EXECUTION

3.1 PREPARATION OF TEST SPECIMENS

- .1 Prepare at least 8 specimens for each test with hand-operated hammer, in accordance with AASHTO T245, except where specified otherwise.

3.2 TEST PROCEDURE

- .1 Do Marshall testing in accordance with AASHTO T245, except where specified otherwise.
- .2 Weigh each specimen in air and in water. Weigh in water as rapidly as possible to minimize absorption.
- .3 Calculate specific gravity of each specimen as follows:
 - .1 Specific Gravity = $A / (A - B)$
 - .2 Where A = weight of specimen in air in grams
 - .3 B = weight of specimen in water in grams
- .4 Sort each set of 8 specimens into 2 groups of 4 specimens each so that average specific gravity of specimens in group 1 is essentially same as that of group 2.
- .5 Test group 1 specimens for Marshall stability. Calculate S1 = Marshall stability of group 1 (average).
- .6 Immerse group 2 specimens in water for 24 h at 60°C, then test immediately for Marshall stability. Calculate S2 = Marshall stability of group 2 (average).

3.3 TEST REPORT

- .1 Report test results to Departmental Representative.
- .2 Report numerical index of retained stability as resistance of asphaltic paving mixtures to detrimental effect of water, expressed as percentage of original stability retained after immersion period.
- .3 Calculate index as follows:
 - .1 Index of Retained Stability = $S_2 / S_1 \times 100$.

PART 1 - GENERAL

1.1 SECTION
INCLUDES

- .1 Materials and installation for asphalt paving.

1.2 RELATED
SECTIONS

- .1 Section 01 29 83 - Payment Procedures for Testing Laboratory Services.
- .2 Section 01 33 00 - Submittal Procedures.
- .3 Section 01 35 28 - Health and Safety Requirements.
- .4 Section 31 05 16 - Aggregate Materials.
- .5 Section 32 12 10 - Marshall Immersion Test for Bitumen.

1.3 REFERENCES

- .1 American Association of State Highway and Transportation Officials (AASHTO)
 - .1 AASHTO M320-02, Standard Specification for Performance Graded Asphalt Binder.
 - .2 AASHTO R29-02, Standard Specification for Grading or Verifying the Performance Graded of an Asphalt Binder.
 - .3 AASHTO T245-97(2001), Resistance to Plastic flow of Bituminous Mixtures Using Marshall Apparatus.
- .2 Asphalt Institute (AI)
 - .1 AI MS2-1994 Sixth Edition, Mix Design Methods for Asphalt Concrete and Other Hot-Mix Types.
- .3 American Society for Testing and Materials International, (ASTM)
 - .1 ASTM C 88-05, Standard Test Method for Soundness of Aggregates by Use of Sodium

- Sulphate or Magnesium Sulphate.
- .2 ASTM C117-04, Standard Test Method for Material Finer Than 0.075mm (No.200) Sieve in Mineral Aggregates by Washing.
- .3 ASTM C123-04, Standard Test Method for Lightweight Particles in Aggregate.
- .4 ASTM C127-07, Standard Test Method for Specific Gravity and Absorption of Coarse Aggregate.
- .5 ASTM C128-07a, Standard Test Method for Density, Relative Density (Specific Gravity), and Absorption of Fine Aggregate.
- .6 ASTM C131-06, Standard Test Method for Resistance to Degradation of Small-Size Coarse Aggregate by Abrasion and Impact in the Los Angeles Machine.
- .7 ASTM C 136-06, Standard Method for Sieve Analysis of Fine and Coarse Aggregates.
- .8 ASTM C207-06, Standard Specification for Hydrated Lime for Masonry Purposes.
- .9 ASTM D995-95b(2002), Standard Specification for Mixing Plants for Hot-Mixed, Hot-Laid Bituminous Paving Mixtures.
- .10 ASTM D2419-02, Standard Test Method for Sand Equivalent Value of Soils and Fine Aggregate.
- .11 ASTM D3203-05, Standard Test Method for Percent Air Voids in Compacted Dense and Open Bituminous Paving Mixtures.
- .12 ASTM D4791-05e1, Standard Test Method for Flat Particles, Elongated Particles, or Flat and Elongated Particles in Coarse Aggregate.
- .4 Canadian General Standards Board (CGSB)
 - .1 CAN/CGSB-8.1-M88, Sieves Testing, Woven Wire, Metric.
 - .2 CAN/CGSB-16.3-M90, Asphalt Cements for Road Purposes.

1.4 PRODUCT DATA

- .1 Submittals in accordance with Section 01 33 00 - Submittal Procedures.
- .2 Submit viscosity-temperature chart for asphalt cement to be supplied showing either

Saybolt Furol viscosity in seconds or Kinematic Viscosity in centistokes, temperature range 105 to 175 degrees C at least 2 weeks prior to beginning Work.

- .3 Submit manufacturer's test data and certification that asphalt cement meets requirements of this Section.
- .4 Submit asphalt concrete mix design and trial mix test results to Departmental Representative for review at least 2 weeks prior to beginning Work.

1.5 SAMPLES

- .1 Submit samples in accordance with Section 01 33 00 - Submittal Procedures.
- .2 Inform Departmental Representative of proposed source of aggregates and provide access for sampling at least 2 weeks prior to beginning Work.
- .3 Submit samples of following materials proposed for use at least 2 weeks prior to beginning Work.
 - .1 One 5 L container of asphalt cement.
- .4 If materials have been tested by an independent testing laboratory within previous 6 months and have successfully passed tests equal to requirements of this specification, disregard above instructions and submit test certificates from testing laboratory showing suitability of materials for this project.

1.6 DELIVERY,
STORAGE AND
HANDLING

- .1 Deliver and stockpile aggregates in accordance with Section 31 05 16 - Aggregate Materials. Stockpile minimum 50% of total amount of aggregate required before beginning asphalt mixing operation.
- .2 When necessary to blend aggregates from one or more sources to produce required gradation, do not blend in stockpiles.

- .3 Stockpile fine aggregate separately from coarse aggregate, although separate stockpiles for more than two mix components are permitted.
- .4 Provide approved storage, heating tanks and pumping facilities for asphalt cement.

1.7 WASTE
MANAGEMENT AND
DISPOSAL

- .1 Separate waste materials for reuse and recycling in accordance with Section 01 74 19 - Construction/Demolition Waste Management And Disposal.
- .2 Remove from site and dispose of all packaging materials at appropriate recycling facilities.
- .3 Collect and separate for disposal paper, plastic, polystyrene, corrugated cardboard and packaging material in appropriate on-site bins for recycling in accordance with Waste Management Plan.
- .4 Divert unused aggregate materials from landfill to quarry, facility for reuse as approved by Departmental Representative.
- .5 Divert unused asphalt from landfill to facility capable of recycling materials.
- .6 Fold up metal banding, flatten and place in designated area for recycling.

1.8 MEASUREMENT FOR
PAYMENT

- .1 Asphalt Paving: (65 mm) Surface Course will be measured by the square metre (m²) of compacted surface coarse asphalt installed in the work within the limits indicated on the drawings.
- .2 No separate payment will be made for any other ingredient or feature of the work and all factors, including asphalt, aggregates, saw cutting, tack coat, excavation and reshaping of existing granular material, compaction and all plant, labour and materials is

inclusive in the above price.

PART 2 - PRODUCTS

2.1 MATERIALS

- .1 Performance graded asphalt cement: to AASHTO M320, grade PG 58 - 28 when tested to AASHTO R29.
- .2 Aggregates: in accordance with Section 31 05 16 - Aggregate Materials: General and following requirements:
 - .1 Crushed stone or gravel.
 - .2 Gradations: within limits specified when tested to ASTM C 136 and ASTM C 117. Sieve sizes to CAN/CGSB-8.2.
 - .3 Table

Sieve Designation	% Passing		
	Lower Course	Surface Course	Sheet Asphalt
200 mm	-	-	-
75 mm	-	-	-
50 mm	-	-	-
38.1 mm	-	-	-
25 mm	100	-	-
19 mm	-	-	-
12.5 mm	70-85	100	-
9.5 mm	-	-	100
4.75 mm	40-65	55-75	85-100
2.00 mm	30-50	35-55	80-95
0.425 mm	15-30	15-30	40-70
0.180 mm	5-20	5-20	10-35
0.075 mm	3-8	3-8	4-14

- .4 Coarse aggregate: aggregate retained on 4.75 mm sieve and fine aggregate is aggregate passing 4.75 mm sieve when tested to ASTM C 136.
- .5 When dryer drum plant or plant without hot screening is used, process fine aggregate through 4.75 mm sieve and stockpile separately from coarse aggregate.
- .6 Do not use aggregates having known polishing characteristics in mixes for surface courses.
- .7 Sand equivalent: ASTM D 2419. Min: 50.
- .8 Magnesium Sulphate soundness: to

- ASTM C 88. Max % loss by mass:
- .1 Coarse aggregate surface course: 12%.
 - .2 Coarse aggregate lower course: 12%.
 - .3 Fine aggregate, surface course: 16%.
 - .4 Fine aggregate, lower course: 16%.
- .9 Los Angeles degradation: Grading B, to ASTM C131. Max % loss by mass:
- .1 Coarse aggregate, surface course: 25%.
 - .2 Coarse aggregate, lower course: 35%.
- .10 Absorption: to ASTM C 127. Max % by mass:
- .1 Coarse aggregate, surface course: 1.75%.
 - .2 Coarse aggregate, lower course: 2.00%.
- .11 Loss by washing: to ASTM C 117. Max % passing 0.075 mm sieve:
- .1 Coarse aggregate, surface course: 1.5.
 - .2 Coarse aggregate, lower course: 2.0.
- .12 Lightweight particles: to ASTM C 123. Max % by mass less than 1.95 relative density:
- .1 Surface course: 1.5%.
 - .2 Lower course: 3.0%.
- .13 Flat and elongated particles: to ASTM D 4791, (with length to thickness ratio greater than 5): Max% by mass:
- .1 Coarse aggregate, surface course: 15%.
 - .2 Coarse aggregate, lower course: 15%.
- .14 Crushed fragments: at least 60% of particles by mass within each of following sieve designation ranges, to have at least 1 freshly fractured face. Material to be divided into ranges, using methods of ASTM C 136.

<u>Passing</u>		<u>Retained on</u>
25 mm	to	2.5 mm
12.5 mm	to	4.75 mm

- .15 Regardless of compliance with specified physical requirements, fine aggregates may

be accepted or rejected on basis of past field performance.

- .3 Mineral filler:
 - .1 Finely ground particles of limestone, hydrated lime, Portland cement or other approved non-plastic mineral matter, thoroughly dry and free from lumps.
 - .2 Add mineral filler when necessary to meet job mix aggregate gradation or as directed to improve mix properties.
 - .3 Mineral filler to be dry and free flowing when added to aggregate.

2.2 EQUIPMENT

- .1 Pavers: mechanical grade controlled self-powered pavers capable of spreading mix within specified tolerances, true to line, grade and crown indicated.
- .2 Rollers: sufficient number of type and weight to obtain specified density of compacted mix.
- .3 Vibratory rollers:
 - .1 Minimum drum diameter: 1200 mm.
 - .2 Maximum amplitude of vibration (machine setting): 0.5 mm for lifts less than 40 mm thick.
- .4 Haul trucks: sufficient number and of adequate size, speed and condition to ensure orderly and continuous operation and as follows:
 - .1 Boxes with tight metal bottoms.
 - .2 Covers of sufficient size and weight to completely cover and protect asphalt mix when truck fully loaded.
 - .3 In cool weather or for long hauls, insulate entire contact area of each truck box.
- .5 Hand tools:
 - .1 Lutes or rakes with covered teeth for spreading and finishing operations.
 - .2 Tamping irons having mass not less than 12 kg and bearing area not exceeding 310 cm² for compacting material along curbs, gutters and other structures inaccessible to roller. Mechanical compaction equipment, when approved by Departmental Representative, may

be used instead of tamping irons.
.3 Straight edges, 4.5 m in length, to test finished surface.

2.3 MIX DESIGN

- .1 Mix design to be provided approved by Departmental Representative.
- .2 Mix design to be developed by testing laboratory approved by Departmental Representative.
- .3 Design of mix: by Marshall method to requirements below.
 - .1 Compaction blows on each face of test specimens: 75.
 - .2 Mix physical requirements:

<u>Property</u>	<u>Roads</u>
Marshall stability at 60°C kN min	5.5 surface course 4.5 lower course
Flow Value mm	2-4
Air Voids in Mixture, %	3-5 surface course 2-6 lower course
Voids in Mineral Aggregate, % min	15 surface course 13 lower course
Index of Retained Stability % minimum	75

.3 Measure physical requirements as follows:

- .1 Marshall load and flow value: to AASHTO T245.
- .2 Compute void properties on basis of bulk specific gravity of aggregate to ASTM C 127 and ASTM C 128. Make allowance for volume of asphalt absorbed into pores of aggregate.
- .3 Air voids: to ASTM D 3203.
- .4 Voids in mineral aggregates: to AI MS2, chapter 4.
- .5 Index of Retained Stability: measure in accordance with Section

32 12 10 - Marshall Immersion Test for Bitumen.

.4 Do not change job-mix without prior approval of Departmental Representative. When change in material source proposed, new job-mix formula will be provided to be approved by Departmental Representative.

.5 Return plant dust collected during processing to mix in quantities acceptable to Departmental Representative.

PART 3 - EXECUTION

3.1 PLANT AND MIXING REQUIREMENTS

- .1 Batch and continuous mixing plants:
 - .1 To ASTM D 995.
 - .2 Feed aggregates from individual stockpiles through separate bins to cold elevator feeders. Do not load frozen materials into bins.
 - .3 Feed cold aggregates to plant in proportions to ensure continuous operations.
 - .4 Calibrate bin gate openings and conveyor speeds to ensure mix proportions are achieved.
 - .5 Before mixing, dry aggregates to moisture content not greater than 1% by mass or to lesser moisture content if required to meet mix design requirements.
 - .6 Immediately after drying, screen aggregates into hot storage bins in sizes to permit recombining into gradation meeting job-mix requirements.
 - .7 Store hot screened aggregates in manner to minimize segregation and temperature loss.
 - .8 Heat asphalt cement and aggregate to mixing temperature directed by Departmental Representative. Do not heat asphalt cement above maximum temperature indicated on temperature-viscosity chart.
 - .9 Make available current asphalt cement viscosity data at plant. With information relative to viscosity of asphalt being used, Departmental Representative to approve review temperature of completed mix at plant and at paver after considering hauling and placing conditions.
 - .10 Maintain temperature of materials

within 5 degrees C of specified mix temperature during mixing.

.11 Mixing time:

.1 In batch plants, both dry and wet mixing times as directed by Departmental Representative. Continue wet mixing as long as necessary to obtain thoroughly blended mix but not less than 30s or more than 75s.

.2 In continuous mixing plants, mixing time as directed by Departmental Representative but not less than 45s.

.3 Do not alter mixing time unless directed by Departmental Representative.

.2 Dryer drum mixing plant:

.1 To ASTM D 995.

.2 Load aggregates from individual stockpiles to separate cold feed bins. Do not load frozen materials into bins.

.3 Feed aggregates to burner end of dryer drum by means of multi-bin cold feed unit and blend to meet job-mix requirements by adjustments of variable speed feed belts and gates on each bin.

.4 Meter total flow of aggregate by an electronic weigh belt system with indicator that can be monitored by plant operator and which is interlocked with asphalt pump so that proportions of aggregate, RAP and asphalt entering mixer remain constant.

.5 Provide for easy calibration of weighing systems for aggregates without having material enter mixer.

.6 Calibrate bin gate openings and conveyor speeds to ensure mix proportions are achieved. Calibrate weigh bridge on charging conveyor by weighing amount of aggregate passing over weigh bridge in set amount of time. Difference between this value and amount shown by plant computer system to differ by not more than plus or minus 2%.

.7 Make provision for conveniently sampling full flow of materials from cold feed.

.8 Provide screens or other suitable devices to reject oversize particles or lumps of aggregate from cold feed prior to entering drum.

.9 Provide system interlock stop on feed

components if either asphalt or aggregate from bin stops flowing.

.10 Accomplish heating and mixing of asphalt mix in approved parallel flow dryer-mixer in which aggregate enters drum at burner end and travels parallel to flame and exhaust gas stream. Control heating to prevent fracture of aggregate or excessive oxidation of asphalt. Equip system with automatic burner controls and provide for continuous temperature sensing of asphalt mixture at discharge, with printing recorder that can be monitored by plant operator. Submit printed record of mix temperatures at end of each day.

.11 Mixing period and temperature to produce uniform mixture in which particles are thoroughly coated, and moisture content of material as it leaves mixer to be less than 2%.

.3 Temporary storage of hot mix:

.1 Provide mix storage of sufficient capacity to permit continuous operation and designed to prevent segregation.

.2 Do not store asphalt mix in storage bins in excess of 3 hours.

.4 Mixing tolerances:

.1 Permissible variation in aggregate gradation from job mix (percent of total mass).

4.75 mm sieve and larger	
2.00 mm sieve	4.0
K	
0.425 mm sieve	3.0
K	
0.180 mm sieve	2.0
K	
0.075 mm sieve	1.0

.2 Permissible variation of asphalt cement from job mix: 0.25%.

.3 Permissible variation of mix temperature at discharge from plant: 5 degrees C.

3.2 PREPARATION

- .1 Preparation of existing granular base, prior to paving, shall be carried out as indicated on detailed drawings.
- .2 Prior to laying mix, clean surfaces of loose and foreign material.
- .3 Tack coat edges of existing asphalt.

3.3 TRANSPORTATION
OF MIX

- .1 Transport mix to job site in vehicles cleaned of foreign material.
- .2 Paint or spray truck beds with limewater, soap or detergent solution, or non petroleum based commercial product, at least daily or as required. Elevate truck bed and thoroughly drain. No excess solution to remain in truck bed.
- .3 Schedule delivery of material for placing in daylight, unless Departmental Representative approves artificial light.
- .4 Deposit mix from surge or storage silo to trucks in multiple drops to reduce segregation. Do not dribble mix into trucks.
- .5 Deliver material to paver at uniform rate and in an amount within capacity of paving and compacting equipment.
- .6 Deliver loads continuously in covered vehicles and immediately spread and compact. Deliver and place mixes at temperature within range as directed by Departmental Representative, but not less than 135 degrees C.

3.4 PLACING

- .1 Obtain Departmental Representative's approval of existing surface prior to placing asphalt butuminous tack coat.
- .2 Place asphalt to thicknesses, grades and lines

as indicated on drawings.

- .3 Placing conditions:
 - .1 Place asphalt mixtures only when air temperature is above 5 degrees C.
 - .2 When temperature of surface on which material is to be placed falls below 10 degrees C, provide extra rollers as necessary to obtain required compaction before cooling.
 - .3 Do not place hot-mix asphalt when pools of standing water exist on surface to be paved, during rain, or when surface is damp.
- .4 Place asphalt concrete in compacted lifts of thickness as indicated.
 - .1 Surface course in 1 layer of maximum 65 mm.
- .5 Where possible do tapering and levelling where required in lower lifts. Overlap joints by not less than 300 mm.
- .6 Spread and strike off mixture with self propelled mechanical finisher.
 - .1 Construct longitudinal joints and edges true to line markings. Departmental Representative to establish lines for paver to follow parallel to centerline of proposed pavement. Position and operate paver to follow established line closely.
 - .2 When using pavers in echelon, have first paver follow marks or lines, and second paver follow edge of material placed by first paver. Work pavers as close together as possible and in no case permit them to be more than 30 m apart.
 - .3 Maintain constant head of mix in auger chamber of paver during placing.
 - .4 If segregation occurs, immediately suspend spreading operation until cause is determined and corrected.
 - .5 Correct irregularities in alignment left by paver by trimming directly behind machine.
 - .6 Correct irregularities in surface of pavement course directly behind paver. Remove by shovel or lute excess material forming high spots. Fill and smooth indented areas with hot mix. Do not broadcast material over such areas.
 - .7 Do not throw surplus material on freshly

screeded surfaces.

- .7 When hand spreading is used:
 - .1 Distribute material uniformly. Do not broadcast material.
 - .2 During spreading operation, thoroughly loosen and uniformly distribute material by lutes or covered rakes. Reject material that has formed into lumps and does not break down readily.
 - .3 After placing and before rolling, check surface with templates and straightedges and correct irregularities.
 - .4 Provide heating equipment to keep hand tools free from asphalt. Control temperature to avoid burning material. Do not use tools at higher temperature than temperature of mix being placed.

3.5 COMPACTING

- .1 Do not change rolling pattern unless mix changes or lift thickness changes. Change rolling pattern only as directed by Departmental Representative.
- .2 Roll asphalt continuously to density not less than 98% of blow Marshall density to AASHTO T245.
- .3 General:
 - .1 Provide at least two rollers and as many additional rollers as necessary to achieve specified pavement density. When more than two rollers are required, one roller must be pneumatic tired type.
 - .2 Start rolling operations as soon as placed mix can bear weight of roller without excess displacement of material or cracking of surface.
 - .3 Operate roller slowly initially to avoid displacement of material. Do not exceed 5 km/h for breakdown and intermediate rolling for static steel-wheeled and pneumatic tired rollers. Do not exceed 9 km/h for finish rolling.
 - .4 For lifts 50 mm thick and greater, adjust speed and vibration frequency of vibratory rollers to produce minimum of 25 impacts per metre of travel. For lifts less than 50 mm

thick, impact spacing not to exceed compacted lift thickness.

.5 Overlap successive passes of roller by minimum of 200 mm and vary pass lengths.

.6 Keep wheels of roller slightly moistened with water to prevent pick-up of material but do not over-water.

.7 Do not stop vibratory rollers on pavement that is being compacted with vibratory mechanism operating.

.8 Do not permit heavy equipment or rollers to stand on finished surface before it has been compacted and has thoroughly cooled.

.9 After traverse and longitudinal joints and outside edge have been compacted, start rolling longitudinally at low side and progress to high side. Ensure that all points across width of pavement receive essentially equal numbers of passes of compactors.

.10 When paving in echelon, leave unrolled 50 to 75 mm of edge which second paver is following and roll when joint between lanes is rolled.

.11 Where rolling causes displacement of material, loosen affected areas at once with lutes or shovels and restore to original grade of loose material before re-rolling.

.4 Breakdown rolling:

.1 Begin breakdown rolling with static steel wheeled roller vibratory roller immediately following rolling of transverse and longitudinal joint and edges.

.2 Operate rollers as close to paver as necessary to obtain adequate density without causing undue displacement.

.3 Operate breakdown roller with drive roll or wheel nearest finishing machine. When working on steep slopes or super-elevated sections use operation approved by Departmental Representative.

.4 Use only experienced roller operators.

.5 Intermediate rolling:

.1 Use pneumatic-tired, steel wheel or vibratory rollers and follow breakdown rolling as closely as possible and while paving mix temperature allows maximum density from this operation.

.2 Rolling to be continuous after initial rolling until mix placed has been thoroughly

compacted.

- .6 Finish rolling:
 - .1 Accomplish finish rolling with two-axle or three-axle tandem steel wheeled rollers while material is still warm enough for removal of roller marks. If necessary to obtain desired surface finish, use pneumatic-tired rollers as directed by Departmental Representative.
 - .2 Conduct rolling operations in close sequence.

3.6 JOINTS

- .1 General:
 - .1 Remove surplus material from surface of previously laid strip. Do not deposit on surface of freshly laid strip.
 - .2 Paint contact surfaces of existing structures such as Portland cement concrete deck, manholes, curbs or gutters with bituminous material prior to placing adjacent pavement.
- .2 Transverse joints:
 - .1 Offset transverse joint in succeeding lifts by at least 600 mm.
 - .2 Cut back to full depth vertical face and tack face with thin coat of hot asphalt prior to continuing paving.
 - .3 Compact transverse joints to provide smooth riding surface. Use methods to prevent rounding of compacted surface at joints.
- .3 Longitudinal joints:
 - .1 Offset longitudinal joints in succeeding lifts by at least 150 mm.
 - .2 Cold joint is defined as joint where asphalt mix is placed, compacted and left to cool below 100 degrees C prior to paving of adjacent lane.
 - .1 If cold joint cannot be avoided, cut back by saw cutting previously laid lane, by at least 150 mm, to full depth vertical face, and tack face with thin coat of hot asphalt of adjacent lane.
 - .3 Overlap previously laid strip with spreader by 25 to 50 mm.
 - .4 Before rolling, carefully remove and

discard coarse aggregate in material overlapping joint with lute or rake.

.5 Roll longitudinal joints directly behind paving operation.

.6 When rolling with static or vibratory rollers, have most of drum width ride on newly placed lane with remaining 150 mm extending onto previously placed and compacted lane.

.4 Construct bevel joints so that thinner portion of joint contains fine graded material obtained by changed mix design or by raking out coarse aggregate in mix. Place and compact joint so that joint is smooth and without visible breaks in grade.

.5 Construct butt joints as directed by Departmental Representative.

3.7 FINISH
TOLERANCES

.1 Finished asphalt surface to be within 5 mm of design elevation but not uniformly high or low.

.2 Finished asphalt surface not to have irregularities exceeding 5 mm when checked with 4.5 m straight edge placed in any direction.

3.8 DEFECTIVE WORK

.1 Correct irregularities which develop before completion of rolling by loosening surface mix and removing or adding material as required. If irregularities or defects remain after final compaction, remove surface course promptly and lay new material to form true and even surface and compact immediately to specified density.

.2 Repair areas showing checking, rippling, or segregation.

.3 Adjust roller operation and screed settings on paver to prevent further defects such as rippling and checking of pavement.

PART 1 - GENERAL

1.1 RELATED
SECTIONS

- .1 Section 01 33 00 - Submittal Procedures.
- .2 Section 01 74 21 - Construction/Demolition Waste Management And Disposal.

1.2 REFERENCES

- .1 American Society for Testing and Materials (ASTM)
 - .1 ASTM C117-13, Standard Test Method for Material Finer than 0.075 mm Sieve in Mineral Aggregates by Washing.
 - .2 ASTM C136-06, Standard Test Method for Sieve Analysis of Fine and Coarse Aggregates.
- .2 Canadian General Standards Board (CGSB)
 - .1 CAN/CGSB-8.1-88, Sieves, Testing, Woven Wire.
 - .2 CAN/CGSB-8.2-M88, Sieves, Testing, Woven Wire, Metric.

1.3 SUBMITTALS

- .1 Submit to Departmental Representative for approval, 4 weeks before blasting, details of proposed blasting operations showing types and quantities of explosives, loading charges and patterns, type of blasting caps, blasting techniques, blast protection measures, time of blasting and other pertinent details. Submit subsequent changes to Departmental Representative before proceeding.
- .2 Samples
 - .1 Submit samples in accordance with Section 01 33 00 - Submittal Procedures.
 - .2 Inform Departmental Representative of proposed source of materials and provide access for sampling at least 2 weeks prior to commencing Work.

.3 Submit samples representative of quarry, minimum 2 weeks prior to beginning Work.

.4 Ship samples prepaid to Departmental Representative for approval.

.3 Submit for approval of review by Departmental Representative proposed method of handling armour stone. Submission to cover phases of handling, from removal from form to final position.

1.4 WASTE
MANAGEMENT AND
DISPOSAL

.1 Separate and recycle waste materials in accordance with Section 01 74 21 - Construction/Demolition Waste Management And Disposal.

.2 Collect and separate for disposal paper, plastic, polystyrene, and corrugated cardboard packaging material in appropriate on-site bins for recycling in accordance with Waste Management Plan.

.3 Divert unused geotextiles from landfill to plastic recycling facility as approved by Departmental Representative.

.4 Divert unused metal materials from landfill to metal recycling facility as approved by Departmental Representative.

.5 Divert unused concrete materials from landfill to local quarry facility as approved by Departmental Representative.

.6 Fold up metal banding, flatten and place in designated area for recycling.

1.5 INTERFERENCE TO
NAVIGATION

.1 Be familiar with vessel movements and fishery activities in area affected by construction operations.

.2 Plan and execute work, in a manner that will not impede navigation, including movement of

vessels at the facility.

- .3 Plan and execute work, in a manner that will not interfere with fishing operations or access to marine structures by land and water.
- .4 Departmental Representative will not be responsible for loss of time, equipment, material or any other charges related to interference with moored vessels in the harbour or other Contractor's operations.
- .5 Keep the Marine Communications and Traffic Services' Centre, Fisheries and Oceans Canada, informed of construction operations, in order that necessary Notices to Mariners may be issued.

1.6 REGULATORY
REQUIREMENTS

- .1 Comply with municipal, provincial and national codes and regulations relating to project.

1.7 MEASUREMENT FOR
PAYMENT

- .1 Rip Rap (500 - 750 kg): measured in cubic metres (m³) of material and supplied and placed in this work within the limits specified on drawings.
- .2 There will be no payment made for any material or stone placed beyond limits indicated on the drawings. The final contract grade must be within 200 mm of the specific elevation. Quantities will be based on an as-built survey. Any material placed outside the lines and grades as shown on the drawings will not be measured.
- .3 There will be no additional payment for delays resulting from fishing operations.
- .4 There will be no additional payment for downtime.
- .5 Mobilization/demobilization of equipment to be lump sum will not be measured for payment included in the above pay items.

- .6 Construction and maintenance of haul roads will not be measured for payment.

PART 2 - PRODUCTS

2.1 ROCK MATERIAL

- .1 Hard, angular rock free from cracks, seams and other defects which may impair durability.
- .2 Relative density, 2.65 minimum.
- .3 Absorption, 1.5 to 2.0% maximum as determined by ASTM C127 test procedure.
- .4 Durability, less than 35% abrasion Wear, ASTM C535 test procedure.
- .5 Sulphate Soundness Determination maximum 12% by ASTM C88.

2.2 RIP-RAP

- .1 Hard, dense with relative density (formally specific gravity) not less than 2.65, durable quarry stone, free from seams, cracks or other structural defects, to meet following size distribution for use intended.
- .2 Rip-rap stone to be well graded with maximum sizes not exceeding 800 mm on any side and minimum size of not less than 500 mm on any side.
- .3 Supply rock spalls to fill open joints.
- .4 Field stones of appropriate sizes are acceptable for hand placed rip-rap.

PART 3 - EXECUTION

3.1 GENERAL

- .1 Contractors will not be permitted to work the existing wharf deck. No equipment allowed on or operate from the structure.

3.2 PREPARATION

- .1 Haul roads: construct and maintain haul roads.

3.3 PLACING

- .1 Place rip-rap as directed to thickness and details indicated or as designated by Departmental Representative.
- .2 Where rip-rap is to be placed on slopes, excavate trench at toe of slope to dimensions as indicated.
- .3 All side slopes to be one (1) vertical to one and one half (1.5) horizontal.
- .4 Fine grade area to be rip-rapped to uniform, even surface. Fill depressions with suitable material and compact to provide firm bed.
- .5 Place stones in manner approved by Departmental Representative.

3.4 ROCK MATERIAL
WASHED OUT OF WORK

- .1 Should during the progress of the Work, any rock material be washed out of the Work, or through neglect or carelessness of the Contractor or their employees or from any other cause, be dumped into the water near the Work or anywhere within the harbour or channel so as to interfere in the opinion of the Departmental Representative with actual depths of water and/or impede navigation, it will be removed by the Contractor when ordered to do so by the Departmental Representative.

Any material washed out of the Work or displaced beyond the contract limits will be replaced by the Contractor at no cost to Canada.

3.5 TOLERANCES

- .1 Note: These tolerances are not to be considered pay limits but are specified to ensure contractor keeps within acceptable lines and grades.
- .2 Completed component layers to be within the following tolerances of lines and grades as indicated:
 - .1 Rip rap +/-300 mm.

PART 1 - GENERAL

1.1 DESCRIPTION

- .1 This section specifies the requirements for supply and installation of mooring devices as follows:
 - .1 Supply and installation of Type "B1" mooring cleats.
 - .2 Supply and installation of mooring rings as indicated on drawings.

1.2 RELATED WORK

- .1 Section 02 41 16 - Sitework, Demolition, and Removal.
- .2 Section 03 10 00 - Concrete, Forming and Accessories.
- .3 Section 03 20 00 - Concrete Reinforcing.
- .4 Section 03 30 00 - Cast-in-Place Concrete.

1.3 MEASUREMENT FOR PAYMENT

- .1 Mooring cleats - Type "B1": The supply and installation of Type "B1" mooring cleats, including reinforced concrete block and pedestal, will be measured by the unit secured in place. Contractor to provide all concrete, reinforcing steel, anchor bolts, nuts, washers, steel anchor plates, welding, grout, fastenings, paint, plant, equipment, and labour.
- .2 Mooring Rings: The supply and placement will be measured by unit secured in place. Contractor to provide all fastenings, equipment and labour.

PART 2 - PRODUCTS

2.1 MATERIALS

- .1 Mooring Devices:
 - .1 Mooring Cleats Type "B1": galvanized cast iron cleats, 36.2 kg weight as dimensioned on the attached drawing.
 - .2 Mooring rings galvanized cast iron dimensioned on drawings.
 - .3 Anchor Bolts and Nuts: to ASTM A307, galvanized.
 - .4 Non-Shrink Grout: pre-mixed compound of non-metallic aggregate and plasticizing agents, capable of developing minimum compressive strength of 50 MPa at 28 days.
 - .5 Galvanizing: to CSA G164, minimum zinc coating 610 g/m².
 - .6 Welding: to CSA W59.
 - .7 Sealer: to Section 07 92 10 Joint Sealer.
 - .8 Concrete: to Section 03 30 00 Cast-in-Place Concrete.
 - .9 Concrete Reinforcement: to CSA G30.12M, Grade 400.

2.2 SHOP DRAWINGS

- .1 Submit fabricator's shop drawings on cleats in accordance with Section 01 33 00 - Submittal Procedures.

PART 3 - EXECUTION

3.1 INSTALLATION

- .1 Mooring Cleats Type "B1":
 - .1 Install concrete cleat block and pedestal for Type "B1" mooring cleat as per attached drawing.
 - .2 Install concrete cleat blocks monolithically with deck.
 - .3 Secure cleats with 25 mm diameter anchor bolts of lengths required complete with

associated nuts and washers.

.4 After cleat installation is complete, bolt holes in cleats to be filled with approved waterproofing compound.

.5 Do not paint cleats.

3.2 GROUT

- .1 Set all mooring cleats at locations and elevations indicated or as directed by the Departmental Representative. Grout under base of cleat using a non-shrink, non-metallic type of grout after tightening of anchor bolts or positioning wedges. Grout must be approved by Departmental Representative. Fill anchor bolt holes with approved sealer. Ensure that temperatures of foundation, air, base and grout are within range specified by grout manufacturers.
- .2 Do not grout until approval given by Departmental Representative.