


ISSUED FOR CONSTRUCTION



NOVA 3 ENGINEERING LTD.
CONSULTING ENGINEERS
201-120 FORT STREET TEL: (204) 943-6142
WINNIPEG, MANITOBA R3C 1C7 FAX: (204) 942-1276
WWW.NOVA3.CA IN: 35-260

THIS DRAWING IS THE EXCLUSIVE PROPERTY OF NOVA 3 ENGINEERING LTD. AND MAY ONLY BE REPRODUCED WITH THE WRITTEN PERMISSION OF NOVA 3 ENGINEERING LTD.
THE CONCEPT AND DESIGN INCORPORATED INTO THIS DRAWING ARE BASED ON INFORMATION PROVIDED BY THE CLIENT AND OTHER RELATED SOURCES. PROFESSIONAL ENGINEER ACCEPTS NO RESPONSIBILITY FOR DRAWING AND DESIGN UNLESS DRAWING IS ACCEPTED BY ORIGINAL SEALED LETTER OF INTENT OR EQUIVALENT ACCEPTABLE FACSIMILE. PROFESSIONAL ENGINEER ACCEPTS NO RESPONSIBILITY FOR FINAL INSTALLATION PERFORMANCE WITHOUT ORIGINAL SEALED CERTIFICATE OF INSPECTION OR EQUIVALENT ACCEPTABLE FACSIMILE.

5		
4		
3		
2		
1		
0	ISSUED FOR CONSTRUCTION	MAY 13, 2016
Revision	Description	Date

Client _____ client _____

PUBLIC WORKS AND GOVERNMENT SERVICES CANADA

Project title: **THE FORKS NHS INFRASTRUCTURE UPGRADES**
Project: _____
THE FORKS WINNIPEG, MANITOBA

Designed by: **MY** Conçu par _____
Drawn by: **MY** Dessiné par _____
Approved by: _____ Approuvé par _____


PWGS Project Manager: **Christina Kovacs** Administrateur de Projets TPSGC

Drawing title: **MAIN ORIENTATION NODE MECHANICAL CRAWLSPACE HVAC DEMOLITION**
Titre du dessin: _____

Project no./No. du projet: **R.075208.001**
Drawing no./No. du dessin: **M2.0**
Revision no.: **0**
4 OF 5

DRAWING NOTES - HVAC

- 1 EXISTING EXHAUST FAN TO BE DEMOLISHED.
- 2 EXISTING DUCTWORK TO BE DEMOLISHED.
- 3 EXISTING EXHAUST DUCTWORK AND GOOSENECK (LOCATED ON ROOF) TO BE DEMOLISHED.
- 4 EXISTING SUPPLY DUCTWORK AND GRILLE TO BE CLEANED AND REUSED IN RENOVATION. GRILLE/DUCTWORK IN WALL ARE EXISTING TO REMAIN. REFER TO M2.1 FOR RENOVATION DRAWINGS.
- 5 EXISTING MAKE UP AIR TRAP TO BE REMOVED. CHASE TO BE REUSED FOR SUPPLY DUCTWORK TO HRV. REFER TO M2.1 FOR RENOVATION DRAWINGS.
- 6 APPROXIMATE LOCATION OF EXISTING EXHAUST DUCTWORK TO BE REMOVED. EXISTING CHASE TO BE REUSED IN RENOVATION.
- 7 EXISTING SUPPLY DUCTWORK TO BE CLEANED AND REUSED IN RENOVATION. APPROXIMATE LOCATIONS SHOWN. REFER TO M2.1 FOR RENOVATION DRAWINGS.
- 8 EXISTING EXHAUST DUCT AND DUCTWORK TO BE DEMOLISHED.
- 9 EXISTING SUPPLY AIR DUCT DOWN FROM FURNACE ABOVE TO BE CLEANED AND REUSED. REFER TO M2.1 FOR RENOVATION DRAWINGS.

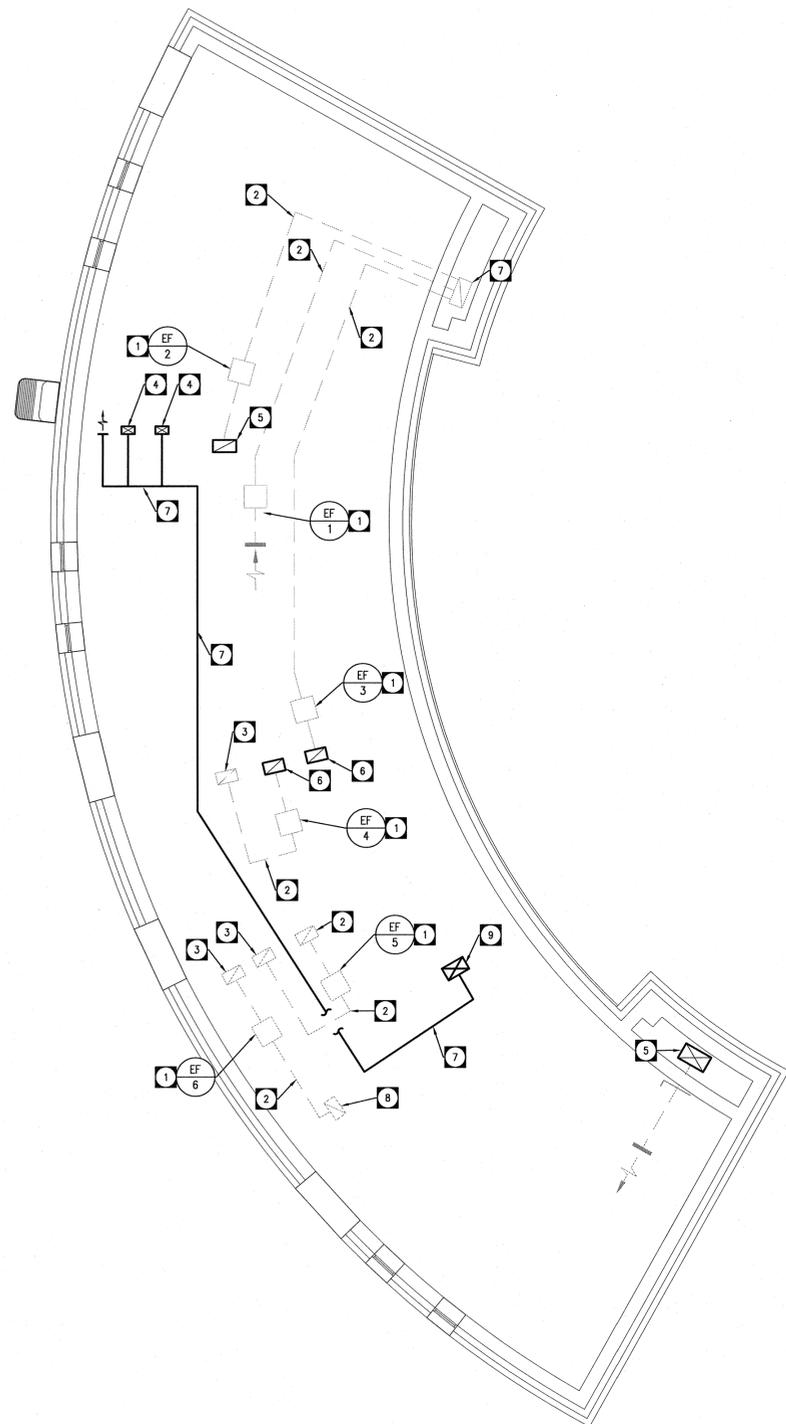

DEMOLITION PLAN - HVAC
SCALE: 1:50

	SUPPLY AIR DIFFUSER
	RETURN AIR GRILLE
	EXHAUST AIR GRILLE
	DOOR GRILLE
	THERMOSTAT
	HUMIDISTAT
	CARBON DIOXIDE DETECTOR
	ON / OFF SWITCH (DIV. 16)
	DUCTWORK LOCATED IN FLOOR
	BALANCING DAMPER
	FIRE DAMPER
	BACK DRAFT DAMPER
	MOTORIZED DAMPER
	FLEXIBLE DUCT CONNECTION
	THERMAL INSULATION
	ACOUSTIC INSULATION
	GRILLE / DIFFUSER TAG TYPE, SIZE, CFM, NECKØ
	EQUIPMENT TAG EQ NO
	ALTERNATE EQUIPMENT TAG TYPE, SIZE, OUTPUT
	DRAWING NOTE TAG