



Public Works  
Government Services  
Canada

Travaux publics  
Services gouvernementaux  
Canada



LIST OF DRAWINGS

COVER PAGE
ARCHITECTURAL A1 FLOOR PLANS
ELECTRICAL E1 ELECTRICAL LEGEND AND SCHEDULES E2 ELECTRICAL REVISED PLANS E3 ELECTRICAL DEMOLITION PLANS
MECHANICAL M1 MECHANICAL MODIFICATIONS
FIRE PROTECTION F1 FIRE PROTECTION MODIFICATIONS

Public Works and  
Government Services  
Canada

Travaux publics et  
services gouvernementaux  
Canada

Environment Canada  
Environnement Canada  
Real Projects  
Grands projets  
Management Division  
Division de gestion des  
Technical Services  
Services techniques

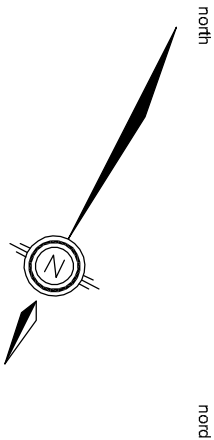

200, 2011 GERRARD ST. E.  
OTTAWA, ONTARIO, CANADA K2B 8K2

TEL.: 613-623-2600 FAX: 613-623-6296 WWW.WSPGROUP.COM

58 KING STREET, SUITE 400  
ST. CATHARINES, ONTARIO, CANADA L2R 3K5

TEL.: 905-687-1770 FAX: 905-687-1774 WWW.WSPGROUP.COM

77 LAKE STREET NORTH, SUITE 400  
ST. CATHARINES, ONTARIO, CANADA L2R 3K5

TEL.: 905-687-1770 FAX: 905-687-1774 WWW.WSPGROUP.COM

ARCHITECTURE | 49

Contractor to verify all dimensions  
& conditions on site and immediately  
notify the engineer of all discrepancies.

03	ISSUED FOR TENDER	2016.04.15
02	99% DESIGN	2016.01.14
01	50% DESIGN	2015.05.08
revisions	description	date

A	no. du dessin	A
C	no. de la feuille	C
B	no. du dessin	B
C	no. de la feuille	C

L757 RENOVATIONS

867 LAKESHORE RD  
BURLINGTON ON L7R 4A6

COVER SHEET

Designed By	SD/OV/DV	Conçu par
Date	2016-01-14	(yyyy/mm/dd)
Drawn By	SD/OV/DV	Dessiné par
Date	2016-01-14	(yyyy/mm/dd)
Reviewed By	DV	Examiné par
Date	2016-01-14	(yyyy/mm/dd)
Approved By	NAJ/VWK	Approuvé par
Date	2016-01-14	(yyyy/mm/dd)

Tender ASIF MOHAMMED

Submission

Project Manager

Administrateur de projets

Project no.

No. du projet


CCIW-010-J119

Drawing no.

No. du dessin

Canada



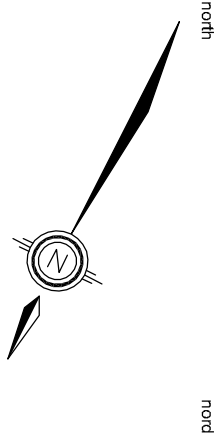

Contractor to verify all dimensions & conditions on site and immediately notify the engineer of all discrepancies.

03	ISSUED FOR TENDER	2016.04.15
02	90% DESIGN	2016.01.14
01	50% DESIGN	2015.05.08
revisions	description	date

A

C

A

C

A

C

B

C

A

C

B

C

A

C

B

C

## L757 RENOVATIONS

867 LAKESHORE RD  
BURLINGTON ON L7R 4A6

## ELECTRICAL LEGEND AND SCHEDULES

Designed By	SD	Conçu par
Date	2016-01-14	(yyyy/mm/dd)
Drawn By	SD	Dessiné par
Date	2016-01-14	(yyyy/mm/dd)
Reviewed By	NA	Examiné par
Date	2016-01-14	(yyyy/mm/dd)
Approved By	NA	Approuvé par
Date	2016-01-14	(yyyy/mm/dd)

Tender ASIF MOHAMMED      Soumission























Project Manager Administrateur de projets

Project no. No. du projet

CCIW-010-J1119

## ELECTRICAL LEGEND

### LIGHTING

	LIGHTING FIXTURE RECESS/SURFACE MOUNTED, SEE SPECIFICATION
	STRIP FLUORESCENT LIGHTING FIXTURE, SEE SPECIFICATION
	CEILING MOUNTED LIGHTING FIXTURE, SEE SPECIFICATION
	WALL MOUNTED LIGHTING FIXTURE, SEE SPECIFICATION
	ILLUMINATED SIGN "IN USE" (EXISTING, SEE NOTES ON PLAN)
RECEPTACLES	
	DUPLEX RECEPTACLE, 15A/125V – LOW MOUNTING HEIGHT
	"WP" = WEATHER PROOF    "F" = FLOOR MOUNTED
	DUPLEX RECEPTACLE, 15A/125V – SPLIT CIRCUIT TYPE
	DUPLEX RECEPTACLE – SPECIAL MOUNTING HEIGHT
	DUPLEX RECEPTACLE, 15A/125V – ISOLATED GROUND TYPE
	DUPLEX RECEPTACLE, 15A/125V – GROUND FAULT TYPE
	DUPLEX RECEPTACLES, 15A/125V – TWO IN ONE BOX
	DUPLEX RECEPTACLE, 15A/20A/125V T-SLOT
	SPECIAL RATED RECEPTACLE, AMP & VOLT RATING INDICATED
	"R" = RANGE OUTLET    "D" = DRYER OUTLET    "TW" = TWIST LOCK
POWER	
	ELECTRICAL PANEL, SURFACE/FLUSH MTD., SEE SCHEDULE FOR DETAILS
	JUNCTION BOX
	TOGGLE SWITCH    STROKES = NUMBER GANGED    '3' = 3 WAY    '4' = 4 WAY    'D' = 1500W DIMMER    'K' = KEY OPERATED    'DS' = DOOR SWITCH    '4*' = 347V
	PUSHBUTTON/SELECTOR SWITCH STATION FOR PURPOSE INDICATED
	ELECTRIC MOTOR, HP AS NOTED    'EF' = EXHAUST FAN    'KH' = KITCHEN HOOD    'MD' = MOTORIZED DAMPER
	DISCONNECT SWITCH, FUSIBLE/UNFUSED AS NOTED
COMMUNICATIONS	
	COMPUTER DATA OUTLET    # = QUANTITY

THE ABOVE SYMBOLS ARE STANDARDS AND MAY APPLY TO THIS PROJECT, REFER TO THE DRAWINGS AND SPECIFICATIONS FOR FURTHER DETAILS ON USE AND APPLICATIONS


LINE LEGEND	
---	EXISTING EQUIPMENT TO BE REMOVED.
---	EXISTING EQUIPMENT TO REMAIN.
---	NEW EQUIPMENT TO BE INSTALLED.

## GENERAL REVISED NOTES

- UNLESS OTHERWISE NOTED, CONTRACTOR IS TO PROVIDE ALL WIRING, CONDUIT AND MOUNTING HARDWARE TO COMPLETE THE WORKS AS INDICATED.
- CONTRACTOR TO ARRANGE AND PAY FOR ALL PERMITS AND PROVIDE FINAL CERTIFICATE OF ELECTRICAL INSPECTION.
- CONTRACTOR TO PROVIDE COMPLETE INSTALLATION TO ALL EQUIPMENT.
- CONTRACTOR TO COORDINATE WORK WITH OTHER TRADES/UTILITIES.
- ALL WIRING TO BE COPPER TYPE, UNLESS SPECIFIED OTHERWISE.
- REMOVE AND REPLACE ALL CEILING TILES AS REQUIRED FOR CONSTRUCTION ACCESS. ALL DAMAGED TILES TO BE REPLACED TO MATCH EXISTING.
- CONCEAL CONDUIT AND WIRING IN WALLS AND CEILINGS WHERE CONSTRUCTION PERMITS.
- DRAWINGS DO NOT SHOW THE EXACT ROUTE FOR CONDUIT/WIRING/RACEWAY AND IS INTENDED AS A GUIDE TO THE CONTRACTOR. CONTRACTOR TO FIELD ROUTE CONDUITS/WIRING/RACEWAY TO SUIT EXISTING CONDITIONS AND OTHER SERVICES.
- 'EX' PRECEDING TAGS, LINES, ETC. INDICATED EXISTING EQUIPMENT, WIRING AND CONDUIT.
- NEUTRAL CONDUCTORS SHALL NOT BE USED FOR MORE THAN ONE BRANCH CIRCUIT, FOR MORE THAN ONE MULTI-WIRE BRANCH CIRCUIT OR MORE THAN ONE SET OF UNGROUNDED FEEDER CONDUCTORS.

## GENERAL DEMOLITION NOTES

- THIS DRAWING DOES NOT SHOW ALL HIDDEN OR CONCEALED WIRING, CONDUIT AND EQUIPMENT TO BE REMOVED. CONTRACTOR SHALL VISIT THE SITE AND MAKE THEIR OWN EVALUATION AND ESTIMATE OF THE EXTENT AND MAGNITUDE OF THE WORK INVOLVED.
- COORDINATE AND OBTAIN APPROVAL FROM DEPARTMENTAL REPRESENTATIVE FOR ALL INTERRUPTIONS AND SHUTDOWNS.
- ALL ABANDONED BREAKERS IN POWER PANELS TO BE IDENTIFIED AS 'SPARE' IN NEW PANEL LEGEND, UNLESS NOTED OTHERWISE.
- WHERE CEILINGS ARE REMOVED, SECURE ALL UNSUPPORTED WIRING TO UNDERSIDE OF STRUCTURE.

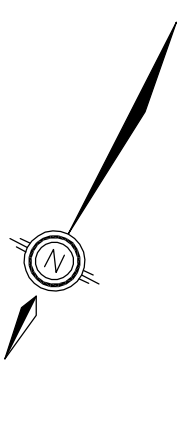

Contractor to verify all dimensions  
& conditions on site and immediately  
notify the engineer of all discrepancies.

03	ISSUED FOR TENDER	2016.04.15
02	99% DESIGN	2016.01.14
01	50% DESIGN	2015.05.08
revisions	description	date

A	no. du détail	A
C	location drawing no.	C
	sur dessin no.	
	C drawing no.	
	dessin no.	

project  
projet

L757 RENOVATIONS

867 LAKESHORE RD  
BURLINGTON ON L7R 4A6

drawing  
dessin

ELECTRICAL  
REVISED PLANS

Designed By	SD	Conçu par
Date	2016-01-14	(yyyy/mm/dd)
Drawn By	SD	Dessiné par
Date	2016-01-14	(yyyy/mm/dd)
Reviewed By	NA	Examiné par
Date	2016-01-14	(yyyy/mm/dd)
Approved By	NA	Approuvé par
Date	2016-01-14	(yyyy/mm/dd)

Tender ASIF MOHAMMED Soumission

Project Manager Administrateur de projets

Project no. No. du projet


CCIW-010-J1119

Drawing no. No. du dessin


E2

REVISED NOTES


TAG	DESCRIPTION
1	PROVIDE NEW SURFACE MOUNT HAZARDOUS FIXTURES AND CONTROLS. COORDINATE FIXTURE LOCATIONS WITH EXISTING SERVICES. PROVIDE CLASS 1 DIV/2 CONDUIT/WIRING INSTALLATION. CONNECT TO EXISTING ROOM EMERGENCY CIRCUIT (PANEL LP7E). ROUTE CONDUITS AROUND EXISTING EXPLOSION VENT.
2	PROVIDE NEW SURFACE CEILING MOUNT FIXTURES AND CONTROLS. COORDINATE FIXTURE LOCATIONS WITH EXISTING SERVICES. PROVIDE SURFACE WIRING IN CONDUIT. REMORK EXISTING NORMAL POWER CIRCUIT.
3	INSTALL FIXTURE/DEVICES TO MAINTAIN 1m CLEARANCE FROM L757A ROOM DOOR.
4	PROVIDE NEW 20A/120V RECEPTACLES AND NEW WIRING IN CONDUIT FROM EXISTING CORRIDOR PANEL LP7D (225A, 120/208V, 3ø4W FPE NALP) FOR RELOCATED EQUIPMENT. CONFIRM EQUIPMENT/DEVICE LOCATIONS WITH DEPARTMENTAL REPRESENTATIVE. PROVIDE (3) NEW 20A1P BREAKERS IN PANEL. UPDATE PANEL SCHEDULE.
5	PROVIDE NEW SURFACE CEILING MOUNT HAZARDOUS FIXTURES. COORDINATE FIXTURE LOCATIONS WITH EXISTING SERVICES. PROVIDE CLASS 1 DIV/1 CONDUIT/WIRING INSTALLATION TO CONTROLS. PROVIDE NEW TOGGLE SWITCH MOUNTED MINIMUM 1m FROM DOOR. REMORK EXISTING ROOM LIGHTING CIRCUIT PANEL LP-WB.
6	PROVIDE NEW HAZARDOUS LOCATION 20A/125V, NEMA 5-20R RECEPTACLE IN CLASS 1 DIV/1/2 SURFACE BOX AND CLASS 1 DIV/2 CONDUIT/WIRING INSTALLATION FROM EXISTING PANEL LPE. FIELD VERIFY RECEPTACLE LOCATIONS WITH DEPARTMENTAL REPRESENTATIVE. IDENTIFY AND REMORK FORMER RECEPTACLE CIRCUITS TO TWO NEW DEVICES.
7	EXISTING PANEL LPE (225A, 120/208V, 3ø4W SIEMENS EQ430225). PROVIDE (2) NEW 20A1P BREAKERS IN PANEL AND WIRING IN CONDUIT TO TWO DEVICES. UPDATE PANEL LEGEND.
8	PROVIDE JUNCTION BOX AND 21mm EMT CONDUIT RACEWAY IN CORRIDOR CEILING SPACE FROM PANEL LP7D TO NEW RECEPTACLE CIRCUITS IN ROOM L757. ALLOW 28m FROM THIS LOCATION TO EXISTING CORRIDOR PANEL LP7D.
9	PROVIDE DATA OUTLET CAST DEVICE BOX AND 21mm EMT TO CORRIDOR CEILING SPACE FOR RELOCATED EQUIPMENT. FIELD VERIFY EQUIPMENT DEVICE LOCATION WITH DEPARTMENTAL REPRESENTATIVE. WIRING BY DEPARTMENTAL REPRESENTATIVE.
10	REINSTALL "IN-USE" SIGN ON CEILING ABOVE ROOM LIGHTING CONTROL. PROVIDE NEW CLASS 1 DIV/1/2 CONDUIT/WIRING INSTALLATION FROM ROOM L757A LIGHTING SWITCH.

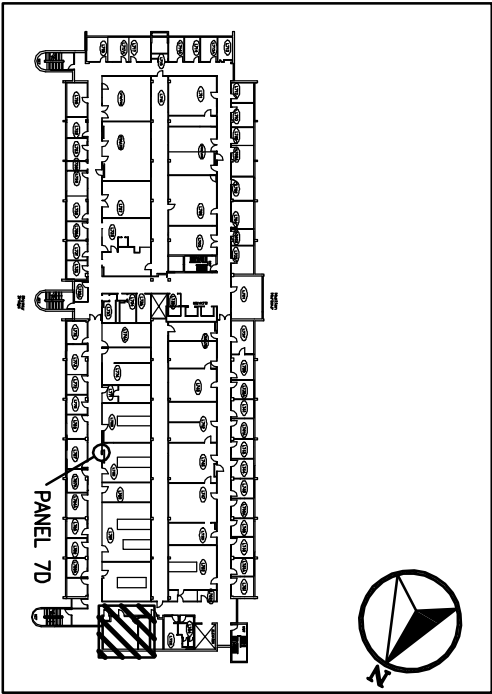


LEVEL 7 – KEY PLAN

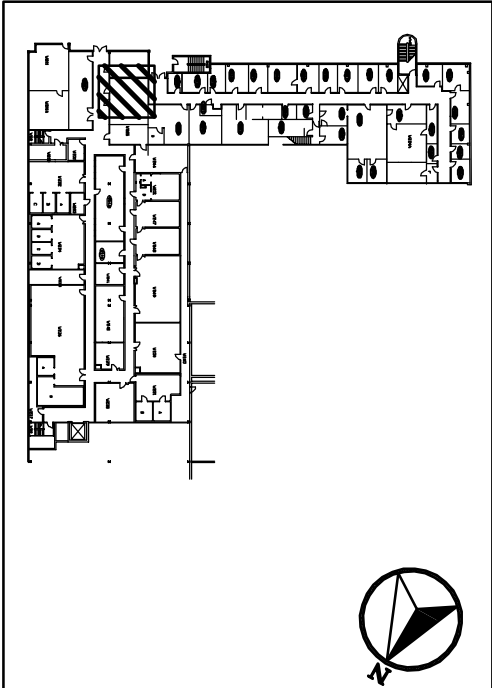

LEVEL 2 – KEY PLAN

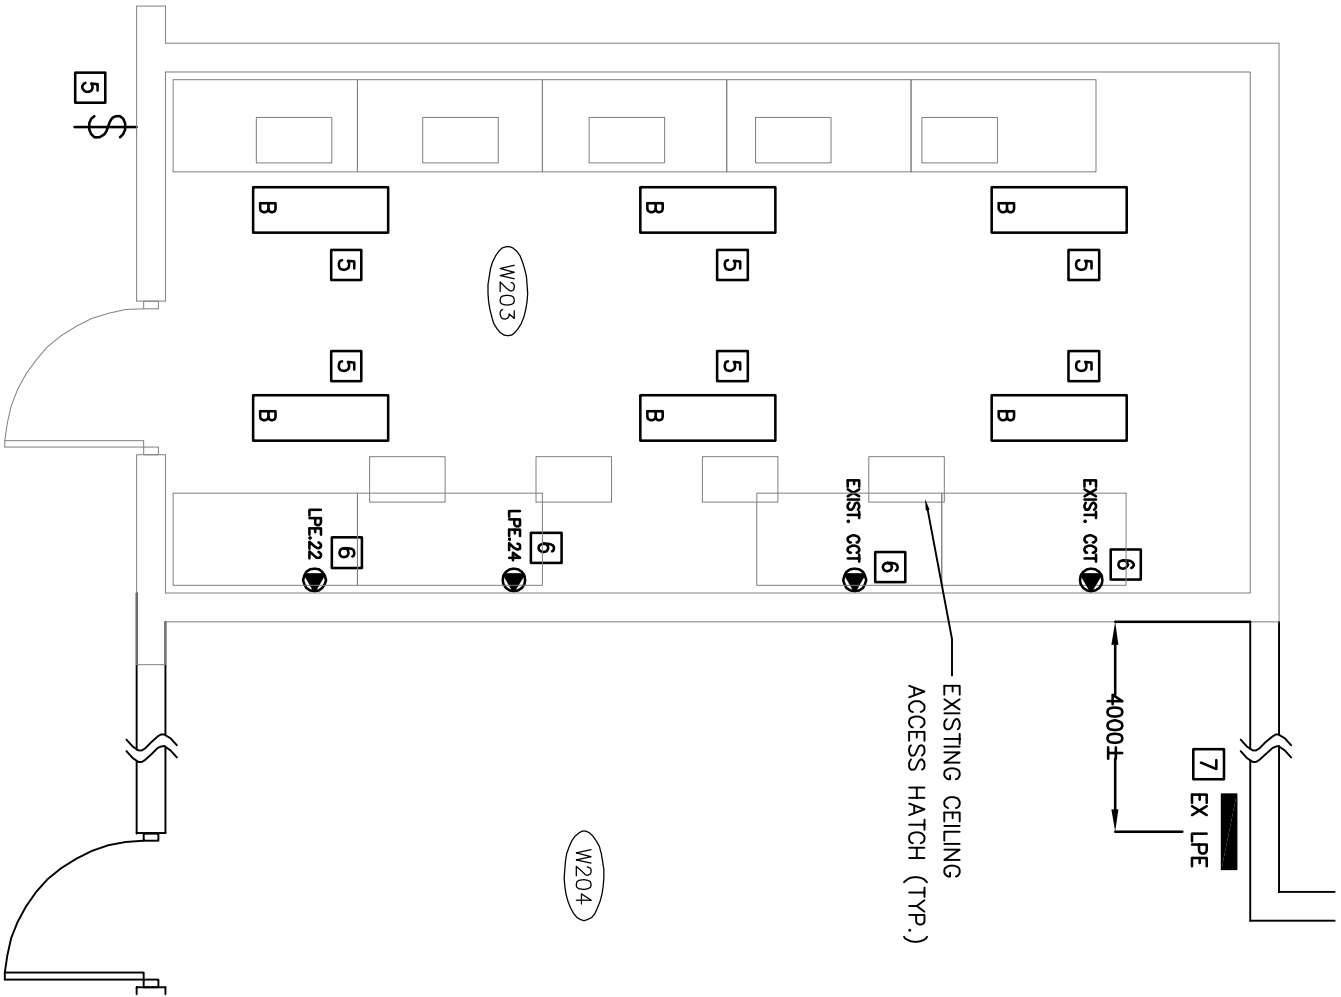


1 ROOM W203 - REVISED  
1:50  
E2

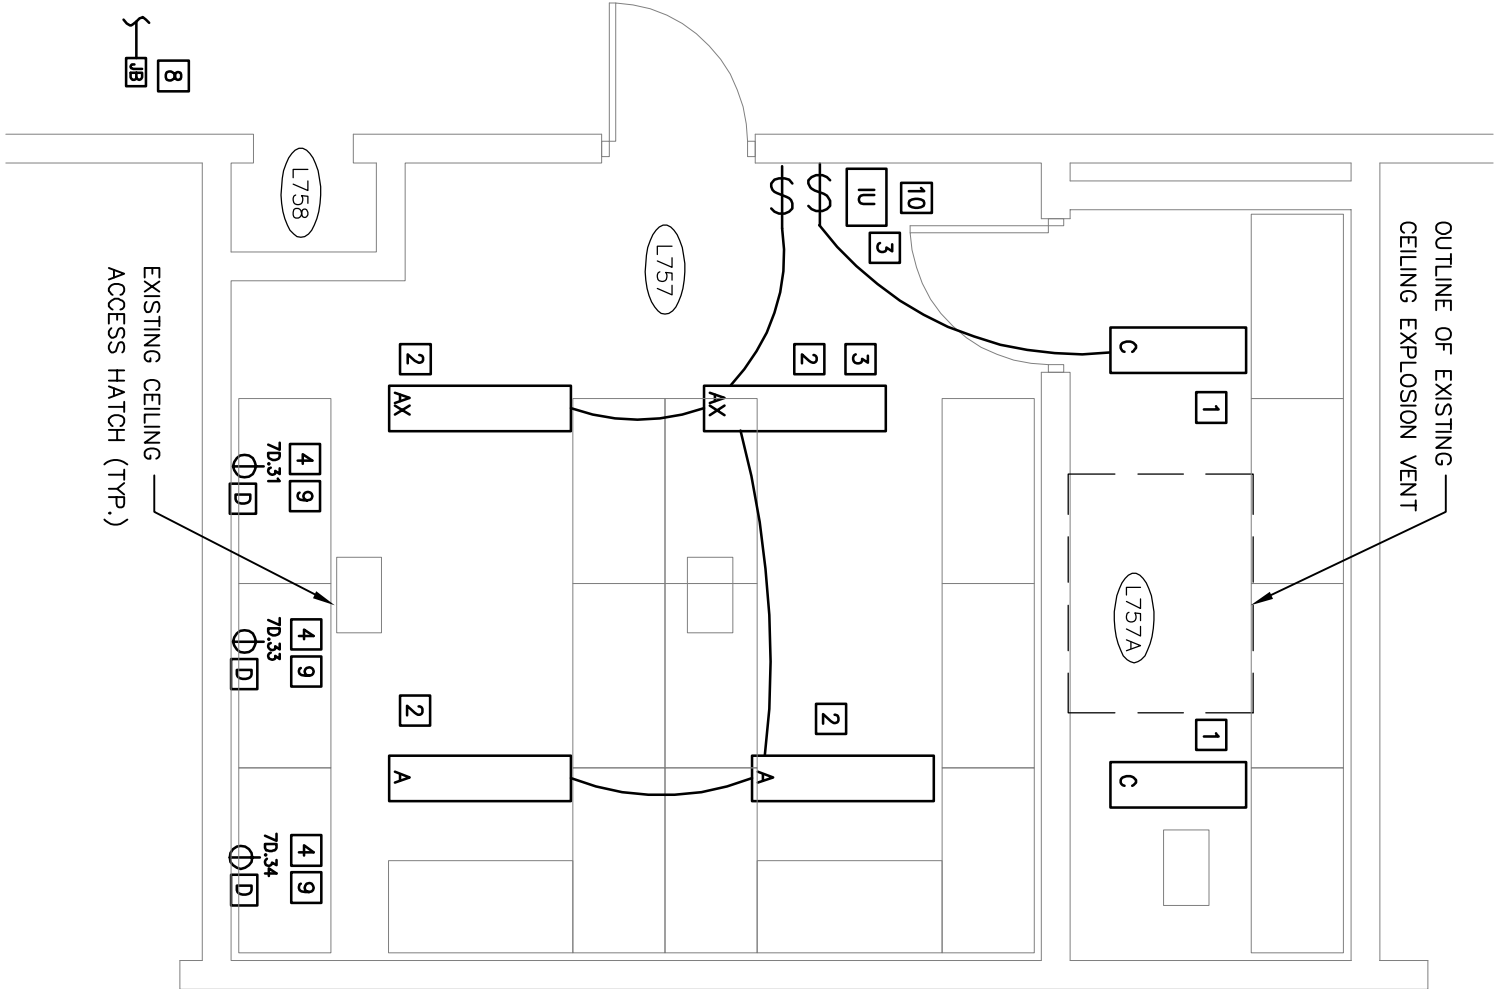

2 ROOMS L757 AND L757A - REVISED  
1:50  
E2



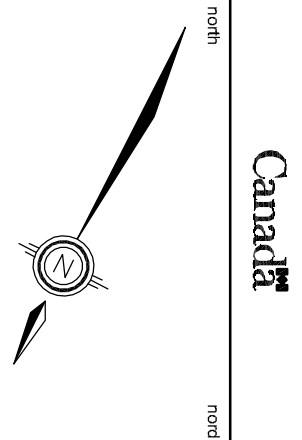

Contractor to verify all dimensions & conditions on site and immediately notify the engineer of all discrepancies.

04 ISSUED FOR TENDER 2016.04.15

03 99% DESIGN 2016.02.15

02 99% DESIGN 2016.01.14

01 50% DESIGN 2015.05.08

revisions description date

A. detail no. no. du détail		A	
B. location drawing no. sur dessin no.		B	
C. drawing no. dessin no.		C	


project  
projet

L757 RENOVATIONS  
867 LAKESHORE RD  
BURLINGTON, ON L7R 4A6


drawing dessin	ELECTRICAL DEMOLITION PLANS	
Designed By Date	SD 2016-01-14	Conçu par (yyyy/mmdd)
Drawn By Date	SD 2016-01-14	Dessiné par (yyyy/mmdd)
Reviewed By Date	NA 2016-01-14	Examiné par (yyyy/mmdd)
Approved By Date	NA 2016-01-14	Approuvé par (yyyy/mmdd)
Tender Project Manager	ASIF MOHAMMED Administrateur de projet	Soumission
Project no. CCIW-010-J1119	No. du projet	
Drawing no. E3	No. du dessin	

DEMOLITION NOTES



TAG	DESCRIPTION
①	DISCONNECT AND REMOVE LIGHTING AND ASSOCIATED SURFACE CONDUIT/WIRING IN ROOM. (EXISTING ROOM LIGHTING CIRCUIT TO BE REMORKED IN CORRIDOR AND REUSED).
②	DISCONNECT AND REMOVE LIGHTING CONTROLS AND ASSOCIATED CONDUIT/WIRING. PROVIDE BLANK STAINLESS STEEL COVER PLATE OVER RECESSED BACKBOXES.
③	DISCONNECT AND REMOVE DEVICE AND ASSOCIATED SURFACE CONDUIT/WIRING IN ROOM. INTERCEPT CIRCUIT IN ADJACENT ROOM AND PROVIDE JUNCTION BOX. IDENTIFY AND LABEL COVER WITH PANEL AND CIRCUIT.
④	DISCONNECT AND REMOVE EXISTING "IN USE" SIGN. (DEVICE TO BE RELOCATED AND REINSTALLED).

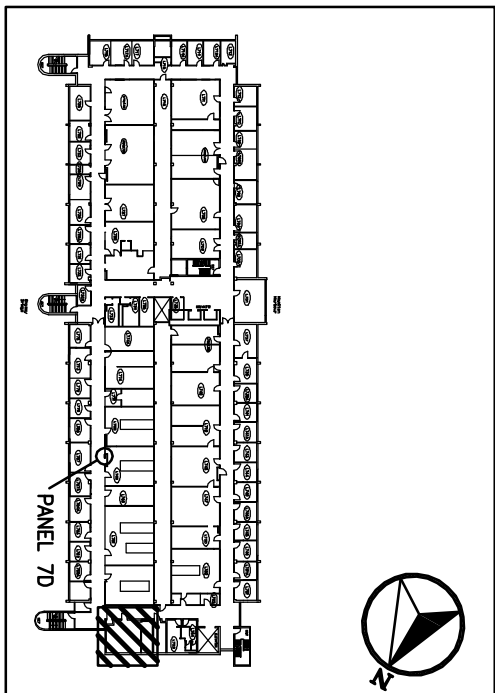

LEVEL 7 – KEY PLAN

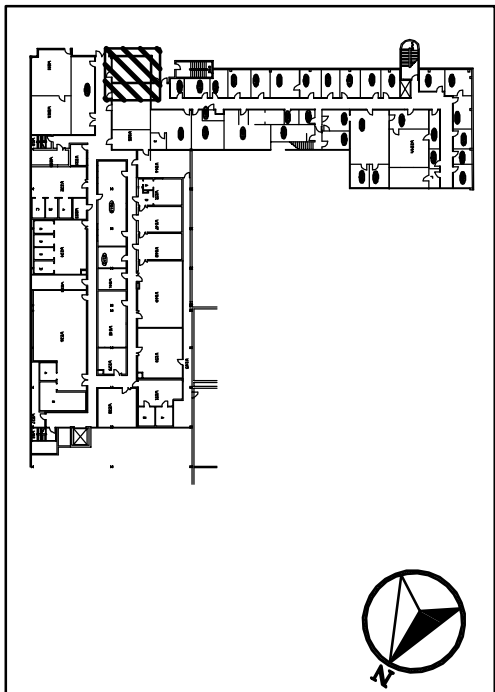


LEVEL 2 – KEY PLAN

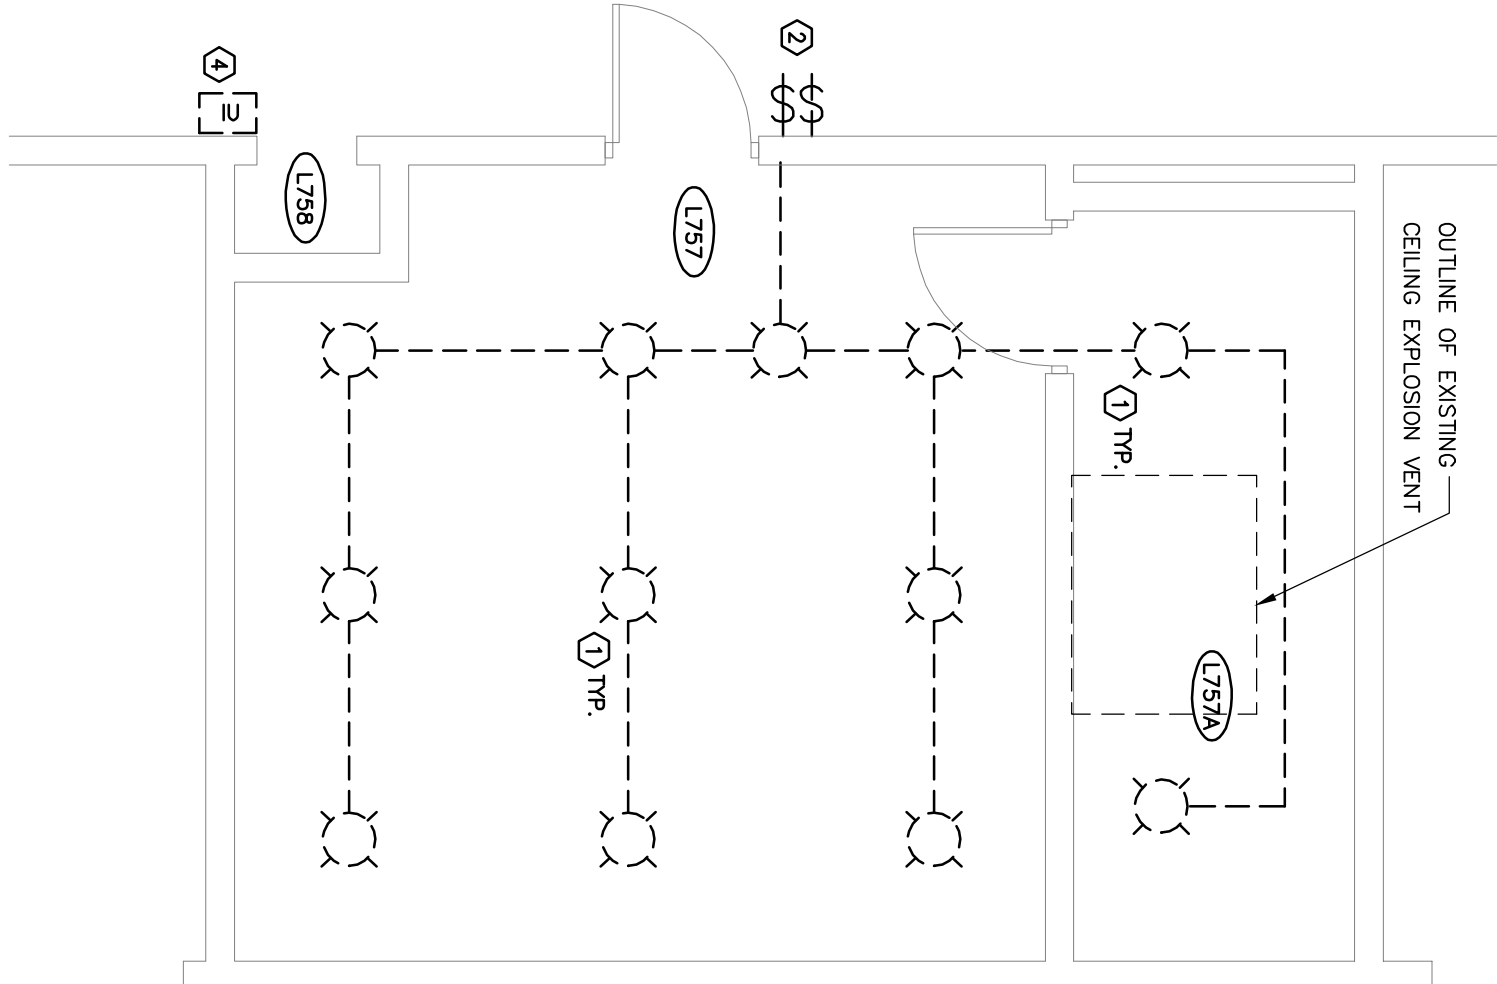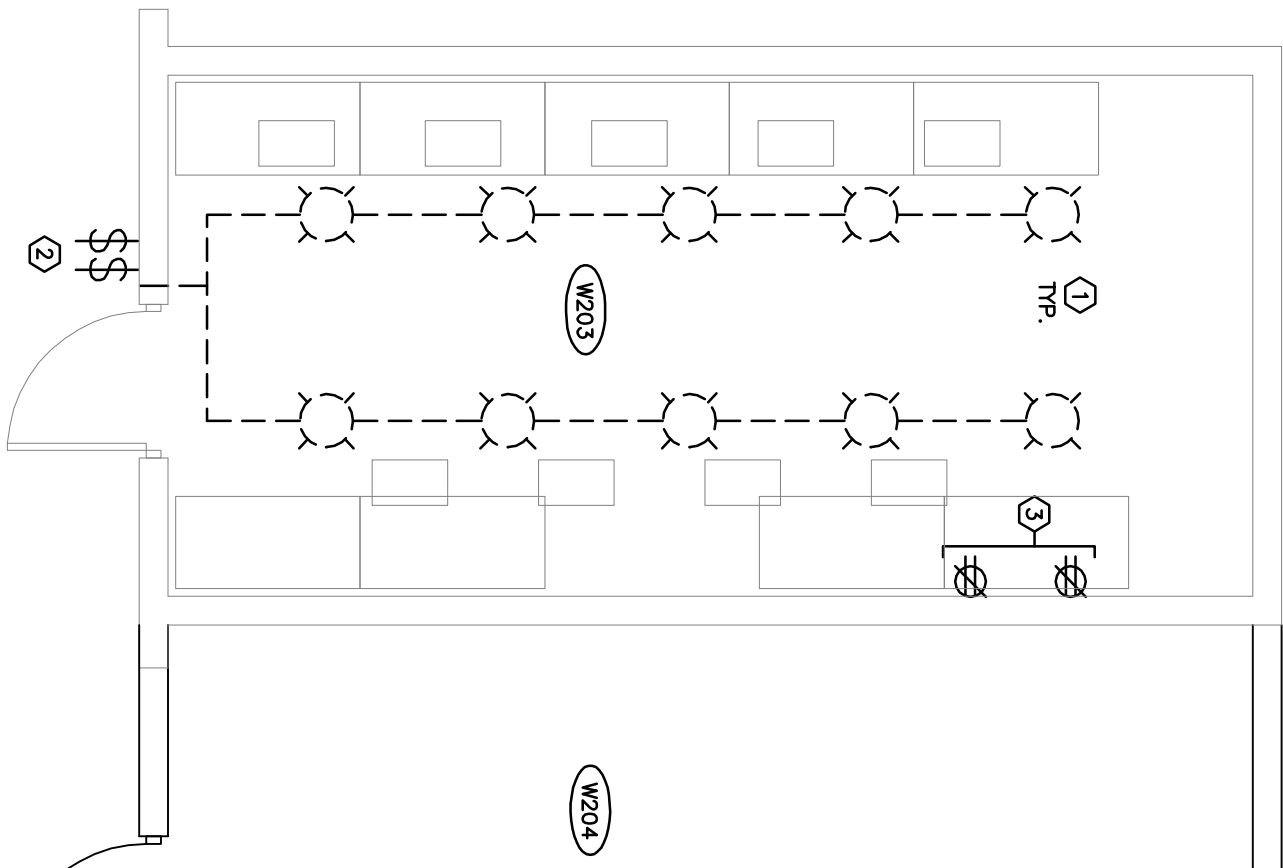


1 ROOM W203 - DEMOLITION  
E3 1:50

2 ROOMS L757 AND L757A - DEMOLITION  
E3 1:50

DIFFUSER AND GRILLE SCHEDULE					
TAG	SIZE	APPLICATION	FRAME	ACCESSORIES	FINISH
S1	300 X 300	SUPPLY	SURFACE MOUNT	RADIAL DAMPER	WHITE
E1	250 X 250	EXHAUST	SURFACE MOUNT	NONE	WHITE
				STEEL STAMPED SQUARE CEILING DIFFUSER	
				ALUMINIUM EGG CRATE GRILLE	

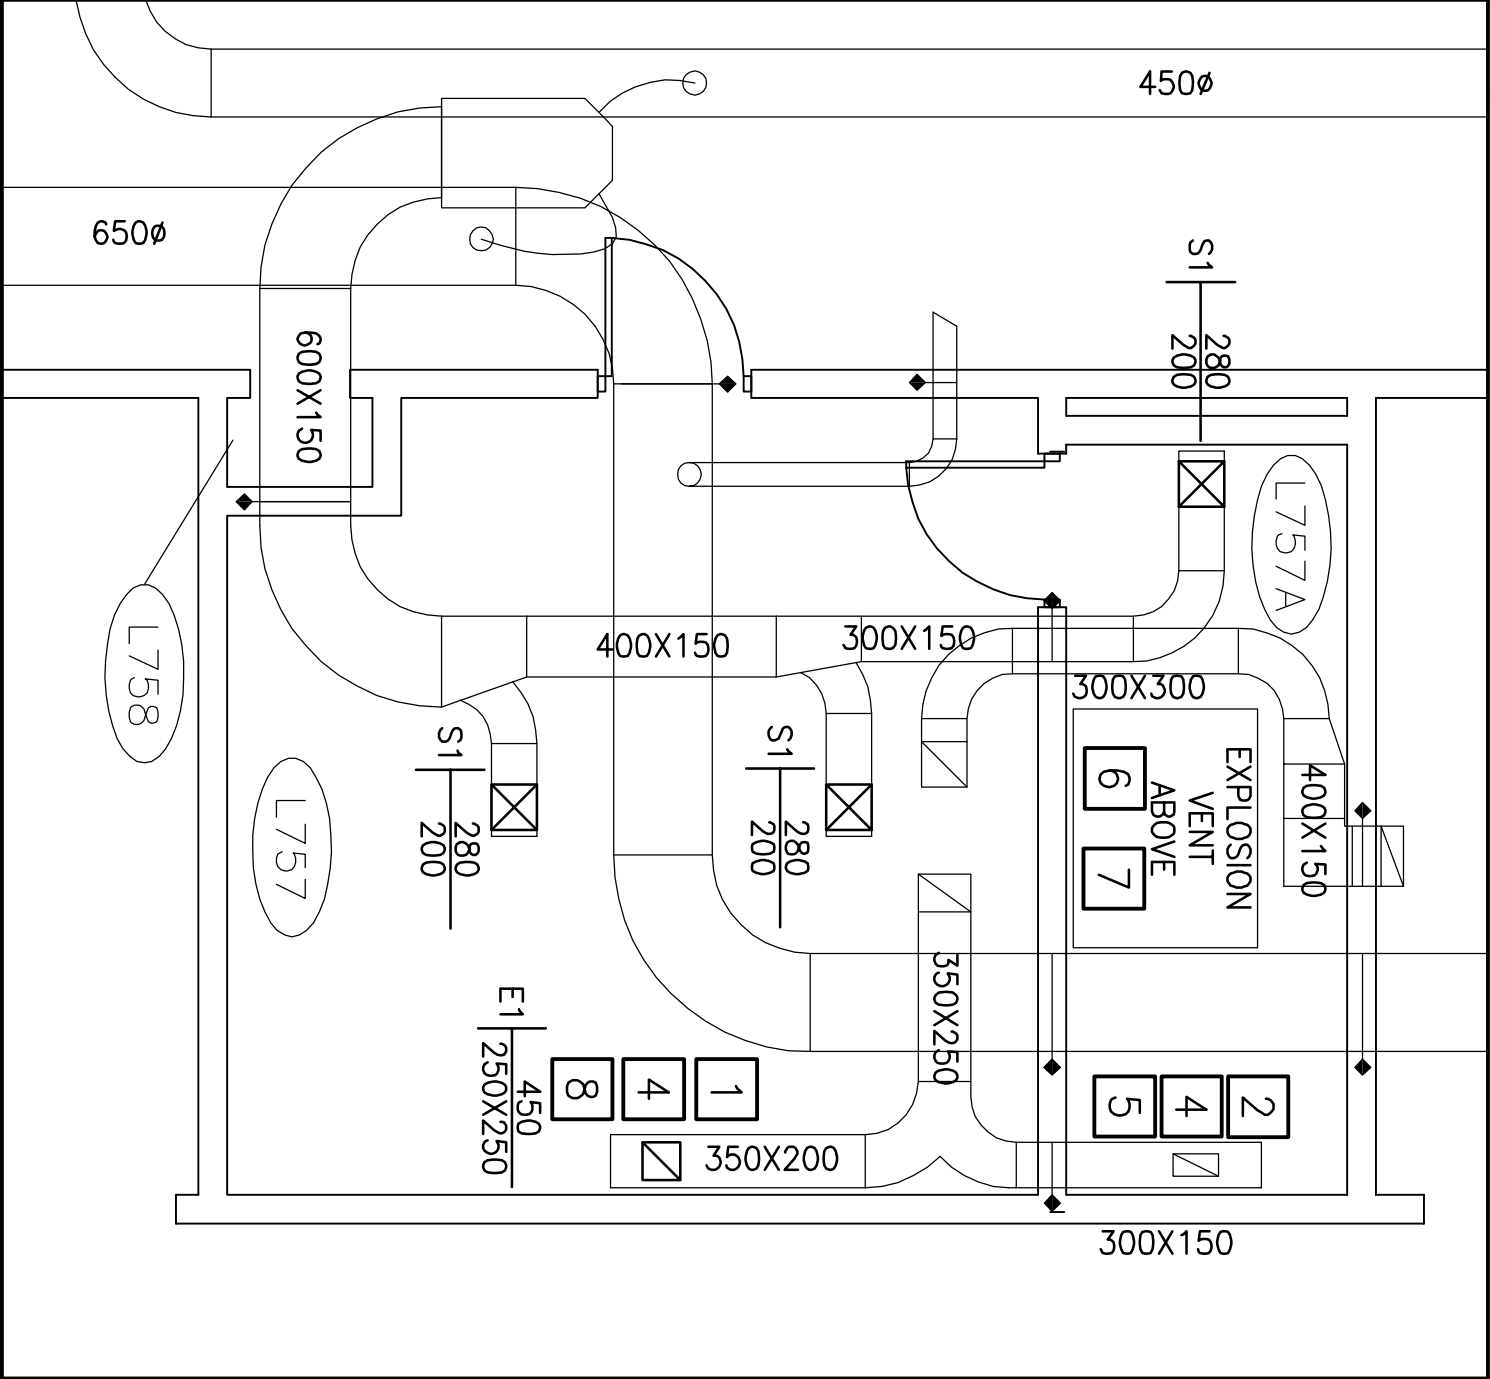

1 ROOMS L757 AND L757A - LAYOUT  
M1 1:50

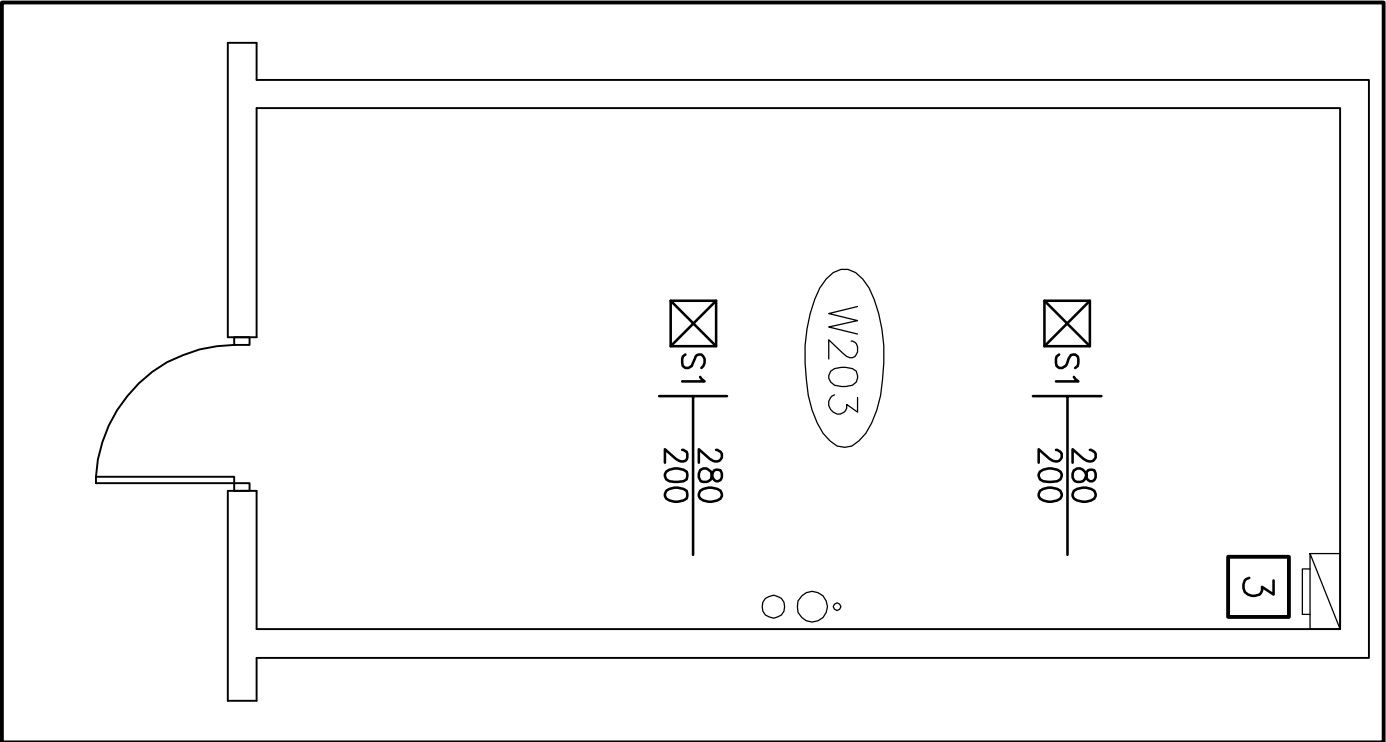

1 ROOM W203 - LAYOUT  
M1 1:50


MECHANICAL LEGEND		
A1 47 150	DIFFUSER OR VOLUME-CFM	GRILLE TYPE SIZE-mm
◆	FIRE DAMPER	
⊗	SUPPLY AIR	
⊗	RETURN/EXHAUST AIR	
□	DUCT	
—	DUCT	
—	OPEN END DUCT	
⊗	EXHAUST FAN	
① TAG ⑤ TAG	T = THERMOSTAT S = SENSOR TAG = EQUIPMENT CONTROLLED	
① TAG ① TAG	PNEUMATIC THERMOSTAT TAG = EQUIPMENT CONTROLLED	
⊗ TAG	BALANCE DAMPER	
⊗ TAG	TAG = EQUIPMENT TAG REFERENCED IN SCHEDULES	

THE ABOVE SYMBOLS ARE STANDARDS AND MAY APPLY TO THIS PROJECT. REFER TO THE DRAWINGS AND SPECIFICATIONS FOR FURTHER DETAILS ON USE AND APPLICATIONS

GENERAL DEMOLITION NOTES	
1.	REMOVE ALL BREACHING, EQUIPMENT, PIPING, STEEL SUPPORTS, CONTROLS, PLUMBING MATERIALS, HOUSE KEEPING PAD, SHOWN APPROXIMATELY WITH HEAVY BROKEN LINES THROUGHOUT (UNLESS OTHERWISE INDICATED).
2.	THIS DRAWING DOES NOT SHOW ALL HIDDEN OR CONCEALED PIPING, DUCTS, PLUMBING AND EQUIPMENT TO BE REMOVED. CONTRACTOR SHALL VISIT THE SITE AND MAKE THEIR OWN EVALUATION AND ESTIMATE OF THE EXTENT AND MAGNITUDE OF THE WORK INVOLVED PRIOR TO SUBMITTING PROPOSAL.
3.	REMOVE ALL CEILING DIFFUSERS IN ROOMS W203, L757 AND L757A.

GENERAL REVISED NOTES	
1.	MECHANICAL CONTRACTOR IS TO VERIFY SIZE AND LOCATION OF EXISTING DRAINS, VENTS, AND HOT AND COLD WATER LINES BEFORE CONNECTING INTO EXISTING.
2.	MECHANICAL CONTRACTOR IS TO VERIFY SIZE AND LOCATION OF SUPPLY AND RETURN DUCTS BEFORE CONNECTING INTO EXISTING.
3.	EXISTING DIFFUSERS ARE TO BE REUSED WHERE INDICATED. CLEAN BEFORE REINSTALLING.
4.	"Ex" PRECEDING TAGS AND LINES, ETC. INDICATES EXISTING EQUIPMENT AND PIPES.
5.	LOCATE, INSPECT AND CLEAN ALL FIRE DAMPERS. REPLACE DEFECTIVE FIRE DAMPERS. ALLOWANCE FOR FIRE DAMPER REPLACEMENT \$5,000.00.
6.	REPAIR ANY DAMAGE TO DUCT INSULATION.

NOTES	
1	BALANCE AND VERIFY EXHAUST RATE IS NO LESS THAN 450 CFM.
2	BALANCE AND VERIFY EXHAUST RATE IS NO LESS THAN 150 CFM.
3	BALANCE AND VERIFY EXHAUST RATE IS NO LESS THAN 400 CFM.
4	REMOVE PNEUMATICALLY OPERATED DAMPER AND ASSOCIATED COMPRESSED AIR PIPING.
5	REPLACE VOLATILE GAS SENSOR WITH NEW SENSOR, BY DIV 25 30.
6	REPLACE EXPLOSION VENT DOOR SEALS ON ROOF LEVEL, BY DIV 07 92.
7	SEAL EXPLOSION VENT FLASHING WITH WEATHERPROOF CAULKING ON ROOF LEVEL, BY DIV 07 92.
8	DEMOLISH VERTICAL DUCTING AND INSTAL GRILLE AT CEILING.

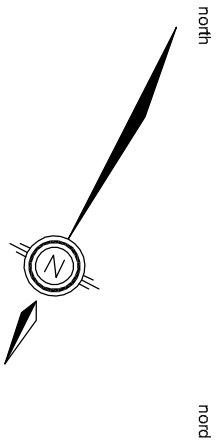

Contractor to verify all dimensions & conditions on site and immediately notify the engineer of all discrepancies.

revision	description	date
03	ISSUED FOR TENDER	2016-04-15
02	99% DESIGN	2016-01-14
01	50% DESIGN	2015-05-08

A	A. detail no. no. du détail	A
C	B. location drawing no. sur dessin no.	C
C	C. drawing no. dessin no.	C

## L757 RENOVATIONS

drawing	867 LAKESHORE RD BURLINGTON, ON L7R 4A6	dessin
---------	--	--------

## MECHANICAL

Designed By	GV	Conçu par
Date	2016-01-14	(yyyy/mm/dd)
Drawn By	GV	Dessiné par
Date	2016-01-14	(yyyy/mm/dd)
Reviewed By	VJ	Examiné par
Date	2016-01-14	(yyyy/mm/dd)
Approved By	VJ	Approuvé par
Date	2016-01-14	(yyyy/mm/dd)
Tender	ASIF MOHAMMED	Soumission
Project Manager	Administrateur de projets	
Project no.	CCIW-010-J1119	No. du projet
Drawing no.	M1	No. du dessin





3 PRIMARY CARBON DIOXIDE SYSTEM  
ON 8th FLOOR







2 BACKUP CARBON DIOXIDE SYSTEM  
ON 7th FLOOR

FIRE PROTECTION LEGEND	
	PENDENT SPRINKLER
	CO <sub>2</sub> NOZZLE TO BE REMOVED.
	CO <sub>2</sub> PIPING TO BE REMOVED.
	DETECTOR FOR CO <sub>2</sub> SYSTEM TO BE REMOVED.
	NEW FIRE EXTINGUISHER

## NOTES

TAG	DESCRIPTION
1	REPLACE THREE (3) PENDENT SPRINKLERS IN ROOM (W203) WITH NEW CORROSION RESISTANT SPRINKLERS.
2	LOCATION OF BACKUP CARBON DIOXIDE SYSTEM ON 7th FLOOR. SYSTEM TO BE REMOVED INCLUDING CYLINDERS (5) AND ALL CONTROL/OPERATING EQUIPMENT. ALL PIPING TO BE REMOVED INTO ROOMS L757 AND L757A.
3	APPROXIMATE LOCATION OF CARBON DIOXIDE SYSTEM ON 8th FLOOR. SYSTEM TO BE REMOVED INCLUDING CYLINDERS (5) AND ALL CONTROL/OPERATING EQUIPMENT. ALL PIPING TO BE REMOVED INTO ROOMS L757 AND L757A. REMOVE ALL PIPING FROM PENTHOUSE TO LOCATION IDENTIFIED BY NOTE #2.
4	PIPING AND NOZZLES TO BE REMOVED. HANGERS SECURING PIPING TO WALL SHALL ALSO BE REMOVED.
5	DETECTION FOR CARBON DIOXIDE SYSTEM TO BE REMOVED. REMOVE WIRING BACK TO SOURCE.
6	ACTUATOR ON DUCTWORK TO BE REMOVED. REMOVE WIRING BACK TO SOURCE.
7	PROVIDE NEW 2.25 KG. MULTI-PURPOSE DRY CHEMICAL FIRE EXTINGUISHER WITH 3A 40BC RATING. MOUNT ON WALL WITH TOP AT 1200 mm ABOVE FINISH FLOOR.

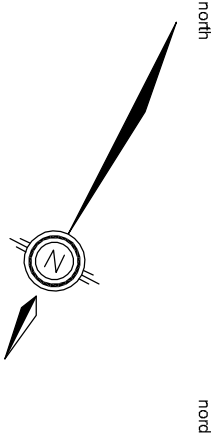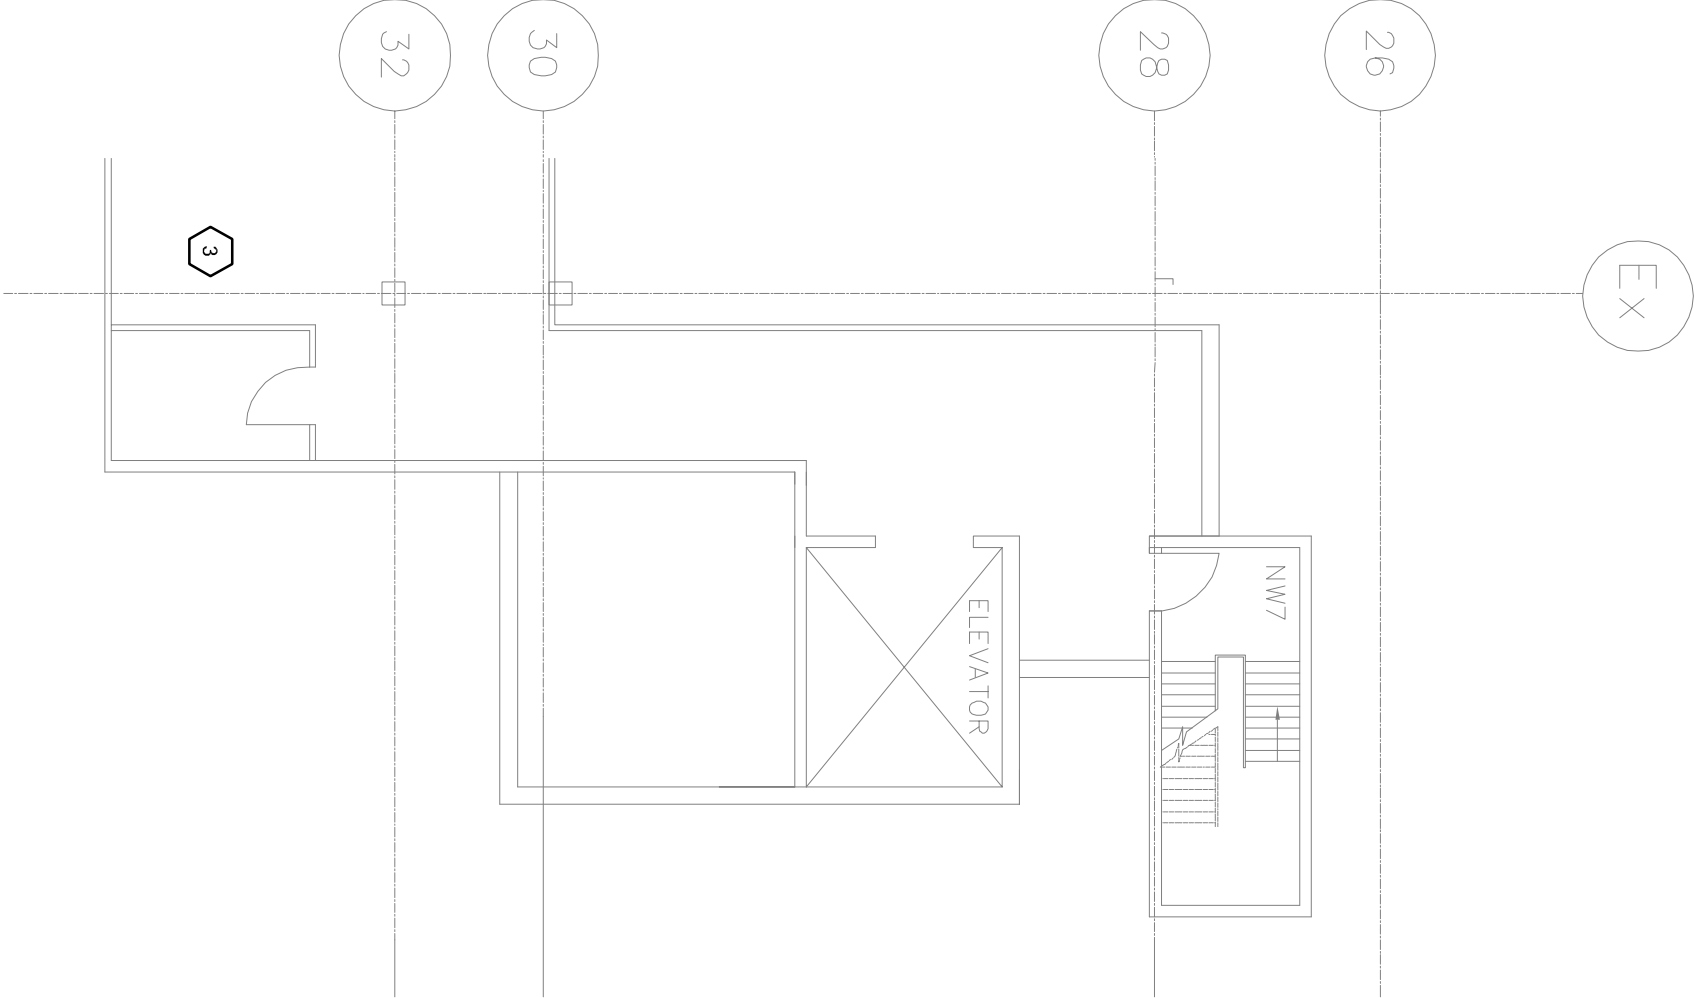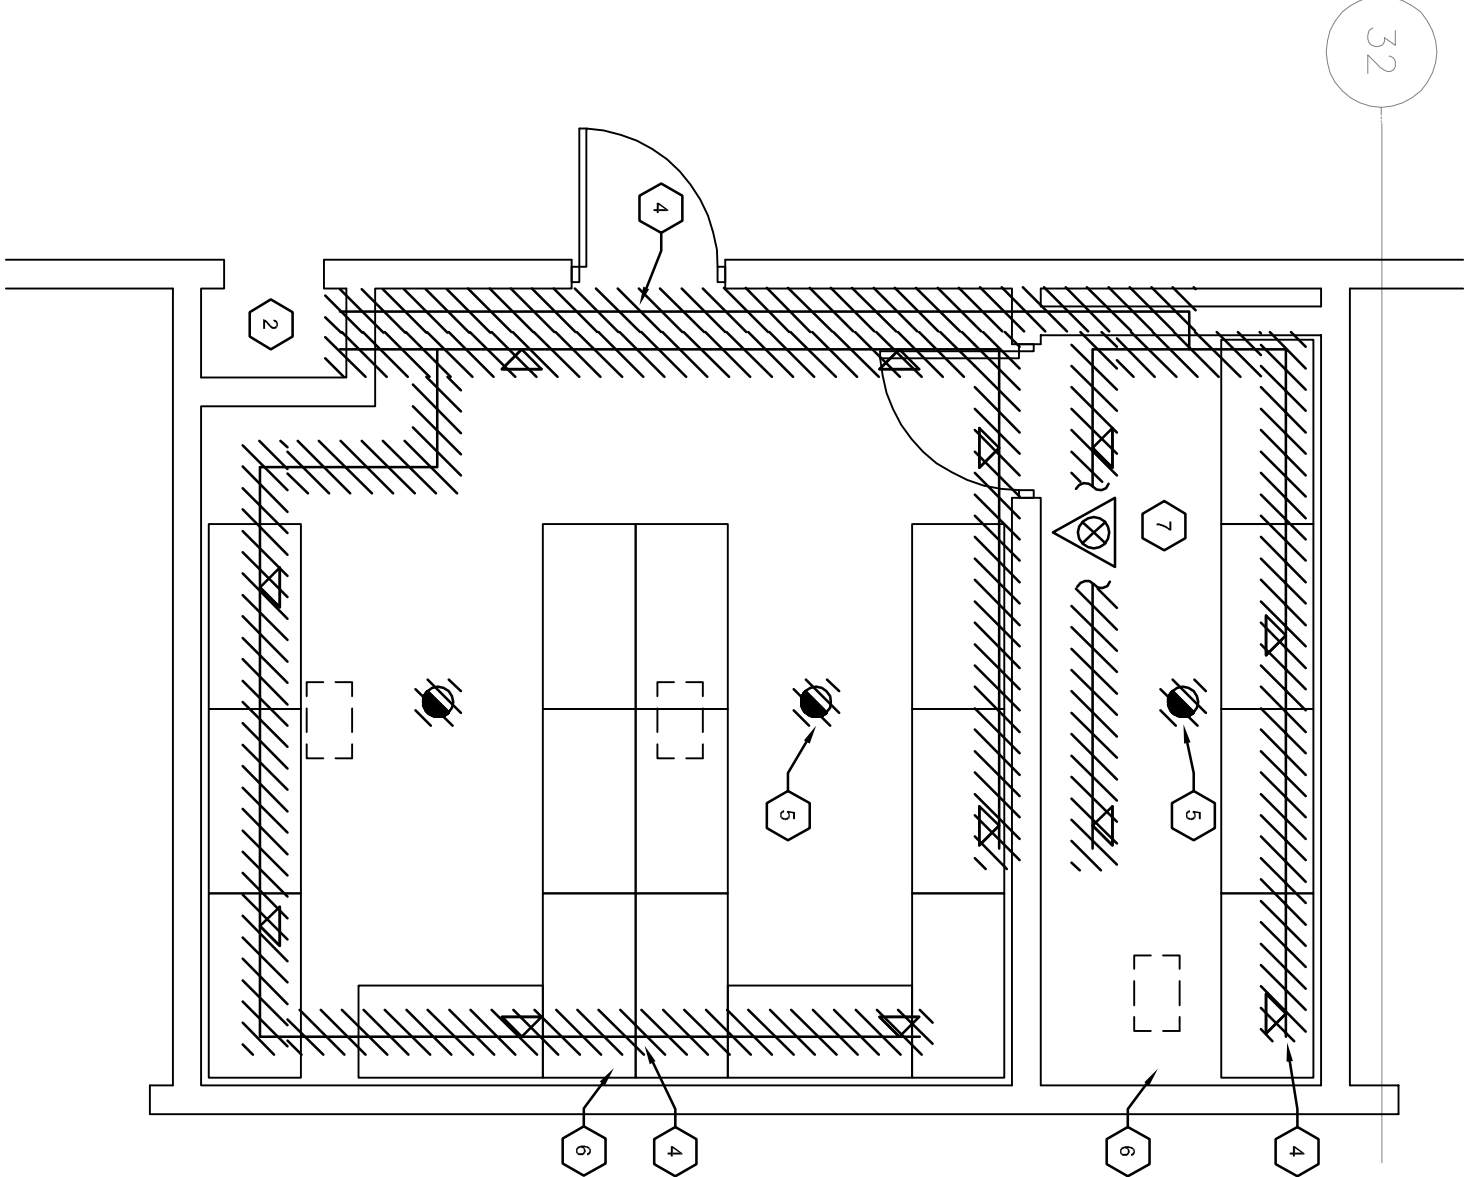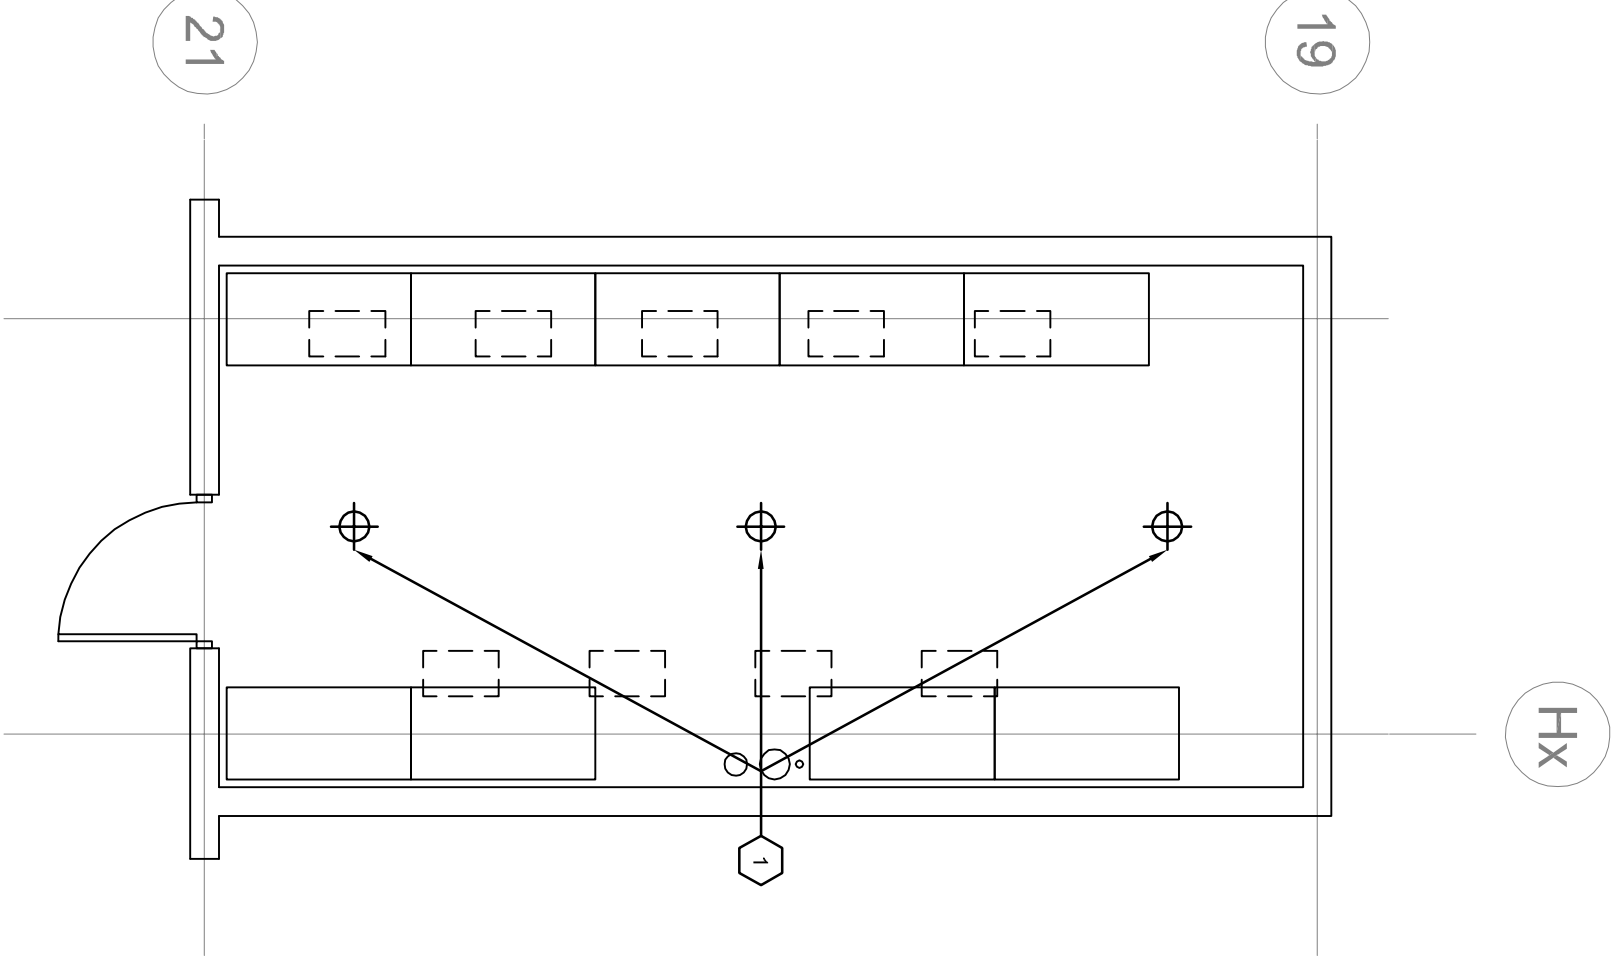

Contractor to verify all dimensions  
& conditions on site and immediately  
notify the engineer of all discrepancies.

03	ISSUED FOR TENDER	2016.04.15
02	99% DESIGN	2016.01.14
01	50% DESIGN	2015.05.08
revisions	description	date

A	no. du détail	A
C	location drawing no.	C
	sur dessin no.	
	C drawing no.	
	dessin no.	

## L757 RENOVATIONS

867 LAKESHORE RD.  
BURLINGTON, ON L7R 4A6

drawing

## FIRE PROTECTION MODIFICATIONS

Designed By	DV	Conçu par
Date	2016-01-14	(yyyy/mm/dd)
Drawn By	LS	Dessiné par
Date	2016-01-14	(yyyy/mm/dd)
Reviewed By	DV	Examiné par
Date	2016-01-14	(yyyy/mm/dd)
Approved By	WK	Approuvé par
Date	2016-01-14	(yyyy/mm/dd)

Tender ASIF MOHAMMED

Project Manager

CCIW-010-J119

Drawing no. F1

No. du dessin

1 ROOM W203 - SPRINKLER MODIFICATIONS  
F1 1:50

2 CARBON DIOXIDE - DEMOLITION  
F1 1:50

3 CARBON DIOXIDE - DEMOLITION (8th FLOOR)  
F1 1:125