



RETURN BIDS TO:
RETOURNER LES SOUMISSIONS À:
Bid Receiving Public Works and Government
Services Canada/Réception des soumissions
Travaux publics et Services gouvernementaux
Canada
The Cambridge Building
3 Queen Street/ 3, rue Queen
PO Box 5000/CP 5000
Charlottetown, PEI C1A 4A2
Bid Fax: (902) 566-7514

SOLICITATION AMENDMENT

MODIFICATION DE L'INVITATION

The referenced document is hereby revised; unless otherwise indicated, all other terms and conditions of the Solicitation remain the same.

Ce document est par la présente révisé; sauf indication contraire, les modalités de l'invitation demeurent les mêmes.

Comments - Commentaires

Vendor/Firm Name and Address
Raison sociale et adresse du
fournisseur/de l'entrepreneur

Issuing Office - Bureau de distribution
Commercial Acquisitions (PEI)
The Cambridge Building
3 Queen Street/3 rue, Queen
Charlottetown, PEI C1A 4A2

Title - Sujet Parking Lot Repair JAG Bldg PEI	
Solicitation No. - N° de l'invitation ED001-170593/A	Amendment No. - N° modif. 002
Client Reference No. - N° de référence du client R.074056.001	Date 2016-07-06
GETS Reference No. - N° de référence de SEAG PW-\$PWC-023-3902	
File No. - N° de dossier PEI-6-39030 (023)	CCC No./N° CCC - FMS No./N° VME
Solicitation Closes - L'invitation prend fin at - à 02:00 PM on - le 2016-07-12	
Time Zone Fuseau horaire Atlantic Daylight Saving Time ADT	
F.O.B. - F.A.B. Plant-Usine: <input type="checkbox"/> Destination: <input checked="" type="checkbox"/> Other-Autre: <input type="checkbox"/>	
Address Enquiries to: - Adresser toutes questions à: Ellis-Herring, Alison	Buyer Id - Id de l'acheteur pwc023
Telephone No. - N° de téléphone (506) 636-3908 ()	FAX No. - N° de FAX (506) 636-4376
Destination - of Goods, Services, and Construction: Destination - des biens, services et construction:	

Instructions: See Herein

Instructions: Voir aux présentes

Delivery Required - Livraison exigée	Delivery Offered - Livraison proposée
Vendor/Firm Name and Address Raison sociale et adresse du fournisseur/de l'entrepreneur	
Telephone No. - N° de téléphone Facsimile No. - N° de télécopieur	
Name and title of person authorized to sign on behalf of Vendor/Firm (type or print) Nom et titre de la personne autorisée à signer au nom du fournisseur/ de l'entrepreneur (taper ou écrire en caractères d'imprimerie)	
Signature	Date

Solicitation No. - N° de l'invitation
ED001-170593/A

Amd. No. - N° de la modif.
002

Buyer ID - Id de l'acheteur
pwc023

Client Ref. No. - N° de réf. du client
R.074056.001

File No. - N° du dossier
PEI-6-39030

CCC No./N° CCC - FMS No./N° VME

Cette modification à l'invitation numéro deux (2) est soumise pour inclure l'addenda numéro 2 suivant.

La modification qui suit apportée aux documents de soumission entre en vigueur dès maintenant.
L'addenda fera partie des documents de contrat.

Toutes autres conditions ne changent pas.

Addenda numéro 2.

1. DOCUMENT D'APPEL D'OFFRE

ENLEVEZ l'Appendice 1 - Formulaire de prix combinés et le **REMPLACEZ AVEC**
l'Appendice 1 - Formulaire de prix combinés révisé et daté du 4 juillet 2016 ci-attaché.

Veuillez noter que l'Appendice 1 - Formulaire de prix combinés et daté du 4 juillet 2016 qui
est joint à la présente modification est celui que vous **DEVEZ** présenter avec votre soumission.

2. SPECIFICATIONS

1. The revised Unit Price Table (refer to item 1 of Addendum 2) includes a new item "Mobilization & Demobilization" along with revised quantities to represent additional work outlined in revised drawings and specifications.
2. Bidders are advised that they will be paid for Mobilization & Demobilization on one occasion only for the entire project. All shutdowns and restarts due to restrictions outlined in the drawings and specifications are to be included in the lump sum bid price for Mobilization & Demobilization. In addition, no monies will be paid due to any shutdown/slowdown as a result of elevated odours/contaminants in the Joseph A. Ghiz Building air distribution systems.
3. Include all costs for relocation of existing concrete light base, pole, lamp and wiring in the lump sum bid price for Mobilization & Demobilization.
4. Include all costs for removal of existing concrete curb, removal/replacement of paving stones, removal/replacement of flagpole and base for construction of one additional disabled parking stall in the lump sum bid price for Mobilization & Demobilization.
5. **Section 01 10 10**, Part 1.20.2:
The word "wit2hin" should be "within"
6. **Section 32 11 23**, Part 3.6.1 and 3.6.2:
Remove Phases 1, 2 and 3 and replace with the following:

Heavy Duty:	Asphalt Base	75mm
	Asphalt Seal	<u>50mm</u>
	Total Asphalt	

Solicitation No. - N° de l'invitation
ED001-170593/A

Amd. No. - N° de la modif.
002

Buyer ID - Id de l'acheteur
pwc023

Client Ref. No. - N° de réf. du client
R.074056.001

File No. - N° du dossier
PEI-6-39030

CCC No./N° CCC - FMS No./N° VME

Thickness = 125mm

Light Duty: Asphalt Base 60mm

Asphalt Seal 40mm

Total Asphalt

Thickness = 100mm

4. DRAWINGS

REMOVE drawings C0, C1, C2, C3, C4, C5, C6, C7 and C8 **AND REPLACE WITH** attached revised drawings C0, C1, C2, C3, C4, C5, C6, C7 and C8.

5. QUESTIONS AND ANSWERS

Q1. Section 31 23 33 .01 page 4, 3.6.2

States we are to retain services of PEI Land Surveyor for layout and grade certification.

Do we have to have them layout all items and individual layers of materials in the same capacity that our own construction surveyor would or is it just for final signoff and verification or our own layout. My concern is that the cost to have this done by a land surveyor will be extremely expensive and in my own opinion unnecessary. Day to day layout should be own forces and if needed verification should be by land surveyor. Please indicate scope of what is expected of the land surveyor.

A1. The contractor can provide its own day to day surveying. All quantity calculations shall be submitted with progress claims. Final grade certification shall be by a PEI Licensed Land Surveyor.

Q2. Section 32 01 16 page 1, 1.4.1

States that Asphalt corings have been carried out and included in appendix A.

I do not see an appendix A in the documents and as it is vital to know the existing thickness, Can you please provide any information on this that you have. We will need to know the thickness to calculate the price per M2 for the removal of asphalt.

A2. See attached, "Table 1 – Pavement Coring Summary" and Dwg No. 1 titled "Pavement Condition Assessment".

Solicitation No. - N° de l'invitation
ED001-170593/A

Amd. No. - N° de la modif.
002

Buyer ID - Id de l'acheteur
pwc023

Client Ref. No. - N° de réf. du client
R.074056.001

File No. - N° du dossier
PEI-6-39030

CCC No./N° CCC - FMS No./N° VME

Q3. Section 32 01 16 Page 3, 3.6.1

States that all work is to be carried out on this project during weekend times.

Is this the case. It is shown elsewhere in the document that it is incorrect at some level.

A3. Delete Section 32 01 16 part 3.6.1

Q4. Section 01 10 10 page 7, 1.20.1

States that at all times, driveway, loading areas and parking areas shall be left in a usable state for all employees and visitors to the tax centre.

Can you define usable. I am wondering what finished surface is considered acceptable for the duration of the project. At various times due to your scheduling / phasing requirements we will be required to have the project in a semi finished state until the next available phase window. It could mean that a granular surface is what can be available. Is this acceptable, and if not what surface is.

A4. A well graded granular surface free from potholes and controlled for dust will be acceptable and considered useable for up to one week at any one location. All surfaces must be paved with hot mix asphalt base material in order to be considered useable for periods longer than one week.

Q5. Section 01 10 10 page 8, 1.20.7

States that work must be completed by specified date or we will be required to provide parking / transport for those areas still under construction. Should we be the successful bid, can you confirm the actual date we would be able to start the work with the full award and contracts done. We have been given an end date but no start date. It is impossible to allow for this penalty if we are unable to set a start time and evaluate if we can have the project complete by the time stipulated. We would need the time frame to allow properly.

A5. Assume work will be permitted to begin on Monday July 18th. The Contractor must fulfil their obligations that are required prior to starting work onsite, including submission of insurance certificates, health and safety plan, detailed schedule, required permits, and all other required items.

Q6. Section 01 10 10 page 8, 1.20.10

Solicitation No. - N° de l'invitation
ED001-170593/A

Amd. No. - N° de la modif.
002

Buyer ID - Id de l'acheteur
pwc023

Client Ref. No. - N° de réf. du client
R.074056.001

File No. - N° du dossier
PEI-6-39030

CCC No./N° CCC - FMS No./N° VME

States that the roadway in front of the building must be done on weekends.

Are we able to use smaller areas with traffic control to do curb and sidewalk repairs prior to working on the main asphalt roadway?

Further to that can you define what "Usable" is? Is it a granular surface or is it asphalt? Or other?

A6. Most work on and around the roadway directly in front of the building and main entrances must be completed on weekends or during evenings to prevent disruptions to traffic and pedestrians and to prevent paving odours and emissions from materials and equipment from entering the building through the doors or fresh air intake grills. Miscellaneous work can take place in this area during the day on weekdays if there will be no disruption to traffic and pedestrians and no odours and emissions will be generated to the extent that they will enter the building.

See above definition provided as a response to item #10.

Q7. Section 01 11 01 general observation ad question

The item for Mobilization and Demobilization has a considerable amount of work involved and various items that can be easily covered off by unit measure or a Lump Sum item. Can you add a pay item to the contract for this work. With the majority of the items being unit measure it is impossible to allow for Lump sum costs in unit bid items that will vary in Quantity throughout the project. If seem completely unrealistic to try to blend a scope this large across various fluctuating items. Please provide an item so that we may be compensated fairly for the work required and also allow to not have to provide weighted unit bid items that would unbalance the bid.

A7. Mobilization & Demobilization has been added as a bid item in the Unit Price Table – Revised July 04, 2016.

Q8. Can we work on the loading dock and side entrance roads during normal operating times while still working on the areas of parking lot up to 140 stalls?

A8. Yes. Work on the access roads and parking/service areas to the south and west of the building must be coordinated with the building facilities staff to ensure there is, at all times, safe and efficient passage, parking and use by pedestrians, staff, vehicles, delivery trucks and all other vehicles.

Q9. Do we need to provide asphalt base and seal along with line paint prior to moving to the next section of construction?

A9. It is a requirement of this project that all parking areas are to be completed in their entirety prior to moving to another parking area. The intention is to minimize shuffling the areas where staff can park. If the Contractor wishes, consideration will be given to permitting placement of the asphalt seal

Solicitation No. - N° de l'invitation
ED001-170593/A

Amd. No. - N° de la modif.
002

Buyer ID - Id de l'acheteur
pwc023

Client Ref. No. - N° de réf. du client
R.074056.001

File No. - N° du dossier
PEI-6-39030

CCC No./N° CCC - FMS No./N° VME

coat during off hours (evenings or weekends) if an acceptable arrangement can be agreed to among all parties. In addition, it is reaffirmed that lane painting must occur as specified.

Q10. Is work allowed after hours and through the night in order to meet schedule requirements?

A10. Any work carried out after hours must meet Provincial and Municipal bylaws. If this option is chosen, additional coordination of limited parking would be required by the Contractor since some staff in the building do work overnight shifts. In addition, the Contractor shall be required to ensure safe passage for pedestrians and vehicles through the twilight and night times.

Solicitation No. - N° de l'invitation
ED001-170593/A

Amd. No. - N° de la modif.
002

Buyer ID - Id de l'acheteur
pwc023

Client Ref. No. - N° de réf. du client
R.074056.001

File No. - N° du dossier
PEI-6-39030

CCC No./N° CCC - FMS No./N° VME

APPENDICE 1 - FORMULAIRE DE PRIX COMBINÉS - Révisée (3 pages) le 4 juillet 2016

- 1) Les prix unitaires seront retenus pour établir le montant total des prix calculés. Toute erreur arithmétique à cet appendice sera corrigée par le Canada.
- 2) Le Canada peut rejeter la soumission si quelconque des prix soumis ne tient pas fidèlement compte du coût de l'exécution de la partie des travaux à laquelle ce prix s'applique.

MONTANT FORFAITAIRE

Le montant forfaitaire désigne la partie des travaux qui est assujettie à un arrangement à prix forfaitaire.

- (a) Les travaux inclus dans le montant forfaitaire représentent tous les travaux qui ne sont pas inclus dans le tableau des prix unitaires.

MONTANT FORFAITAIRE (MF) Excluant les taxes applicable(s)	Non applicable
---	----------------

TABLEAU DES PRIX UNITAIRES

Le tableau des prix unitaires désigne la partie des travaux qui est assujettie à un arrangement à prix unitaires.

- a) Les travaux faisant partie de chaque article sont tels que décrits aux sections du devis en référence.
- b) Le prix unitaire ne doit pas inclure de montants pour des travaux qui ne sont pas inclus aux articles de prix unitaires.

Article	Référence au devis	Catégorie de main-d'œuvre, outillage ou matériaux	Unité de mesure	Quantité Estimative (QE)	Prix unitaire (PU) Excluant les taxe(s) applicables	Prix calculé (QE x PU) Excluant les taxe(s) applicables
1	01 11 01	Mobilisation et démobilisation	montant forfaitaire	1		
2	01 29 83	Essai des matériaux	montant forfaitaire	1		
3	32 01 16	Enlèvement du revêtement bitumineux existant	m ²	19700		
4	31 23 33.01	Excavation : pour aires de stationnement/voies d'accès (y compris l'excavation et le nivellement du compactage d'épreuve)	m ³	3800		
5	31 23 33.01	Excavation : pour bordures, caniveaux et sentiers en béton	m ³	500		
6	35 05 14	Puisards (réparations)	unités	10		
7	32 11 16.01	Compactage d'épreuve	montant forfaitaire	1		

Solicitation No. - N° de l'invitation
ED001-170593/A

Amd. No. - N° de la modif.
002

Buyer ID - Id de l'acheteur
pwc023

Client Ref. No. - N° de réf. du client
R.074056.001

File No. - N° du dossier
PEI-6-39030

CCC No./N° CCC - FMS No./N° VME

Article	Référence au devis	Catégorie de main-d'œuvre, outillage ou matériaux	Unité de mesure	Quantité Estimative (QE)	Prix unitaire (PU) Excluant les taxe(s) applicables	Prix calculé (QE x PU) Excluant les taxe(s) applicables
8	32 11 16.01	Remblayer les aires de compactage d'épreuve et les aires à réparer indiquées sur les plans avec du remblai d'emprunt de qualité supérieure	tonne	4700		
9	32 11 16.01	Matériau d'emprunt de qualité supérieure — bordures, caniveaux et sentiers en béton	tonne	400		
10	32 11 23	Remblayer les aires de compactage d'épreuve et les aires à réparer indiquées sur les plans avec du gravier de catégorie A	tonne	4300		
11	32 11 23	Gravier de catégorie A — bordures, caniveaux et sentiers en béton	tonne	300		
12	32 16 15	Trottoirs, bordures et caniveaux en béton				
		Bordures et caniveaux	m	365		
		Trottoirs	m	90		
13	32 12 13.16	Couche de bitume d'accrochage	m ²	20 000		
14	32 17 23	Marques sur la chaussée	montant forfaitaire	1		
15	32 91 19	Mise en place de terre végétale et nivellement de finition	m ²	650		
16	32 12 16	Revêtement bitumineux				
		Couche de case (75 mm d'épaisseur)	tonne	1650		
		Couche de scellement (50 mm d'épaisseur)	tonne	1100		
17	32 12 16	Revêtement bitumineux				

Solicitation No. - N° de l'invitation
ED001-170593/A

Amd. No. - N° de la modif.
002

Buyer ID - Id de l'acheteur
pwc023

Client Ref. No. - N° de réf. du client
R.074056.001

File No. - N° du dossier
PEI-6-39030


CCC No./N° CCC - FMS No./N° VME

Article	Référence au devis	Catégorie de main-d'œuvre, outillage ou matériaux	Unité de mesure	Quantité Estimative (QE)	Prix unitaire (PU) Excluant les taxe(s) applicables	Prix calculé (QE x PU) Excluant les taxe(s) applicables
		Couche de case (60 mm d'épaisseur)	tonne	2050		
		Couche de scellement (40 mm d'épaisseur)	tonne	1370		
18	32 92 23	Gazonnement	m ²	900		
TOTAL DES PRIX CALCULÉS (TPC) Excluant les taxes applicable(s)						

MONTANT TOTAL DE LA SOUMISSION (MF +TPC) Excluant les taxes applicable(s)	
---	--

Table 1 - Pavement Core Summary

	Core #/Location	Pavement Thickness (mm)			Comments
		Seal	Base	Total	
1	P1-1	45	70	115	1999 expansion; core in good condition
2	P2-1	40	65	105	1999 expansion; core delaminated between seal and base lifts
3	P2-2	45	90	135	1999 expansion; core delaminated between seal and base lifts
4	P3-1	40	80	120	seal core in good condition; base layer fragmented by coring equipment
5	P3-2	50	55	105	core in good condition
6	P4-1	35	60	95	core in good condition
7	P5-1	35	65	100	seal core in good condition; base layer fragmented by coring equipment
8	P5-2	45	55	100	seal core in good condition; base layer fragmented by coring equipment
9	P6-1	30	65	95	core in good condition
10	P6-2	35	70	105	core in good condition
11	P7-1	30	65	95	core in good condition
12	P7-2	30	70	100	core in good condition
13	R1-1	20	70	90	roadway; core in good condition
14	R1-2	50	105	155	roadway; core in good condition
15	R2-1 (west)	25	110	135	roadway; core in good condition
16	R2-2 (south)	60	105	165	roadway; core in good condition; two layers of seal at 30 mm per layer
17	R2-3 (south)	30	75	105	roadway; core in good condition
18	R2-4 (east)	30	115	145	roadway; core in good condition

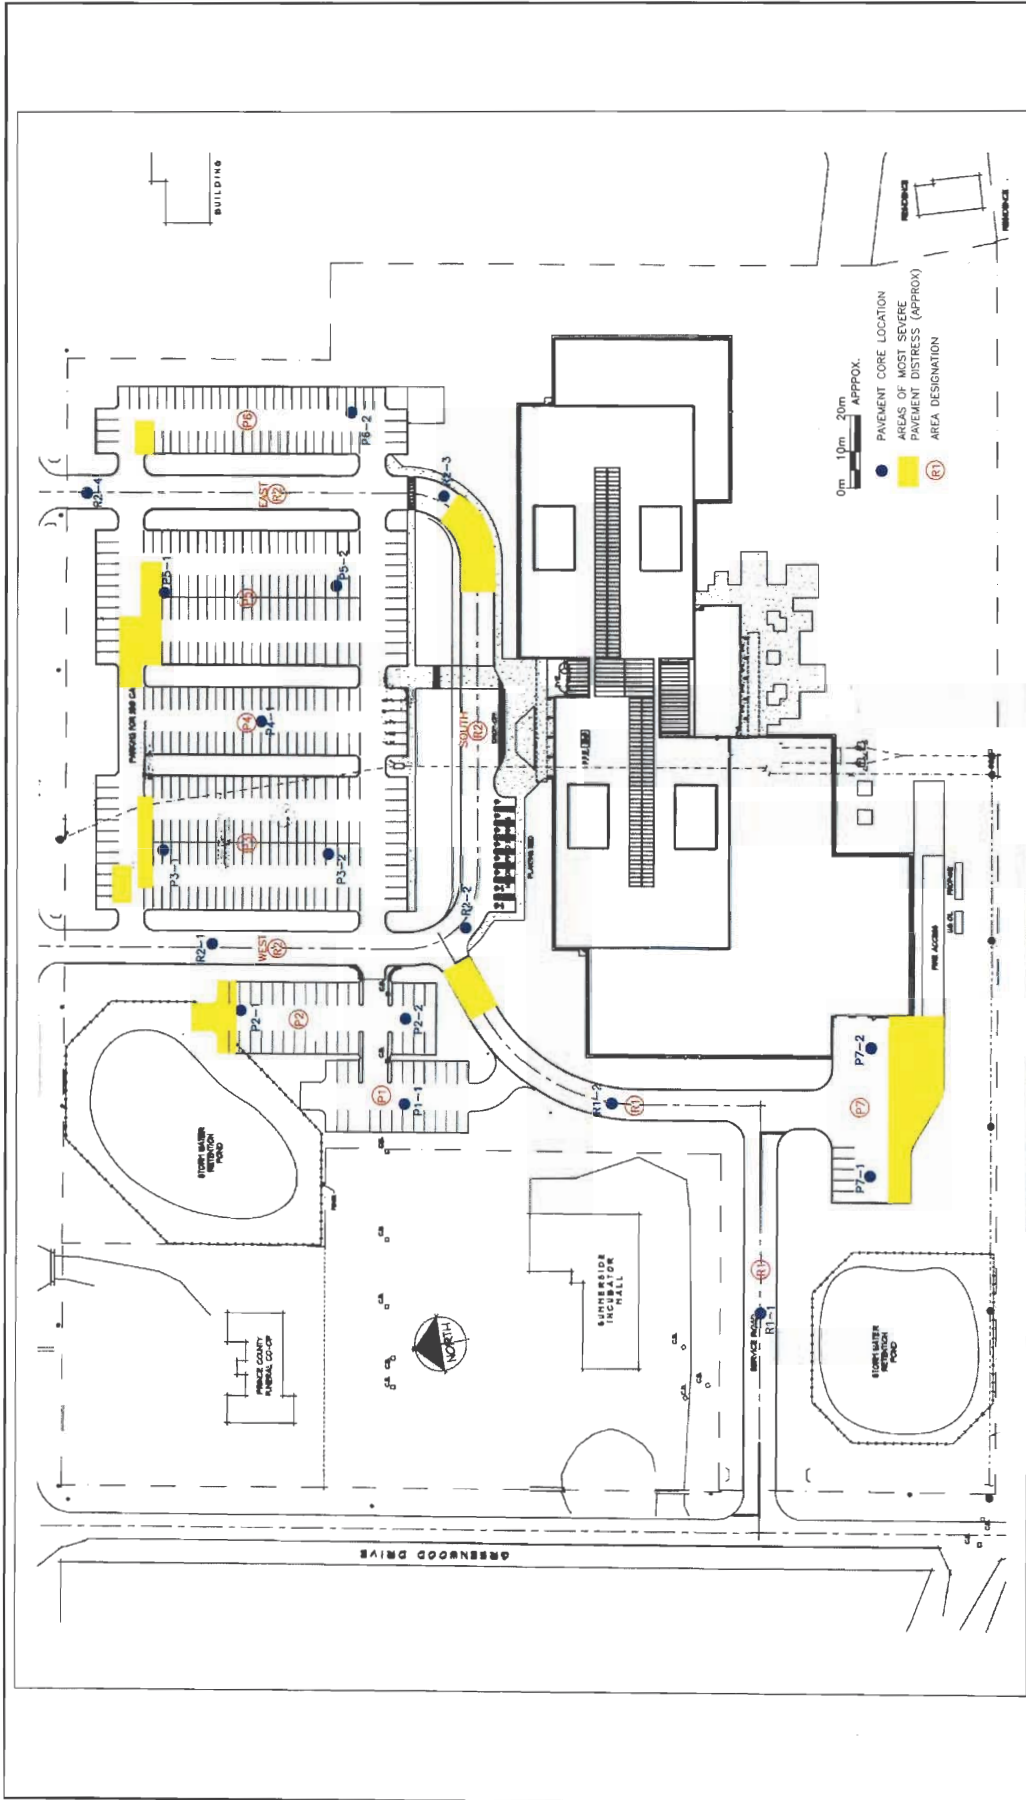

Reference:	THIS DRAWING ILLUSTRATES SUPPORTING INFORMATION SPECIFIC TO A STANTEC CONSULTING LTD. REPORT AND MUST NOT BE USED FOR OTHER PURPOSES.	PAVEMENT CONDITION ASSESSMENT		Job No.:	121617730	Dwg. No.:	1
		SUMMERSIDE TAX CENTER (JOSEPH A. GHIZ BUILDING)		Scale:	1 : 1250		
		SUMMERSIDE, PRINCE COUNTY, PEI		Date:	9-SEPT-2014		
				Dwn. By:	MO		
				App'd By:	GZ		
Client:		WSP CANADA					