



Control Room
 HS-3177, HS-3178; PT-3103, PT-3104

Ground Floor - Room 116

Ground Floor - Room 115

P&ID Block 2 Sheet 2-05
 FCV-2501; FT-2501; PSL-2501; PT-2501

P&ID Block 2 Sheet 2-06
 FCV-2601, FCV-2602, FCV-2603, FCV-2605, FCV-2606; FSH-2604; FT-2601, FT-2602, FT-2603, FT-2604, FT-2605, FT-2606; M-2601 (VFD-2601), M-2602 (VFD-2602), M-2603 (YE-2603); PCV-2601; PT-2601, PT-2602, PT-2603, PT-2604, PT-2605

TC-116-2

P&ID Block 4 Sheet 4-04
 LT-4401; M-4401 (YE-4401); PCV-4401; PT-4401

P&ID Block 5 Sheet 5-03

TC-115-2

SC-115-1
SC-115-2

SC-116-1
SC-116-2
SC-116-3
SC-116-4

P&ID Block 4 Sheet 4-05
 FSL-4501; M-4501 (YE-4501), M-4502 (HS-4502); PT-4501; TCV-4501

P&ID Block 2 Sheet 2-04
 FT-2402; H-2401; LT-2401; M-2402 (VFD-2402); PT-2401

P&ID Block 3 Sheet 3-02
 H-3201

P&ID Block 3 Sheet 3-01


TC-116-1

P&ID Block 1 Sheet 1-06
 PDSH-1601, PDSH-1602; M-1601 (YE-1601), M-1602 (YE-1602), M-1603 (YE-1603), M-1604 (YE-1604); PCV-1601, PCV-1602; PT-1601, PT-1602

TC-115-1

P&ID Block 3 Sheet 3-03
 FT-3301; LCV-3301, LCV-3302; PDT-3301, PDT-3302, PDT-3303, PDT-3304

REV.	DESCRIPTION	DATE	BY	DRAWN BY:	Ground Level		
1	OSLI Phase 2 Electrical Layout	2015/11/23	SC				
					ISSUED:		1
					SCALE:	NONE	
							1



Second Level – Room M9

Second Level – Room M8


P&ID Block 2 Sheet 2-01
 FCV-2101, FCV-2102, FCV-2103, FCV-2104, FCV-2105, FCV-2106,
 FCV-2107, FCV-2108, FCV-2109, FCV-2110, FCV-2111; FT-2101, FT-2102,
 FT-2103, FT-2104, FT-2105, FT-2106, FT-2107, FT-2108, FT-2109,
 FT-2110, FT-2111; PT-2101, PT-2103, PT-2104, PT-2105,
 PT-2106, PT-2109, PT-2110, PT-2111, PT-2113, PT-2115, PT-2117,
 PT-2119, PT-2120, PT-2121

TC-M9-1

P&ID Block 4 Sheet 4-01
 FT-4101, FT-4102, FT-4103,
 FT-4104, FT-4105; TCV-4101,
 TCV-4102, TCV-4103, TCV-4104,
 TCV-4105

P&ID Block 4 Sheet 4-02
 FT-4202, FT-4203; TCV-4202,
 TCV-4203

Up →

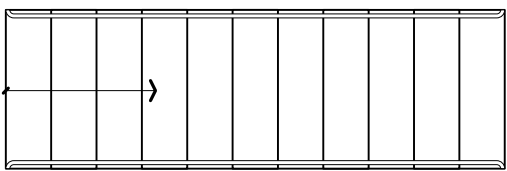

P&ID Block 2 Sheet 2-06
 H-2602, H-2603

SC-M9-1
 SC-M9-2
 SC-M9-3
 SC-M9-4

P&ID Block 2 Sheet 2-03
 M-2301 (VFD-2301), M-2302 (VFD-2302); PT-2301; WT-2301

P&ID Block 3 Sheet 3-04
 LT-3401

TC-M8-5

P&ID Block 3 Sheet 3-02
 FS-3203; PDT-3201,
 PDT-3202

TC-M8-4

P&ID Block 3 Sheet 3-02
 PT-3201; LT-3201

P&ID Block 5 Sheet 5-01
 FCV-5103, FCV-5105;
 FT-5103, FT-5105;
 PT-5103, PT-5105

TC-M8-3

P&ID Block 3 Sheet 3-01
 LT-3101; PT-3102

TC-M8-1

P&ID Block 4 Sheet 4-03
 F-4301;
 M-4301
 (VFD-4301);
 PT-4301,
 PT-4302;
 TCV-4301,
 TCV-4302

TC-M8-2

TC-M9-2

P&ID Block 5 Sheet 5-01, 5-02
 FCV-5102, FCV-5104, FCV-5106; FSL-5201;
 FT-5102, FT-5104, FT-5106; PT-5102, PT-5104, PT-5106;
 HS-5101, HS-5102, HS-5103, HS-5201, HS-5202

SC-M9-5


SC-M8-1 SC-M8-2 SC-M8-3

REV.	DESCRIPTION	DATE	BY	DRAWN BY:
1	OSLI Phase 2 Electrical Layout	2015/11/23	SC	
				APPROVED BY:
				ISSUED:
				SCALE: NONE

Second Level		
DRAWING NO	SHEET NO	REVISION NO
	2	1




Third Level – M8 Mezzanine

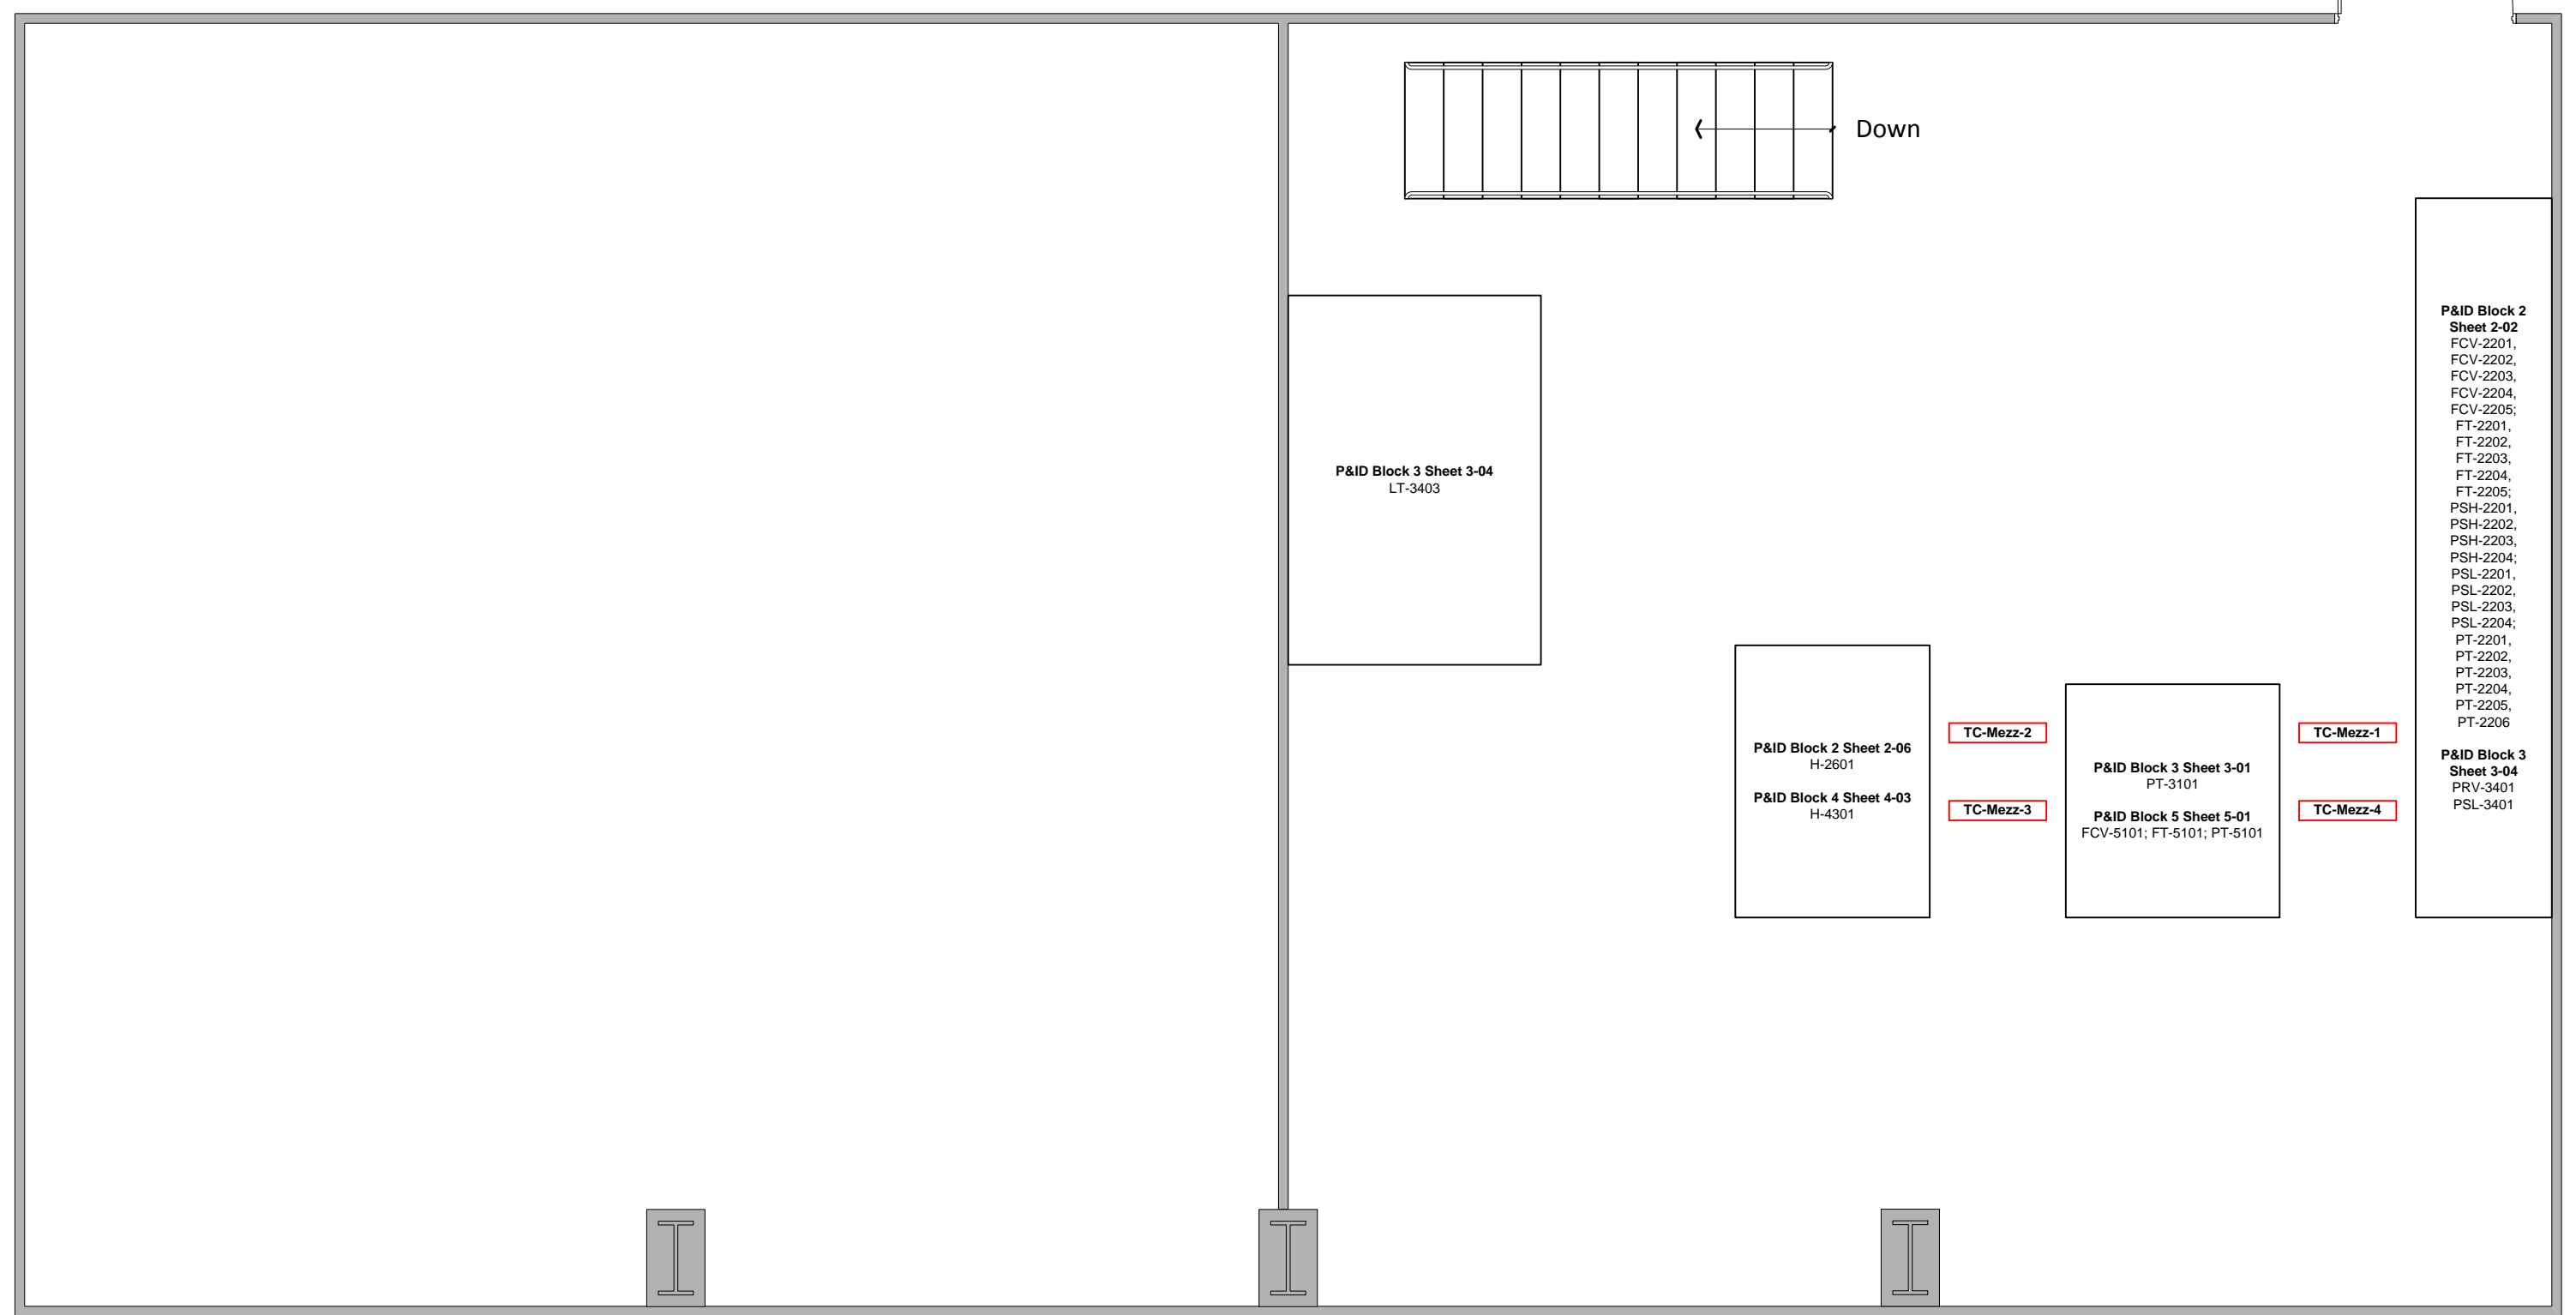

REV.	DESCRIPTION	DATE	BY	DRAWN BY:	Third Level		
1	OSLI Phase 2 Electrical Layout	2015/11/23	SC				
				APPROVED BY:			
				ISSUED:	DRAWING NO	SHEET NO	REVISION NO
				SCALE:		3	1


N




P&ID Block 4 Sheet 4-05
M-4503A (YE-4503A), M-4503B (YE-4503B)

Building 4 (roof)


Building 4 Parking Lot (Paved)

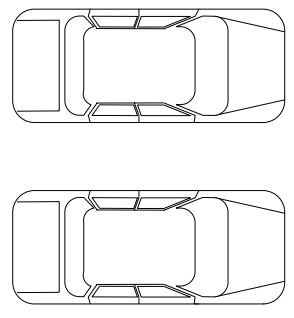

Building 3 Parking Lot (Gravel)

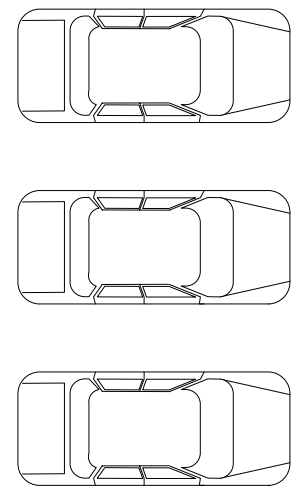

Building 3 Parking Lot (Paved)

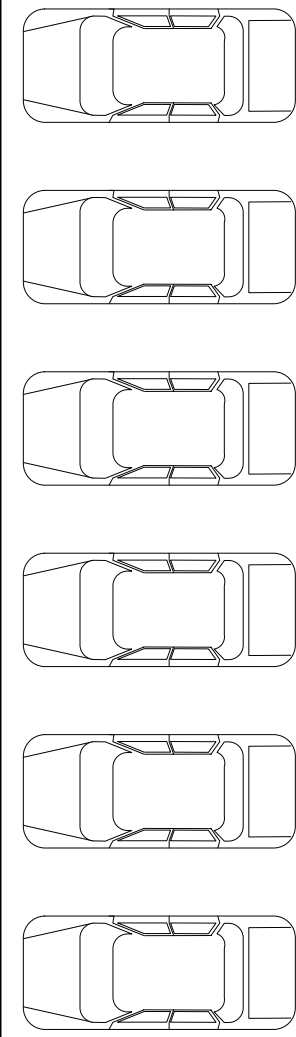

Fire Route

N2 Gas Pad

P&ID Block 1 Sheet 1-03
M-1301A/B (YE-1301); PT-1302

O2 Gas Pad

N2 Gas Pad

CO2 Gas Pad

P&ID Block 1 Sheet 1-01
H-1102; M-1101A/B (YE-1101); PT-1102

P&ID Block 1 Sheet 1-06
H-1601, H-1602; LT-1601, LT-1602; M-1605, M-1606

TC Jack Panel x
TC (x)
TE-1101
TE-1102
TE-1103
TE-1104
TE-1105

O2 Compressor and Buffer Tank

P&ID Block 1 Sheet 1-02
M-1201A/B (YE-1201); PT-1203

P&ID Block 1 Sheet 1-04
FQ-1401; FQ-1402, FQ-1403, FQ-1404; M-1401 (YE-1401); PSH-1401; PSL-1401

Gravel Pad Access

REV.	DESCRIPTION	DATE	BY	DRAWN BY:	Outside		
1	OSLI Phase 2 Electrical Layout	2015/11/23	SC				
				APPROVED BY:			
				ISSUED:	DRAWING NO	SHEET NO	REVISION NO
				SCALE:		4	1