

SPECIFICATION

Restoration of the Cape Bauld Light Tower, NL


F6879-167006

PREPARED FOR

Fisheries and Oceans Canada

DATE

August 8, 2016
Revision 1

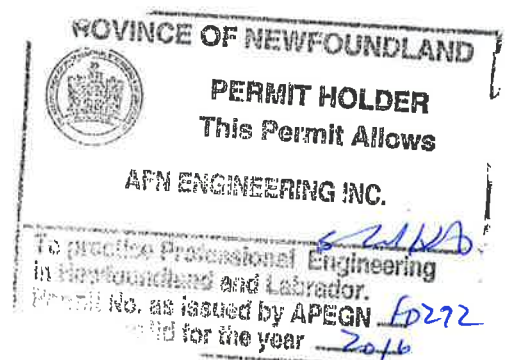

LIST OF DRAWINGS

Page 1

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

DRAWING NO

TITLE

02M1101A02401C1

Work Plan

02M1101A02401C2

Details

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

<u>Section</u>	<u>Title</u>	<u>Pages</u>
01 10 10	GENERAL INSTRUCTIONS	12
01 33 00	SUBMITTAL PROCEDURES	5
01 35 24	SPECIAL PROCEDURES ON FIRE SAFETY REQUIREMENTS	5
01 35 29	HEALTH AND SAFETY REQUIREMENTS	12
01 35 43	ENVIRONMENTAL PROCEDURES	4
01 50 00	TEMPORARY FACILITIES	1
01 56 00	TEMPORARY BARRIERS AND ENCLOSURES	1
01 74 11	CLEANING	1
01 78 00	CLOSEOUT SUBMITTALS	1
02 41 16	SITWORK, DEMOLITION AND REMOVAL	3
02 83 12	LEAD PAINT ABATEMENT MAXIMUM PRECAUTIONS	7
09 91 13	PAINTING	12

Appendix A: General Pictures
Appendix B: Lead Paint Samples
Appendix C: FHBRO Report

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

1.1 SCOPE

- .1 The work consists of the furnishing of all plant, labour, equipment and material for restoration of the Light Tower in Cape Bauld, NL, in strict accordance with specifications and accompanying drawings and subject to all terms and conditions of the Contract. The Cape Bauld Light tower is located in a rocky, barren landscape on the northern tip of Quirpon Island at the northern entrance to the Strait of Belle Isle. The lightstation is visible from L'Anse-aux-Meadows National Historic Site and World Heritage Site, located on the mainland. The site is only accessible by boat or helicopter.
- .2 DFO will schedule a mandatory site visit during the tender period. Details of the mandatory site visit will be provided by the DFO Contracting officer.
- .3 The Cape Bauld Lighttower is a "Recognized" Federal Heritage Building because of its historical associations, and its architectural and environmental values. Standards and Guidelines for the Conservation of Historic Places in Canada is to be abided by in this contract. A copy of the standards can be obtained on-line or by contacting the Departmental Representative.

1.2 DESCRIPTION OF WORK

- .1 In general, work under this contract consists of, but will not necessarily be limited to, the following:
 - .1 Removal of all paint from the exterior concrete surfaces (down to bare concrete) and re-painting of the exterior concrete tower. General requirements include high pressure washing or sand blasting to remove all the previous paint coatings and re-painting using 2 coats of Master

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

Protect EL750 Elastomeric Coating (or approved equivalent). All paint to be applied as per manufacturer's instructions. Prior to re-painting, apply repair mortar MasterEmaco N425 (or approved equivalent), to any concrete surfaces with open cracks (coordinate on site with Departmental Representative). Note that lead paint is present on the exterior surfaces and controls will have to be in place to limit occupational exposure to lead dust during sand blasting activities. Also note that the exterior of the tower is to be fully scaffolded, enclosed and hoarded prior to re-painting (the intent being to ensure temperatures an ambient surface conditions can be maintained for the newly applied paint). All scaffolding/hoarding systems to bear the stamp of a professional engineer, licensed by PEG-NL.

.2 Re-painting of the exterior aluminum lantern room enclosure. General requirements include a light abrasive blast to remove all the existing coatings on the surface to achieve an anchor profile of 1.5mils (rough sand paper finish). Prime the surface by applying 2 coats of Amerlock 2 surface tolerant epoxy coating (or approved equivalent) at 5-7 mils film thickness per coat. Apply one coat of Amershield high solids polyurethane coating (or approved equivalent) at 3-5 mils dry film thickness. Apply as per manufacturer's instructions.

.3 Repairs to the exterior concrete steps and re-painting.

.4 Repairs to the lower concrete lintel above the lighthouse window on the first

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

floor.

.5 Replacement of one (1) broken window pane in the lantern room enclosure, as noted on the drawings.

Do not proceed with any portion of the work until the Departmental Representative has approved the Contractor's written work plan. Ensure any paint chips removed from the exterior concrete surfaces of the tower are properly contained and disposed of at an approved waste site. In the absence of further testing (completed by and paid for) by the Contractor, the lead paint removed from the site is to be disposed of as leachable hazardous waste.

1.3 SITE OF WORK

.1 Work will be carried out at Cape Bauld, NL. The Site is remote and only accessible by boat or helicopter.

1.4 DATUM

.1 Datum used for this project is Lowest Normal Tides (LNT). If requested by the Contractor, the Departmental Representative will establish a benchmark prior to the start of deconstruction activities.

1.5 FAMILIARIZATION
WITH SITE

.1 Before submitting a bid, it is required that bidders visit the site and its surroundings to review and verify the form, nature and extent of the work, materials needed for the completion of the work, the means of access to the site, severity, exposure and uncertainty of weather, any accommodations they may require, and in general shall obtain all necessary information as to risks, contingencies and other circumstances which may influence or affect their bid or costs to do the work. No allowance shall

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

be made subsequently in this connection on account of error or negligence to properly observe and determine the conditions that will apply.

- .2 Contractors, bidders or those they invite to site are to review specification Section 01 35 29 - Health and Safety Requirements before visiting site. Take all appropriate safety measures for any visit to site, either before or after acceptance of bid.

1.6 CODES AND STANDARDS

- .1 Perform work in accordance with the latest edition of the National Building Code of Canada, and any other code of provincial or local application including all amendments up to project bid closing date provided that in any case of conflict or discrepancy, the more stringent requirements shall apply.
- .2 Materials and workmanship must meet or exceed requirements of specified standards, codes and referenced documents.

1.7 TERM ENGINEER

- .1 Unless specifically stated otherwise, the term Engineer where used in the Specifications and on the Drawings shall mean the Departmental Representative.

1.8 SETTING OUT WORK

- .1 Set grades and layout work in detail from control points and grades established by Departmental Representative.
- .2 Assume full responsibility for and execute complete layout of work to locations, lines and elevations indicated or as directed by Departmental Representative.
- .3 Provide devices needed to layout and

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

construct work.

- .4 Supply such devices required to facilitate Departmental Representative's inspection of work.
- .5 Supply stakes and other survey markers required for laying out work.

1.9 COST BREAKDOWN

- .1 Before submitting first progress claim submit breakdown of Contract price in detail as directed by Departmental Representative and aggregating contract price.
- .2 Provide cost breakdown in same format as the numerical and subject title system used in this specification project manual and thereafter sub-divided into major work components as directed by Departmental Representative.
- .3 Upon approval by Departmental Representative, cost breakdown will be used as basis for progress payment.
- .4 This will be a lump sum project. Individual work items will not be measured separately for payment.

1.10 WORK SCHEDULE

- .1 Submit within 7 work days of notification of acceptance of bid, a construction schedule showing commencement and completion of all work within the time stated on the Bid and Acceptance Form and the date stated in the bid acceptance letter.
- .2 Provide sufficient details in schedule to clearly illustrate entire implementation plan, depicting efficient coordination of tasks and resources, to achieve completion of work on time and permit effective

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

monitoring of work progress in relation to established milestones.

- .3 As a minimum, work schedule to be prepared and submitted in the form of Bar (GANTT) Charts, indicating work activities, tasks and other project elements, their anticipated durations and planned dates for achieving key activities and major project milestones provided in sufficient details and supported by narratives to demonstrate a reasonable plan for completion of project within designated time. Generally Bar Charts derived from commercially available computerized project management system are preferred but not mandatory.
- .4 Submit schedule updates on a minimum bi-weekly basis and more often, when requested by Departmental Representative, due to frequent changing project conditions. Provide a narrative explanation of necessary changes and schedule revisions at each update.
- .5 The schedule, including all updates, shall be to Departmental Representative's approval. Take necessary measures to complete work within approved time. Do not change schedule without Departmental Representative's approval.
- .6 All work on the project will be completed within the time indicated on the Bid and Acceptance Form.

1.11 ABBREVIATIONS

- .1 Following abbreviations of standard specifications have been used in this specification and on the drawings:

CGSB - Canadian Government Specifications Board

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

CSA - Canadian Standards Association
NLGA - National Lumber Grades Authority
ASTM - American Society for Testing and
Materials

- .2 Where these abbreviations and standards are used in this project, latest edition in effect on date of bid call will be considered applicable.

1.12 SITE
OPERATIONS

- .1 Arrange for sufficient space adjacent to project site for conduct of operations, storage of materials and so on. Exercise care so as not to obstruct or damage public or private property in area. All arrangements for space and access will be made by Contractor.

1.13 PROJECT
MEETINGS

- .1 Departmental Representative will arrange project meetings and assume responsibility for setting times and recording minutes.
- .2 Project meetings will take place on site of work unless so directed by the Departmental Representative.
- .3 Departmental Representative will assume responsibility for recording minutes of meetings and forwarding copies to all parties present at the meetings.
- .4 Have a responsible member of firm present at all project meetings.

1.14 PROTECTION

- .1 Store all materials and equipment to be incorporated into work to prevent damage by any means.
- .2 Repair or replace all materials damaged in transit or storage to the satisfaction of Departmental Representative and at no cost to Canada.

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

1.15 EXISTING
SERVICES

- .1 Where work involves breaking into or connecting to existing services, carry out work at times directed by governing authorities, with minimum of disturbance to site operations, and tenant operations.
- .2 Before commencing work, establish location and extent of service lines in area of work and notify Departmental Representative of findings.
- .3 Submit schedule to and obtain approval from Departmental Representative for any shut-down or closure of active service or facility.
- .4 Provide temporary services when directed by Departmental Representative to maintain critical facility systems.

1.16 DOCUMENTS
REQUIRED

- .1 Maintain at job site, one copy each of the following:
 - .1 Contract Drawings
 - .2 Specifications
 - .3 Addenda
 - .4 Contract and any resulting amendments signed by contracting authority.
 - .5 Test Reports
 - .6 Copy of Approved Work Schedule
 - .7 Site specific Health and Safety Plan and other safety related documents.

1.17 PERMITS

- .1 Obtain and pay for all permits, certificates and licenses as required by Municipal, Provincial, Federal and other Authorities.
- .2 Provide appropriate notifications of project to municipal and provincial inspection authorities.
- .3 Obtain compliance certificates as prescribed by legislative and regulatory

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

provisions of municipal, provincial and federal authorities as applicable to the performance of work.

.4 Submit to Departmental Representative, copy of application submissions and approval documents received for above referenced authorities.

.5 Comply with all requirements, recommendations and advice by all regulatory authorities unless otherwise agreed in writing by Departmental Representative. Make requests for such deviations to these requirements sufficiently in advance of related work.

1.18 CUTTING,
FITTING AND
PATCHING

.1 Execute cutting, including excavation, fitting and patching required to make work fit properly.

1.19 ACCEPTANCE

.1 Prior to the issuance of the Certificate of Substantial Performance, in company with Departmental Representative, make a check of all work. Correct all discrepancies before final inspection and acceptance.

1.20 WORKS
COORDINATION

.1 Responsible for coordinating the work of the various trades, where the work of such trades interfaces with each other.

.2 Convene meetings between trades whose work interfaces and ensure that they are fully aware of the areas and the extent of where interfacing is required. Provide each trade with the plans and specifications of the interfacing trade, as required, to assist them in planning and carrying out their respective work.

.3 Canada will not be responsible for or held accountable for any extra costs incurred

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

as a result of the failure to carry out coordination work. Disputes between the various trades as a result of their not being informed of the areas and extent of interface work shall be the sole responsibility of the General Contractor and shall be resolved at no extra cost to Canada.

1.21 CONTRACTOR'S
USE OF SITE

- .1 Responsible for arranging the storage of materials on or off site, and any materials stored at the site which interfere with any of the day to day activities at or near the site will be moved promptly at the Contractor's expense, upon request by Departmental Representative.
- .2 Exercise care so as not to obstruct or damage public or private property in the area.
- .3 At completion of work, restore area to its original condition. Damage to ground and property will be repaired by Contractor. Remove all construction materials, residue, excess, etc., and leave site in a condition acceptable to Departmental Representative.

1.22 WORK
COMMENCEMENT

- .1 Mobilization to project site is to commence immediately after acceptance of bid and submission of Site Specific Safety Plan and insurance and bonding documentation, unless otherwise agreed by Departmental Representative.
- .2 Project work on site is to commence as soon as possible, with a continuous reasonable work force, unless otherwise agreed by Departmental Representative.

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

- .3 Weather conditions, short construction season, delivery challenges and the location of the work site may require the use of longer working days and additional work force to complete the project within the specified completion time.
- .4 Make every effort to ensure that sufficient material and equipment is delivered to site at the earliest possible date after acceptance of bid and replenished as required.

1.23 DFO PROPERTY
LIMITS

- .1 DFO only own the light tower, helipad, equipment building, and fog alarm. The two dwellings and the boat landing area was transferred/sold to Linkum Tours in 1999 and is currently operated as a tourism operation. The boat house adjacent to the tower and the former fog alarm building are both under lease to Linkum Tours. Use of the landing area would need to be negotiated with Linkum Tours. The only structure available for use by the contractor for storage (besides the tower itself) is a portion of the equipment bldg., if approved by the Departmental Representative.

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

PART 1 - GENERAL

1.1 SECTION
INCLUDES

- .1 Product data.
- .2 Samples.
- .3 Certificates.

1.2 SUBMITTAL
GENERAL REQUIREMENTS

- .1 Submit to Departmental Representative for review submittals listed, including samples, certificates and other data, as specified in other sections of the Specifications. Note that any and all changes to the contract will have to be approved in writing by the Contracting Authority.
- .2 Submit with reasonable promptness and in orderly sequence so as to allow for Departmental Representative's review and not cause delay in Work. Failure to submit in ample time will not be considered sufficient reason for an extension of Contract time and no claim for extension by reason of such default will be allowed.
- .3 Do not proceed with work until relevant submissions are reviewed by Departmental Representative.
- .4 Present product data, samples and mock-ups in SI Metric units.
- .5 Where items or information is not produced in SI Metric units, provide soft converted values.
- .6 Review submittals prior to submission to Departmental Representative. Ensure during review that necessary requirements have been determined and verified, required field measurements or data have been taken, and that each submittal has been checked and

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

- co-ordinated with requirements of Work and Contract Documents.
- .1 Submittals not stamped, signed, dated and identified as to specific project will be returned unexamined by Departmental Representative and considered rejected.
- .7 Notify Departmental Representative, in writing at time of submission, identifying deviations from requirements of Contract Documents stating reasons for deviations.
- .8 Verify field measurements and affected adjacent work and coordinate.
- .9 Contractor's responsibility for errors and omissions in submission is not relieved by Departmental Representative's review of submittals.
- .10 Contractor's responsibility for deviations in submission from requirements of Contract Documents is not relieved by Departmental Representative's review.
- .11 Submittal format: paper originals, or alternatively clear and fully legible photocopies of originals. Facsimiles are not acceptable, except in special circumstances pre-approved by Departmental Representative. Poorly printed non-legible photocopies or facsimiles will not be accepted and be returned for resubmission.
- .12 Make changes or revision to submissions which Departmental Representative may require, consistent with Contract Documents and resubmit as directed by Departmental Representative. When resubmitting, notify Departmental Representative in writing of any revisions other than those requested.
- .13 Keep one reviewed copy of each submittal

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

document on site for duration of Work.

1.3 PRODUCT DATA

- .1 Product data includes drawings, diagrams, illustrations, schedules, performance charts, brochures and other data which are to be provided by Contractor to illustrate details of a portion of Work.
- .2 Submit sufficient copies of product data which are required by the General Contractor and sub-contractors plus 2 copies which will be retained by Departmental Representative. Ensure sufficient numbers are submitted to enable one complete set to be included in each of the maintenance manuals specified, if applicable.
- .3 Allow 10 calendar days for Departmental Representative's review of each submission.
- .4 Adjustments or corrections made on product data by Departmental Representative are not intended to change Contract Price. If adjustments affect value of Work, advise Departmental Representative in writing prior to proceeding with Work.
- .5 If upon review by Departmental Representative, no errors or omissions are discovered or if only minor corrections and comments are made, fabrication and installation may proceed upon receipt of shop drawings. If product data are rejected and noted to be Resubmitted, do not proceed with that portion of work until resubmission and review of corrected product data, through same submission procedures indicated above.
- .6 Accompany each submission with transmittal letter, containing:
 - .1 Date.
 - .2 Project title and project number.
 - .3 Contractor's name and address.

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

- .4 Identification and quantity of each product data and sample.
- .5 Other pertinent data.
- .7 Submissions shall include:
 - .1 Date and revision dates.
 - .2 Project title and project number.
 - .3 Name and address of:
 - .1 Subcontractor.
 - .2 Supplier.
 - .3 Manufacturer.
 - .4 Contractor's stamp, signed by Contractor's authorized representative certifying approval of submissions, verification of field measurements and compliance with Contract Documents.
 - .5 Cross references to particular details of contract drawings and specifications section number for which product data submission addresses.
 - .6 Details of appropriate portions of Work.
- .8 After Departmental Representative's review, distribute copies.
- .9 The review of samples and product data by the Departmental Representative or their delegated representative is for sole purpose of ascertaining conformance with general concept. This review shall not mean that the Departmental Representative approves the detail design inherent in the product data, responsibility for which shall remain with Contractor submitting same, and such review shall not relieve Contractor of responsibility for errors or omissions in product data or of responsibility for meeting all requirements of the construction and Contract Documents. Without restricting generality of foregoing, Contractor is responsible for dimensions to be confirmed and correlated at job site, for information that pertains solely to fabrication processes or to techniques of construction and

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

installation and for co-ordination of Work
of all sub-trades.

1.4 SCHEDULES,
PERMITS AND
CERTIFICATES

- .1 Upon acceptance of bid, submit to Departmental Representative copy of Work Schedule and various other schedules, permits, certification documents and project management plans as specified in other sections of the Specifications.
- .2 Submit copy of permits, notices, compliance Certificates received by Regulatory Agencies having jurisdiction and as applicable to the Work.
- .3 Submission of above documents to be in accordance with Submittal General Requirements procedures specified in this section.

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

-
- 1.1 SECTION INCLUDES .1 Fire Safety Requirements.
.2 Hot Work Permit.
- 1.2 RELATED WORK .1 Section 01 35 29 - Health and Safety Requirements.
- 1.3 REFERENCES .1 Fire Protection Standards issued by Fire Protection Services of Human Resources Development Canada as follows:
.1 National Fire Code - Standard for Construction Operations - latest edition (http://www.hrsdc.gc.ca/eng/labour/fire_protection/policies_standards/commissioner/301/page00.shtml).
.2 National Fire Code - Standard for Welding and Cutting - latest edition (http://www.hrsdc.gc.ca/eng/labour/fire_protection/policies_standards/commissioner/302/page00.shtml).
.3 FCC standards, may also be viewed at the Regional Labour Canada Office located at Baine Johnson Centre, 10 Fort William Place, St. John's, NL, A1C 1K4; Telephone 1-800-641-4049; fax 1-709-772-5985.
- 1.4 DEFINITIONS .1 Hot Work defined as:
.1 Welding work.
.2 Cutting of materials by use of torch or other open flame devices.
.3 Grinding with equipment which produces sparks.
- 1.5 SUBMITTALS .1 Submit copy of Hot Work Procedures and sample of Hot Work permit to Departmental Representative for review, within five (5) calendar days after notification of acceptance of bid.
.2 Submit in accordance with the Submittal General Requirements specified in Section

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

01 33 00.

1.6 FIRE SAFETY
REQUIREMENTS

- .1 Implement and follow fire safety measures during Work. Comply with following:
 - .1 National Fire Code, latest edition.
 - .2 Fire Protection Standards FCC 301 and FCC 302 - latest edition.
 - .3 Federal and Provincial Occupational Health and Safety Acts and Regulations as specified in Section 01 35 29 - Health and Safety Requirements.
- .2 In event of conflict between any provisions of above authorities the most stringent provision will apply. Should a dispute arise in determining the most stringent requirement, Departmental Representative will advise on the course of action to be followed.

1.7 HOT WORK
AUTHORIZATION

- .1 Obtain Departmental Representative's written "Authorization to Proceed" before conducting any form of Hot work on site.
- .2 To obtain authorization submit to Departmental Representative:
 - .1 Contractor's typewritten Hot Work Procedures to be followed on site as specified below.
 - .2 Description of the type and frequency of Hot Work required.
 - .3 Sample Hot Work Permit to be used.
- .3 Upon review and confirmation that effective fire safety measures will be implemented during performance of hot work, Departmental Representative will provide authorization to proceed as follows:
 - .1 Issue one written "Authorization to Proceed" covering the entire project for duration of work or;
 - .2 Separate work, or segregate certain parts of work, into individual entities. Each

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

entity requiring a separately written "Authorization to Proceed" from Departmental Representative. Follow Departmental Representative's directives in this regard.

- .4 Requirement for individual authorization based on:
 - .1 Nature or phasing of work;
 - .2 Risk to Facility operations;
 - .3 Quantity of various trades needing to perform hot work on project or;
 - .4 Other situation deemed necessary by Departmental Representative to ensure fire safety on premises.
- .5 Do not perform any Hot Work until receipt of Departmental Representative's written "Authorization to Proceed" for that portion of work.

1.8 HOT WORK PROCEDURES

- .1 Develop and implement safety procedures and work practices to be followed during the performance of Hot Work.
- .2 Procedures to include:
 - .1 Requirement to perform hazard assessment of site and immediate hot work area for each hot work event in accordance with Hazard Assessment and Safety Plan requirements of Section 01 35 29.
 - .2 Use of a Hot Work Permit system for each hot work event.
 - .3 The step by step process of how to prepare and issue permit.
 - .4 Permit shall be issued by Contractor's site Superintendent, or other authorized person designated by Contractor, granting permission to worker or subcontractor to proceed with hot work.
 - .5 Provision of a designated person to carryout a Fire Safety Watch for a minimum of 60 minutes immediately upon completion of the hot work.

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

.6 Compliance with fire safety codes and standards specified herein and occupational health and safety regulations specified in Section 01 35 29.

.3 Generic procedures, if used, must be edited and supplemented with pertinent information tailored to reflect specific project conditions. Clearly label as being the Hot Work Procedures applicable to this contract.

.4 Hot Work Procedures shall clearly establish worker instructions and allocate responsibilities of:

- .1 Worker(s),
- .2 Authorized person issuing the Hot Work Permit,
- .3 Fire Safety Watcher,
- .4 Subcontractors and Contractor.

.5 Brief all workers and subcontractors on Hot Work Procedures and Permit system established for project. Stringently enforce compliance.

.1 Failure to comply with the established procedures may result in the issuance of a Non-Compliance Notification at Departmental Representative's discretion with possible disciplinary measures imposed as specified in Section 01 35 29.

1.9 HOT WORK
PERMIT

.1 Hot Work Permit to include, as a minimum, the following data:

- .1 Project name and project number.
- .2 Building name, address and specific room or area where hot work will be performed.
- .3 Date when permit issued.
- .4 Description of hot work type to be performed.
- .5 Special precautions required, including type of fire extinguisher needed.
- .6 Name and signature of person authorized to issue the permit.
- .7 Name of worker (clearly printed) to

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

which the permit is being issued.

.8 Time Duration that permit is valid (not to exceed 8 hours). Indicate start time and date, and completion time and date.

.9 Worker signature with date and time upon hot work termination.

.10 Specified time period requiring safety watch.

.11 Name and signature of designated Fire Safety Watcher, complete with time and date when safety watch terminated, certifying that surrounding area was under continual surveillance and inspection during the full watch time period specified in Permit and commenced immediately upon completion of Hot Work.

.2 Permit to be typewritten form. Industry Standard forms shall only be used if all data specified above is included on form.

.3 Each Hot Work Permit to be completed in full and signed as follows:

.1 Authorized person issuing Permit before hot work commences.

.2 Worker upon completion of Hot Work.

.3 Fire Safety Watcher upon termination of safety watch.

.4 Returned to Contractor's Site Superintendent for safe keeping.

1.10 DOCUMENTS
ON SITE

.1 Keep Hot Work Permits and Hazard assessment documentation on site for duration of Work.

.2 Upon request, make available to Departmental Representative or to authorized safety representative for inspection.

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

-
- 1.1 RELATED WORK .1 Section 01 35 24 - Special Procedures on Fire Safety Requirements.
- 1.2 DEFINITIONS .1 COSH: Canada Occupational Health and Safety Regulations made under Part II of the Canada Labour Code.
- .2 Competent Person: means a person who is:
- .1 Qualified by virtue of personal knowledge, training and experience to perform assigned work in a manner that will ensure the health and safety of persons in the workplace, and;
- .2 Knowledgeable about the provisions of occupational health and safety statutes and regulations that apply to the Work and;
- .3 Knowledgeable about potential or actual danger to health or safety associated with the Work.
- .3 Medical Aid Injury: any minor injury for which medical treatment was provided and the cost of which is covered by Workers' Compensation Board of the province in which the injury was incurred.
- .4 PPE: personal protective equipment.
- .5 Work Site: where used in this section shall mean areas, located at the premises where Work is undertaken, used by Contractor to perform all of the activities associated with the performance of the Work.
- 1.3 SUBMITTALS .1 Make submittals in accordance with Section 01 33 00.
- .2 Submit to Departmental Representative, copies of the following documents including updates.
- .1 Site specific Health and Safety Plan.

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

- .2 Building permit, compliance certification and other permits obtained.
 - .3 Reports or directives issued by Federal and Provincial Inspectors and other Authorities having jurisdiction.
 - .4 Accident or incident reports.
 - .5 WHMIS - MSDS data sheets.
 - .6 Name of Contractor's Representative designated to perform health and safety supervision in site.
 - .7 Certificate of clearance from Workplace Health Safety and Compensation Commission (Assessment Services Department) of Newfoundland and Labrador.
-
- .3 Submit within five (5) work days of notification of Bid Acceptance. Provide one (1) copy.
 - .4 Departmental Representative will review Health and Safety Plan and provide comments.
 - .5 The Contractor will revise the Plan as appropriate and resubmit within five (5) work days after receipt of comments.
 - .6 Departmental Representative's review and comments made of the Plan shall not be construed as an endorsement, approval or implied warranty of any kind by Canada and does not reduce Contractor's overall responsibility for Occupational Health and Safety of the Work.
 - .7 Submit revisions and updates made to the Plan during the course of Work.

1.4 COMPLIANCE
REQUIREMENTS

- .1 Comply with the Occupational Health and Safety Act for the Province of Newfoundland and Labrador, and the Occupational Health and Safety Regulations

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

made pursuant to the Act.

- .2 Comply with Canada Labour Code Part II, (entitled Occupational Health and Safety) and the Canada Occupational Health and Safety Regulations (COSH) as well as any other regulations made pursuant to the Act.
 - .1 The Canada Labour Code can be viewed at:
[www.http://laws.justice.gc.ca/en/L-2/](http://laws.justice.gc.ca/en/L-2/)
 - .2 COSH can be viewed at:
[www.http://laws.justice.gc.ca/eng/SOR-86-304/ne.html](http://laws.justice.gc.ca/eng/SOR-86-304/ne.html).
 - .3 A copy may be obtained at: Canadian Government Publishing Public Works & Government Services Canada Ottawa, Ontario, K1A 0S9 Tel: (819) 956-4800 (1-800-635-7943) Publication No. L31-85/2000 E or F).
- .3 Observe construction safety measures of:
 - .1 Part 8 of National Building Code.
 - .2 Municipal by-laws and ordinances.
- .4 In case of conflict or discrepancy between any specified requirements, the more stringent shall apply.
- .6 Maintain Workers Compensation Coverage in good standing for duration of Contract. Provide proof through submission of Certificate of Clearance from Workplace Health, Safety and Compensation Commission (Assessment Services Department) of Newfoundland and Labrador.
- .7 Obtain and maintain worker medical surveillance documentation where prescribed by legislation or regulation.

1.5 RESPONSIBILITY

- .1 Be responsible for health and safety of persons on site, safety of property and for protection of persons and environment

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

adjacent to the site to extent that they may be affected by conduct of Work.

- .2 Comply with and enforce compliance by all workers, sub-contractors and other persons granted access to work site with safety requirements of Contract Documents, applicable Federal, Provincial, and local by-laws, regulations, and ordinances, and with site specific Health and Safety Plan.

1.6 SITE CONTROL
AND ACCESS

- .1 Control the Work and entry points to Work Site. Approve and grant access only to workers and authorized persons. Immediately stop and remove non-authorized persons.

- .1 Departmental Representative will provide names of those persons authorized by Departmental Representative to enter onto Work Site and will ensure that such authorized persons have the required knowledge and training on Health and Safety pertinent to their reason for being at the site, however, Contractor remains responsible for the health and safety of authorized persons while at the Work Site.

- .2 Isolate Work Site from other areas of the premises by use of appropriate means.

- .1 Erect fences, hoarding, barricades and temporary lighting as required to effectively delineate the Work Site, stop non-authorized entry, and to protect pedestrians and vehicular traffic around and adjacent to the Work and create a safe environment.

- .2 Post signage at entry points and other strategic locations indicating restricted access and conditions for access.

- .3 Provide safety orientation session to

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

persons granted access to Work Site.
Advise of hazards and safety rules to be
observed while on site.

- .4 Ensure persons granted site access wear appropriate PPE. Supply PPE to inspection authorities who require access to conduct tests or perform inspections.
- .5 Secure Work Site against entry when inactive or unoccupied and to protect persons against harm. Provide security guard where adequate protection cannot be achieved by other means.

1.7 PROTECTION

- .1 Give precedence to safety and health of persons and protection of environment over cost and schedule considerations for Work.
- .2 Should unforeseen or peculiar safety related hazard or condition become evident during performance of Work, immediately take measures to rectify situation and prevent damage or harm. Advise Departmental Representative verbally and in writing.

1.8 FILING OF NOTICE

- .1 File Notice of Project with pertinent provincial health and safety authorities prior to beginning of Work.

1.9 PERMITS

- .1 Post permits, licenses and compliance Certificates at Work Site.
- .2 Where a particular permit or compliance certificate cannot be obtained, notify Departmental Representative in writing and obtain approval to proceed before carrying out applicable portion of work.

1.10 HAZARD
ASSESSMENTS

- .1 Perform site specific health and safety hazard assessment of the Work and its site.

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

- .2 Carryout initial assessment prior to commencement of Work with further assessments as needed during progress of work, including when new trades and subcontractors arrive on site.
- .3 Record results and address in Health and Safety Plan.
- .4 Keep documentation on site for entire duration of the Work.

1.11 PROJECT/SITE
CONDITIONS

- .1 The following are known or potential project related safety hazards at site:
 - .1 Working in close proximity of water.
 - .2 Remote site location.
 - .3 Wet and slippery conditions.
 - .4 Inclement weather conditions.
 - .5 Heavy lifting.
 - .6 Working at heights.
 - .7 Cutting tools and other construction power tools.
 - .8 Hazardous materials, including lead paint.
 - .9 Sharp objects (construction debris).
 - .10 Surrounding steep terrain/cliffs/risk of falling.
- .2 Above items shall not be construed as being complete and inclusive of potential health, and safety hazards encountered during work.
- .3 Include above items into hazard assessment process.

1.12 MEETINGS

- .1 Contractor to hold pre-construction health and safety meeting prior to commencement of Work. Ensure attendance of:
 - .1 Superintendent of Work.

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

1.13 HEALTH AND
SAFETY PLAN

- .2 Contractor's designated Health & Safety Site Representative.
- .3 Subcontractor's Health and Safety Site Representative.
- .4 Health and Safety Site Coordinator.
- .2 Conduct regularly scheduled tool box and safety meetings during the Work in conformance with Occupational Health and Safety regulations.
- .3 Keep documents on site.
- .1 Prior to commencement of Work, develop written Health and Safety Plan specific to the work. Implement, maintain, and enforce Plan for entire duration of Work and until final demobilization from site.
- .2 Health and Safety Plan shall include the following components:
 - .1 List of health risks and safety hazards identified by hazard assessment.
 - .2 Control measures used to mitigate risks and hazards identified.
 - .3 On-site Contingency and Emergency Response Plan as specified below.
 - .4 On-site Communication Plan as specified below.
 - .5 Name of Contractor's designated Health & Safety Site Representative and information showing proof of his/her competence and reporting relationship in Contractor's company.
 - .6 Names, competence and reporting relationship of other supervisory personnel used in the Work for occupational health and safety purposes.
- .3 On-site Contingency and Emergency Response Plan shall include:
 - .1 Operational procedures, evacuation

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

- measures and communication process to be implemented in the event of an emergency.
- .2 Evacuation Plan: site and floor plan layouts showing escape routes, marshaling areas. Details on alarm notification methods, fire drills, location of fire fighting equipment and other related data.
 - .3 Name, duties and responsibilities of persons designated as Emergency Warden(s) and deputies.
 - .4 Emergency Contacts: name and telephone number of officials from:
 - .1 General Contractor and subcontractors.
 - .2 Pertinent Federal and Provincial Departments and Authorities having jurisdiction.
 - .3 Local emergency resource organizations.
 - .4 On-site Communication Plan:
 - .1 Procedures for sharing of work related safety information to workers and subcontractors, including emergency and evacuation measures.
 - .5 Address all activities of the Work including those of subcontractors.
 - .6 Review Health and Safety Plan regularly during the Work. Update as conditions warrant to address emerging risks and hazards, such as whenever new trade or subcontractor arrive at Work Site.
 - .7 Departmental Representative will respond in writing, where deficiencies or concerns are noted and may request re-submission of the Plan with correction of deficiencies or concerns.

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

.8 Post copy of the Plan, and updates,
prominently on Work Site.

1.14 SAFETY
SUPERVISION

.1 Employ Health & Safety Site Representative
responsible for daily supervision of health
and safety of the Work.

.2 Health & Safety Site Representative may be
the Superintendent of the Work or other person
designated by Contractor and shall be assigned
the responsibility and authority to:

.1 Implement, monitor and enforce daily
compliance with health and safety
requirements of the Work

.2 Monitor and enforce Contractor's
site-specific Health and Safety Plan.

.3 Conduct site safety orientation session
to persons granted access to Work Site.

.4 Ensure that persons allowed site access
are knowledgeable and trained in health
and safety pertinent to their
activities at the
site or are escorted by a competent
person while on the Work Site.

.5 Stop the Work as deemed necessary for
reasons of health and safety.

.3 Health & Safety Site Representative must:

.1 Be qualified and competent person in
occupational health and safety.

.2 Have site-related working experience
specific to activities of the Work.

.3 Be on Work Site at all times during
execution of the Work.

.4 All supervisory personnel assigned to
the Work shall also be competent
persons.

.5 Inspections:

.1 Conduct regularly scheduled safety
inspections of the Work on a
minimum daily basis. Record
deficiencies and remedial action
taken.

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

- .2 Conduct Formal Inspections on a minimum monthly basis. Use standardized safety inspection forms. Distribute to subcontractors.
- .3 Follow-up and ensure corrective measures are taken.
- .6 Keep inspection reports and supervision related documentation on site.

1.15 TRAINING

- .1 Use only skilled workers on Work Site who are effectively trained in occupational health and safety procedures and practices pertinent to their assigned task.
- .2 Maintain employee records and evidence of training received. Make data available to Departmental Representative upon request.
- .3 When unforeseen or peculiar safety-related hazard, or condition occur during performance of Work, follow procedures in place for Employee's Right to Refuse Work in accordance with Acts and Regulations of Province having jurisdiction and advise Departmental Representative verbally and in writing.
- .4 All workers dealing with hazardous materials are required to provide evidence of training, in accordance with Provincial regulations.

1.16 MINIMUM
SITE SAFETY RULES

- .1 Notwithstanding requirement to abide by federal and provincial health and safety regulations; ensure the following minimum safety rules are obeyed by persons granted access to Work Site:
 - .1 Wear appropriate PPE pertinent to the Work or assigned task; minimum being hard hat, safety footwear, safety glasses safety vest and hearing

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

protection.

.2 Immediately report unsafe condition at site, near-miss accident, injury and damage.

.3 Maintain site and storage areas in a tidy condition free of hazards causing injury.

.4 Obey warning signs and safety tags.

.2 Brief persons of disciplinary protocols to be taken for non compliance. Post rules on site.

1.17 CORRECTION OF
NON-COMPLIANCE

.1 Immediately address health and safety non-compliance issues identified by authority having jurisdiction or by Departmental Representative.

.2 Provide Departmental Representative with written report of action taken to correct non-compliance of health and safety issues identified.

.3 Departmental Representative will stop Work if non-compliance of health and safety regulations is not corrected in a timely manner.

1.18 INCIDENT
REPORTING

.1 Investigate and report the following incidents to Departmental Representative:

.1 Incidents requiring notification to Provincial Department of Occupational Safety and Health, Workers Compensation Board or to other regulatory Agency.

.2 Medical aid injuries.

.3 Property damage in excess of \$10,000.00.

.2 Submit report in writing.

1.19 HAZARDOUS
PRODUCTS

.1 Comply with requirements of Workplace Hazardous Materials Information System (WHMIS).

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

- .2 Keep MSDS data sheets for all products delivered to site.
 - .1 Post on site.
 - .2 Submit copy to Departmental Representative.

1.20 SITE RECORDS

- .1 Maintain on Work Site copy of safety related documentation and reports stipulated to be produced in compliance with Acts and Regulations of authorities having jurisdiction and of those documents specified herein.
- .2 Upon request, make available to Departmental Representative or authorized Safety Officer for inspection.

1.21 POSTING OF DOCUMENTS

- .1 Ensure applicable items, articles, notices and orders are posted in conspicuous location on Work Site in accordance with Acts and Regulations of Province having jurisdiction.
- .2 Post other documents as specified herein, including:
 - .1 Site specific Health and Safety Plan.
 - .2 WHMIS data sheets.

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

-
- 1.1 RELATED WORK .1 Section 02 41 16 - Sitework, Demolition and Removal.
- 1.2 DEFINITIONS .1 Hazardous Material: Product, substance, or organism that is used for its original purpose; and that is either dangerous goods or a material that may cause adverse impact to the environment or adversely affect health of persons, animals, or plant life when released into the environment.
- 1.3 DISPOSAL OF WASTES AND HAZARDOUS MATERIALS
- .1 Do not bury rubbish and waste materials on site.
- .2 Do not dispose of hazardous waste or volatile materials, such as mineral spirits, paints, thinners, oil or fuel into waterways, storm or sanitary sewers or waste landfill sites.
- .3 Store, handle and dispose of hazardous materials and hazardous waste in accordance with applicable federal and provincial laws, regulations, codes and guidelines.
- .4 Dispose of construction waste materials and demolition debris, resulting from work, at approved landfill sites only. Carryout such disposal in strict accordance with provincial and municipal rules and regulations. Separate out and prevent improper disposal of items banned from landfills.
- .5 Establish methods and undertake construction practices which will minimize waste and optimize use of construction materials. Separate at source all construction waste materials, demolition debris and product packaging and delivery containers into various waste categories in order to maximize recycling abilities of various materials and avoid disposal of debris at landfill site(s) in a "mixed state". Where recycling firms, specializing in recycling of specific

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

materials exist, transport such materials to the recycling facility and avoid disposal at landfill sites.

- .6 Communicate with landfill operator prior to commencement of work, to determine what specific construction, demolition and renovation waste materials have been banned from disposal at the landfill and at transfer stations.

1.5 DRAINAGE

- .1 Provide temporary drainage and pumping as necessary to keep excavations and site free from water.
- .2 Do not pump water containing suspended materials into waterways, sewer or drainage systems.
- .3 Control disposal or runoff of water containing suspended materials or other harmful substances in accordance with governing regulations and requirements.
- .4 Pumped water must meet applicable federal, provincial, and municipal standards before it can be discharged to a surface water body. If regulatory guidelines exceedences are noted, the Departmental Representative has the right to issue stop pumping instructions to the Contractor. Contractor will not be compensated for any delays associated with retrofitting equipment to meet guidelines.

1.6 PERMITS

- .1 All guidelines and instructions stated on permits must be strictly adhered to.

1.7 WORK ADJACENT
TO WATERWAYS

- .1 Do not operate construction equipment in waterways.
- .2 Do not use waterway beds for borrow material.

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

- .3 Do not dump excavated fill, waste material or debris in waterways.
- .4 At borrow sites, design and construct temporary crossings to minimize erosion to waterways in strict conformance with provincial and federal environmental regulations.
- .5 Do not skid logs or construction materials across waterways.
- .6 Ensure refueling of any type of equipment does not, either directly or indirectly, create pollution by causing or permitting any leaks or spills.
- .7 Maintain equipment in good working condition with no fluid leaks, loose hoses or fittings.

1.8 POLLUTION
CONTROL

- .1 Maintain temporary erosion and pollution control features installed under this contract.
- .2 Control emissions from equipment and plant to local authorities emission requirements.
- .3 Cover or wet down dry materials and rubbish to prevent blowing dust and debris.
- .4 Have emergency spill response equipment and rapid clean-up kit, appropriate to work, at site. Locate adjacent to work and where hazardous materials are stored. Provide personal protective equipment as required for clean-up.
- .5 Report, to Federal and Provincial Department of the Environment, spills of petroleum and other hazardous materials as well as accidents having potential of polluting the environment. Also notify Departmental

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

Representative and submit a written spill report to Departmental Representative within 24 hours of occurrence.

1.9 WILDLIFE
PROTECTION

- .1 Should sea bird nests be encountered during work, immediately notify Departmental Representative for directives to be followed.
 - .1 Do not disturb nest site and neighbouring vegetation until nesting is completed.
 - .2 Minimize work immediately adjacent to such areas until nesting is completed.

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

-
- 1.1 SANITARY FACILITIES
- .1 Provide sanitary facilities for work force in accordance with governing regulations and ordinances.
 - .2 Post notices and take such precautions as required by local health authorities. Keep area and premises in sanitary condition.
- 1.2 WATER SUPPLY
- .1 Arrange, pay for and maintain temporary water supply in accordance with governing regulations and ordinances.
- 1.3 SCAFFOLDING
- .1 Design, construct and maintain scaffolding in rigid, secure and safe manner in accordance with CSA797-09, or other applicable standard acceptable to Departmental Representative. Scaffolding is to be designed and stamped by a Professional Engineer, licensed to practice by PEG-NL in the Province of NL. Provide stamped design drawings and design notes to Departmental Representative. Erect scaffolding independent of walls. Remove when no longer required.
- 1.4 CONSTRUCTION SIGN AND NOTICES
- .1 Contractor or subcontractor advertisement signboards are not permitted on site.
 - .2 Only notices of safety or instructions are permitted on site.
 - .3 Maintenance and Disposal of Site Signs:
 - .1 Maintain approved signs and notices in good condition for duration of project and dispose of off site on completion of project or earlier if directed by Departmental Representative.
- 1.5 REMOVAL OF TEMPORARY FACILITIES
- .1 Remove temporary facilities from site when directed by Departmental Representative.

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

PART 1 - GENERAL

- 1.1 SECTION INCLUDES .1 Barriers.
- 1.2 INSTALLATION AND REMOVAL .1 Provide temporary controls in order to execute work expeditiously.
- .2 Remove from site all such work after use.
- 1.3 HOARDING .1 Erect temporary site enclosure if required by governing authorities, using new 1.2 m high snow fence wired to rolled steel "T" bar fence posts spaced at 2.4 m centres. Provide one lockable truck gate. Maintain fence in good repair.
- 1.4 GUARD RAILS AND BARRICADES .1 Provide secure, rigid guard rails and barricades as required to protect against falls. Note steep cliffs around work area and construct barricades to protect workers.
- .2 Provide as required by governing authorities.

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

PART 1 - GENERAL

- 1.1 GENERAL
- .1 Conduct cleaning and disposal operations to comply with local ordinances and anti-pollution laws.
 - .2 Store volatile waste in covered metal containers, and remove from premises at end of each working day.
 - .3 Prevent accumulation of wastes which create hazardous conditions.
 - .4 Provide adequate ventilation during use of volatile or noxious substances.
- 1.2 CLEANING DURING CONSTRUCTION
- .1 Maintain project grounds and public properties in a tidy condition, free from accumulations of waste material and debris. Clean areas on a daily basis.
 - .2 Provide on-site garbage containers for collection of waste materials and debris.
 - .3 Remove waste materials and debris from site on a daily basis.
- 1.3 FINAL CLEANING
- .1 In preparation for acceptance of the Work perform final cleaning. Final cleaning to include exterior rake of work area, to satisfaction of Departmental Representative.

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

1.1 SECTION
INCLUDES

- .1 Project Record Documents as follows:
 - .1 Manual of paint products used, including Manufacturer's literature brochures.
 - .2 Manufacturer's data and reviewed shop drawings.

1.2 PROJECT RECORD
DOCUMENTS

- .1 Departmental Representative will provide two white print sets of contract drawings and two copies of Specifications.
- .2 Maintain at site one set of the contract drawings and specifications to record actual "As-Built" site conditions.

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

PART 1 - GENERAL

1.1 DESCRIPTION

- .1 This section specifies requirements for demolishing and removing wholly or in part various items designated to be removed or partially removed.
- .2 Demolition and removal will consist of, but not necessarily be limited to, the following:
 - .1 Removal and disposal of the lower lintel above the first floor window and the broken window pane in the lantern room.
 - .2 Removal of loose/flaking paint from the exterior concrete surfaces and entrance hand railing.
 - .3 Removal of paint from the lantern room aluminum enclosure.

Note that the painted surfaces are to be considered lead based (for the purposes of transportation and disposal, the lead based paint is considered to be hazardous). Leachate testing may be carried out by the Contractor (at the Contractor's cost) to determine alternate disposal options.

1.2 MEASUREMENT FOR
PAYMENT

- .1 This portion of the work will not be measured for payment but will be included in the Lump Sum Amount of the contract.

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

PART 2 - PRODUCTS

NOT APPLICABLE

PART 3 - EXECUTION

3.1 EXECUTION

- .1 Inspect site and verify with Departmental Representative objects designated for removal.
- .2 Locate and protect utility lines. Preserve in operating condition active utilities traversing site.

3.2 REMOVAL

- .1 Remove in their entirety all materials and objects specified for removal.
- .2 Do not disturb adjacent work designated to remain in place.

3.3 DISPOSAL OF MATERIAL

- .1 All demolished materials will become property of contractor and will be removed from site and disposed of to satisfaction of Departmental Representative and in accordance with environmental guidelines. It is the sole responsibility of the contractor to dispose of all demolished materials at an approved disposal site. Ensure that disposal site is approved and willing to accommodate any materials disposed of from work site.
- .2 Contractor shall obtain and pay for all necessary permits and disposal fees for use of an approved waste disposal site.

3.4 RESTORATION

- .1 Upon completion of work, remove debris, trim surfaces and leave work site in clean condition.
- .2 Reinstate areas and existing works outside

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

areas of demolition to conditions that
existed prior to commencement of work.

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

PART 1 - GENERAL

- 1.1 REFERENCES
- .1 Guideline for Lead on Construction Projects from Occupational Health and Safety Branch, Ontario Ministry of Labour, April 2011.
 - .2 Health Canada
 - .1 Workplace Hazardous Materials Information System (WHMIS), Material Safety Data Sheets (MSDS).
 - .3 Human Resources and Social Development Canada (HRSDC)
 - .1 Canada Labour Code Occupational Health and Safety Regulations.
 - .4 Transport Canada (TC)
 - .1 Transportation of Dangerous Goods Act, 1992 (TDGA).
 - .5 Management of Disposal of Construction, Abatement and Demolition Waste Containing Lead-Based Paint, 2010, NL Department of Environment and Conservation.
- 1.2 SCOPE
- .1 For this work scope, lead based paint is noted to be present on the existing structure. For the purposes of transportation and disposal, the lead based paint is leachable and is to be disposed of as hazardous waste. Refer to the laboratory results appended to the specifications. The Contractor may at his discretion, carry out lead leachate testing on the paint to determine alternate disposal options.
 - .2 Comply with requirements of this Section when performing following Work:
 - .1 Removal of lead based paint

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

from the tower, as indicated on the drawings. Consider this activity to be a Type 3b activity as defined in the document referenced in Part 1.1.1 of this specification section. Removal of the paint from the interior/exterior concrete surfaces is to be considered a Type 3b activity as well.

.2 Disposal of lead based paint and abrasive blasting material in accordance with the NL Department of Environment Regulations, as defined in the reference document noted under Part 1.1.5 of this specification section. In the absence of additional sampling, the lead paint is to be considered leachable for the purposes of transportation and disposal.

1.3 SUBMITTALS

- .1 Provide submittals in accordance with Section 01 33 00 - Submittal Procedures.
- .2 Provide proof satisfactory to Departmental Representative that suitable arrangements have been made to dispose of lead based paint waste in accordance with requirements of authority having jurisdiction. Note that it is the Contractor's responsibility to determine an approved waste site for all flaking/peeling paint and spent abrasives (while the paint is non-leachable, the Contractor is cautioned that landfill disposal on the Island may in fact be limited to the Regional Waste Disposal sites in Norris Arm or St. John's).
- .3 Provide proof of Contractor's General and Environmental Liability Insurance governing abatement of lead.
- .4 Quality Control:
 - .1 Provide proof satisfactory to Departmental Representative that employees had instruction on

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

hazards of lead exposure,
respirator use, dress, entry and
exit from Work Area, and aspects of
work procedures and protective
measures.

- .2 Provide proof that supervisory personnel have attended lead abatement course, of not less than one day duration, approved by Departmental Representative. Minimum of one supervisor for every ten workers.
- .5 Contractor to submit Shop Drawings on containment system under seal of Professional Engineer licensed to practice in Newfoundland & Labrador.
- .6 All shop drawings for scaffolding, temporary supports and structures to be utilized in the work shall be submitted under seal of professional engineer licensed to practice in Newfoundland & Labrador.

1.4 QUALITY
ASSURANCE

- .1 Regulatory Requirements: comply with federal, provincial/Territorial and local requirements pertaining to lead, in case of conflict among those requirements or with these specifications the more stringent requirement applies. Comply with regulations in effect at time work is performed.

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

PART 2 - PRODUCTS

- 2.1 MATERIALS
- .1 Polyethylene 0.15 mm unless otherwise specified; in sheet size to minimize joints.
 - .2 FR polyethylene: 0.15 mm woven fibre reinforced fabric bonded both sides with polyethylene.
 - .3 Tape: fibreglass - reinforced duct tape suitable for sealing polyethylene under dry conditions and wet conditions using amended water.
 - .4 Slow - drying sealer: non-staining, clear, water - dispersible type that remains tacky on surface for at least 8 hours and designed for trapping residual lead paint residue.
 - .5 Lead waste containers: metal fibre type acceptable to dump operator with tightly fitting covers and 0.15 mm sealable polyethylene liners.
 - .1 Label containers with pre-printed cautionary warning "Lead" clearly visible when ready for removal to disposal site.

PART 3 - EXECUTION

- 3.1 SUPERVISION
- .1 Approved Supervisor must remain within Work Area during disturbance, removal, or handling of lead based paints.
- 3.2 RESPIRATORS
- .1 For Type 2a operation, as per Part 1.2.2 of this specification section, use half mask particulate respirator with N-, R- or P-series filter, and 95, 99 or 100% efficiency.
 - .2 For Type 3b operation, as per Part 1.2.1 of this specification section, use type CE abrasive blast supplied respirator operated in a positive pressure mode

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

with a tight fitting mask facepiece.

3.3 GENERAL

- .1 Washing facilities to be established on site before removal of lead paint surfaces. Washing facilities to consists of a wash basin, water, soap and towels.
- .2 No eating, drinking, chewing gum or smoking in work area.
- .3 Drop sheets to be used below all lead operations which produce or may produce dust, chips or debris containing lead.
- .4 Dust and waste to be cleaned up and removed by vacuuming with a HEPA filter equipped vacuum.
- .5 Clean-up after each operation to be done to prevent lead contamination and exposure to lead.

3.4 MEASURES

- .1 Type 3b (removal of paint from aluminum, concrete and galvanized steel surfaces:
 - .1 Post signs to warn of lead hazard.
 - .2 Wear respirators in accordance with Part 3.2 of this specification, during all paint removal activities, involving pressure washing or abrasive blasting.
 - .3 Wear protective clothing to prevent skin contamination, including but not limited to coveralls, gloves, hats and footwear or disposable coverlets; safety glasses, face shields or goggles. All protective clothing to be removed at the end of each shift and be decontaminated.
 - .4 Construct full tight enclosure (with tarps that are generally impermeable and fully sealed joints and entryways). Install negative pressure machine system and operate continuously from installation of polyethylene sheeting

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

- until completion of final cleanup.
- .5 Seal off openings, polyethylene sheeting sealed with tape. Cover floor surfaces or working platform in work area from wall to wall with FR polyethylene drop sheets. Build airlocks at entrances and exits from work areas to ensure work areas are always closed off by one curtained doorway when workers enter or exit. At point of access to work areas install warning signs.
 - .6 Maintain emergency and fire exits from work areas, or establish alternative exits satisfactory to Authority having jurisdiction
 - .7 Where water application is required provide temporary water supply by use of appropriately sized hoses for application of water as required.
 - .8 Provide electrical power and shut off for operation of powered tools and equipment. Provide 24 volt safety lighting and ground fault interrupter circuits on power source for electrical tools, in accordance with applicable CSA Standard. Ensure safe installation of electrical lines and equipment.
 - .9 Worker Decontamination Enclosure System includes Equipment and Access Room and Clean Room, as follows:
 - .1 Equipment and Access Room: construct between exit and work areas, with two curtained doorways, one to the rest of the site, and one to work area. Install waste receptor and storage facilities for workers' shoes and protective clothing to be re-worn in work areas. Build large enough to accommodate specified facilities, equipment needed, and at least one worker allowing sufficient space to change comfortably.
 - .2 Clean Room: construct with curtained doorway to outside of enclosures. Provide lockers or hangers

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

and hooks for workers' street clothes and personal belongings. Provide storage for clean protective clothing and respiratory equipment. Install mirror to permit workers to fit respiratory equipment properly.

- .10 Construction of Decontamination Enclosures:
 - .1 Construct framing for enclosures or otherwise provide portable enclosures as approved by the Departmental Representative. Line enclosure with polyethylene sheeting and seal with tape, apply two layers of FR polyethylene on floor.
 - .2 Construct curtain doorways between enclosures so when people move through or waste containers and equipment are moved through doorway, one of two closure comprising doorway always remains closed.
 - .3 Shower room in decontamination facility to be provided with the following:
 - .1 Hot and cold water or water of constant temperature not less than 40 degrees Celsius or more than 50 degrees Celsius.
 - .2 Individual controls inside to regulate water flow and temperature.
 - .4 Prior to each shift in which a decontamination facility is being used, a competent person should inspect the facility to ensure that there are no defects that would allow lead-containing dust to escape. Defects should be repaired before the facility is used. The decontamination facility should be maintained in a clean and sanitary condition.

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

PART 1 GENERAL

- 1.1 Related Sections .1 01 33 00 - Submittal Procedures.
-
- 1.2 References .1 Canada Green Building Council (CaGBC)
- .1 LEED Canada-NC Version 1.0-2004, LEED (Leadership in Energy and Environmental Design): Green Building Rating System Reference Package for New Construction and Major Renovations.
 - .2 Environmental Protection Agency (EPA)
 - .1 Test Method for Measuring Total Volatile Organic Compound Content of Consumer Products, Method 24 (for Surface Coatings).
 - .3 Health Canada/Workplace Hazardous Materials Information System (WHMIS)
 - .1 Material Safety Data Sheets (MSDS).
 - .4 The Master Painters Institute (MPI)
 - .1 Architectural Painting Specification Manual - February 2004.
 - .2 Standard GPS-1-05, MPI Green Performance Standard for Painting and Coatings.
 - .5 National Fire Code of Canada.
 - .6 Society for Protective Coatings (SSPC)
 - .1 Systems and Specifications, SSPC Painting Manual 2005.
- 1.3 Quality Assurance .1 Qualifications:
- .1 Qualified journeypersons as defined by local jurisdiction to be engaged in painting work
 - .2 Apprentices: may be employed provided they work under direct supervision of

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

qualified journeyperson in accordance with trade regulations.

- .3 Conform to latest MPI requirements for exterior painting work including preparation and priming.
- .4 Materials: in accordance with MPI Painting Specification Manual "Approved Product" listing and from a single manufacturer for each system used.
- .5 Paint materials such as linseed oil, shellac, and turpentine to be highest quality product of an approved manufacturer listed in MPI Painting Specification Manual and to be compatible with other coating materials as required.

1.4 Performance Requirements

- .1 Environmental Performance Requirements:
 - .1 Green Performance in accordance with MPI Standard GPS-1.

1.5 Scheduling

- .1 Submit work schedule for various stages of painting to Engineer for approval. Submit schedule minimum of 48 hours in advance of proposed operations.
- .2 Obtain written authorization from Engineer for changes in work schedule.
- .3 Schedule painting operations to prevent disruption of occupants in and about building.

1.6 Submittals

- .1 Provide submittals in accordance with Section 01 33 00 - Submittal Procedures.
- .2 Product Data:
 - .1 Submit manufacturer's printed product literature, specifications and datasheet and include product characteristics, performance criteria, physical size, finish and

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

limitations.

- .3 Upon completion, submit records of products used. List products in relation to finish system and include the following:
 - .1 Product name, type and use.
 - .2 Manufacturer's product number.
 - .3 Colour numbers.
 - .4 MPI Environmentally Friendly classification system rating.
 - .5 Manufacturer's Material Safety Data Sheets (MSDS).
- .4 Provide samples in accordance with Section 01 33 00 - Submittal Procedures.
- .5 When approved, samples shall become acceptable standard of quality for appropriate on-site surface with one of each sample retained on-site. Submit full range of available colours where colour availability is restricted.

1.7 Quality Control

- .1 Provide mock-up in accordance with Section 01 45 00 - Quality Control.

1.8 Maintenance

- .1 Extra Materials:
 - .1 Submit maintenance materials in accordance with Section 01 78 00 - Closeout Submittals.
 - .2 Submit one, four litre can of each type and colour of finish coating. Identify colour and paint type in relation to established colour schedule and finish system.

1.9 Delivery, Storage And Handling

- .1 Deliver, store and handle as follows:
 - .1 Deliver and store materials in original containers, sealed, with labels intact.
 - .2 Labels: to indicate:
 - .1 Manufacturer's name and address.

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

- .2 Type of paint or coating.
- .3 Compliance with applicable standard.
- .4 Colour number in accordance with established colour schedule.
- .3 Remove damaged, opened and rejected materials from site.
- .4 Provide and maintain dry, temperature controlled, secure storage.
- .5 Observe manufacturer's recommendations for storage and handling.
- .6 Store materials and supplies away from heat generating devices.
- .7 Store materials and equipment in well ventilated area with temperature range 7 degrees C to 30 degrees C.
- .8 Store temperature sensitive products above minimum temperature as recommended by manufacturer.
- .9 Keep areas used for storage, cleaning and preparation, clean and orderly to approval of Departmental Representative. After completion of operations, return areas to clean condition to approval of Departmental Representative.
- .10 Remove paint materials from storage only in quantities required for same day use.
- .11 Comply with requirements of Workplace Hazardous Materials Information System (WHMIS) regarding use, handling storage, and disposal of hazardous materials.
- .12 Fire Safety Requirements:
 - .1 Provide one 9 kg Type ABC dry chemical fire extinguisher adjacent to storage area.
 - .2 Store oily rags, waste products, empty containers and materials subject to spontaneous combustion in ULC approved, sealed containers and remove

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

from site on a daily basis.

- .3 Handle, store, use and dispose of flammable and combustible materials in accordance with the National Fire Code of Canada.
- .2 Waste Management and Disposal:
 - .1 Paint, stain and wood preservative finishes and related materials (thinners, solvents, etc.) are regarded as hazardous products and are subject to regulations for disposal. Information on these controls can be obtained from Provincial Ministries of Environment and Regional levels of Government.
 - .2 Material which cannot be reused must be treated as hazardous waste and disposed of in an appropriate manner.
 - .3 Place materials defined as hazardous or toxic waste, including used sealant and adhesive tubes and containers, in containers or areas designated for hazardous waste.
 - .4 To reduce the amount of contaminants entering waterways, sanitary/storm drain systems or into the ground the following procedures shall be strictly adhered to:
 - .1 Retain cleaning water for water-based materials to allow sediments to be filtered out.
 - .2 Retain cleaners, thinners, solvents and excess paint and place in designated containers and ensure proper disposal.
 - .3 Return solvent and oil soaked rags used during painting operations for contaminant recovery, proper disposal, or appropriate cleaning and laundering.
 - .4 Dispose of contaminants in an approved legal manner in accordance with hazardous waste

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

regulations.

- .5 Empty paint cans are to be dry prior to disposal or recycling (where available).
- .5 Close and seal tightly partly used sealant and adhesive containers and store protected in well ventilated fire-safe area at moderate temperature.

1.10 Ambient
Conditions

- .1 Heating, Ventilation and Lighting:
 - .1 Provide temporary ventilating and heating equipment. Do not perform painting work unless adequate and continuous ventilation and sufficient heating facilities are in place to maintain ambient air and substrate temperatures above 10 degrees C for 24 hours before, during and after paint application until paint has cured sufficiently.
 - .2 Where required, provide continuous ventilation for seven days after completion of application of paint.
 - .3 Perform no painting work unless a minimum lighting level of 323 Lux is provided on surfaces to be painted. Adequate temporary lighting facilities to be provided by General Contractor.
- .2 Temperature, Humidity and Substrate Moisture Content Levels:
 - .1 Unless specifically pre-approved by specifying body, Paint Inspection Agency and, applied product manufacturer, perform no painting work when:
 - .1 Ambient air and substrate temperatures are below 10 degrees C.
 - .2 Substrate temperature is over 32 degrees C unless paint is specifically formulated for application at high

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

- temperatures.
- .3 Substrate and ambient air temperatures are expected to fall outside MPI or paint manufacturer's prescribed limits.
- .4 Relative humidity is above 85 % or when dew point is less than 3 degrees C variance between air/surface temperature.
- .5 Rain or snow is forecast to occur before paint has thoroughly cured or when it is foggy, misty, raining or snowing at site.
- .2 Perform no painting work when maximum moisture content of substrate exceeds:
 - .1 15 % for wood.
- .3 Conduct moisture tests using a properly calibrated electronic Moisture Meter.
- .3 Surface and Environmental Conditions:
 - .1 Apply paint to adequately prepared surfaces and to surfaces within moisture limits noted herein.
 - .2 Apply paint when previous coat of paint is dry or adequately cured.
 - .3 Apply paint finishes when conditions forecast for entire period of application fall within manufacturer's recommendations.
 - .4 Do not apply paint when:
 - .1 Temperature is expected to drop below 10 degrees C before paint has thoroughly cured.
 - .2 Substrate and ambient air temperatures are expected to fall outside MPI or paint manufacturer's limits.
 - .3 Surface to be painted is wet, damp or frosted.
 - .5 Provide and maintain cover when paint

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

must be applied in damp or cold weather. Heat substrates and surrounding air to comply with temperature and humidity conditions specified by manufacturer. Protect until paint is dry or until weather conditions are suitable.

- .6 Schedule painting operations such that surfaces exposed to direct, intense sunlight are scheduled for completion during early morning.
- .7 Remove paint from areas which have been exposed to freezing, excess humidity, rain, snow or condensation. Prepare surface again and repaint.

PART 2 PRODUCTS

2.1 Materials

- .1 Paint materials listed in latest edition of MPI Approved Products List (APL) are acceptable for use on this project.
- .2 Paint materials for paint systems: to be products of single manufacturer.
- .3 Acceptable products (or approved equivalents), are as follows:
 - .1 Exterior concrete: 2 coats of Master Protect EL750 Elastomeric Coating (or approved equivalent). Apply as per manufacturer's instructions. Note that the tower is to be fully enclosed and hoarded with proper conditions inside the hoarding, prior to re-painting.
 - .2 Aluminum lantern room enclosure: Prime the surface by applying 2 coats of Amerlock 2 surface tolerant epoxy coating (or approved equivalent) at 5-7 mils film thickness per coat. Apply one coat of Amershield high solids polyurethane coating (or approved equivalent) at 3-5 mils dry film thickness. Apply as per manufacturer's instructions.
- .2 Galvanized steel hand rail: Prime the

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

surface by applying 2 coats of Amerlock 2 surface tolerant epoxy coating (or approved equivalent) at 5-7 mils film thickness per coat. Apply one coat of Amershield high solids polyurethane coating (or approved equivalent) at 3-5 mils dry film thickness. Apply as per manufacturer's instructions.

- 2.2 Colours
- .1 The intent is to match the existing colours (white for the concrete tower and coast guard red for the lantern room enclosure and entrance hand rail).
 - .2 Selection of colours will be from manufacturers full range of colours.
 - .3 Where specific products are available in restricted range of colours, selection will be based on limited range.

PART 3 EXECUTION

- 3.1 Manufacture Instructions
- .1 Compliance: comply with manufacturer's written recommendations or specifications, including product technical bulletins, handling, storage and installation instructions, and datasheets.

- 3.2 Preparation
- .1 Perform preparation and operations for exterior painting in accordance with MPI Maintenance Repainting Manual except where specified otherwise.
 - .2 Apply paint materials in accordance with paint manufacturer's written application instructions.

Clean and prepare surfaces as noted on the drawings.
 - .3 Prevent contamination of cleaned surfaces by salts, acids, alkalis, other corrosive chemicals, grease, oil and solvents before priming and between applications of remaining coats. Touch-up, spot prime, and

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

apply primer, paint, or pre-treatment as soon as possible after cleaning and before deterioration occurs.

- 3.3 Protection
- .1 Protect factory finished products and equipment.
 - .2 Protect passing pedestrians, and general public in and about building.
 - .3 Remove light fixtures, surface hardware on doors, and other surface mounted equipment, fittings and fastenings prior to undertaking painting operations. Store items and re-install after painting is completed.
 - .4 As painting operations progress, place "WET PAINT" signs in pedestrian and vehicle traffic areas to approval of Engineer.

- 3.4 Application
- .1 Method of application to be approved by Departmental Representative. Apply paint by brush, roller or sprayer. Conform to manufacturer's application instructions unless specified otherwise.
 - .2 Spray Application:
 - .1 Provide and maintain equipment that is suitable for intended purpose, capable of properly atomizing paint to be applied, and equipped with suitable pressure regulators and gauges.
 - .2 Keep paint ingredients properly mixed in containers during paint application either by continuous mechanical agitation or by intermittent agitation as frequently as necessary.
 - .3 Apply paint in a uniform layer, with overlapping at edges of spray pattern. Brush out immediately runs and sags. Use brushes to work paint into cracks, crevices and places that are not

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

adequately painted by spray.

- .3 Brush and Roller Application:
 - .1 Apply paint in a uniform layer using brush and/or roller of types suitable for application.
 - .2 Work paint into cracks, crevices and corners.
 - .3 Paint surfaces and corners not accessible to brush using spray, daubers and/or sheepskins. Paint surfaces and corners not accessible to roller using brush, daubers or sheepskins.
 - .4 Brush and/or roll out runs and sags, and over-lap marks. Rolled surfaces shall be free of roller tracking and heavy stipple unless approved by Engineer.
 - .5 Remove runs, sags and brush marks from finished work and repaint.
- .4 Apply coats of paint as continuous film of uniform thickness. Repaint thin spots or bare areas before next coat of paint is applied.
- .5 Allow surfaces to dry and properly cure after cleaning and between subsequent coats for minimum time period as recommended by manufacturer.
- .6 Sand and dust between coats to remove visible defects.
- .7 Finish surfaces both above and below sight lines as specified for surrounding surfaces, including such surfaces as projecting ledges.
- .8 Finish top, bottom, edges and cutouts of doors after fitting as specified for door surfaces.

3.5 Field
Quality Control

- .1 Inspection:
 - .1 Advise Departmental Representative

Restoration of the Cape Bauld
Light Tower, NL

2016-08-08

when each surface and applied coating is ready for inspection. Do not proceed with subsequent coats until previous coat has been approved.

- 3.6 Cleaning .1 Proceed in accordance with Section 01 74 11 - Cleaning.
- .1 Remove paint where spilled, splashed, splattered or sprayed as work progresses using means and materials that are not detrimental to affected surfaces.
- 3.7 Restoration .1 Clean and re-install hardware items removed before undertaken painting operations.
- .2 Remove protective coverings and warning signs as soon as practical after operations cease.
- .3 Remove paint splashings on exposed surfaces that were not painted. Remove smears and spatter immediately as operations progress, using compatible solvent.
- .4 Protect freshly completed surfaces from paint droppings and dust to approval of Engineer. Avoid scuffing newly applied paint.
- .5 Restore areas used for storage, cleaning, mixing and handling of paint to clean condition as approved by Engineer.

Appendix A: General Pictures















Appendix B: Lead Paint Samples

Your Project #: 5-841
Site Location: CAPE BAULD
Your C.O.C. #: 5-841

Attention:NEIL HUNT

AFN Engineering Inc
29 Brad Gushue Crescent
St. John's, NL
A1H 0A3

Report Date: 2016/08/05
Report #: R4094463
Version: 1 - Partial

CERTIFICATE OF ANALYSIS – PARTIAL RESULTS

MAXXAM JOB #: B6F9928

Received: 2016/07/28, 10:41

Sample Matrix: Paint
Samples Received: 2

Analyses	Quantity	Date Extracted	Date Analyzed	Laboratory Method	Reference
Metals Paint Acid Extr. ICPMS	2	2016/08/04	2016/08/04	ATL SOP 00058	EPA 6020A R1 m

Reference Method suffix "m" indicates test methods incorporate validated modifications from specific reference methods to improve performance.

* RPDs calculated using raw data. The rounding of final results may result in the apparent difference.

Encryption Key

Please direct all questions regarding this Certificate of Analysis to your Project Manager.

Avery Withrow, Project Manager

Email: AWithrow@maxxam.ca

Phone# (902)420-0203 Ext:233

=====
This report has been generated and distributed using a secure automated process.

Maxxam has procedures in place to guard against improper use of the electronic signature and have the required "signatories", as per section 5.10.2 of ISO/IEC 17025:2005(E), signing the reports. For Service Group specific validation please refer to the Validation Signature Page.

Maxxam Job #: B6F9928
Report Date: 2016/08/05

AFN Engineering Inc
Client Project #: 5-841
Site Location: CAPE BAULD
Sampler Initials: WS

ELEMENTS BY ATOMIC SPECTROSCOPY (PAINT)

Maxxam ID		CUL226	CUL227		
Sampling Date		2016/07/22	2016/07/22		
COC Number		5-841	5-841		
	UNITS	INSIDE	OUTSIDE	RDL	QC Batch
Metals					
Acid Extractable Lead (Pb)	mg/kg	17000	2700	5.0	4605581
RDL = Reportable Detection Limit					
QC Batch = Quality Control Batch					

Maxxam Analytics International Corporation - 200 Bluewater Rd, Suite 105, Bedford, Nova Scotia Canada B4B 1G9 Tel: 902-420-0203 Toll-free: 800-565-7227 Fax: 902-420-8612 www.maxxamanalytics.com

Maxxam Job #: B6F9928
Report Date: 2016/08/05

AFN Engineering Inc
Client Project #: 5-841
Site Location: CAPE BAULD
Sampler Initials: WS

GENERAL COMMENTS

Results relate only to the items tested.

Maxxam Analytics International Corporation - 200 Bluewater Rd, Suite 105, Bedford, Nova Scotia Canada B4B 1G9 Tel: 902-420-0203 Toll-free: 800-565-7227 Fax: 902-420-8612 www.maxxamanalytics.com

Maxxam Job #: B6F9928
Report Date: 2016/08/05

AFN Engineering Inc
Client Project #: 5-841
Site Location: CAPE BAULD
Sampler Initials: WS

QUALITY ASSURANCE REPORT

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
4605581	BAN	Matrix Spike	Acid Extractable Lead (Pb)	2016/08/04		TBA	%	75 - 125
4605581	BAN	Spiked Blank	Acid Extractable Lead (Pb)	2016/08/04		104	%	75 - 125
4605581	BAN	Method Blank	Acid Extractable Lead (Pb)	2016/08/04	<5.0		mg/kg	
4605581	BAN	RPD	Acid Extractable Lead (Pb)	2016/08/04	TBA		%	35

TBA = Result to follow

Duplicate: Paired analysis of a separate portion of the same sample. Used to evaluate the variance in the measurement.

Matrix Spike: A sample to which a known amount of the analyte of interest has been added. Used to evaluate sample matrix interference.

Spiked Blank: A blank matrix sample to which a known amount of the analyte, usually from a second source, has been added. Used to evaluate method accuracy.


Method Blank: A blank matrix containing all reagents used in the analytical procedure. Used to identify laboratory contamination.

Maxxam Job #: B6F9928
Report Date: 2016/08/05

AFN Engineering Inc
Client Project #: 5-841
Site Location: CAPE BAULD
Sampler Initials: WS

VALIDATION SIGNATURE PAGE

The analytical data and all QC contained in this report were reviewed and validated by the following individual(s).



Mike MacGillivray, Scientific Specialist (Inorganics)

Maxxam has procedures in place to guard against improper use of the electronic signature and have the required "signatories", as per section 5.10.2 of ISO/IEC 17025:2005(E), signing the reports. For Service Group specific validation please refer to the Validation Signature Page.

Appendix C: FHBRO Report

**FHBRO HERITAGE CHARACTER STATEMENT
CAPE BAULD LIGHTTOWER
QUIRPON ISLAND, NEWFOUNDLAND AND LABRADOR**

FHBRO Number: **06-023**
DFRP Number: **01729**
Resource Name: **Cape Bauld Lighttower**
Address: **Quirpon Island, Newfoundland and Labrador**
FHBRO Status: **"Recognized" Federal Heritage Building**
Construction: **1960-61**
Designer: **Department of Transport**
Original Function: **lighthouse**
Current Function: **lighthouse**
Modifications: **no known modifications**
Custodian: **Fisheries and Oceans Canada**

Description of Historic Place

The Cape Bauld Lighttower is a tapered, concrete octagonal lighttower, topped by an octagonal, aluminum lantern. The gently tapered walls of the tower are painted white and rise to a flared cornice, above which a railed observation platform surrounds the red lantern. A vertical row of three windows with simple, concrete lintels runs up one side of the lighttower. The Cape Bauld Lighttower is located in a rocky, barren landscape on the northern tip of Quirpon Island at the northern entrance to the Strait of Belle Isle. The lightstation is visible from L'Anse-aux-Meadows National Historic Site and World Heritage Site, located on the mainland. The designation is confined to the footprint of the building.

Heritage Value

The Cape Bauld Lighttower is a "Recognized" Federal Heritage Building because of its historical associations, and its architectural and environmental values.

Historical value:

The Cape Bauld Lighttower is a very good example of the theme of aids to navigation in Canadian waters. As a landfall light with a range of 17 nautical miles located on the northern tip of Quirpon Island, it guides international and coastal shipping at the northern entry to the Strait of Belle Isle. The importance of a lighttower at this location is emphasized by the fact that the Dominion government built the first tower here soon after Confederation in what were then non-Canadian waters. The light is the second replacement structure on the site.

Architectural value:

The Cape Bauld Lighttower is a good example of the freestanding, concrete, tapered, octagonal type of lighttower. Its solid and competent design is notable for its simplicity, its minimalist approach and its nice proportions. The lighttower adequately fulfills its function of providing a secure base for the lantern and conveying the iconographic message as a day marker. The lighttower is a good example of a standardized

FEDERAL HERITAGE BUILDINGS REVIEW OFFICE
National Historic Sites Directorate, Parks Canada
25 Eddy Street, 5th Floor, Gatineau, QC K1A 0M5
Telephone: 819-997-6740 / Fax: 819-953-6146 / Web Site: http://www.pc.gc.ca/progs/beefp-fhbro/index_f.asp

FHBRO HERITAGE CHARACTER STATEMENT CAPE BAULD LIGHTTOWER QUIRPON ISLAND, NEWFOUNDLAND AND LABRADOR

plan that was prepared by the Department of Transport and refined throughout the 20th century. The tower was built of common materials for its time. The structure has been well maintained and has stood up well, demonstrating good craftsmanship.

Environmental value:

Sitting atop a steep, rocky, barren point in an isolated area only accessible by boat, the lighthouse reinforces the maritime character of the area. The relationship between the lighthouse, the rugged landscape and the surrounding small structures has retained its character despite the replacement of some structures. The lighthouse is a familiar reference point and a known landmark for local navigation and tourists visiting L'Anse-aux-Meadows National Historic Site.

Character-Defining Elements

The following character-defining elements of the Cape Bauld Lighthouse should be respected:

The features that illustrate the theme of aids to navigation in Canadian waters, as reflected in:

- Its design and materials typical of the concrete, tapered, octagonal lighthouse type; and,
- Its location on the northern tip of Quirpon Island, at the northern entry to the Strait of Belle Isle.

Its good aesthetic design, its good functional design, and good quality of materials and craftsmanship, as manifested in:

- Its nice proportions and simple, minimalist approach, characterized by its smooth tapered walls, the octagonal forms of its base and lantern, its tall shaft, flared cornice, and railed platform;
- The vertical alignment of its three window openings;
- Its simple and functional detailing, including slightly projecting concrete lintels over window and door openings and the slightly projecting foundation at the base of the tower;
- The octagonal aluminum-and-glass lantern, with its gently sloping roof and finial;
- Its straightforward interior spatial arrangement, divided vertically into three floors connected by interior metal stairs leading up to the lantern; and,
- The use of durable material for its construction, including its poured concrete foundation, reinforced concrete walls and floors, and prefabricated metal elements such as its interior stairs, railings and lantern.

The manner in which it reinforces its maritime setting, as evidenced in:

- Its location on a steep, rocky, barren and isolated point of land at the northern tip of Quirpon Island;
- Its relationship to the other structures at the site; and,
- Its visibility from the water.

For guidance on interventions, please refer to the *Standards and Guidelines for the Conservation of Historic*

FEDERAL HERITAGE BUILDINGS REVIEW OFFICE
National Historic Sites Directorate, Parks Canada
25 Eddy Street, 5th Floor, Gatineau, QC K1A 0M5
Telephone: 819-997-6740 / Fax: 819-953-6146 / Web Site: http://www.pc.gc.ca/progs/beefp-fhbro/index_f.asp

**FHBRO HERITAGE CHARACTER STATEMENT
CAPE BAULD LIGHTTOWER
QUIRPON ISLAND, NEWFOUNDLAND AND LABRADOR**

Places in Canada. For further information contact FHBRO.

August 2007

FEDERAL HERITAGE BUILDINGS REVIEW OFFICE
National Historic Sites Directorate, Parks Canada
25 Eddy Street, 5th Floor, Gatineau, QC K1A 0M5
Telephone: 819-997-6740 / Fax: 819-953-6146 / Web Site: http://www.pc.gc.ca/progs/beefp-fhbro/index_f.asp