
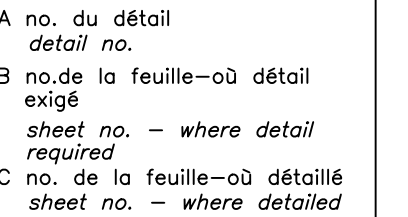


SERVICES METALLURGIQUES DU QUÉBEC LTÉE
765 RUE DE L'ÉGLISE
SAINT-ROMUALD (Qc) CANADA G6W 5M6
TÉL: 418 210-3600


BEFORE STARTING THE WORKS,
CHECK ACCORDINGLY, AND MEASURE
ADEQUATELY BEFORE CUTTING ANY
COMPONENT.

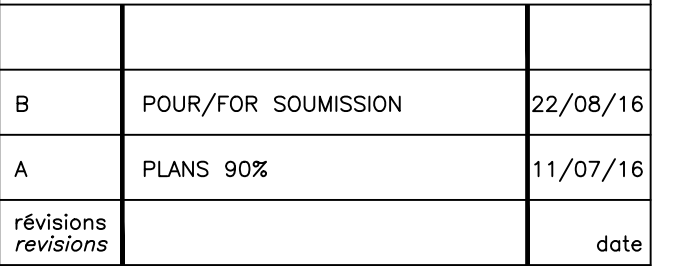


SAINTE-FLAVIE
INSTITUT MAURICE LAMONTAGNE
CORRECTIONS AU SYSTÈME DE
POMPAGE D'EAU DE MER FILTRÉE
CORRECTIONS AT SEA WATER
PUMP SYSTEM

ELECTRICAL DIAGRAM

		<i>File no</i>	
No de plan ou dessin	<i>File name</i>	No feuille	<i>Sheet no</i>
RM16014C		PC6/6	

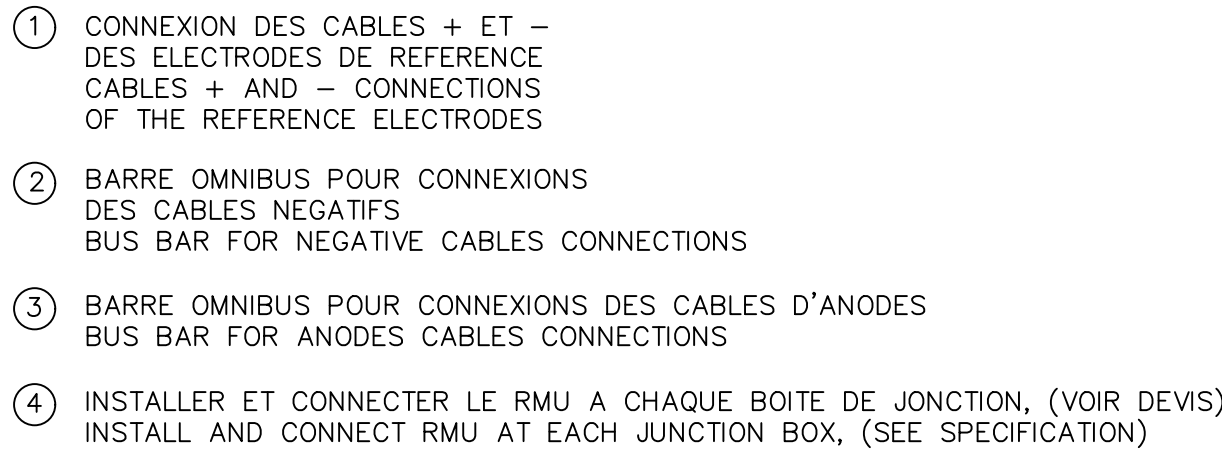

AUCUNE ECHELLE / NO SCALE

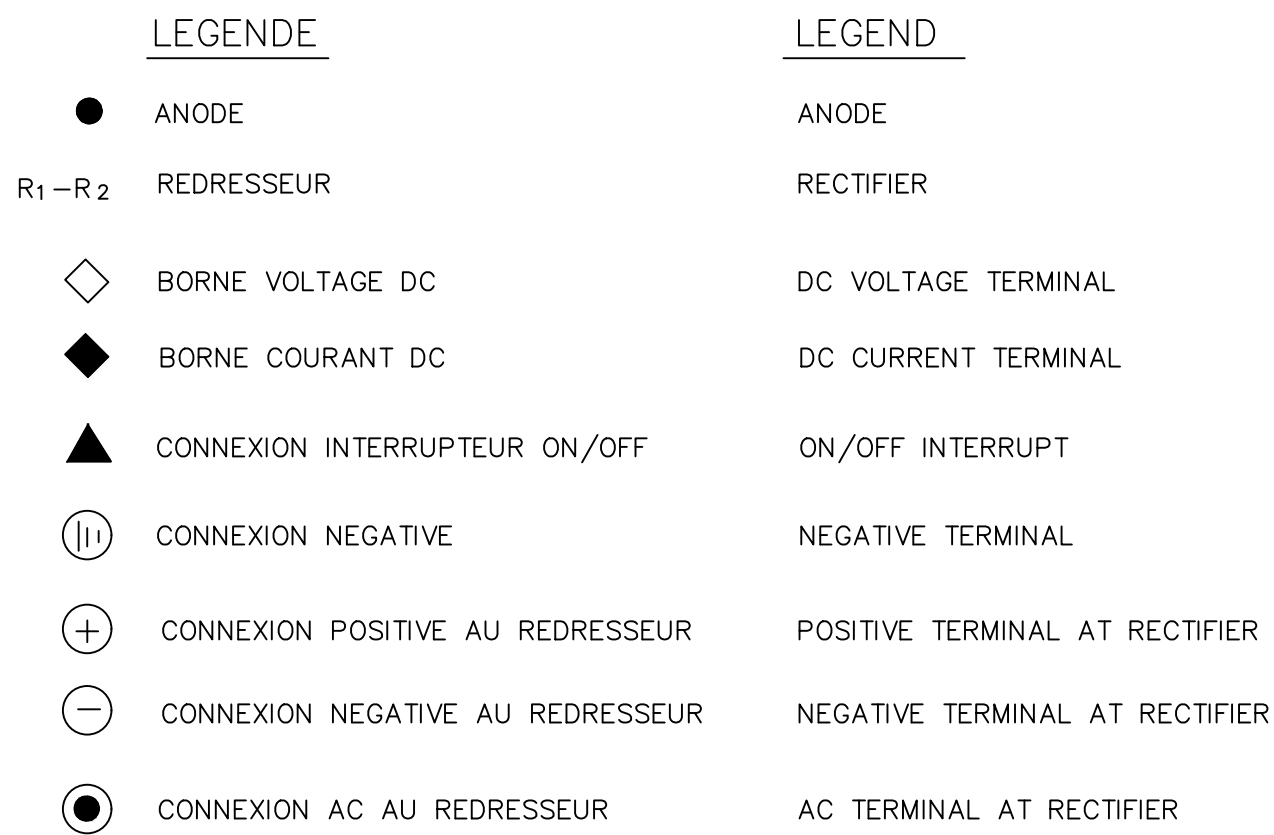

NOTE 1: TOUS LES CABLES D'ANODES SONT A DOUBLE ISOLATION DE TYPE HALAR / HMWPE
NOTE 1: ALL ANODE CABLES ARE DOUBLE INSULATION AND HALAR / HMWPE TYPE

NOTE 2: LES DETAILS POUR LES EQUIPEMENTS ELECTRIQUES SONT INCLUS AU DEVIS
NOTE 2: THE DETAILS FOR ELECTRICAL EQUIPMENTS ARE INCLUDED IN THE SPECIFICATIONS

NOTE 3: N1 ET N3 SONT DES NEGATIFS PROVENANT DU PUIT AU DETAIL 16 ET
N2 ET 4 SONT DES NEGATIFS PROVENANT DE LA CONNEXION
DES TIGES DE VALVES ET DES CONDUITS DES POMPES
NOTE 3: N1 AND N3 ARE THE NEGATIVES FROM WELL SHOW ON DETAIL 16
N2 AND N4 ARE THE NEGATIVES FROM THE VALVES ACTIVATION ROD
AND FROM PUMPS CONDUITS

NOTE GENERALE / GENERAL NOTE

1 - SOUDURE PAR POINTS A EFFECTUER SUR TOUS LES ECROUS A INSTALLER ET EXISTANTS
PERFORME TACK WELD ON ALL EXISTING AND TO BE INSTALLED NUTS

2 - TOUTES LES PIECES ET METAUX D'APPORT EXISTANTS OU A INSTALLER SONT EN ACIER INOXYDABLE AISI 316L
ALL EXISTING AND TO BE INSTALLED PIECES AND WELDS MUST BE IN STAINLESS STEEL AISI 316L