

**APEGM**  
Certificate of Authorization  
HDK Consulting Incorporated  
No. 5539 Date: 04/30/2017

Revision/	Description/Description	Date/Date
0	ISSUED FOR TENDER	Sept. 12, 16

Client/client  
**Public Works and Government Services Canada**

100 - 167 Lombard Avenue  
Winnipeg, Manitoba

Project title/Titre du projet  
**Lower Fort Garry (LFG)  
National Historic Site, Manitoba**

**HERITAGE BUILDING  
RECAPITALIZATION**

Approved by/Approve par  
HCC

Designed by/Concept par  
PL

Drawn by/Dessine par  
RD

PWGC Project Manager/Administrateur de Projets TPSCG  
CHRISTINA KOVACS


PWGC, Architectural and Engineering Resources Manager/  
Ressources Architectural et de Directeur d'ingénierie, TPSCG

Client/client  
PARKS CANADA

Drawing title/Titre du dessin

**BIG HOUSE  
BASEMENT AND MAIN FLOOR  
NEW LIGHTING PLAN**

Project No./No. du projet <b>R.075212.001</b>	Sheet/Fauille <b>E5</b> OF 24	Revision no./ La Révision no. <b>0</b>
--	-------------------------------------	--

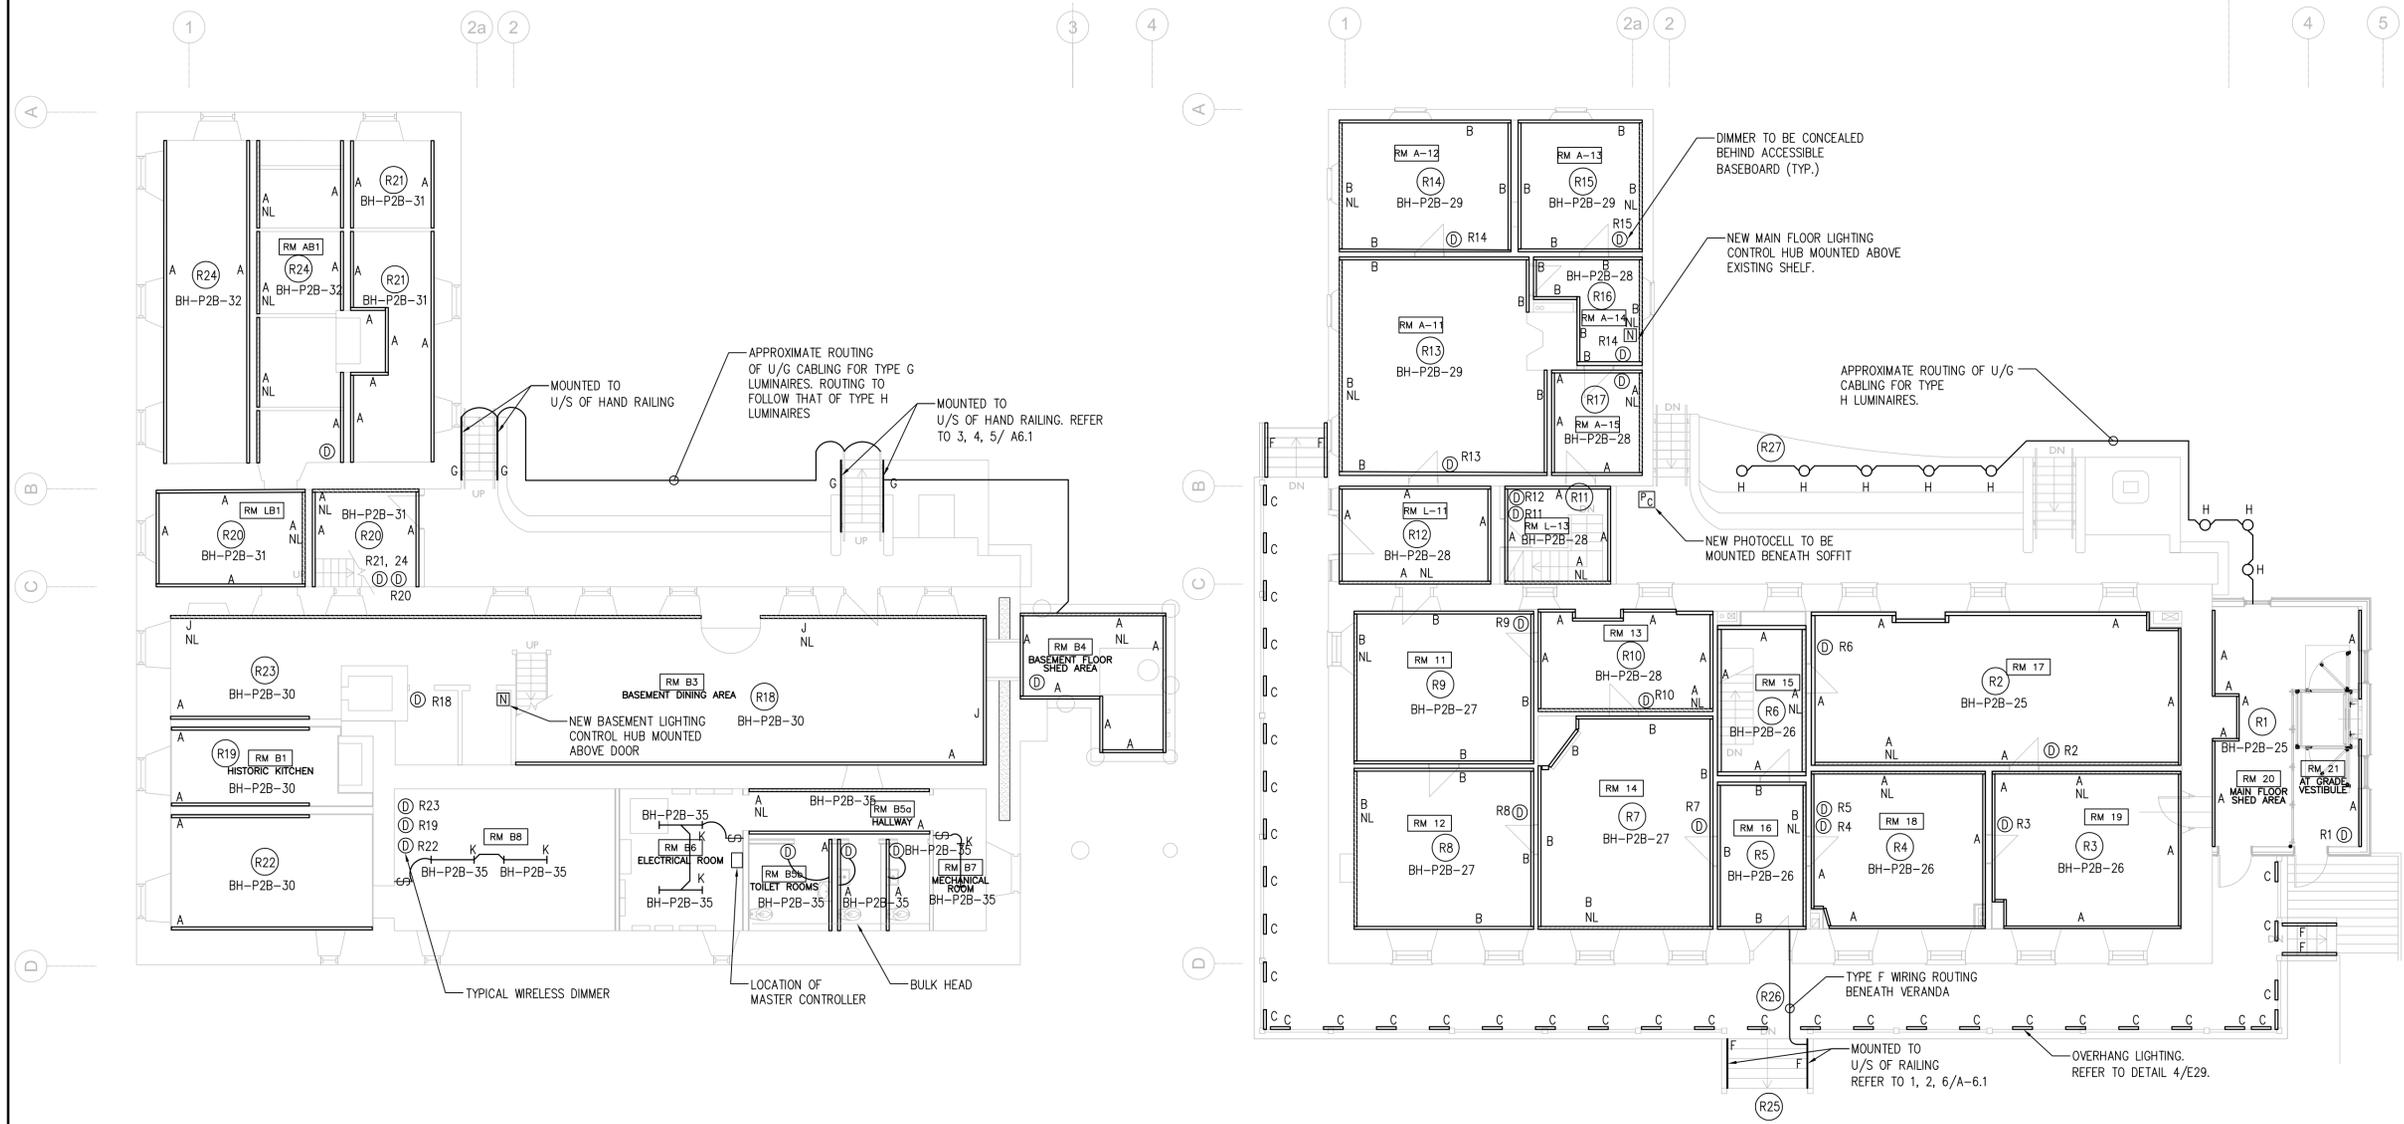

**1** BIGHOUSE – BASEMENT NEW LIGHTING PLAN  
E5 1:100

**2** BIGHOUSE – MAIN FLOOR NEW LIGHTING PLAN  
E5 1:100

NOTES:

- ALL LUMINAIRES DENOTED AS NIGHT LIGHT (NL) ARE TO BE CONNECTED TO EMERGENCY LIGHTING INVERTER BASEMENT TO BE CONNECTED TO ELI-B AND MAIN FLOOR TO ELI-M.
- (Rxx) DENOTES RELAY # FOR LIGHTING CONTROL SCHEDULE PURPOSE ONLY.
- INSPECT EXISTING SURFACES WHERE NEW LUMINAIRES ARE TO BE INSTALLED. \*SURFACE TO BE PREPARED PRIOR TO INSTALLATION OF LUMINAIRES. REFER TO ARCHITECTURAL FOR DETAILS.
- ALL LIGHTING CONTROL RELAYS/POWER SUPPLIES FOR BASEMENT TO BE LOCATED IN NON "TOUR" SPACES IE ELECTRICAL ROOM. NON-PUBLIC SPACES IN ELECTRICAL ROOM. ALL LIGHTING CONTROL RELAYS/POWER SUPPLIES TO BE LOCATED IN ATTIC. SUBMIT FLOOR PLANS INDICATING PROPOSED LOCATIONS OF POWER SUPPLIES AND POWER PACKS AS SHOP DRAWING PRIOR TO COMMENCEMENT OF WORKS. CONFIRM FINAL LOCATION OF ALL DEVICES ON SITE WITH PARKS CANADA.
- ALL NEW PENETRATIONS THRU EXISTING STONE WALL TO BE THRU MORTAR JOINTS. COORDINATE ALL WORK WITH PARKS CANADA.
- NO NEW PENETRATIONS THRU EXISTING STRUCTURE SHALL BE PERMITTED.

