




1 DEVICE LOCATED BETWEEN BEAMS (TYP.)  
E19 NTS

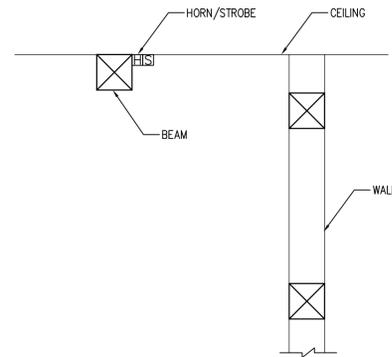


2 DEVICE LOCATED BETWEEN WALL AND BEAM (TYP.)  
E19 NTS

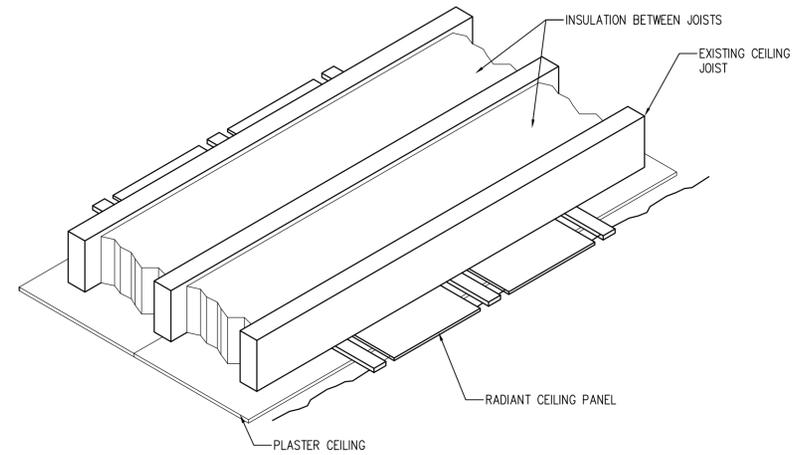


3 ELECTRIC RADIANT PANEL INSTALLATION DETAIL  
E19 NTS

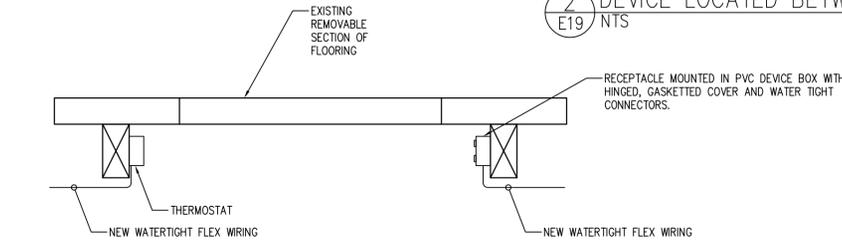


6 TYPICAL UNDER FLOOR RECEPTACLE  
E19 NTS

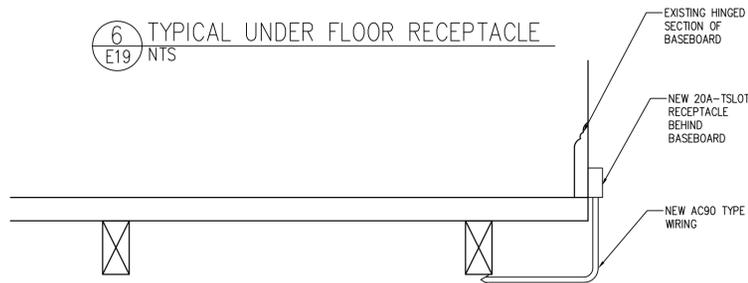

7 TYPICAL BEHIND BASEBOARD RECEPTACLE  
E19 NTS

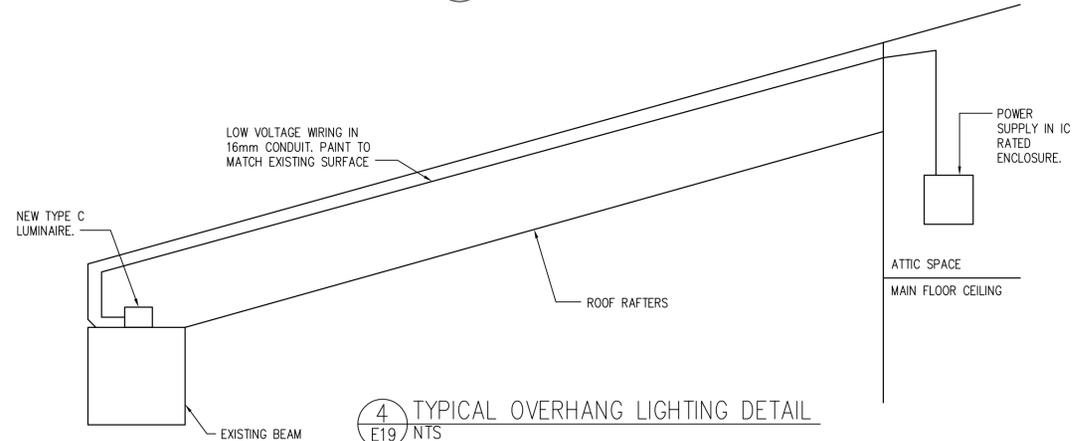

4 TYPICAL OVERHANG LIGHTING DETAIL  
E19 NTS

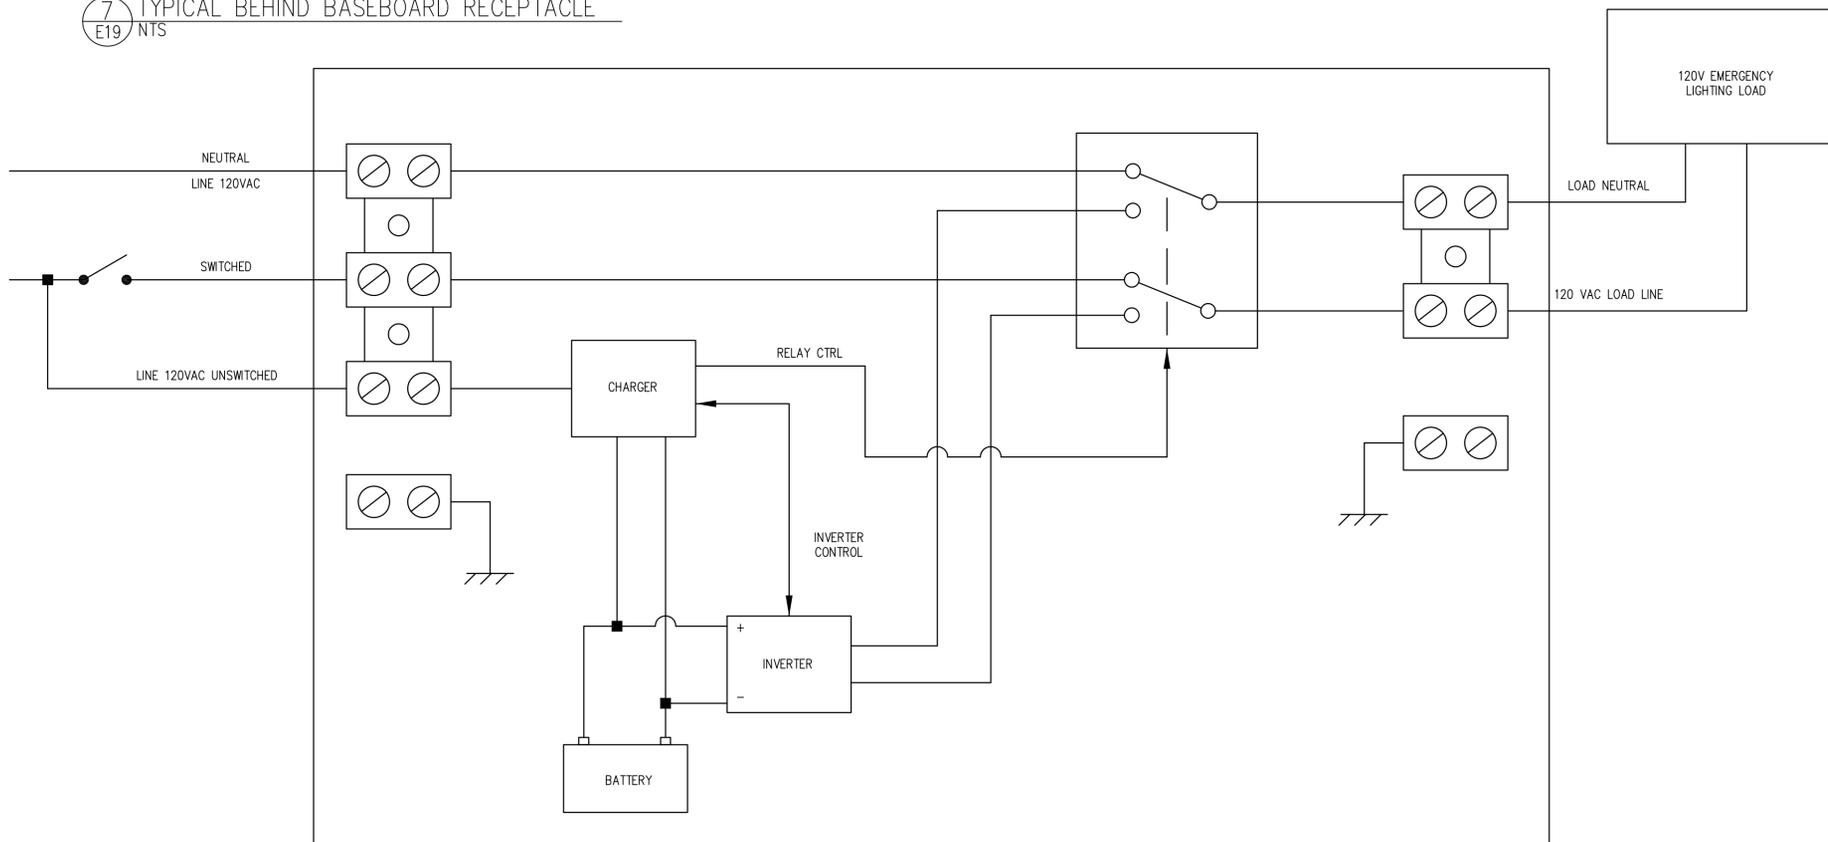

5 EMERGENCY LIGHTING INVERTER WIRING DIAGRAM  
E19 NTS



**APEGM**  
Certificate of Authorization  
HDK Consulting Incorporated  
No. 5539 Date: 04/30/2017

| Revision/ | Description/Description | Date/Date    |
|-----------|-------------------------|--------------|
| 0         | ISSUED FOR TENDER       | Sept. 12, 16 |

Client/client

**Public Works and Government Services Canada**  
100 - 167 Lombard Avenue  
Winnipeg, Manitoba

Project title/Titre du projet  
**Lower Fort Garry (LFG)  
National Historic Site, Manitoba**

**HERITAGE BUILDING  
RECAPITALIZATION**

Approved by/Approve par  
HCC

Designed by/Concept par  
PL

Drawn by/Dessine par  
RD

PWGSC Project Manager/Administrateur de Projets TPSCG  
CHRISTINA KOVACS

PWGSC, Architectural and Engineering Resources Manager/  
Ressources Architectural et de Directeur d'ingénierie, TPSCG

Client/client  
PARKS CANADA

Drawing title/Titre du dessin

**ELECTRICAL DETAILS**

| Project No./No. du projet | Sheet/Fauille | Revision no./<br>La Révision no. |
|---------------------------|---------------|----------------------------------|
| R.075212.001              | E19<br>OF 24  | 0                                |