

Revision/	Description/Description	Date/Date
0	ISSUED FOR TENDER	Sept. 12, 16

Client/client

Public Works
and Government Services
Canada

100 - 167 Lombard Avenue
Winnipeg, Manitoba

Project title/Titre du projet
Lower Fort Garry (LFG)
National Historic Site, Manitoba

HERITAGE BUILDING
RECAPITALIZATION

Approved by/Approuvé par
KO

Designed by/Concept par
JS

Drawn by/Dessiné par
RD

PWGSC Project Manager/Administrateur de Projets TPSCG
CK

PWGSC, Architectural and Engineering Resources Manager/
Ressources Architectural et de Directeur d'ingénierie, TPSCG

Client/client
PARKS CANADA


Drawing title/Titre du dessin

MEN'S HOUSE
MAIN FLOOR - DEMOLITION AND
NEW CONSTRUCTION PLAN AND
INTRUSION ALARM SINGLE LINE
DIAGRAM


Project No./No. du
projet
R.075212.001

Sheet/Feuille
T7
OF 8


Revision no./
La Révision
no.
0

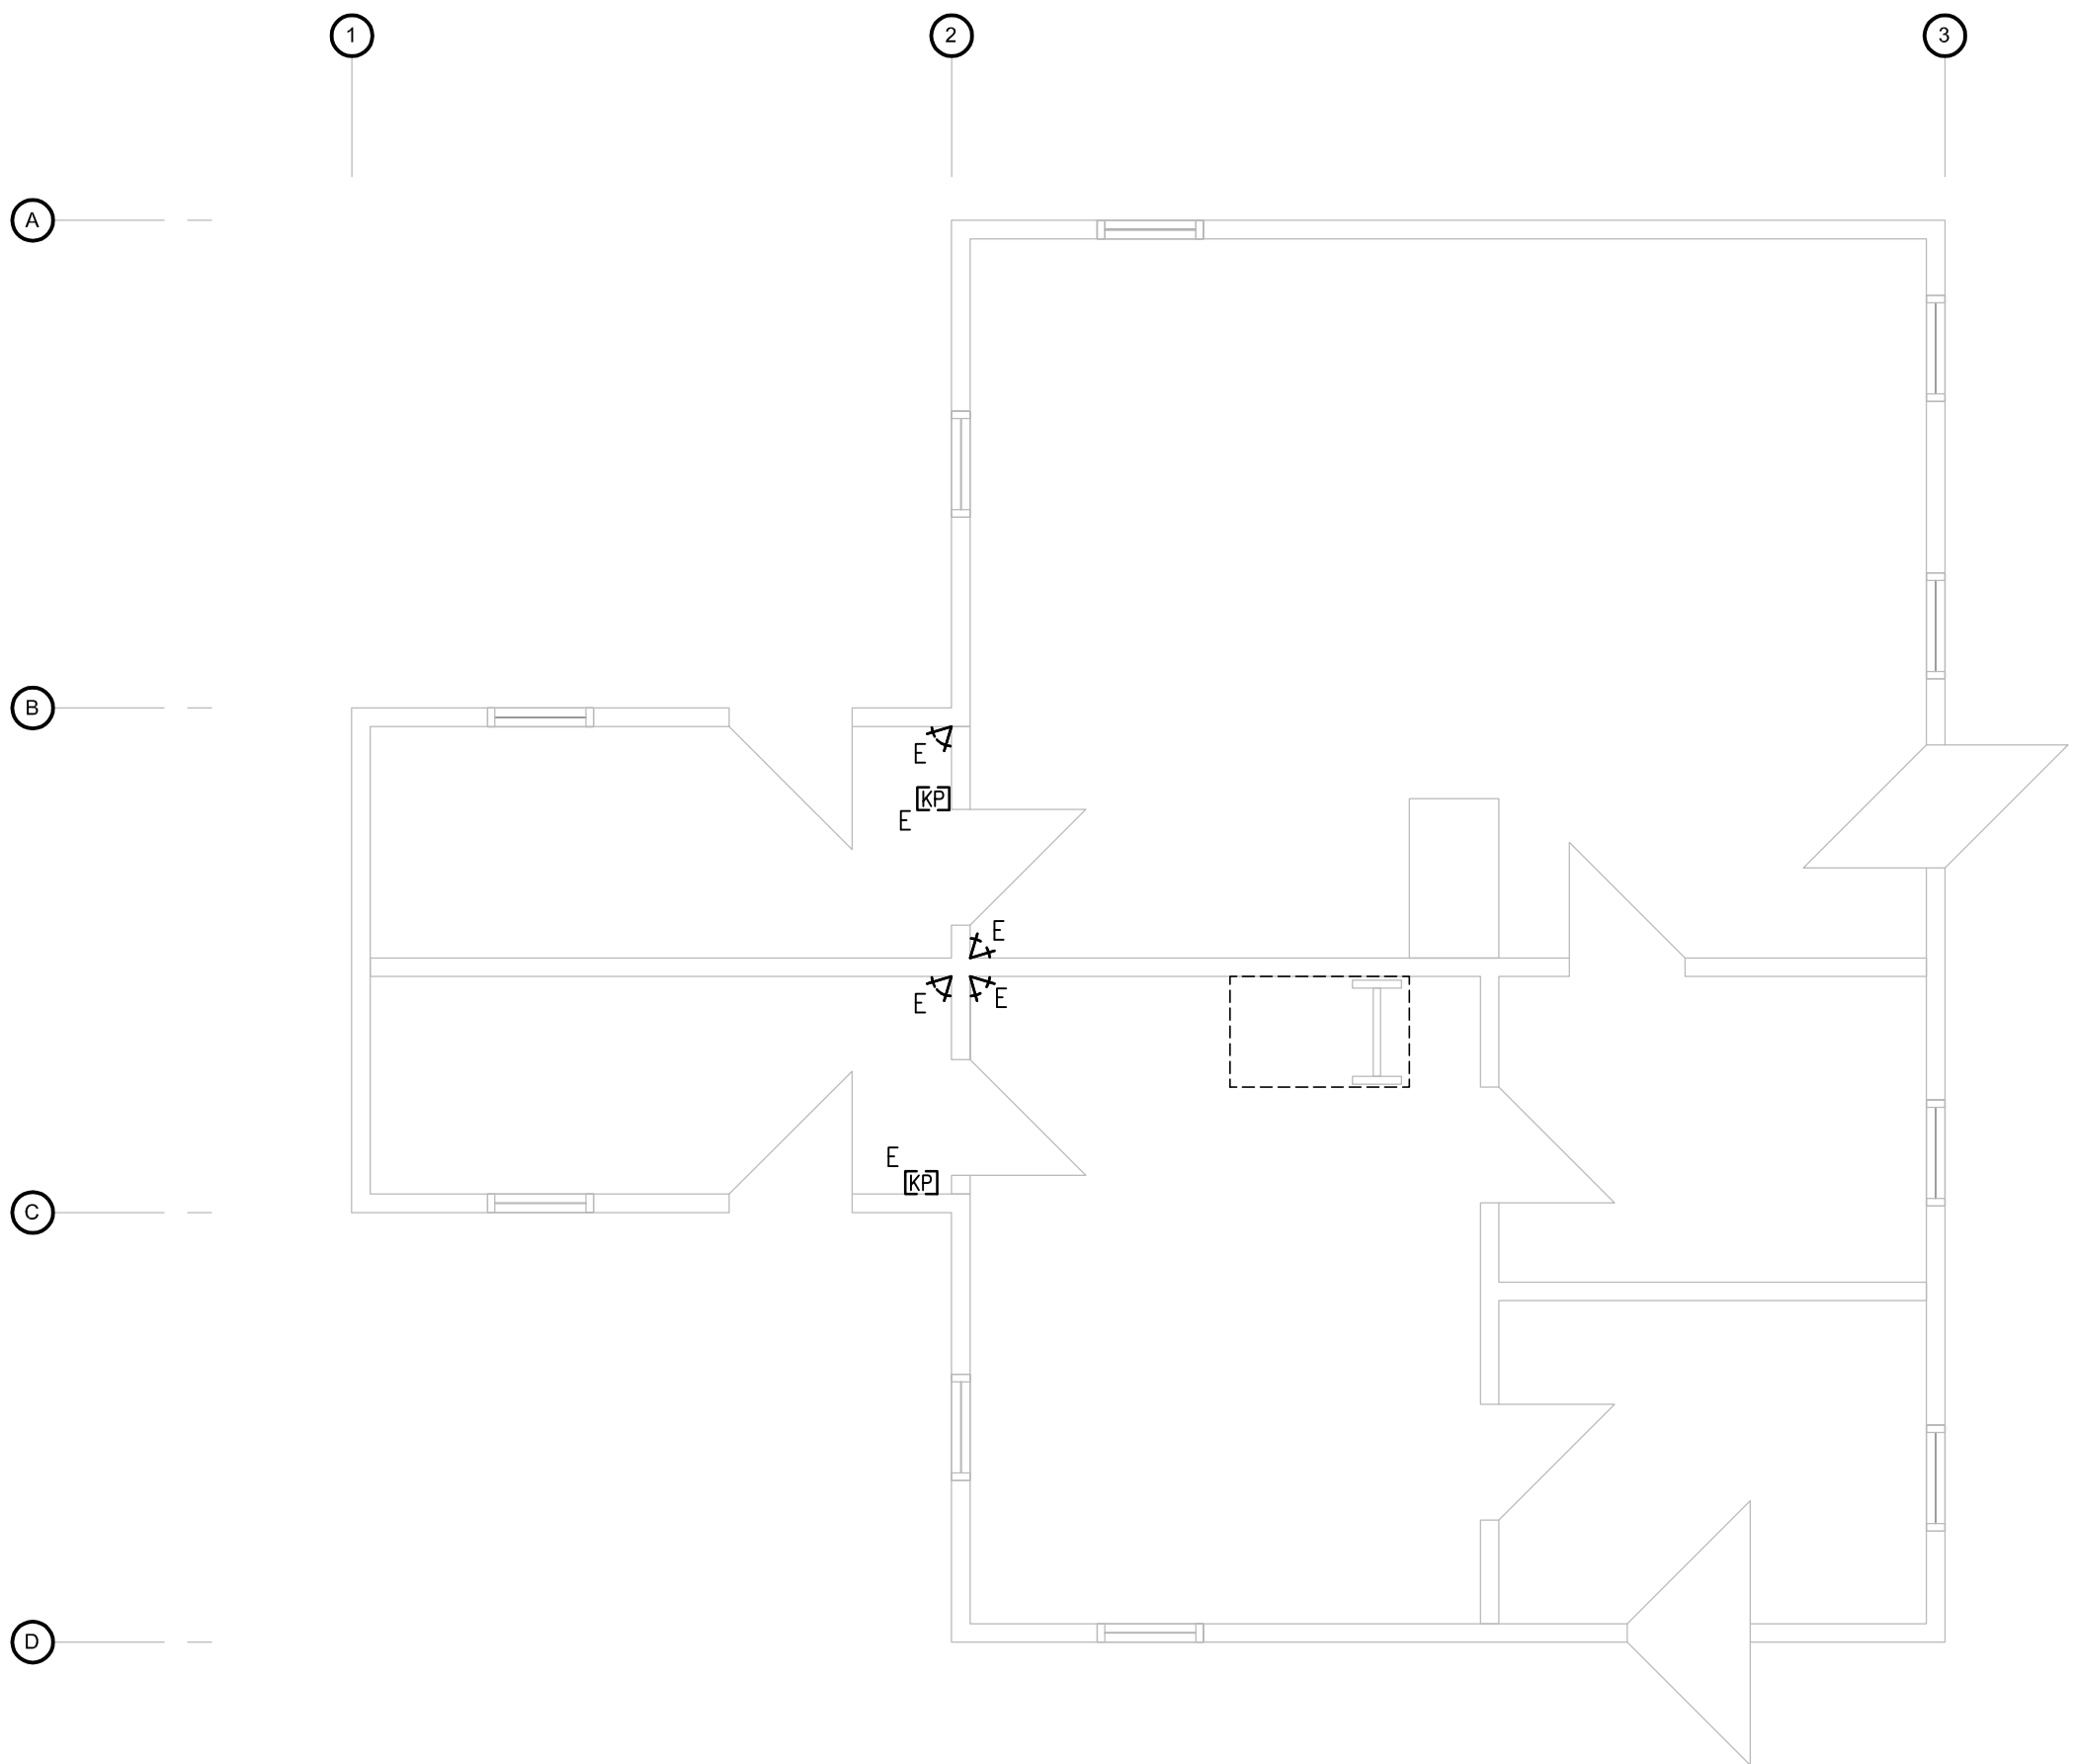

1 MEN'S HOUSE - MAIN FLOOR - SECURITY DEMOLITION PLAN
1:50

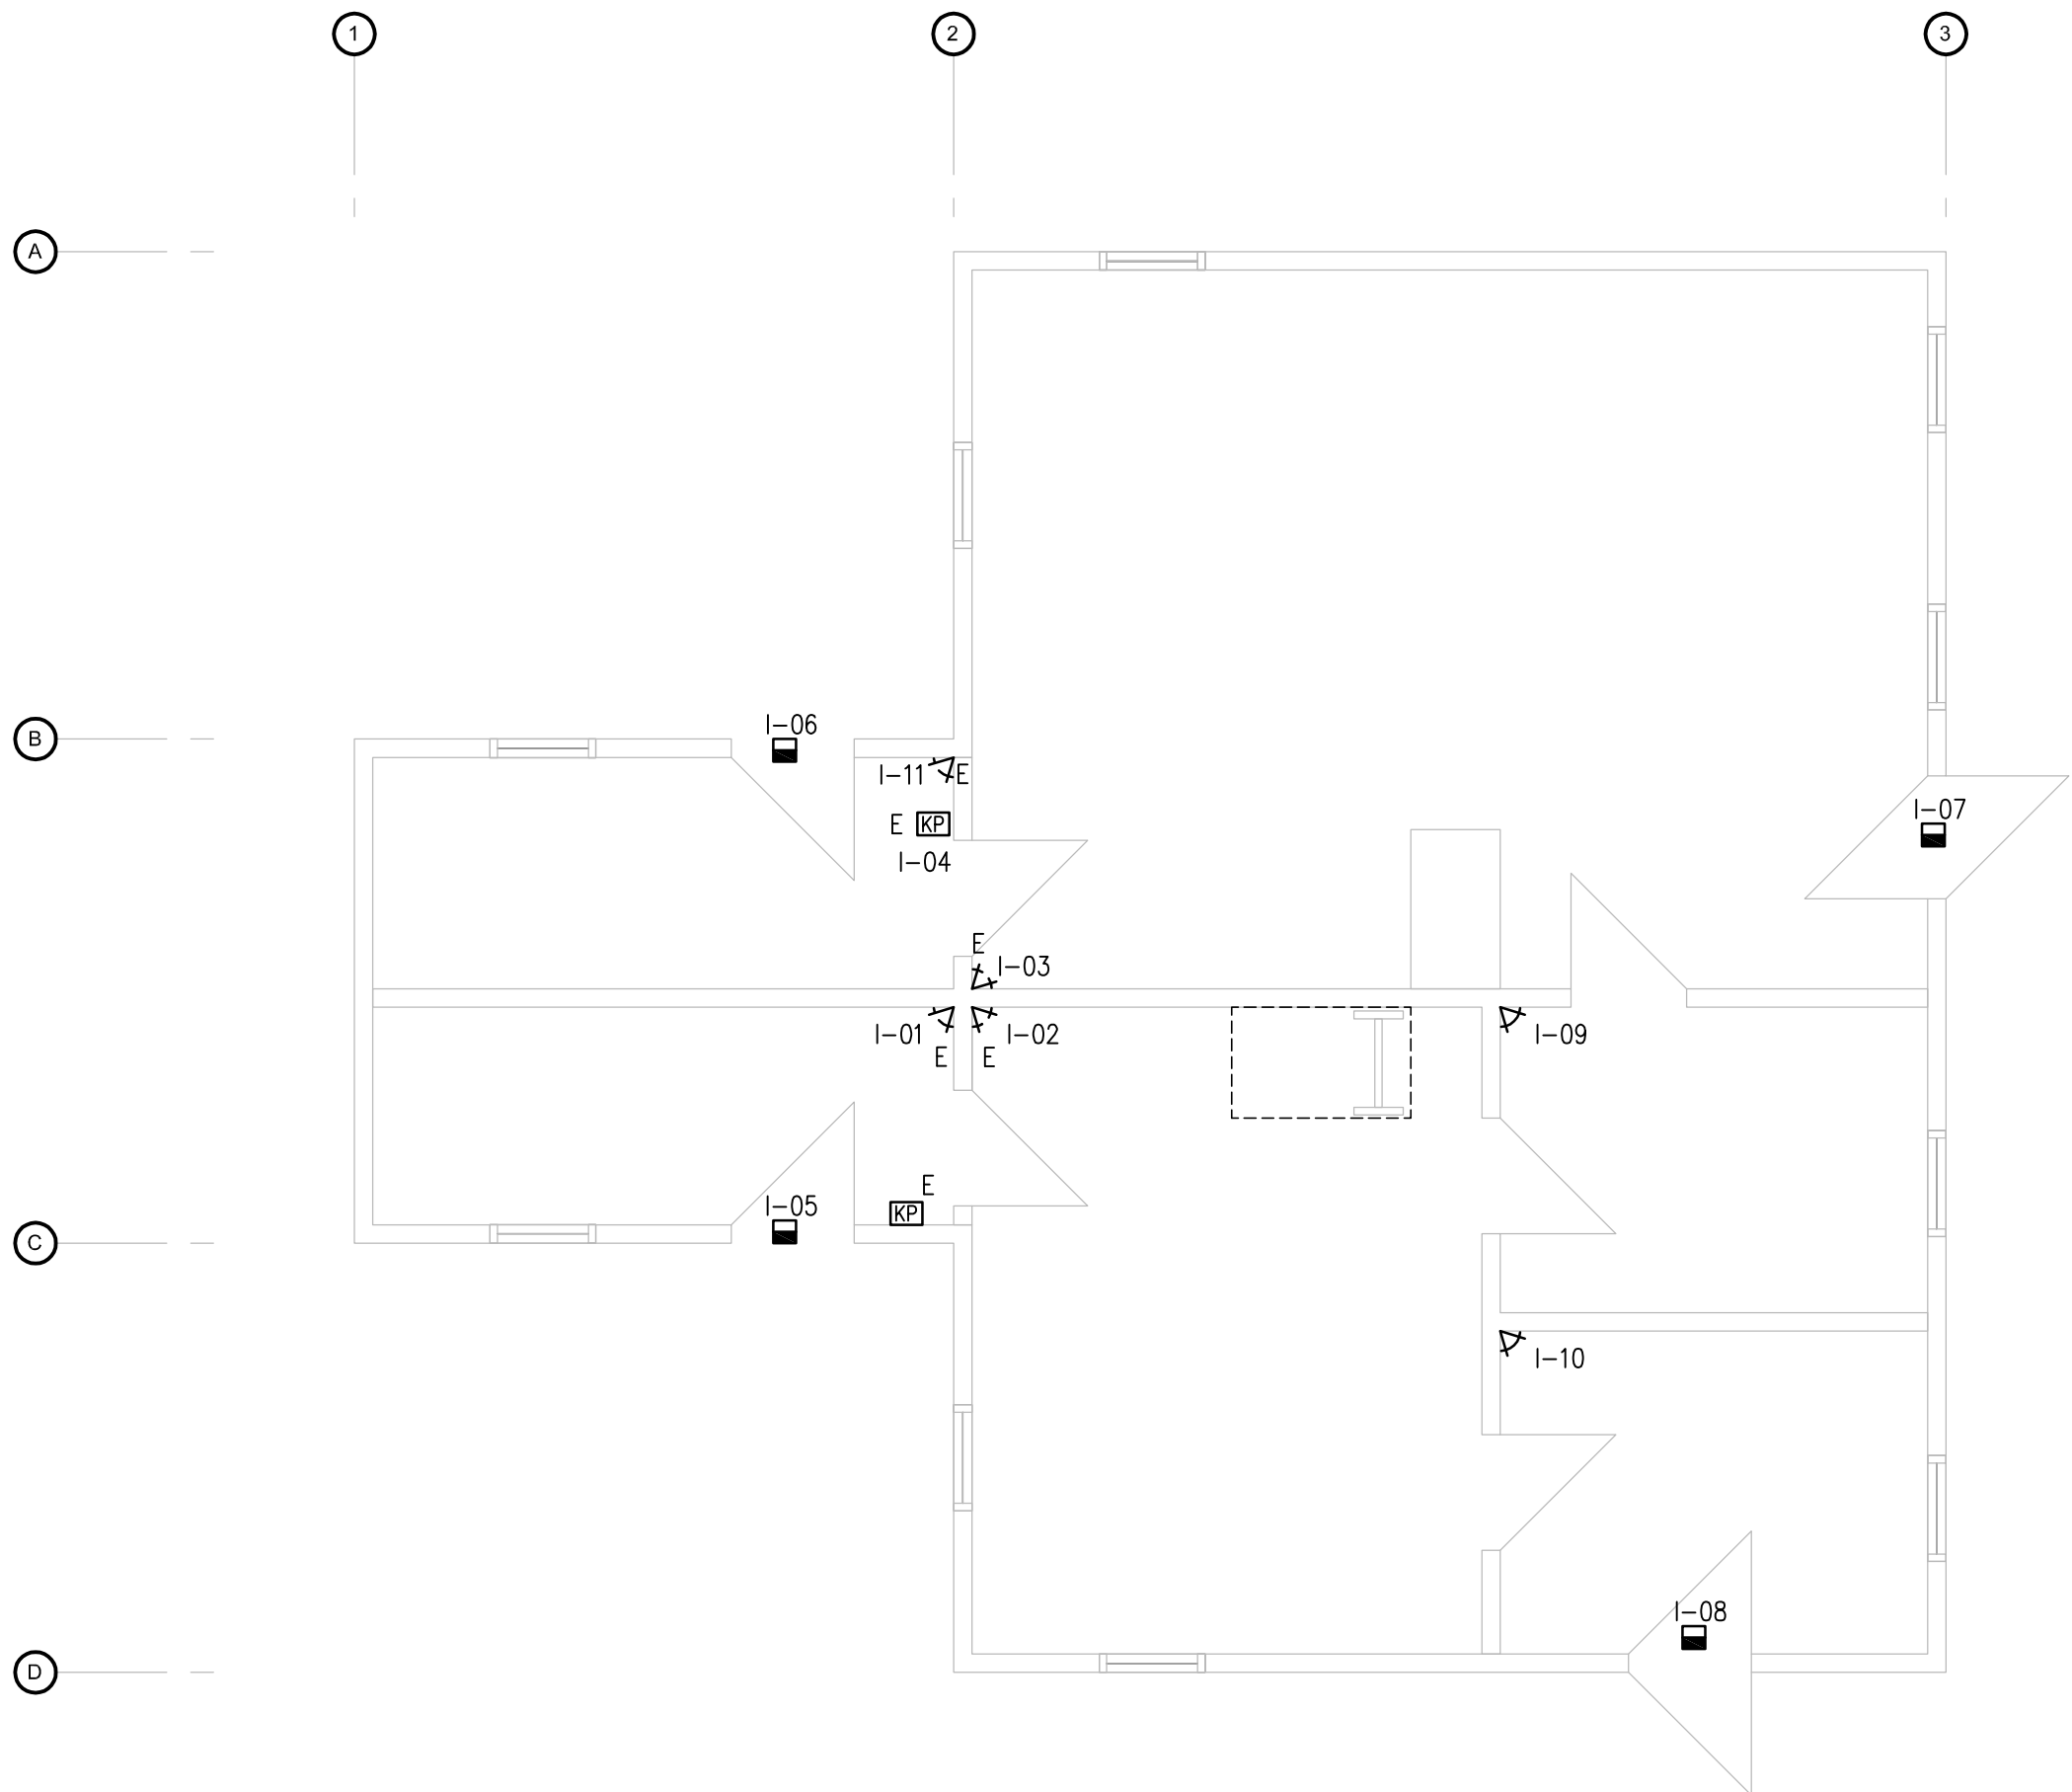

2 MEN'S HOUSE - MAIN FLOOR SECURITY NEW CONSTRUCTION PLAN
1:50

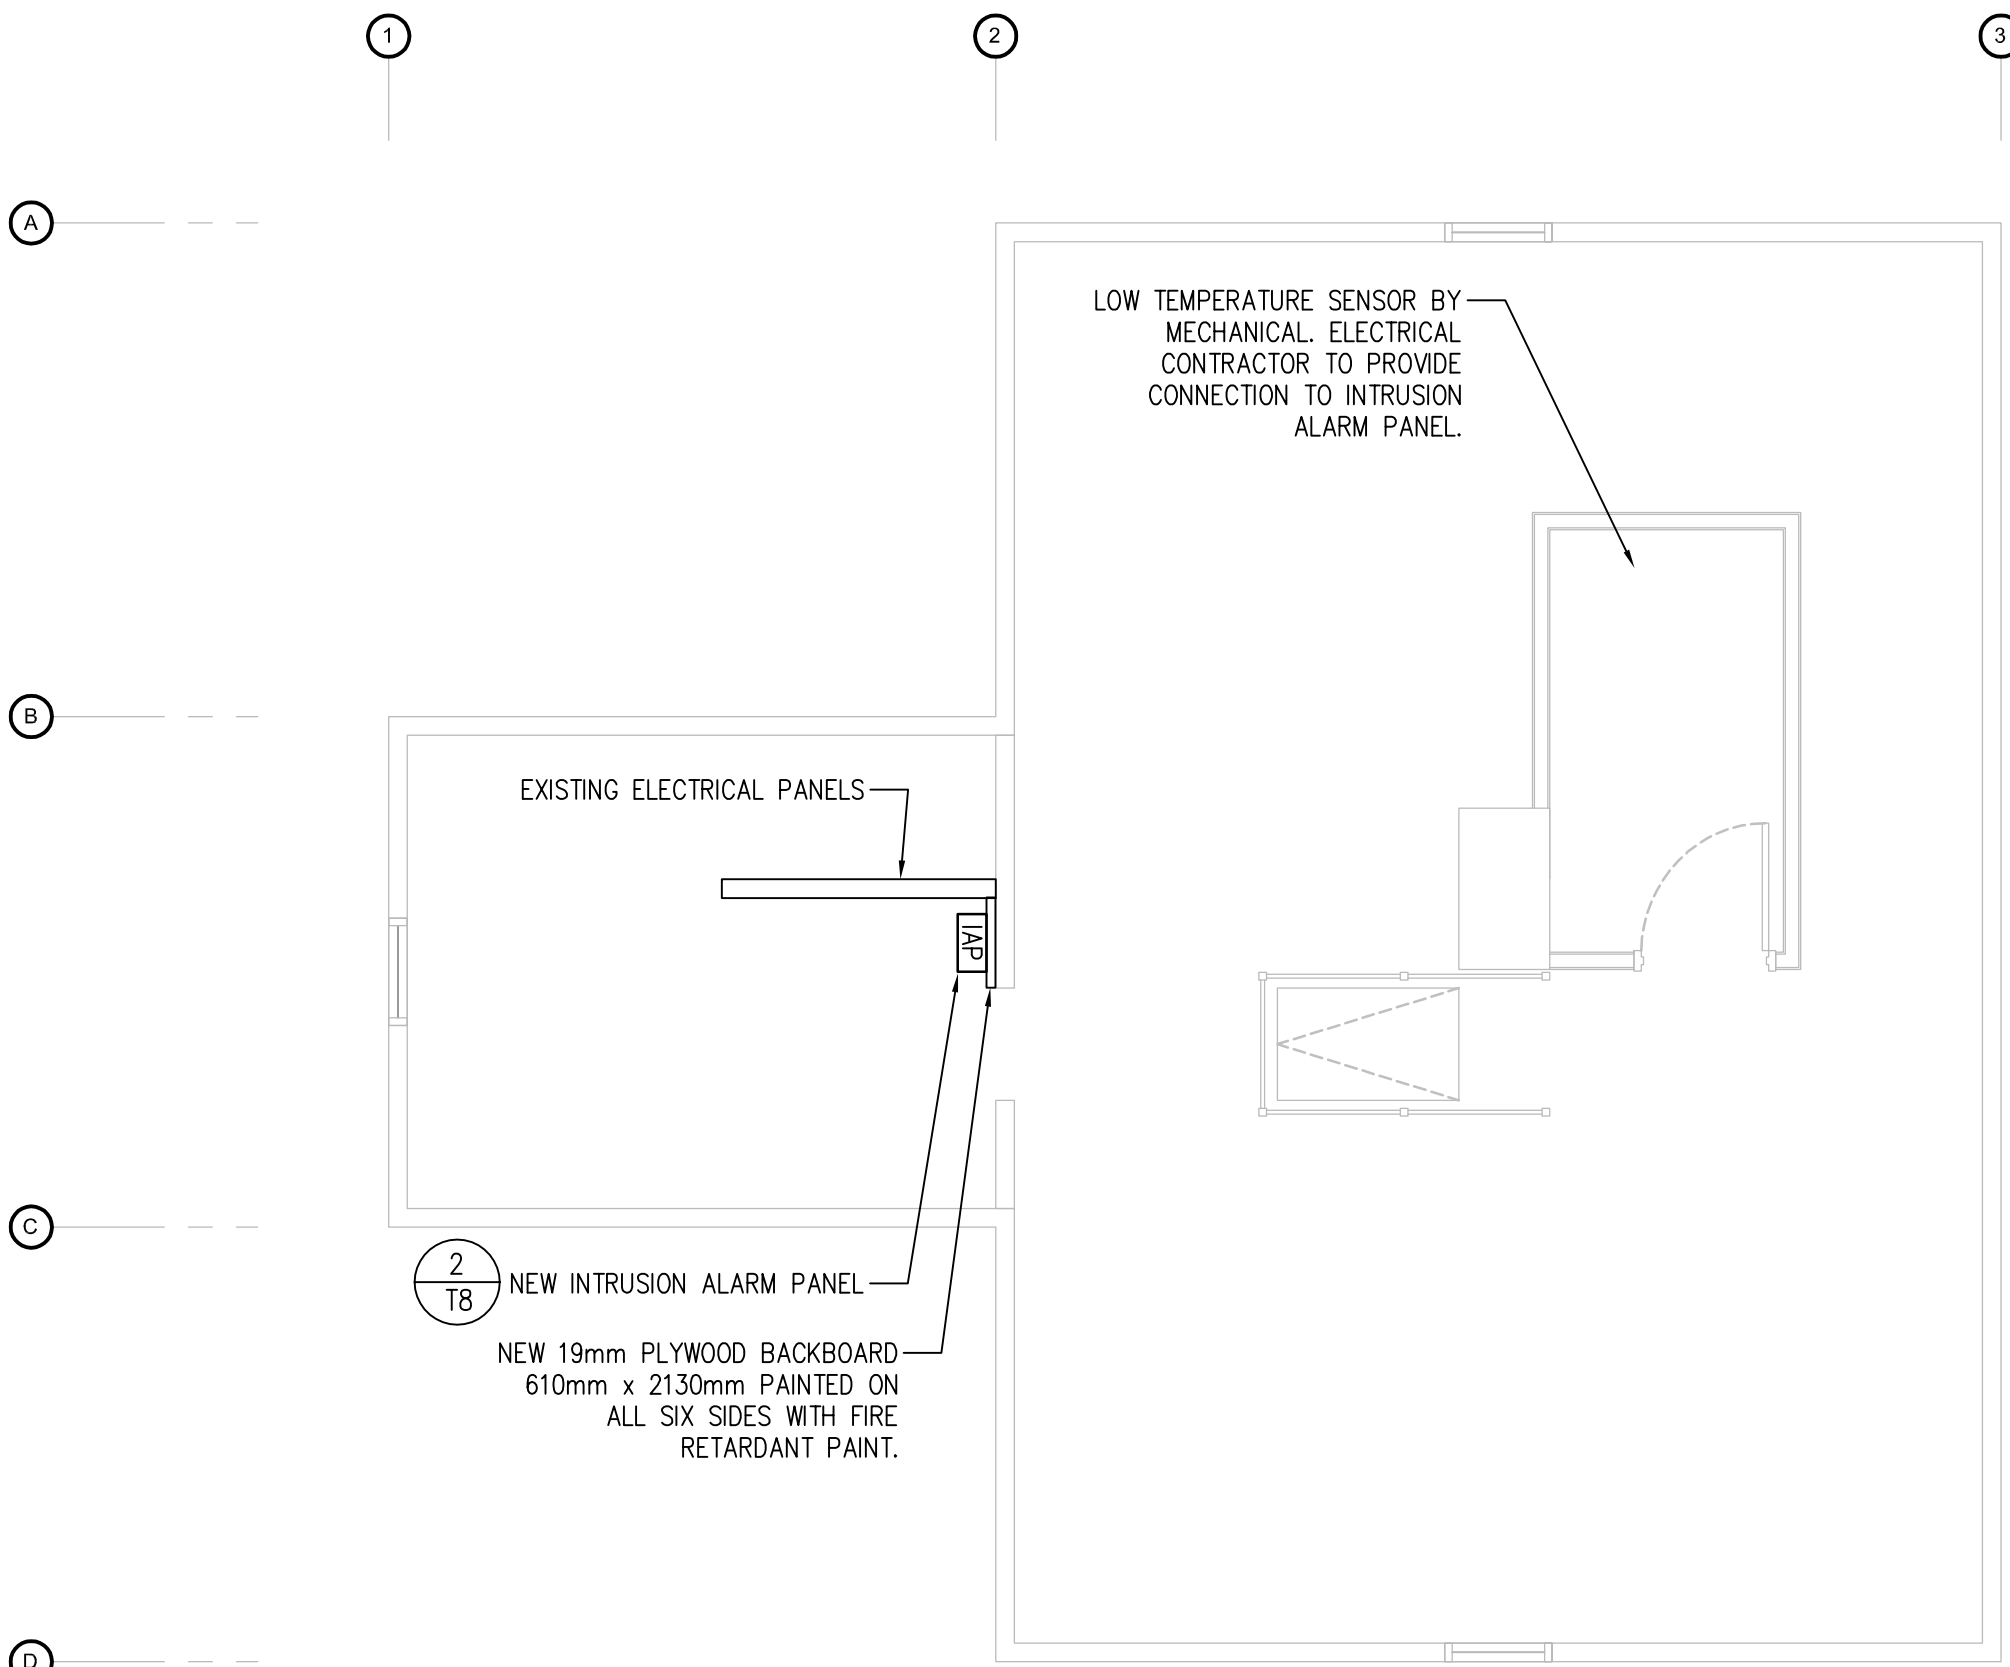


3 MEN'S HOUSE - ATTIC SPACE - SECURITY NEW CONSTRUCTION PLAN
1:50

GENERAL NOTES:

- ALL EXISTING INTRUSION ALARM DEVICES DENOTED BY "D" TO BE REMOVED. ALL CABLES SHALL BE LEFT IN PLACED AND TO BE RE-USED FOR THE INSTALLATION OF NEW DEVICE.
- EXTEND EXISTING CABLES TO THE NEW INTRUSION ALARM PANEL.
- FISH THE CABLES IN THE WALL TO NEW DEVICE LOCATIONS.
- REPLACE EXISTING CABLES FOR ALL EXISTING DEVICES THAT ARE TO BE REPLACED.
- TERMINATE EXISTING 12 PAIR CABLE TO NEW TELECOM PROTECTOR BLOCK.
- ALL INTRUSION ALARM SENSORS TO BE LOW TEMP RATED.
- ALL NEW PENETRATIONS THRU EXISTING STONE WALL TO BE THRU MORTAR JOINTS. COORDINATE ALL WORK WITH PARKS CANADA.
- NO NEW PENETRATIONS THRU EXISTING STRUCTURE SHALL BE PERMITTED.

SYMBOL SCHEDULE:

- D DEMOLISH ITEM
- DOOR CONTACT
- INTRUSION ALARM MOTION DETECTOR
- KP SECURITY KEYPAD (HS2LCD)
- IAP INTRUSION ALARM PANEL
- EM EXPANSION MODULE (2108)

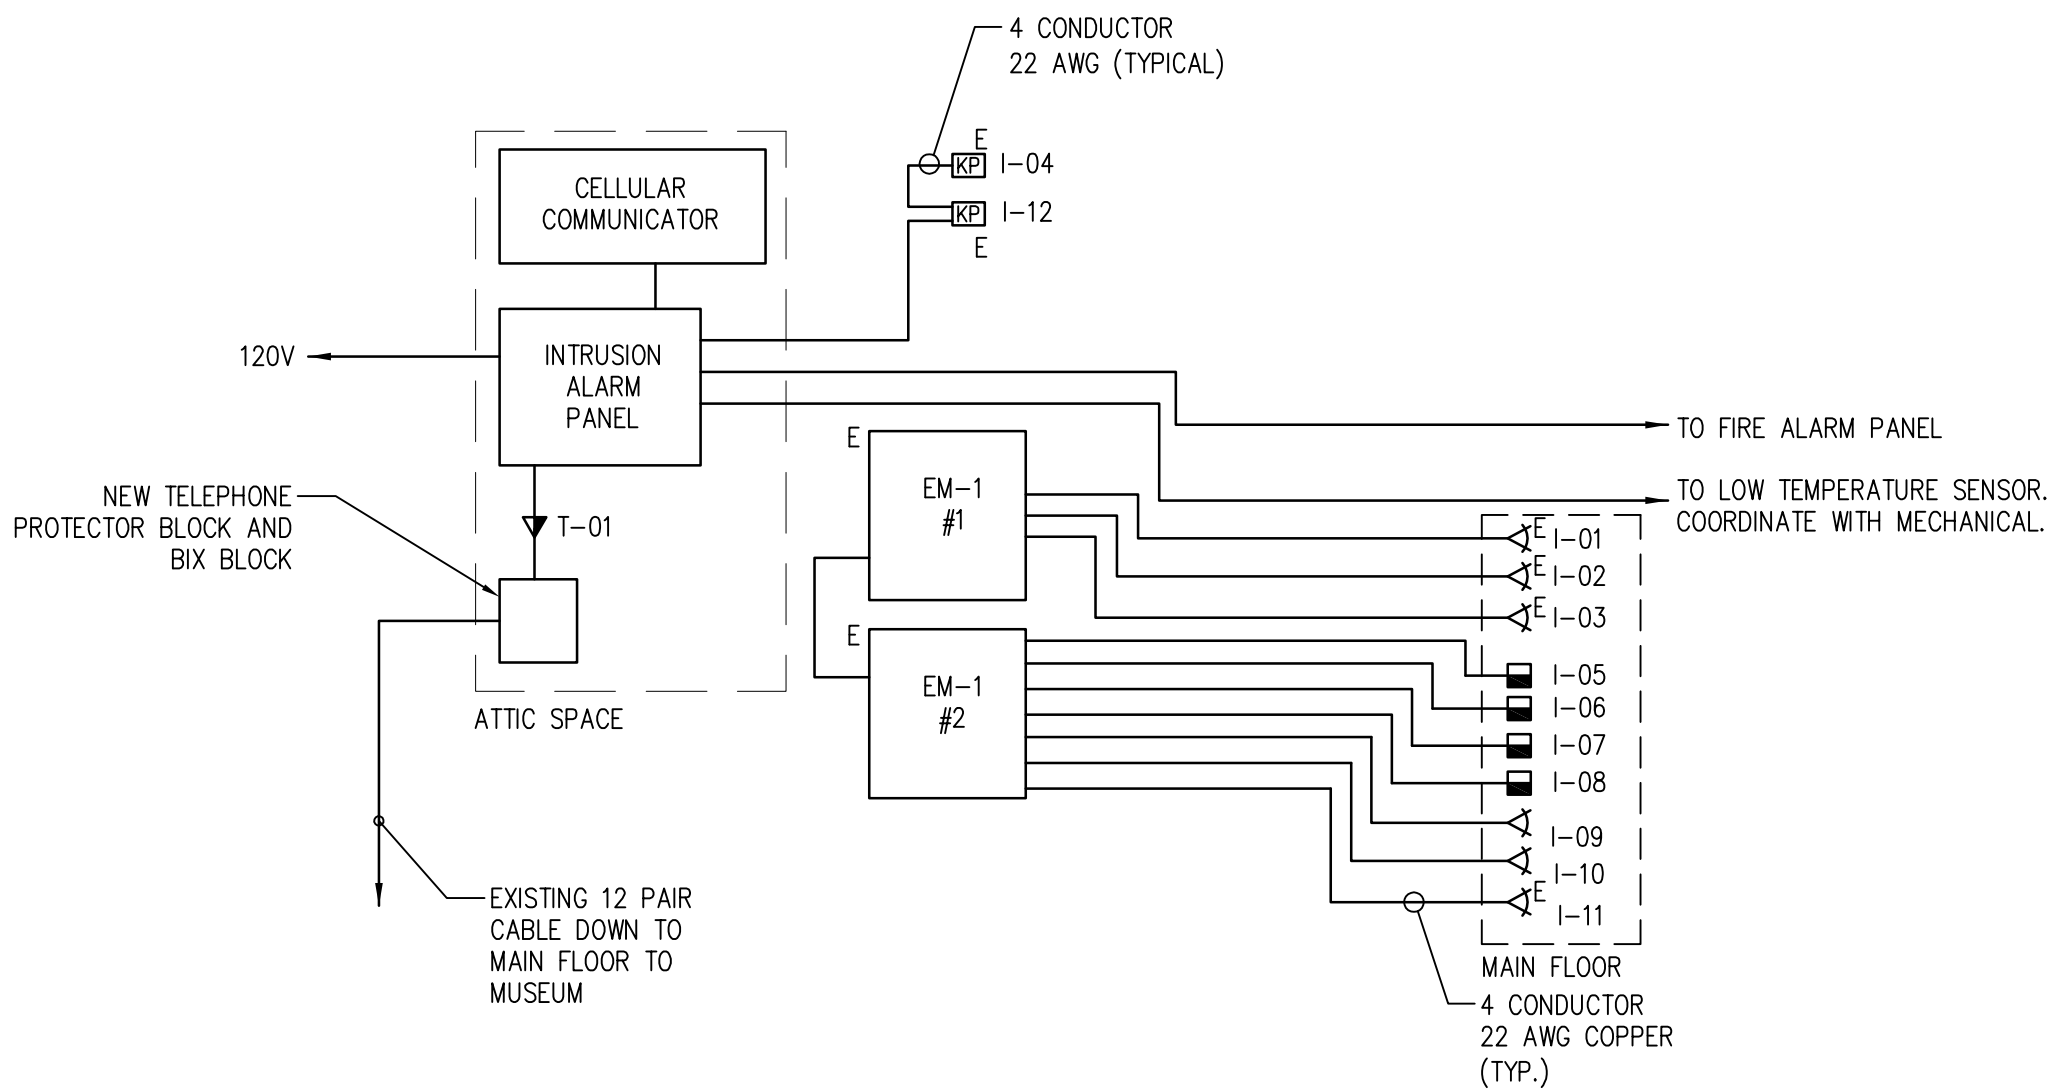

4 INTRUSION ALARM SINGLE LINE DIAGRAM
NTS