



GENERAL NOTES:

1. MAINTAIN THE INTEGRITY OF ALL EXISTING SYSTEMS REQUIRED TO REMAIN OPERATIONAL. IDENTIFY ALL CIRCUIT BREAKERS, WIRING, JUNCTION BOXES AND DEVICES PRIOR TO PROCEEDING WITH WORK. CONTACT DEPARTMENTAL REPRESENTATIVE IF UNSURE BEFORE SHUTDOWNS, DEMOLITION, OR RELOCATION OF ANY DEVICES.
2. ALL ITEMS SHOWN DASHED WITH AN 'E' ARE EXISTING AND ARE TO REMAIN. ITEMS SHOWN DASHED WITH A 'D' ARE TO BE DISCONNECTED AND REMOVED AND HAVE ALL ASSOCIATED WIRE AND CONDUIT REMOVED BACK TO PANEL. WHERE EXISTING CONDUIT CANNOT BE REMOVED WITHOUT DAMAGING SURFACES, RENDER CONDUIT PERMANENTLY UNUSABLE AND ABANDON.
3. WIRE AND CONDUIT SERVING DEVICES REQUIRED TO REMAIN IN USE SHALL BE RE-ROUTED AND DIVERTED AS REQUIRED TO MAINTAIN OPERATION. EXTEND, RE-ROUTE, RE-WIRE AND RE-CONNECT AS REQUIRED. CONFIRM EXISTING ON SITE.
4. REPORT ANY DISCREPANCIES BETWEEN THE CONTRACT DOCUMENTS AND SITE OBSERVATIONS TO DEPARTMENTAL REPRESENTATIVE.
5. REMOVE ALL EXISTING ELECTRICAL DEVICES LOCATED ON WALLS OR PORTIONS OF THE BUILDING BEING DEMOLISHED OR MODIFIED. MAINTAIN INTEGRITY OF ALL EXISTING ELECTRICAL SYSTEMS IN AREAS NOT INCLUDED IN THIS PROJECT AND IN PARTS OF THE BUILDING WITHIN RENOVATION THAT ARE NOT SUBJECT TO ANY DEMOLITION WORK.
6. REFER TO SYMBOL SCHEDULE FOR ELECTRICAL SYMBOLS AND LETTER DESIGNATIONS.
7. ALL EXISTING DEVICES ON WALLS, FLOORS OR CEILING NOT BEING AFFECTED BY RENOVATION ARE TO REMAIN.
8. SYSTEMS AND DEVICES IN AREAS OF LIMITED SCOPE OF WORK AREAS TO REMAIN OPERATIONAL. PROVIDE ALL MODIFICATIONS TO ACCOMMODATE SCOPE OF WORK.
9. DISCONNECT AND REMOVE ALL EXISTING RECEPTACLES ALONG WITH ASSOCIATED DEVICE BOX WIRE AND CONDUIT BACK TO SOURCE.
10. PATCH ALL EXISTING SURFACES DAMAGED BY THE REMOVAL OF EQUIPMENT TO MATCH EXISTING CONDITION.

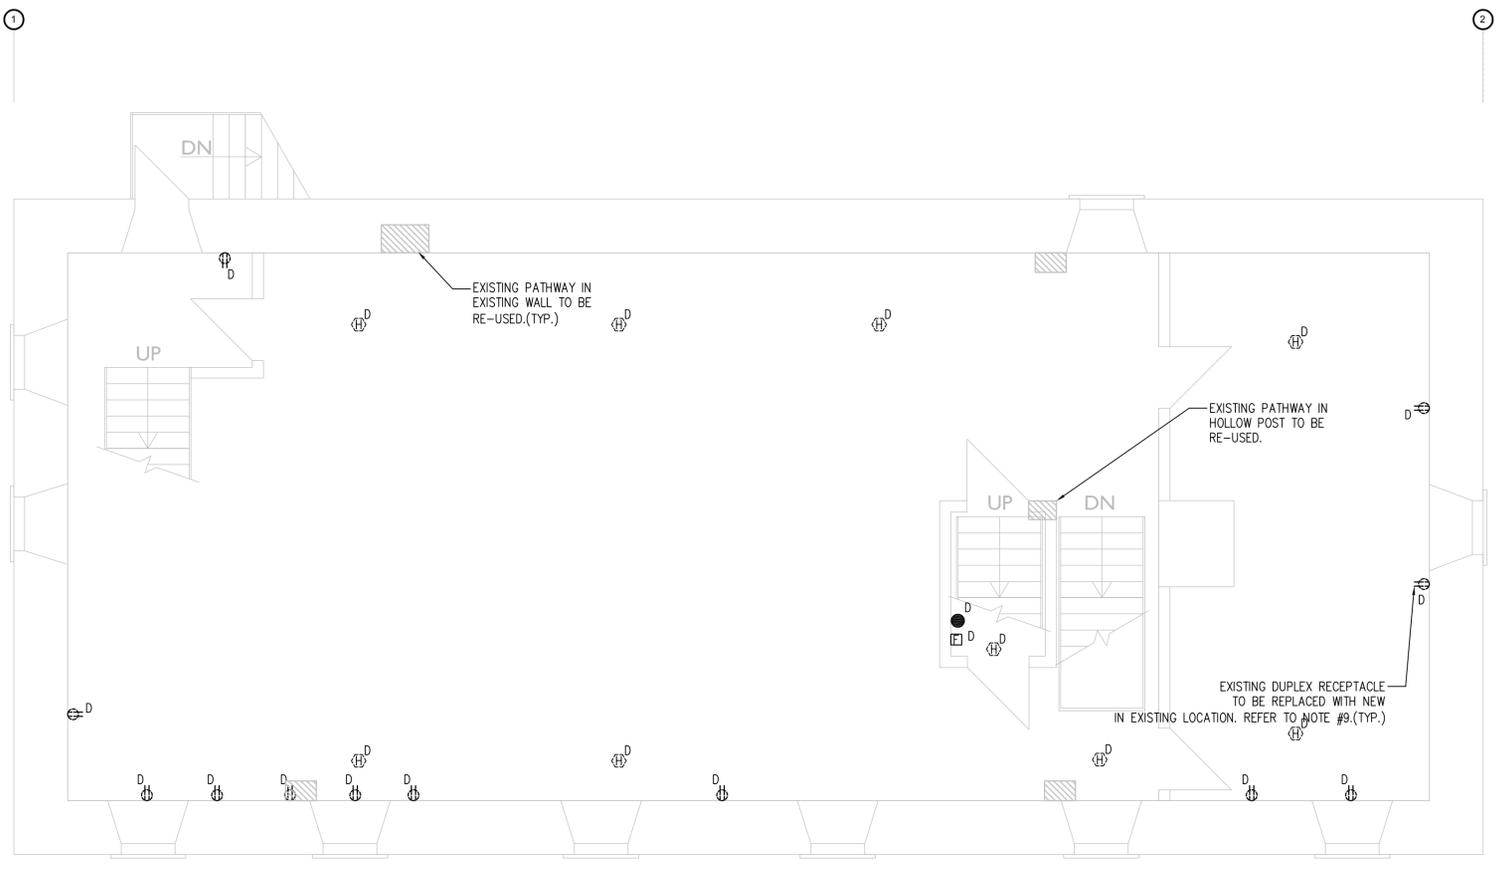

1 FURLOFT - SECOND FLOOR EXISTING/DEMOLITION POWER AND FIRE ALARM PLAN  
E11 1:50

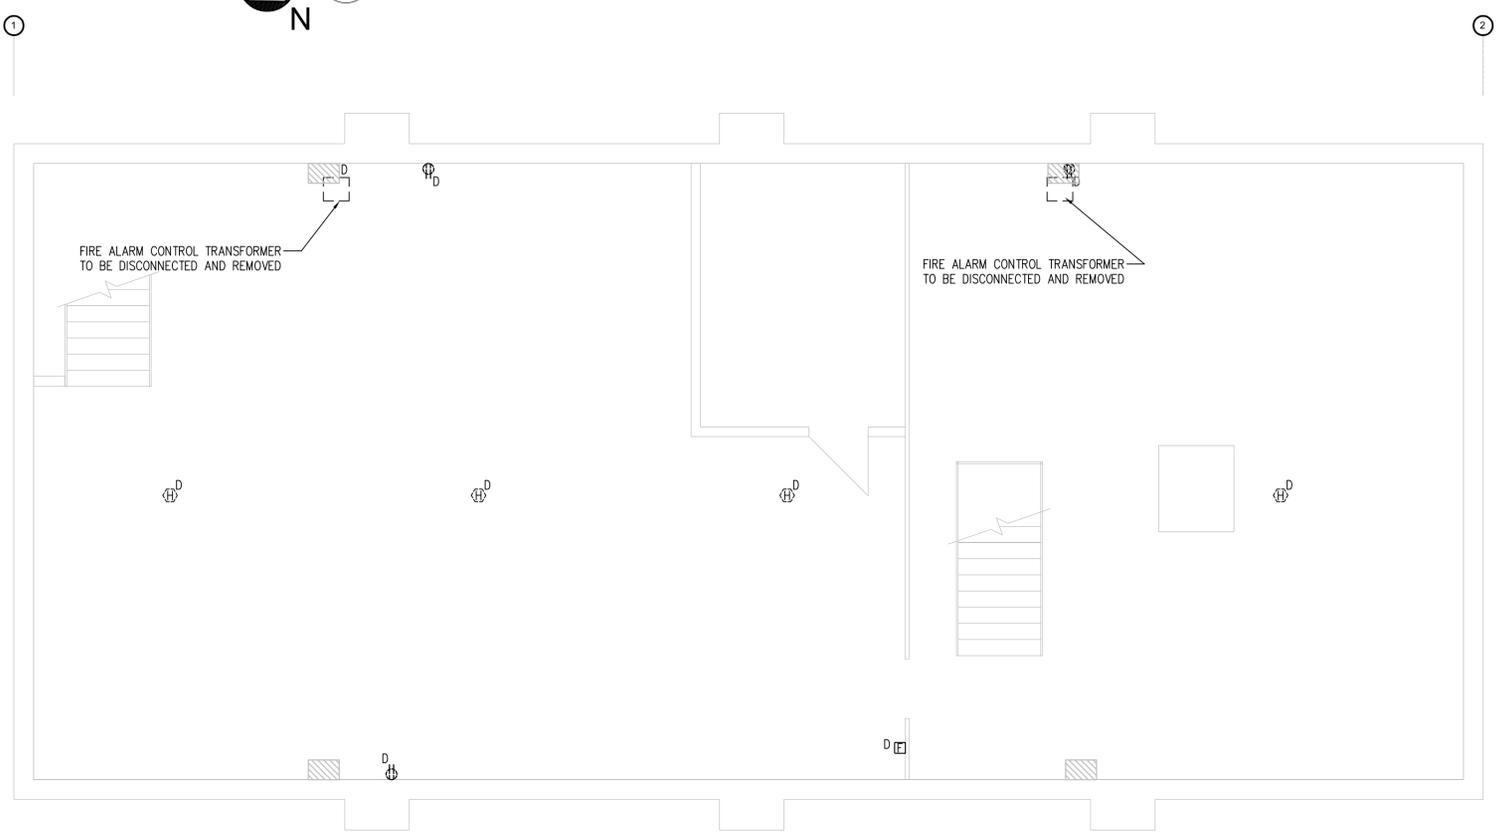

2 FURLOFT - ATTIC SPACE EXISTING/DEMOLITION POWER AND FIRE ALARM PLAN  
E11 1:50

Revision/Revision	Description/Description	Date/Date
0	ISSUED FOR TENDER	Sept. 12, 16

Client/client  
**Public Works and Government Services Canada**  
100 - 167 Lombard Avenue  
Winnipeg, Manitoba

Project title/Titre du projet  
**Lower Fort Garry (LFG)  
National Historic Site, Manitoba**  
**HERITAGE BUILDING  
RECAPITALIZATION**

Approved by/Approve par  
HCC

Designed by/Concept par  
PL

Drawn by/Dessine par  
RD

PWGC Project Manager/Administrateur de Projets TPSC  
CHRISTINA KOVACS

PWGC, Architectural and Engineering Resources Manager/  
Ressources Architectural et de Directeur d'ingénierie, TPSC

Client/client  
PARKS CANADA

Drawing title/Titre du dessin  
**FURLOFT -  
ATTIC SPACE AND SECOND FLOOR -  
EXISTING/DEMOLITION POWER  
AND FIRE ALARM PLAN**

Project No./No. du projet R.075212.001	Sheet/Fauille E11 OF 24	Revision no./ La Révision no. 0
---	-------------------------------	--