

APEGM
Certificate of Authorization
HDK Consulting Incorporated
No. 5539 Date: 04/30/2017

0	ISSUED FOR TENDER	Sept. 12, 16
Revision/	Description/Description	Date/Date


Client/client
Public Works and Government Services Canada
100 - 167 Lombard Avenue
Winnipeg, Manitoba

Project title/Titre du projet
**Lower Fort Garry (LFG)
National Historic Site, Manitoba**
**HERITAGE BUILDING
RECAPITALIZATION**


Approved by/Approuvé par
HCC
Designed by/Concept par
PL
Drawn by/Dessiné par
RD
PWGSC Project Manager/Administrateur de Projets TPSCG
CHRISTINA KOVACS
PWGSC, Architectural and Engineering Resources Manager/
Ressources Architectural et de Directeur d'ingénierie, TPSCG
Client/client
PARKS CANADA
Drawing title/Titre du dessin

**BIG HOUSE -
BASEMENT AND ATTIC EXISTING/
DEMOLITION LIGHTING PLAN**

Project No./No. du projet R.075212.001	Sheet/Feuille E3 OF 24	Revision no./ La Révision no. 0
---	-------------------------------------	--

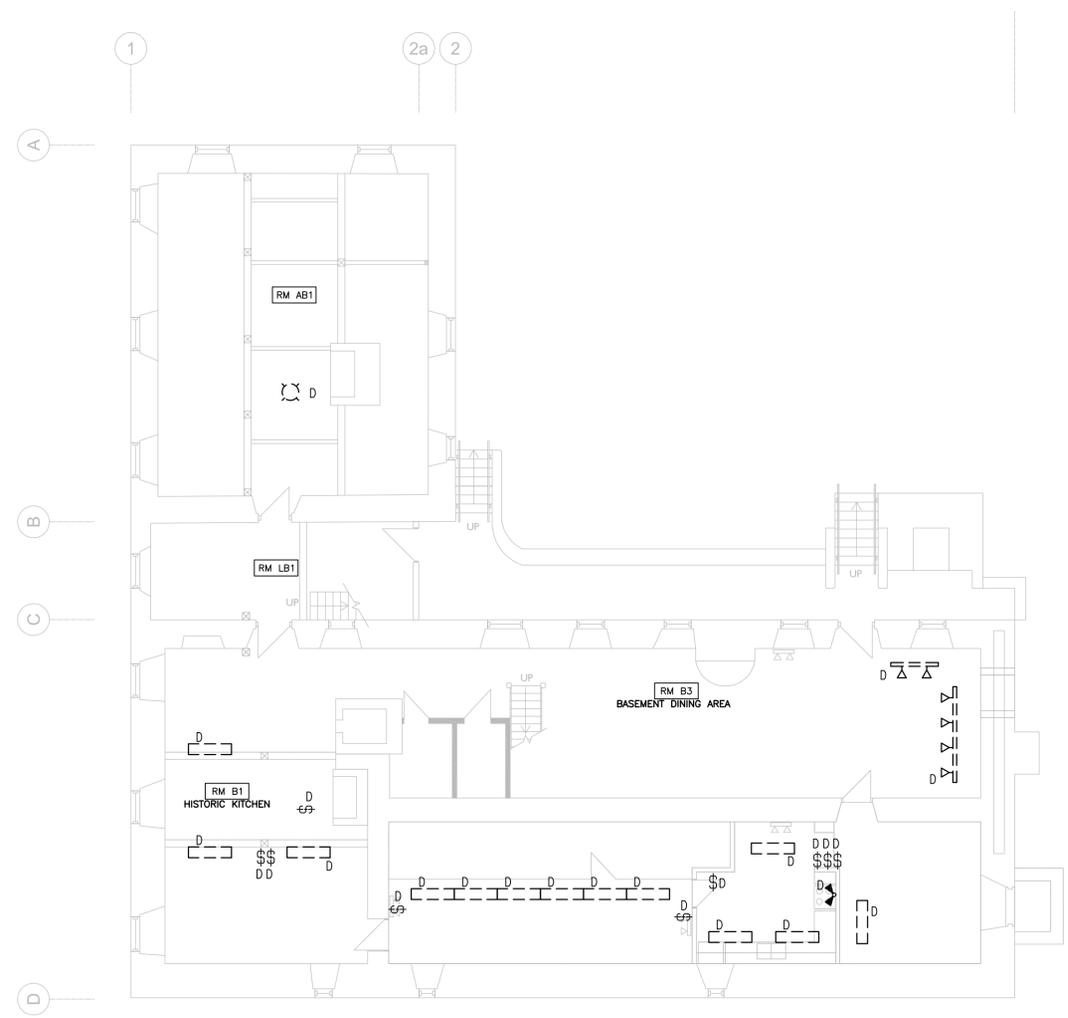

1 BIG HOUSE - BASEMENT EXISTING/DEMOLITION LIGHTING PLAN
E3 1:100

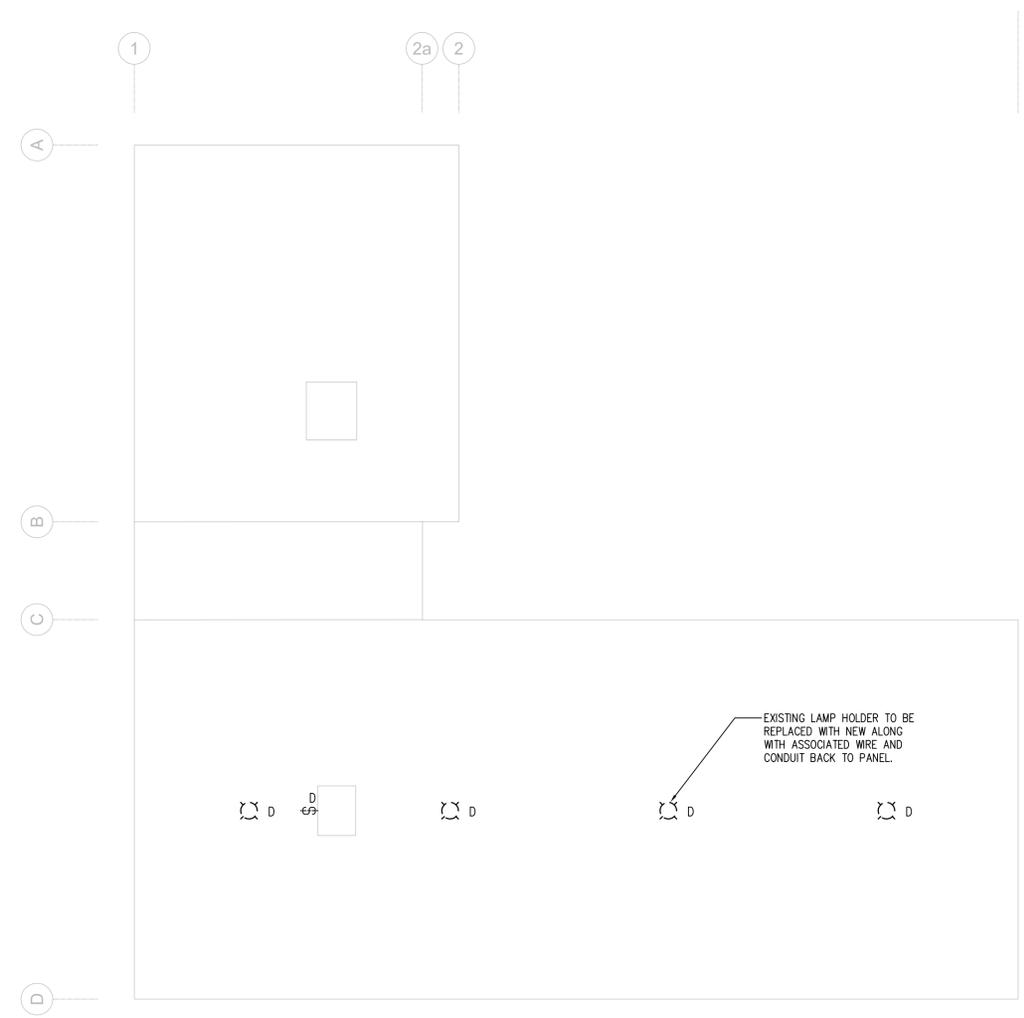

2 BIG HOUSE - ATTIC EXISTING/DEMOLITION LIGHTING PLAN
E3 1:100

GENERAL NOTES:

- ALL ITEMS SHOWN DASHED WITH AN "E" ARE EXISTING AND ARE TO REMAIN. ITEMS SHOWN DASHED WITH A "D" ARE TO BE DISCONNECTED AND DEMOLISHED/REMOVED AND TRANSPORTED TO DESIGNATED SITE TO BE CONFIRMED BY DEPARTMENTAL REPRESENTATIVE. INCLUDE ALL COSTS IN BASE BID. REMOVED AND HAVE ALL ASSOCIATED WIRE AND CONDUIT REMOVED BACK TO SOURCE.
- WIRE AND CONDUIT SERVING DEVICES REQUIRED TO REMAIN IN USE SHALL BE RE-ROUTED AND DIVERTED AS REQUIRED TO MAINTAIN OPERATION. EXTEND, RE-ROUTE, RE-WIRE AND RE-CONNECT AS REQUIRED. CONFIRM EXISTING ON SITE.
- REMOVE ALL EXISTING ELECTRICAL DEVICES LOCATED ON WALLS OR PORTIONS OF THE BUILDING BEING DEMOLISHED OR MODIFIED. MAINTAIN INTEGRITY OF ALL EXISTING ELECTRICAL SYSTEMS IN AREAS NOT INCLUDED IN THIS PROJECT AND IN PARTS OF THE BUILDING WITHIN RENOVATION THAT ARE SUBJECT TO ANY DEMOLITION WORK.
- REFER TO SYMBOL SCHEDULE FOR ELECTRICAL SYMBOLS AND LETTER DESIGNATIONS.
- REPORT ANY DISCREPANCIES BETWEEN CONTRACT DOCUMENTS AND SITE OBSERVATION TO DEPARTMENTAL REPRESENTATIVE.
- PATCH ALL EXISTING SURFACES DAMAGED BY THE REMOVAL OF EQUIPMENT TO MATCH EXISTING CONDITION. REFER TO ARCHITECTURAL.