





**DRAWING NOTES (MEN'S HOUSE):**

- ① RUN SPRINKLER PIPE ALONG CHIMNEY AND UP TO MECHANICAL ROOM IN ATTIC SPACE. HEAT TRACE ALL EXPOSED PIPE IN MAIN FLOOR AND DOWN TO ABOUT 2400MM (8'-0") BELOW GROUND. REFER TO ARCHITECTURAL FOR ENCLOSURE.
- ② SPRINKLER PIPE TO DROP DOWN WITHIN ARCHITECTURAL BULKHEAD, FLUSH SPRINKLER TO U/S OF BULKHEAD. BULKHEADS TO BE INSTALLED PERPENDICULAR TO JOISTS. EXACT LOCATION AND DIMENSION (LENGTH) TO BE DETERMINED ON SITE. REFER TO ARCHITECTURAL.

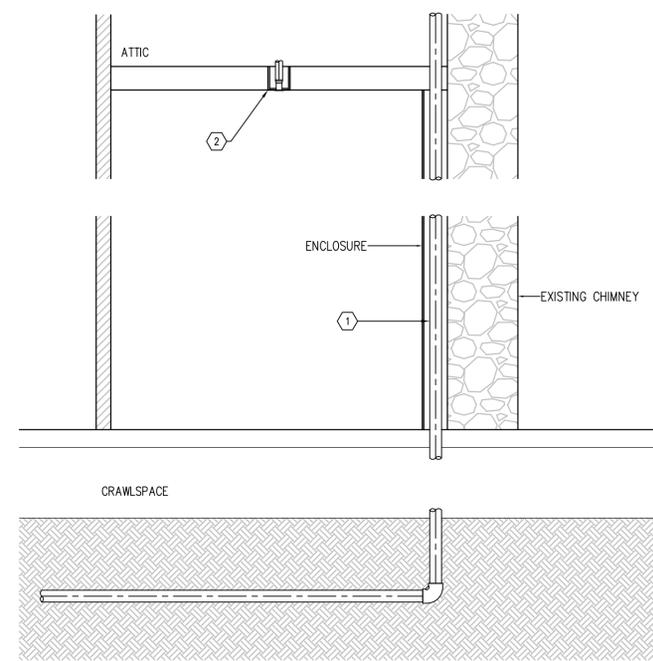

1 SECTION THROUGH MEN'S HOUSE MAIN FLOOR  
M9.2 NTS

**SECTIONS THROUGH FUR LOFT MAIN FLOOR**

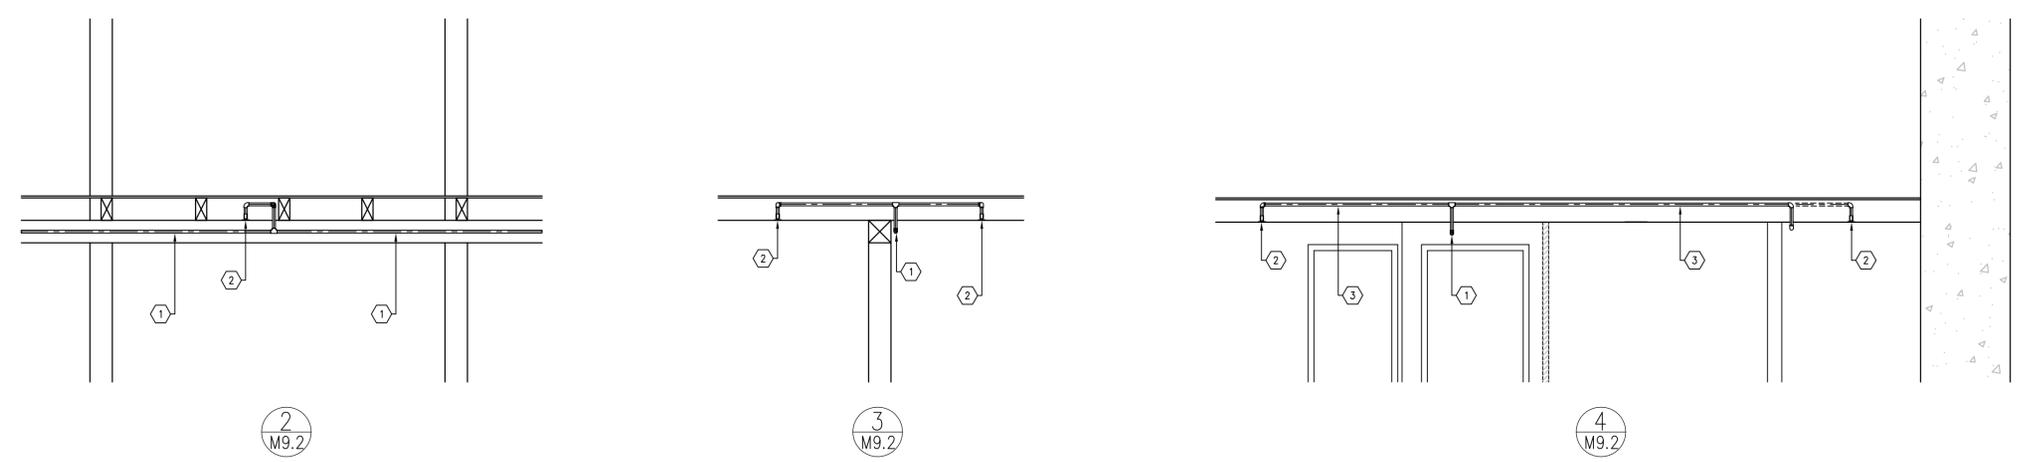

**DRAWING NOTES (FUR LOFT HOUSE):**

- ① RUN SPRINKLER PIPE ALONG AND BEHIND EXPOSED BEAM.
- ② OFFSET SPRINKLER HEAD TO U/S OF JOIST.
- ③ RUN SPRINKLER PIPE ALONG JOISTS IN JOIST SPACE.

0	ISSUED FOR TENDER	Sep. 12, 16
Revisory/Revisions	Description/Description	Date/Date
Client/client		
Public Works and Government Services Canada		
100 - 167 Lombard Avenue Winnipeg, Manitoba		
Project title/Titre du projet		
Lower Fort Garry (LFG) National Historic Site, Manitoba		
HERITAGE BUILDING RECAPITALIZATION		
Approved by/Approuvé par		
DH		
Designed by/Concept par		
PA		
Drawn by/Dessiné par		
PA		
PWGSC Project Manager/Administrateur de Projets TFSGC		
CK		
PWGSC, Architectural and Engineering Resources Manager/Ressources Architectural et de Directeur d'ingénierie, TFSGC		
Client/client		
PARKS CANADA		
Drawing title/Titre du dessin		
MECHANICAL DETAILS		
Project No./No. du projet	Sheet/Feuille	Revision no./La Révision no.
R.075212.001	M9.2 OF 14	0